

**TOWN OF BROOKLYN  
PLANNING AND ZONING COMMISSION  
NOTICE OF PUBLIC HEARING**

The Planning and Zoning Commission will hold a public hearing on February 1, 2023, at 6:30 p.m. via Zoom and in-person at the Brooklyn Middle School Auditorium, 119 Gorman Road Brooklyn, CT on the following:

**SP 22-008:** Special Permit Application for Multi-Family Development (50 Condominium units) on south side of Louise Berry Drive (Assessor's Map 33, Lot 19), 13.5 acres, R-30 Zone, Applicant: Shane Pollack and Erin Mancuso.

**\*Please publish January 18<sup>th</sup> and 25<sup>th</sup>\***



PLANNING AND ZONING COMMISSION  
TOWN OF BROOKLYN  
CONNECTICUT

Application #SP 22-008  
Check # \_\_\_\_\_

APPLICATION FOR SPECIAL PERMIT

Name of Applicant Shane Pollock & Erin Mancuso Phone 866-3129  
Mailing Address 101 Muckin Drive, Griswold, CT 06351 Phone \_\_\_\_\_

Name of Engineer/Surveyor Killingly Engineering Associates  
Address 114 Westcott Road PO Box 423 Killingly, CT 06241  
Contact Person Almond Thomeult Phone 860-771-7299 Fax \_\_\_\_\_

Name of Attorney NICHOLAS MANCUSO  
Address \_\_\_\_\_  
Phone \_\_\_\_\_ Fax \_\_\_\_\_

Property location/address Louise Berry Ave  
Map# 19 Lot# 14 Zone R-30 Total Acres 1.447 Ac  
Sewage Disposal: Private \_\_\_\_\_ Public  Existing \_\_\_\_\_ Proposed   
Water: Private \_\_\_\_\_ Public  Existing \_\_\_\_\_ Proposed

Proposed Activity Multi Family Development (50 single family condominium units)

Compliance with Article 4, Site Plan Requirements

Is parcel located within 500 feet of an adjoining Town? No

The following shall accompany the application when required:

- Fee \$ \_\_\_\_\_ State Fee (\$60.00) \_\_\_\_\_ 3 copies of plans  Sanitary Report
- 4.5.5 Application/ Report of Decision from the Inland Wetlands Commission
- 4.5.5 Applications filed with other Agencies
- 12.1 Erosion and Sediment Control Plans

The owner and applicant hereby grant the Brooklyn Planning and Zoning Commission, the Board of Selectman, Authorized Agents of the Planning and Zoning Commission or Board of Selectman, permission to enter the property to which the application is requested for the purpose of inspection and enforcement of the Zoning regulations and the Subdivision regulations of the Town of Brooklyn

Applicant: [Signature] Shane J Pollock Erin F Mancuso Date: 11/1/2022  
Owner: [Signature] Shane J Pollock Erin F Mancuso Date: 11/1/2022

\*Note: All consulting fees shall be paid by the applicant

**PLANNING AND ZONING COMMISSION  
TOWN OF BROOKLYN  
CONNECTICUT**

Received Date \_\_\_\_\_  
Action Date \_\_\_\_\_

Application # SPR  
Check# \_\_\_\_\_

**APPLICATION FOR SITE PLAN REVIEW**

Name of Applicant Shane Pollock & Erin Mancuso Phone 860-486-3129  
Mailing Address 111 McCain Drive, Groton, CT 06341 Phone \_\_\_\_\_

Name of Owner Same Phone \_\_\_\_\_  
Mailing Address \_\_\_\_\_ Phone \_\_\_\_\_

Name of Engineer/Surveyor Kilnaly Engineering Associates  
Address Po Box 431, Killingly, CT 06241  
Contact Person Alfred Thibault Phone 860-774-7272 Fax \_\_\_\_\_

Property location/address Lewis Bruce Drive  
Map # 14 Lot # 14 Zone R-30 Total Acres 13.491 AC

Proposed Activity Multi Family Development (50 single family subdivisions units)

Change of Use: Yes \_\_\_\_\_ No  If Yes, Previous Use \_\_\_\_\_  
Area of Proposed Structure(s) or Expansion \_\_\_\_\_

Utilities - Septic: On Site \_\_\_\_\_ Municipal  Existing \_\_\_\_\_ Proposed   
Water: Private \_\_\_\_\_ Public  Existing \_\_\_\_\_ Proposed

Compliance with Article 4, Site Plan Requirements

The following shall accompany the application when required:

Fees \$ \_\_\_\_\_ State Fee (\$60.00) \_\_\_\_\_ 3 copies of plans  Sanitary Report   
4.5.5 Application/ Report of Decision from the Inland Wetlands Commission  
4.5.5 Applications filed with other Agencies  
12.1 Erosion and Sediment Control Plans  
See also Site Plan Review Worksheet

Variances obtained N/A Date \_\_\_\_\_

The owner and applicant hereby grant the Brooklyn Planning and Zoning Commission, the Board of Selectman, Authorized Agents of the Planning and Zoning Commission or Board of Selectman, permission to enter the property to which the application is requested for the purpose of inspection and enforcement of the Zoning regulations and the Subdivision regulations of the Town of Brooklyn


Applicant: Shane Pollock Erin Mancuso Date 11/7/2022  
Owner: Shane Pollock Erin Mancuso Date 11/7/2022

\* Note: Any consulting fees will be paid by the applicant

**LIST OF AJACENT LAND OWNERS - INCLUDING ACROSS THE STREET as of 10/21/2022 NECCOG**

*Shane J. Pollock & Erin F. Mancuso  
Louise Berry Drive  
Brooklyn, CT*

MAP/LOT	NAME
33/21	Town of Brooklyn PO Box 356 Brooklyn, CT 06234
24/148	Connecticut Baptist Homes Inc. 292 Thorpe Ave Meriden, CT 06450
24/158	Brooklyn Property Management LLC 211 Wauregan Road Brooklyn, CT 06234
33/10A	Sally A. Wood 68 Franklin Drive Brooklyn, CT 06234
33/13	Cindy Scalzi & Greg Benoit 36 Franklin Drive Brooklyn, CT 06234
33/14	Mark S Benard 273 Main Street Hampton, CT 06247
33/15	Linda Atsales 24 Franklin Drive Brooklyn, CT 06234
33/16	Stephanie A. Hynes & Brennan D. Hynes 20 Franklin Drive Brooklyn, CT 06234
33/17	Richard E Bein 12 Franklin Drive Brooklyn, CT 06234
33/20.3	William J Purcell Jr 179 Gorman Road Brooklyn, CT 06234
33/20	David R Dumont 173 Gorman Road Brooklyn, CT 06234
33/20.1	Curt R Hostman PO Box 351 Brooklyn, CT 06234



## JOSEPH R. THEROUX

~ CERTIFIED FORESTER / SOIL SCIENTIST ~  
PHONE 860-428-7992 ~ FAX 860-376-6842  
P.O. Box 32, VOLUNTOWN, CT. 06384  
FORESTRY SERVICES ~ ENVIRONMENTAL IMPACT ASSESSMENTS  
WETLAND DELINEATIONS AND PERMITTING ~ E&S/SITE MONITORING  
WETLAND FUNCTION AND VALUE ASSESSMENTS

5/10/2022

KILLINGLY ENGINEERING ASSOCIATES  
P.O. Box 421  
DAYVILLE, CT. 06241

RE: TREE PLANTING RECOMMENDATIONS, POLLOCK PROPERTY, LOUISE BERRY DRIVE,  
BROOKLYN, CT.

DEAR MR. THIBEAULT,

AT YOUR REQUEST I HAVE INSPECTED THE ABOVE REFERENCED PROPERTY AND THE SITE PLAN DEPICTING THE PROPOSED DEVELOPMENT FOR THE PURPOSES OF MAKING RECOMMENDATIONS ON TREE SPECIES SUITABLE FOR THE SITE.

IN THE SOUTHERN PORTION OF THE PROPERTY WHERE IT WAS HEAVILY LOGGED AND THE OVERSTORY WAS REMOVED, IN AND ADJACENT TO THE WETLANDS, I WOULD RECOMMEND PLANTING WHITE PINE SEEDLINGS, (*PINUS STROBUS*). THESE SEEDLINGS SHOULD BE 3-YEAR-OLD STOCK, APPROX. 15 TO 18 INCHES IN HEIGHT.

FOR THIS REMAINING AREA THAT WAS HEAVILY LOGGED AND IS NOT BEING DEVELOPED, (+/- 1 ACRE), I WOULD RECOMMEND 250 TREES, AS THIS IS TYPICAL STOCKING PER ACRE FOR HEALTHY WHITE PINE STANDS.

REGARDING TREE SPECIES FOR SCREENING BETWEEN THE UNITS, I WOULD RECOMMEND GREEN GIANT ARBORVITAE, (*THUJA PLICATA*). THESE TREES ARE EVERGREEN, DEER RESISTANT, AND ARE ONE OF THE FASTEST GROWING PRIVACY TREES. THEY WILL GROW APPROX. 3 TO 5 FEET PER YEAR AND WILL REACH HEIGHTS OF 60 FEET. THEY THRIVE IN A WIDE RANGE OF SOILS AND LIKE FULL SUN.

THEY SHOULD BE PLANTED IN STAGGERED ROWS APPROX. 4 TO 6 FEET SPACING.

AS WITH ANY PLANTINGS, THE PINES AND ARBORVITAE SHOULD BE PLANTED IN SPRING OR FALL TO MINIMIZE MORTALITY AND SHOULD BE MONITORED FOR SURVIVAL THE FIRST YEAR.

IN CONCLUSION, IF YOU HAVE ANY QUESTIONS CONCERNING MY RECOMMENDATIONS, PLEASE FEEL FREE TO CONTACT ME.

THANK YOU,

*Joseph R. Theroux*

JOSEPH R. THEROUX  
CERTIFIED SOIL SCIENTIST  
MEMBER SSSSNE, NSCSS.

# Killingly Engineering Associates

## Civil Engineering & Surveying

P.O. Box 421 Dayville, CT 06241  
Phone: 860-779-7299  
Fax: 860-774-3703



Proposed 50-Unit Condominium Development  
for Shane Pollock  
Louise Berry Drive  
Brooklyn, CT

### **Statement of Use**

The referenced project will result in the construction of a 1,000' cul-de-sac road with access from Louise Berry Drive, installation of public water and sanitary sewer and the construction of 51 single-family condominiums that will be "for sale" units. The sanitary sewer design has been reviewed and approved by the Brooklyn WPCA and the waterline extension and installation is approved by CT Water. The plans have been submitted to the Brooklyn Fire Marshal for review and comment.

The total area of the property is 13.497 acres and approximately half of the property will require clearing to facilitate construction. The condominiums will be constructed in groups of 2-7 units and have been positioned a minimum of 40' apart in a manner that will alleviate the necessity for excessive cuts and fills for the project. The Brooklyn Inland Wetlands Commission approved the application at their April 2021 meeting; no clearing is proposed in the wetlands and there will be slightly over 2 acres of disturbance within the regulated upland review area.

During construction, the transport of sediment will be controlled by means of silt fencing backed with double staked haybales between the disturbed areas and the wetlands. A proposed stormwater swale that is proposed for the final stabilized site will be utilized as a temporary sedimentation swale during construction and drainage will be conveyed to a temporary sediment trap which will ultimately be the stormwater basin for the project. Fill slopes have been designed to a controllable 3H:1V grade and will be stabilized with a biodegradable erosion control fabric over seeding.

The stormwater system has been designed in accordance with the Town of Brooklyn requirements for stormwater quality and infiltration, defined per the 2004 State of CT stormwater Quality Guidelines. The design encourages overland flow where possible to preserve the integrity of the wetlands on the site. For paved areas, stormwater will be collected in a series of catch basins and pipe and conveyed to a proposed stormwater basin which has been designed to limit peak flows for up to a 100-year design storm. The basin will be constructed with an underdrain to ensure that it empties completely within 24 hours of any storm event to maintain full design capacity. In addition, by emptying completely after storm events, the design will alleviate any potential habitat for mosquitos and other vector insects.

The roadway and stormwater system will be privately owned and maintained by the homeowner's association and will not be the responsibility of the Town of Brooklyn. It is anticipated that construction of the roadway and installation of utilities will commence in 2022 and will take 3-4 months to complete. Construction of residences will commence upon the completion of the road up to the binder course and will occur in a phased manner, likely beginning with the units at the roadway terminus and working back toward Louise Berry Drive to limit activity in the vicinity of residences where families may be residing.

# Killingly Engineering Associates

*Civil Engineering & Surveying*



P.O. Box 421 Dayville, CT 06241  
Phone: 860-779-7299  
Fax: 860-774-3703

Proposed 50-Unit Condominium Development  
for Shane Pollock  
Louise Berry Drive  
Brooklyn, CT

## **Sanitary Report**

As required by the Town of Brooklyn Zoning Regulations, this project will be served by public sanitary sewer. Each unit will be individually served and conveyed to a collection system prior to discharge to an existing Town owned sanitary manhole. The plans have been reviewed and approved by the Town of Brooklyn Water Pollution Control Authority, Alan Carpenter, P.E., the WPCA's reviewing Engineer, and Syl Pauley, P.E. from the Northeast Connecticut Council of Governments.

# PROPOSED MULTI-FAMILY CONDOMINIUM DEVELOPMENT

LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT

PREPARED FOR:  
**SHANE POLLOCK**

TABLE OF ZONING REQUIREMENTS		
ZONE = R-30*		
	REQUIRED	PROVIDED
Lot Area	30,000 s.f.	13,497 Acres
Front Yard Setback	50'	53.4'
Side Yard Setback	30'	48'
Rear Yard Setback	50'	257'
Building Height	35' Max.	<35'
Lot Frontage	110'	243.74'
Building Separation	40' min	40'-115'
<b>DENSITY:</b> 1 unit per every 5,000 s.f. 13,497 ac = 587,929 s.f. - 117 units max 50 units proposed		
<b>PARKING:</b> 2 spaces per unit required - 100 required 1 garage space + 1 driveway space per unit for 48 units = 96 spaces 1 garage space + 2 driveway spaces per accessible units = 6 spaces + 36 additional spaces - 140 spaces total		


\*Multi-family development in accordance with Section 6.E.  
ZONE = RA\*

**GENERAL NOTES:**

- Ownership of the stormwater basin and drainage system shall be the Homeowner's Association. The Town of Brooklyn will not assume responsibility as such.
- There shall be no parking along the main access roadway or side drives. Appropriate signage shall be installed accordingly.
- The only work allowed prior to installing the perimeter sediment controls shall be clearing vegetation. No grubbing shall be allowed until the perimeter sediment controls have been installed as per plan. Call (860) 779-3411, ext. 31, for an inspection of the perimeter sediment controls. The perimeter sediment controls must be approved in writing by the IWWC Agent or a Commission member prior to commencing any other work.
- The temporary sediment basin and swale must be at least temporarily stabilized prior to discharging any stormwater into them. Call (860) 779-3411, ext. 31, for an inspection of the temporary sediment basin and swale. The temporary stabilization of the temporary sediment basin and swale must be approved in writing by the IWWC Agent or a Commission member prior to discharging any stormwater into them.
- Detention basin side slopes and bottom shall be mowed annually by 6/30 and 10/1 for the life of the basin, in perpetuity.
- The Homeowner's Association shall be responsible for maintenance of the stormwater basin and its outlets in perpetuity.
- The construction of the temporary sediment basin and swale shall begin between April 14 and September 1 to allow for vegetation to become at east temporarily established in the basin prior to discharging stormwater into the temporary sediment basin and swale. The basin and swale should be substantially completed by September 1. Construction of the temporary sediment basin and swale shall not commence between September 2 and April 13 in accordance with the provisions of Section 11.1 of the Brooklyn IWWC Regulations.

**LEGEND**

●	IRON PIN TO BE SET
○	IRON PIN FOUND
○ DH	DRILL HOLE FOUND
□ CB	CATCH BASIN
○ U	UTILITY POLE
○ SMH	SANITARY SEWER MANHOLE
○	HYDRANT
---	EXISTING CONTOURS
---	PROPOSED CONTOURS
---	INLAND WETLANDS FLAG
---	BUILDING SETBACK LINE
---	EXISTING SANITARY SEWER LINE
---	EXISTING WATER LINE
---	STONE WALL
---	STONE WALL REMAINS
---	SILT FENCE
---	175' WATERCOURSE SETBACK
---	125' UPLAND REVIEW

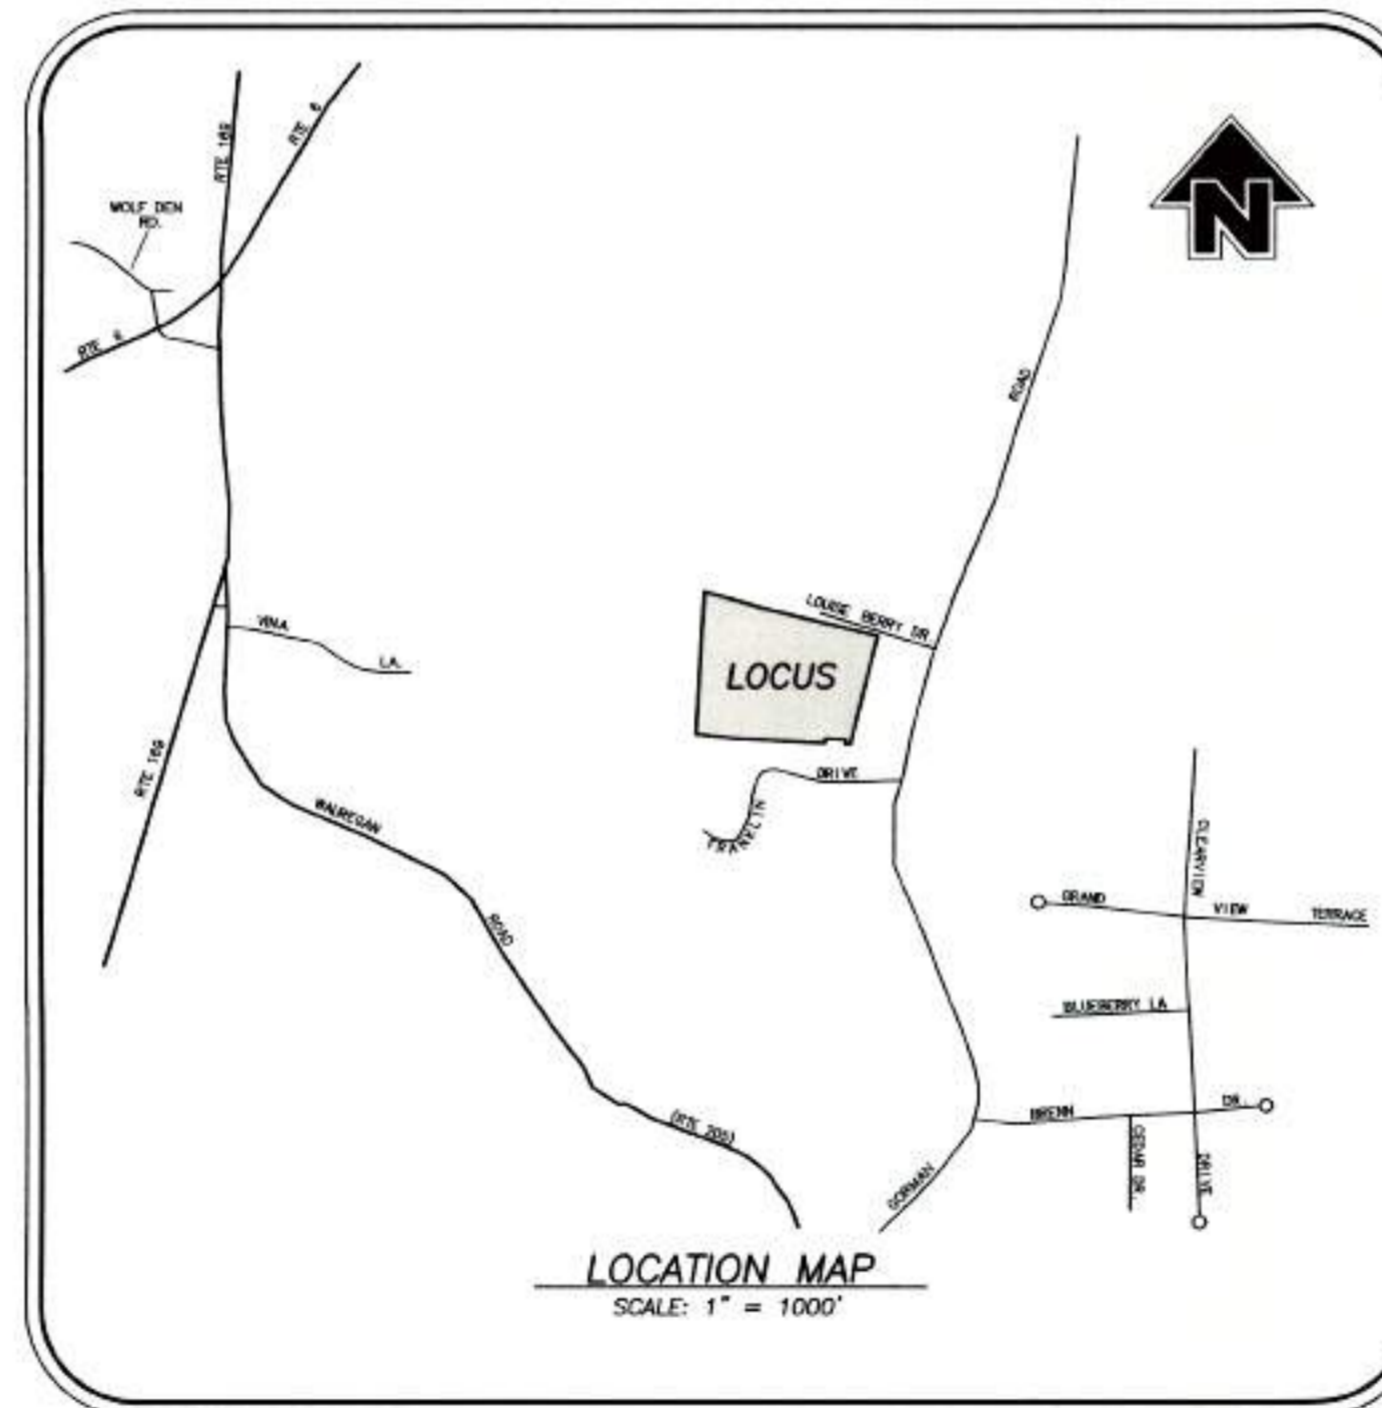

**INDEX TO DRAWINGS**

TITLE	SHEET No.
COVER SHEET	1 OF 16
PROPERTY SURVEY	2 OF 16
EASEMENT MAP	3 OF 16
SITE PLAN	4 OF 16
LAYOUT & LANDSCAPING PLAN	5 OF 16
EROSION CONTROL AND UTILITIES PLAN	6 OF 16
ROAD PROFILE	7 OF 16
PHASING PLAN No. 1	8 OF 16
PHASING PLAN No. 2	9 OF 16
PHASING PLAN No. 3	10 OF 16
PHASING PLAN No. 4	11 OF 16
PHASING PLAN No. 5	12 OF 16
DETAIL SHEET 1	13 OF 16
DETAIL SHEET 2	14 OF 16
DETAIL SHEET 3	15 OF 16
DETAIL SHEET 4	16 OF 16
PROXIMITY PLAN	1 OF 1

PREPARED BY:

DATE	DESCRIPTION
01/04/2021	TOWN & ENGINEERING REVIEW
01/27/2021	PER SWMPCA REVIEW
02/10/2021	EASE ADDED/ZONE/CT WATER COMMENTS
03/30/2021	TOWN & ENGINEERING REVIEW
04/20/2021	IWWC APPROVAL CONDITIONS
08/15/2021	TOWN ROAD FRONTAGE
10/15/2021	CONSULTANT REVIEW / COMMISSION
10/26/2021	PHASING PLANS / EAS
08/28/2022	IWWC APPLICATION RESUBMISSION

**Killingly Engineering Associates**  
Civil Engineering & Surveying

114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 779-7299  
www.killinglyengineering.com

April 23, 2020

FOR REVIEW ONLY  
NOT FOR CONSTRUCTION






*Norman Thibault, Jr.*  
NORMAN THIBAUT, JR., P.E. No. 22834 DATE

K:\20014\Drawings\01\_20014\_COVER\_SHEET.dwg Nov 03, 2022 3:42 PM



LINE	BEARING	DISTANCE
L1	S 11°34'49" W	8.68'
L2	S 09°28'18" W	25.48'
L3	N 89°46'21" W	25.92'
L4	N 00°34'43" W	23.50'
L5	S 08°18'28" W	23.74'
L6	N 44°34'04" E	99.75'
L7	N 61°24'42" E	94.87'
L8	N 31°12'36" E	33.18'
L9	S 31°12'36" W	50.87'
L10	S 61°24'42" W	98.52'
L11	S 44°34'04" W	111.92'
L12	N 77°29'37" W	10.83'

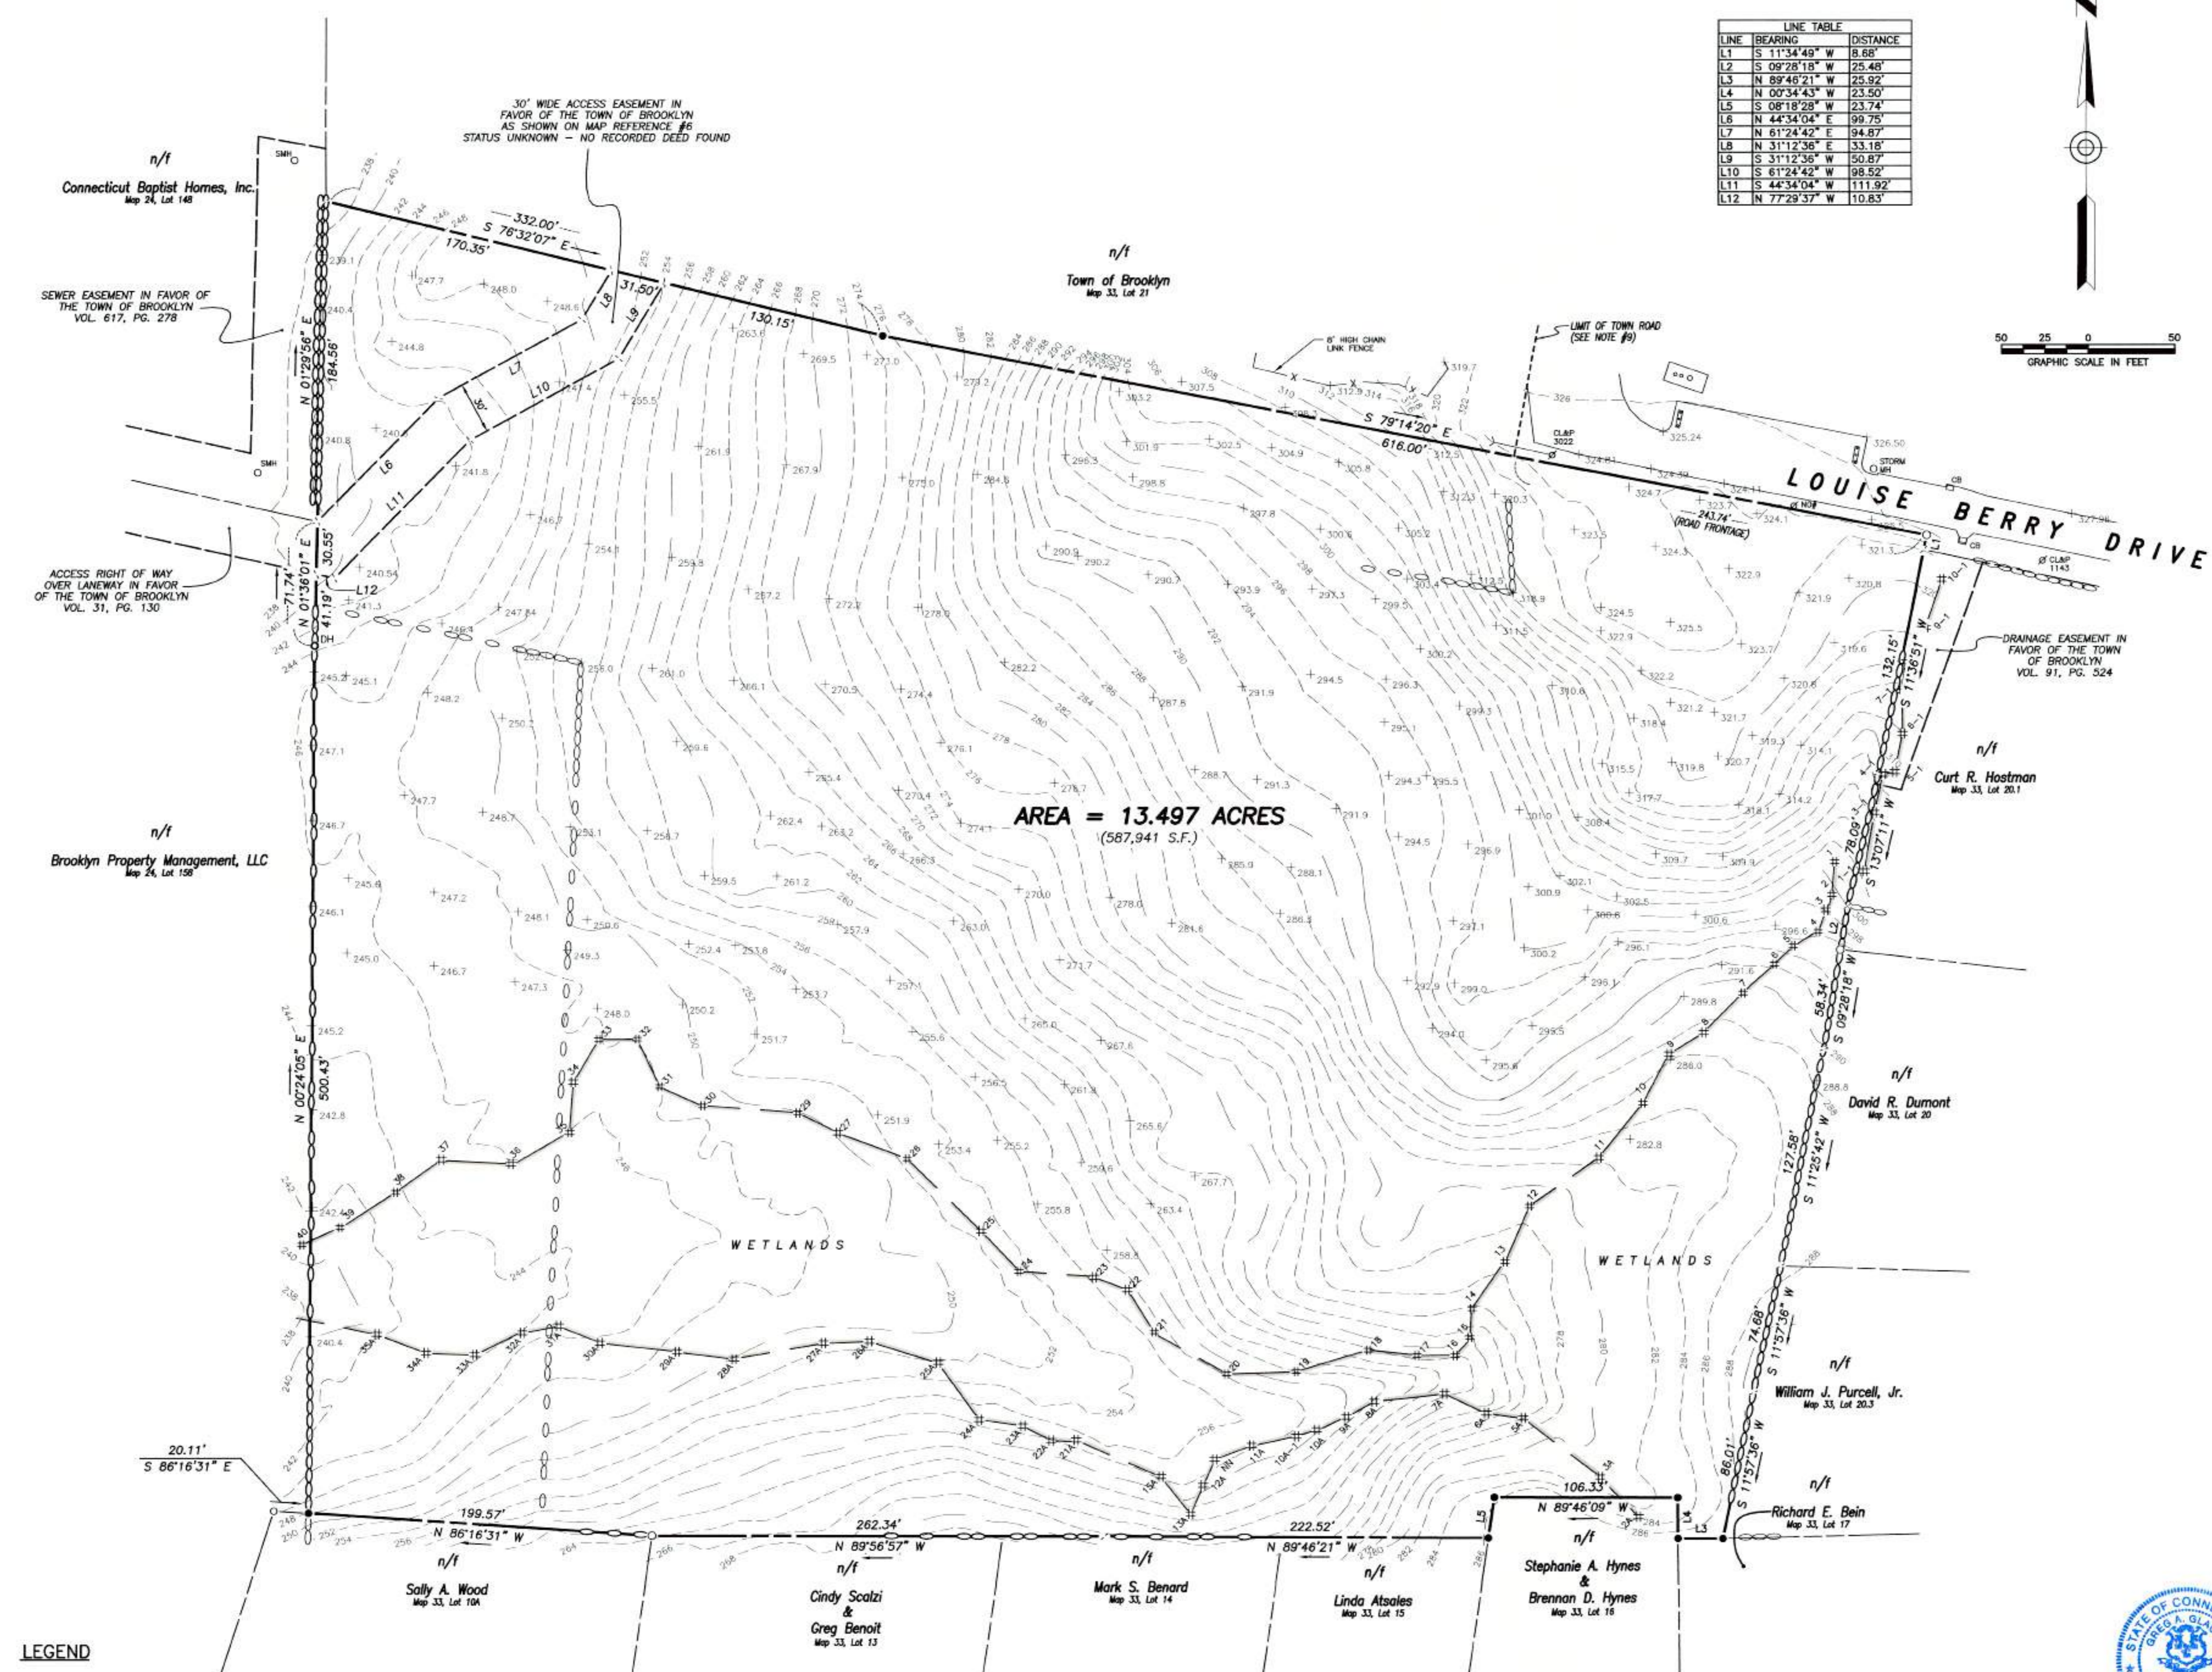

**AREA = 13.497 ACRES**  
(587,941 S.F.)

- NOTES:**
- This survey has been prepared pursuant to the Regulations of Connecticut State Agencies Sections 20-300b-1 through 20-300b-20 and the "Standards for Surveys and Maps in the State of Connecticut" as adopted by the Connecticut Association of Land Surveyors, Inc. on September 26, 1996;
    - This survey conforms to a Class "A-2" horizontal accuracy.
    - Topographic features conform to a Class "T-2", "V-2" vertical accuracy.
    - Survey Type: Property Survey
    - Boundary Determination Category: Resurvey.
  - Zone = R-30.
  - Owner of record: Shane J. Pollock & Erin F. Mancuso  
101 Mackin Drive  
Griswold, CT 06351  
See Volume 659, Page 151
  - Parcel is shown as Lot 19 on Assessors Map 33.
  - North orientation is based on North American Datum of 1982 (NAD 82) and is taken from GPS observations.
  - Elevations shown are based on an North American Vertical Datum of 1988 (NAVD 88). Contours taken from actual field survey. Contour interval = 2'.
  - Parcel lies within Flood Hazard Zone "C" (areas of minimal flooding) as shown on FIRM Map # 090164 Panel 0005A Effective Date: Jan. 3, 1985.
  - Wetlands shown were delineated in the field by Joseph Theroux, Certified Soil Scientist, in 2019.
  - Town road limit was established by referencing the CDOT 2020 Town Roads Report, which designates the length of Louise Berry Drive to be .12 miles or 634' in length.

- MAP REFERENCES:**
- "Plan of site for new school in the Town of Brooklyn, Conn. - Scale: 1" = 100' - Date: June 9, 1952 - Prepared by: William W. Pike, Surveyor." On file in the Brooklyn land records.
  - "Layout of Franklin Drive in the Town of Brooklyn, Conn. - Scale: 1" = 100' - Date: Oct. 15, 1959 - Prepared by: William W. Pike, Surveyor." On file in the Brooklyn land records.
  - "Subdivision Plan - property of Kurt R. & Lampi E. Hostman - Gorman Road - Brooklyn, CT - Date: Aug. 1987 - Revised to: Jan. 21, 1988 - Scale: 1" = 40' - Prepared by: Louis J. Soja, Jr. On file in the Brooklyn land records.
  - "Property Survey and inland wetland field location - Pierce Memorial Baptist Home Inc. - Route 169 - Brooklyn, Connecticut - Date: Mar. 6, 1989 - Revised to: 7/25/1989 - Scale: 1" = 50' - Sheet 6 of 6 - Prepared by: Hallisey & Herbert, Civil Engineers & Surveyors." On file in the Brooklyn Land Records.
  - "Easement Plan prepared for Town of Brooklyn - Brooklyn Elementary School & Brooklyn Junior High School - Route 205 (Wauregan Road) - Brooklyn, Connecticut - Date: 4/5/1999 - Scale: 1" = 40' - Sheet 2 of 2. Prepared by: KWP Associates." On file in the Brooklyn land records.
  - "Easement Plan showing proposed easement on land of Eggs, Inc. prepared for Town of Brooklyn - Wauregan Road (Route #205) - Brooklyn, Connecticut - Date: 4/20/2001 - Scale: 1" = 50' - Sheet 1 of 1 - Prepared by: KWP Associates." On file in the Brooklyn land records.
  - "Property survey showing portion of land of pierce Memorial Baptist Home, Inc. 44 Canterbury Road and Vina Lane - Brooklyn, Connecticut - Date: November 26, 2007 - Scale: 1" = 100' - Sheet 1 of 2 - Prepared by: Dicesare Bentley." On file in the Brooklyn land records.
  - "Perimeter Survey prepared for Eggs Inc. - Gorman Road / Franklin Drive / Wauregan Road - Brooklyn, Connecticut - Date: Oct. 2014 - Scale: 1" = 125' - Sheet 1 of 1 - Prepared by: Archer Surveying, LLC." On file in the Brooklyn land records.
  - "Boundary Line Agreement prepared for Brooklyn Center Complex, BLB, LLC and Vina Land, LLC - Wauregan Road & Vina Lane - Brooklyn, Connecticut - Date: December 11, 2019 - Scale: 1" = 125' - Sheet 1 of 1 - Prepared by: Archer Surveying, LLC." Not on file.

DATE	DESCRIPTION
08/29/2022	INVC APPLICATION RESUBMISSION
10/26/2021	PHASING / EBS
10/15/2021	CONSULTANT REVIEW & COMMISSION
09/15/2021	TOWN ROAD FRONTAGE
04/20/2021	INVC APPROVAL CONDITIONS
DATE	DESCRIPTION
	REVISIONS

**PROPERTY SURVEY**  
PREPARED FOR  
**SHANE POLLOCK**  
LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT

**Killingly Engineering Associates**  
Civil Engineering & Surveying  
114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 776-7299  
www.killinglyengineering.com

DATE: 4/23/2020	DRAWN: DNE
SCALE: 1" = 50'	DESIGN: NET
SHEET: 2 OF 16	CHK BY: GG
DWG. No: CLIENT FILE	JOB No: 20014



I HAVE REVIEWED THE FLAGGED INLAND WETLANDS LOCATION SHOWN ON THIS PLAN AND THEY APPEAR TO BE SUBSTANTIALLY CORRECT.

Certified Soil Scientist \_\_\_\_\_ Date \_\_\_\_\_

TO MY KNOWLEDGE AND BELIEF, THIS MAP IS SUBSTANTIALLY CORRECT AS NOTED HEREON.



*Greg A. Glaude* 11-07-2022  
GREG A. GLAUDE, L.S. LIC. NO. 70191 DATE

NO CERTIFICATION IS EXPRESSED OR IMPLIED UNLESS THIS MAP BEARS THE ORIGINAL SEAL AND SIGNATURE OF THE LAND SURVEYOR.

- LEGEND**
- IRON PIN TO BE SET
  - IRON PIN FOUND
  - DH DRILL HOLE FOUND
  - U UTILITY POLE
  - CB CATCH BASIN
  - SMH SANITARY MANHOLE
  - 260--- EXISTING CONTOURS
  - INLAND WETLANDS FLAG
  - STONE WALL
  - STONE WALL REMAINS

CURVE TABLE	
C1 R = 227.50' D = 37°31'09" L = 148.97' CH = N 83°42'39" W 146.33'	C2 R = 172.50' D = 104°16'33" L = 313.94' CH = N 62°54'39" E 272.37'
C3 R = 227.50' D = 104°16'33" L = 414.04' CH = S 62°54'39" W 359.22'	C4 R = 172.50' D = 37°31'09" L = 112.96' CH = S 83°42'39" E 110.95'

LINE TABLE		
LINE	BEARING	DISTANCE
L1	S 11°34'49" W	8.68'
L2	S 09°28'18" W	25.48'
L3	N 69°46'21" W	25.92'
L4	N 00°34'43" W	23.50'
L5	S 08°18'28" W	23.74'
L6	S 77°29'37" E	38.81'
L7	N 77°29'37" W	18.74'

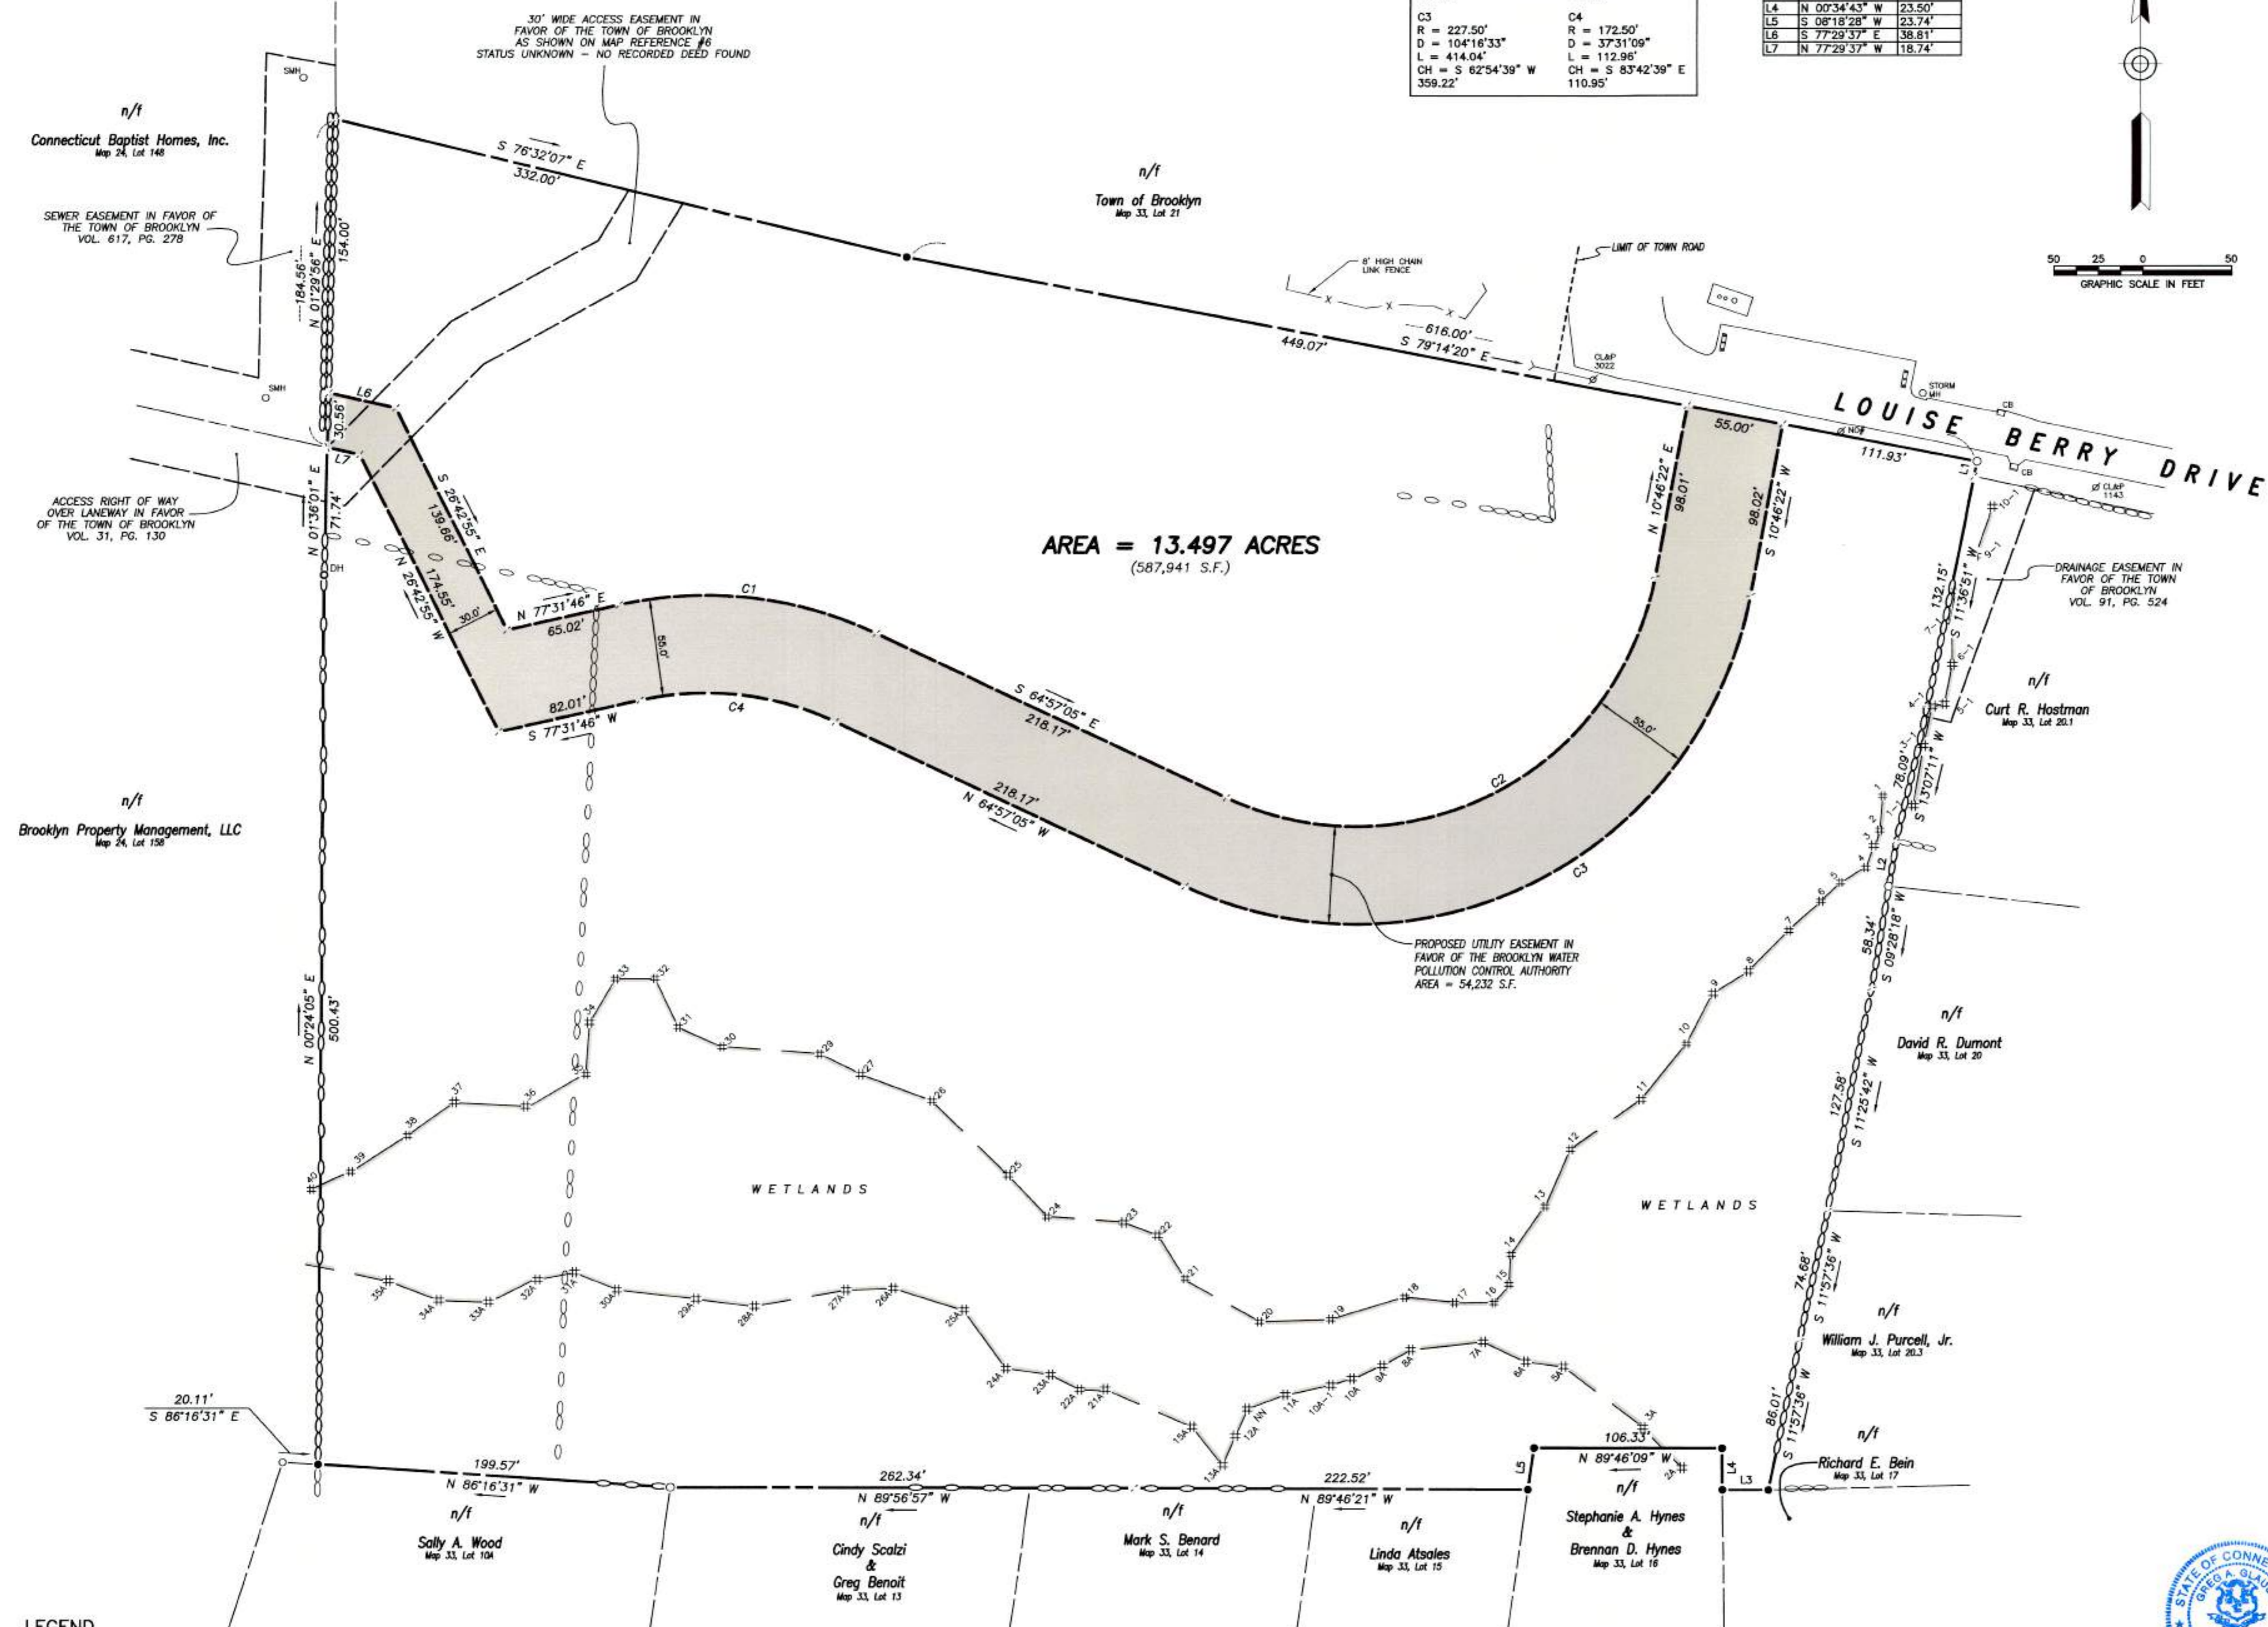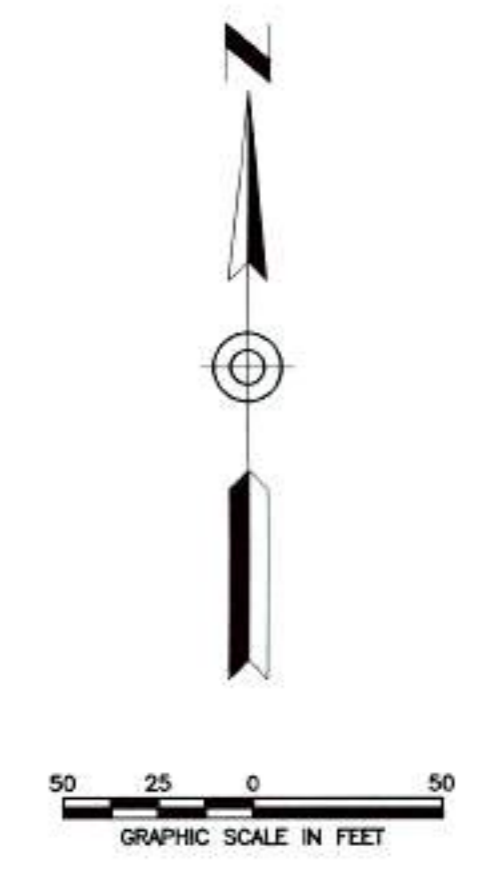

- NOTES:**
- This survey has been prepared pursuant to the Regulations of Connecticut State Agencies Sections 20-300b-1 through 20-300b-20 and the "Standards for Surveys and Maps in the State of Connecticut" as adopted by the Connecticut Association of Land Surveyors, Inc. on September 26, 1996;
    - This survey conforms to a Class "A-2" horizontal accuracy.
    - Topographic features conform to a Class "T-2", "V-2" vertical
  - Survey Type: Easement Map.
  - Boundary Determination Category: Resurvey.
  - Zone = R-30.
  - Owner of record: Shane J. Pollock & Erin F. Mancuso  
101 Mackin Drive  
Griswold CT 06351  
See Volume 659, Page 151
  - Parcel is shown as Lot 19 on Assessors Map 33.
  - North orientation is based on North American Datum of 1982 (NAD 82) and is taken from GPS observations.
  - Parcel lies within Flood Hazard Zone 'C' (areas of minimal flooding) as shown on FIRM Map # 090164 Panel 0005A Effective Date: Jan. 3, 1985.
  - Wetlands shown were delineated in the field by Joseph Theroux, Certified Soil Scientist, in 2019.
- MAP REFERENCES:**
- "Plan of site for new school in the Town of Brooklyn, Conn. - Scale: 1" = 100' - Date: June 9, 1952 - Prepared by: William W. Pike, Surveyor." On file in the Brooklyn land records.
  - "Layout of Franklin Drive in the Town of Brooklyn, Conn. - Scale: 1" = 100' - Date: Oct. 15, 1959 - Prepared by: William W. Pike, Surveyor." On file in the Brooklyn land records.
  - "Subdivision Plan - property of Kurt R. & Lempi E. Hostman - Gorman Road - Brooklyn, CT - Date: Aug. 1987 - Revised to: Jan. 21, 1988 - Scale: 1" = 40' - Prepared by: Louis J. Soja, Jr." On file in the Brooklyn land records.
  - "Property Survey and inland wetland field location - Pierce Memorial Baptist Home Inc. - Route 169 - Brooklyn, Connecticut - Date: Mar. 6, 1989 - Revised to: 7/25/1989 - Scale: 1" = 50' - Sheet 6 of 6 - Prepared by: Hollisey & Herbert, Civil Engineers & Surveyors." On file in the Brooklyn Land Records.
  - "Easement Plan prepared for Town of Brooklyn - Brooklyn Elementary School & Brooklyn Junior High School - Route 205 (Waregan Road) - Brooklyn, Connecticut Date: 4/5/1999 - Scale: 1" = 40' - Sheet 2 of 2. Prepared by: KWP Associates." On file in the Brooklyn land records.
  - "Easement Plan showing proposed easement on land of Eggs, Inc. prepared for Town of Brooklyn - Waregan Road (Route #205) - Brooklyn, Connecticut - Date: 4/20/2001 - Scale: 1" = 50' - Sheet 1 of 1 - Prepared by: KWP Associates. On file in the Brooklyn land records.
  - "Property survey showing portion of land of pierce Memorial Baptist Home, Inc. 44 Canterbury Road and Vina Lane - Brooklyn, Connecticut - Date: November 26, 2007 - Scale: 1" = 100' - Sheet 1 of 2 - Prepared by: Dicesare Bentley." On file in the Brooklyn land records.
  - "Perimeter Survey prepared for Eggs Inc. - Gorman Road / Franklin Drive / Waregan Road - Brooklyn, Connecticut - Date: Oct. 2014 - Scale: 1" = 125' - Sheet 1 of 1 - Prepared by: Archer Surveying, LLC." On file in the Brooklyn land records.
  - "Boundary Line Agreement prepared for Brooklyn Center Complex, BLB, LLC and Vina Land, LLC - Waregan Road & Vina Lane - Brooklyn, Connecticut - Date: December 11, 2019 - Scale: 1" = 125' - Sheet 1 of 1 - Prepared by: Archer Surveying, LLC." Not on file.

DATE	DESCRIPTION
08/29/2022	INVC APPLICATION RESUBMISSION
10/26/2021	PHASING / EAS
10/15/2021	CONSULTANT REVIEW & COMMISSION
09/15/2021	TOWN ROAD FRONTAGE
04/20/2021	INVC APPROVAL CONDITIONS
DATE	DESCRIPTION
	REVISIONS

**EASEMENT MAP**  
PREPARED FOR  
**SHANE POLLOCK**  
LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT



**Killingly Engineering Associates**  
Civil Engineering & Surveying  
114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 779-7299  
www.killinglyengineering.com

DATE: 4/23/2020	DRAWN: DNE
SCALE: 1" = 50'	DESIGN: NET
SHEET: 3 OF 16	CHK BY: GG
DWG. No: CLIENT FILE	JOB No: 20014

TO MY KNOWLEDGE AND BELIEF, THIS MAP IS SUBSTANTIALLY CORRECT AS NOTED HEREON.




*Greg A. Glaude* 11-04-2022  
GREG A. GLAUDE, L.S. LIC. NO. 70191 DATE

NO CERTIFICATION IS EXPRESSED OR IMPLIED UNLESS THIS MAP BEARS THE ORIGINAL SEAL AND SIGNATURE OF THE LAND SURVEYOR.

K:\20014\Drawings\03-20014\_EASEMENT.dwg Nov 03, 2022 - 3:43 PM

- LEGEND**
- IRON PIN TO BE SET
  - IRON PIN FOUND
  - OH DRILL HOLE FOUND
  - UTILITY POLE
  - CB CATCH BASIN
  - SMH SANITARY MANHOLE
  - INLAND WETLANDS FLAG
  - ○ ○ ○ ○ STONE WALL
  - ○ ○ ○ ○ STONE WALL REMAINS



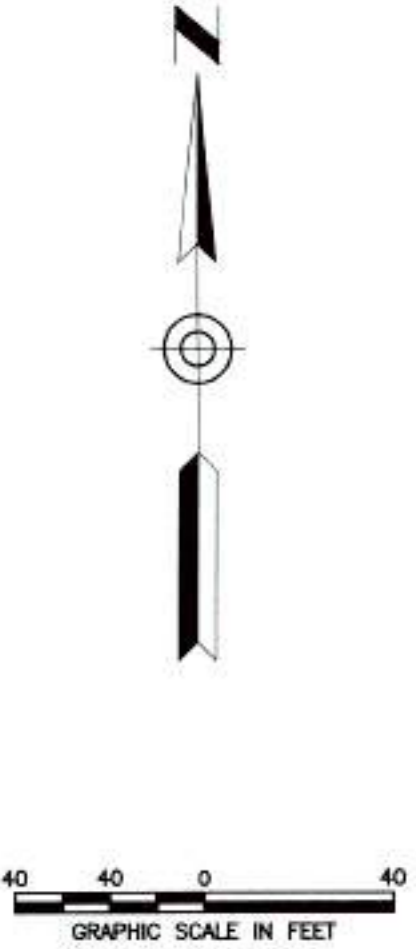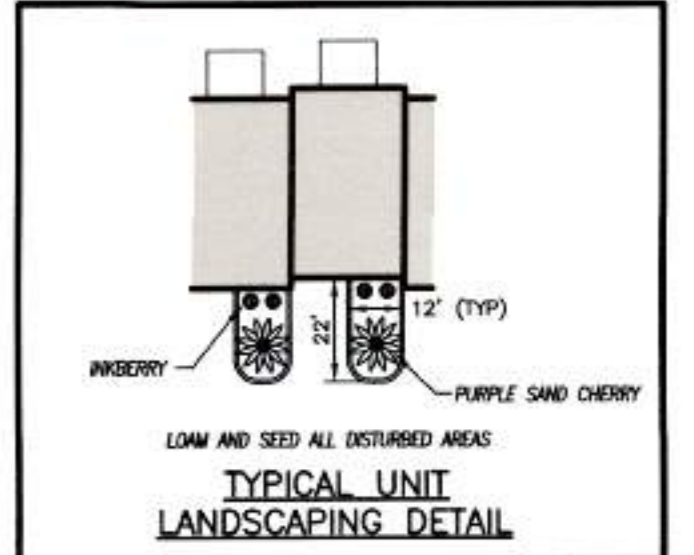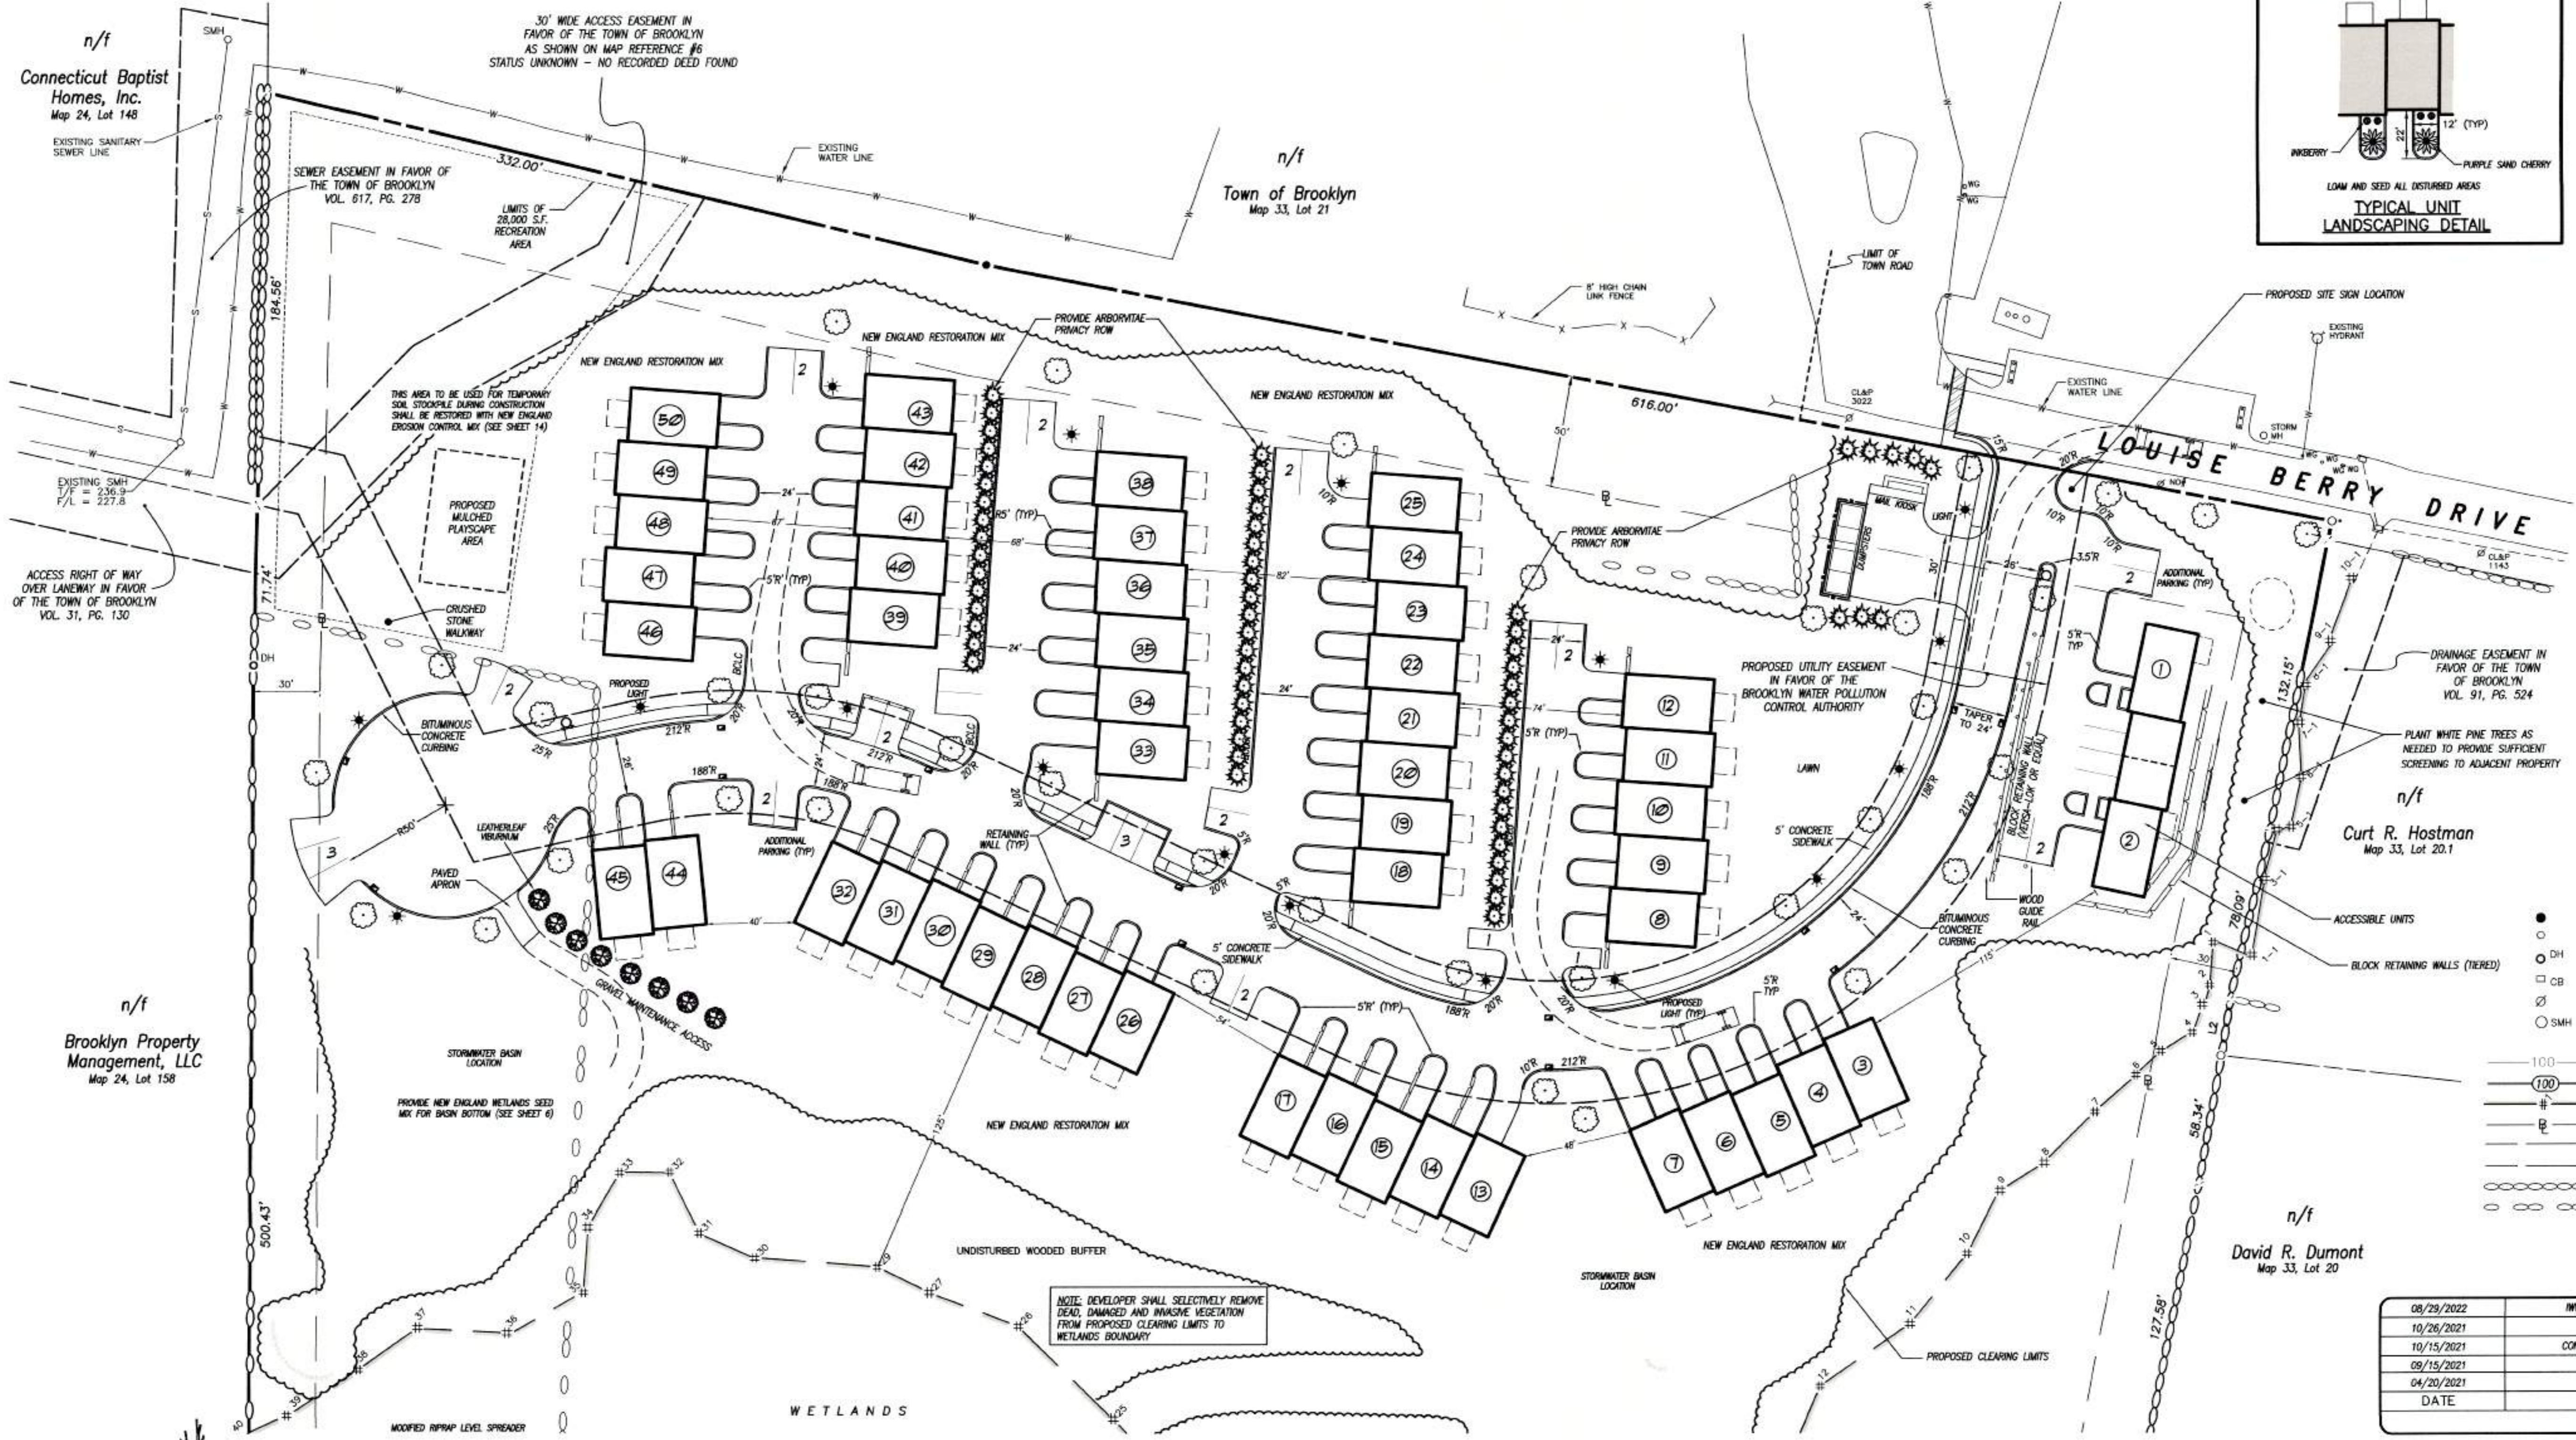

**LEGEND**

- IRON PIN TO BE SET
- IRON PIN FOUND
- DH DRILL HOLE FOUND
- CB CATCH BASIN
- UP UTILITY POLE
- SMH SANITARY SEWER MANHOLE
- HYDRANT
- 100 EXISTING CONTOURS
- 100 PROPOSED CONTOURS
- INLAND WETLANDS FLAG
- BUILDING SETBACK LINE
- EXISTING SANITARY SEWER LINE
- EXISTING WATER LINE
- ○ ○ ○ ○ STONE WALL
- ○ ○ ○ ○ STONE WALL REMAINS

DATE	DESCRIPTION
08/29/2022	MWC APPLICATION RESUBMISSION
10/26/2021	PHASING / E&S
10/15/2021	CONSULTANT REVIEW & COMMISSION
09/15/2021	TOWN ROAD FRONTAGE
04/20/2021	MWC APPROVAL CONDITIONS
DATE	REVISIONS

**LANDSCAPE SCHEDULE**

BOTANICAL NAME	COMMON NAME	SIZE	NUMBER
Cornus kousa	Korean Flowering Dogwood	2.5" cal.	10
Pyrus calleryna	Flowering Pear	2.5" cal.	23
Ilex glabra	Inkberry 'Shamrock'	1 gal.	102
Prunus x cistena	Purple Sand Cherry	1 gal.	51
Thuja occidentalis	Arborvitae 'Emerald Green'	4' height	54
Viburnum rhytidophyllum	Leatherleaf Viburnum	4'	8

NOTE: Provide Cornus kousa at ends of drives and around cul-de-sac  
Provide Pyrus calleryna for street trees

**LAYOUT & LANDSCAPING PLAN**

PREPARED FOR


**SHANE POLLOCK**

LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT


**Killingly Engineering Associates**  
Civil Engineering & Surveying

114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 779-7299  
www.killinglyengineering.com


DATE: 4/23/2020	DRAWN: DNE
SCALE: 1" = 40'	DESIGN: NET
SHEET: 5 OF 16	CHK BY: GG
DWG. No: CLIENT FILE	JOB No: 20014

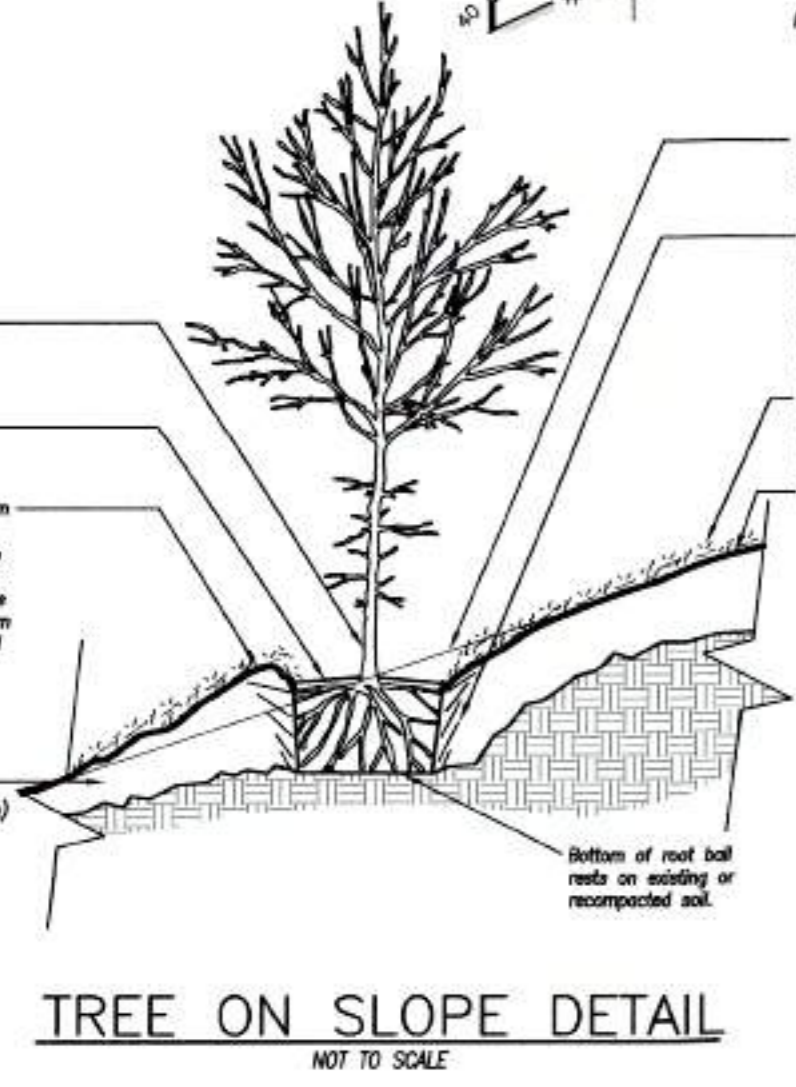

**PLANTING CROSS SECTION FOR TREES UNDER 20'**  
NOT TO SCALE

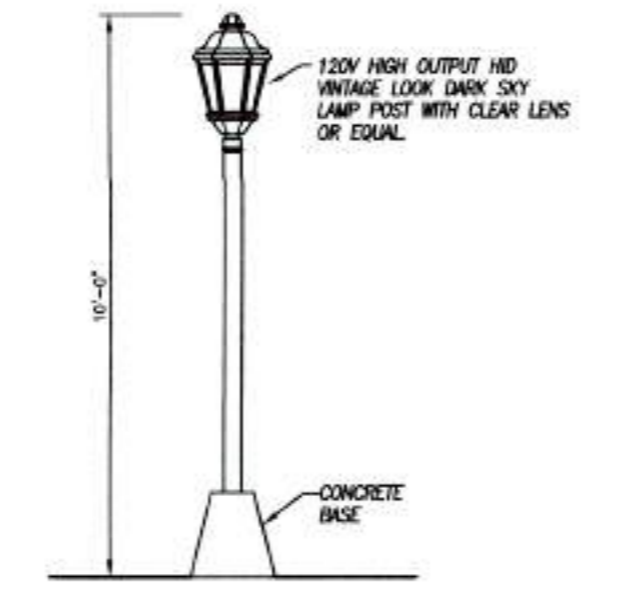

**LIGHT POLE DETAIL**  
NOT TO SCALE  
NOTE: BUILDING MOUNTED LIGHTING SHALL BE FULL CUTOFF FIXTURES

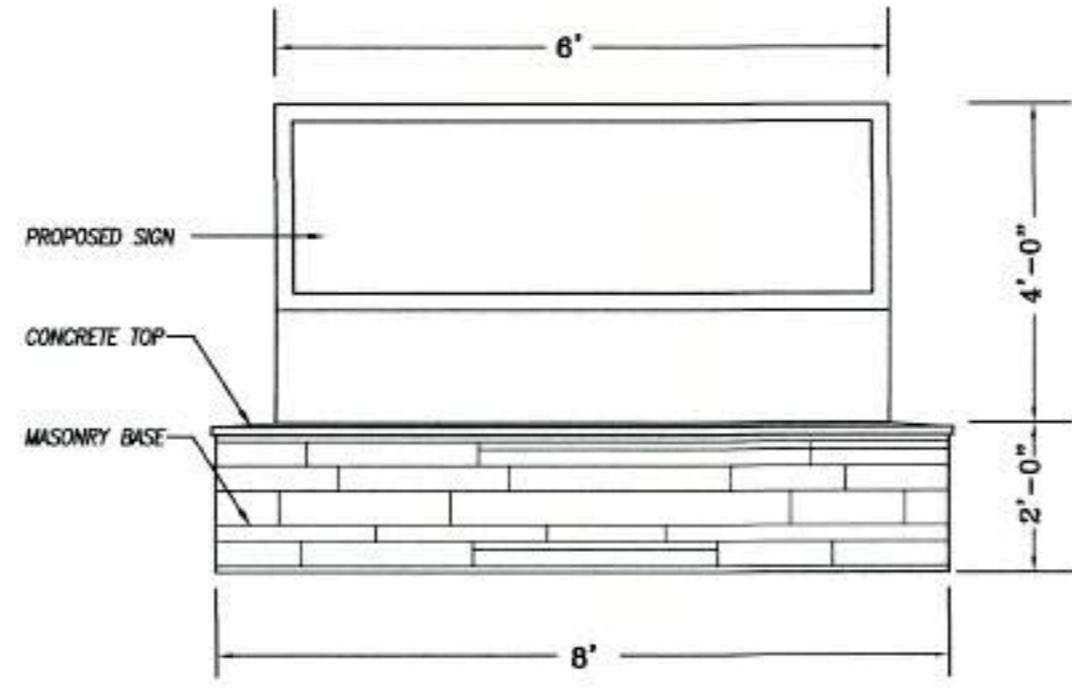

**SITE SIGN DETAIL**  
NOT TO SCALE



*Norman E. Thebaud, Jr., P.E.*  
NORMAN E. THEBAUD, JR., P.E. DATE  
LIC #PEN 0022834

K:\20014\Drawings\05\_20014\_LSP.dwg Nov 03, 2022 3:44 PM

SEE SHEET 7 FOR WATER MAIN INSTALLATION NOTES

- DRAINAGE GENERAL NOTES:**
1. ALL DRAINAGE PIPE SHALL BE CORRUGATED HIGH DENSITY POLYETHYLENE (HDPE), SMOOTH INTERIOR AS MANUFACTURED BY ADVANCED DRAINAGE SOLUTIONS OR APPROVED EQUAL.
  2. CATCH BASIN TOPS SHALL BE TYPE "C" UNLESS OTHERWISE NOTED.
  3. ALL BASINS SHALL BE INSTALLED WITH 4" SUMP.
  4. PROVIDE 4" SUMP AND HOODED OUTLET AT TERMINATION CATCH BASIN PRIOR TO DISCHARGE INTO STORMWATER BASIN.

- SANITARY SEWER GENERAL NOTES:**
1. ALL SANITARY SEWER MAINS SHALL BE 8" SDR 35 PVC.
  2. SANITARY SEWER LATERALS TO RESIDENCES SHALL BE 4" SDR 35 PVC AND SHALL BE INSTALLED WITH A MINIMUM 42" OF COVER AND A SLOPE OF 2%.
  3. LATERALS SHALL NOT BE INSTALLED DIRECTLY TO OR WITHIN 5' OF A SANITARY MANHOLE.
  4. SANITARY SEWER SYSTEM CONSTRUCTION IS SUBJECT TO INSPECTION AND APPROVAL BY THE BROOKLYN WPCA. THE CONTRACTOR SHALL SCHEDULE A PRE-CONSTRUCTION MEETING WITH THE BROOKLYN WPCA AND NOTIFY THE BROOKLYN WPCA A MINIMUM OF 72 HOURS PRIOR TO THE START OF ANY CONSTRUCTION.
  5. AS-BUILT DRAWINGS SHALL BE SUBMITTED AND APPROVED PRIOR TO PROJECT ACCEPTANCE.

- WATER MAIN & SERVICES:**
1. ALL WATER PIPE SHALL BE CLASS 52 DUCTILE IRON PIPE IN ACCORDANCE WITH CT WATER REQUIREMENTS.
  2. TAPS INTO EXISTING MAINS SHALL BE UNDER THE SUPERVISION OF CT WATER REPRESENTATIVES.
  3. WATER SERVICE CONNECTIONS TO THE WATER MAIN SHALL BE PER CT WATER REQUIREMENTS. SERVICES FROM SHUT OFF VALVES TO RESIDENCES SHALL BE 1" HDPE.
  4. HYDRANT REQUIREMENTS AND LOCATIONS SHALL BE DETERMINED BY THE TOWN OF BROOKLYN FIRE MARSHAL.

- TOWN OF BROOKLYN WATER POLLUTION CONTROL AUTHORITY (BWPCA) NOTES:**
1. PRIOR TO ANY WORK BEING CONDUCTED SANITARY SEWER, CONTRACTOR SHALL CONTACT ALAN CARPENTER, P.E., REPRESENTATIVE FOR THE BROOKLYN WPCA. PHONE: 860-208-3394 OR 508-659-7020. EMAIL: [ALCARPENTER@BROOKLYNCT.COM](mailto:ALCARPENTER@BROOKLYNCT.COM)
  2. THE MAIN TRUNK LINE THROUGH THE SITE IS DEDICATED TO THE BWPCA UNDER A 30 FOOT WIDE EASEMENT (15 FEET EACH SIDE OF THE LINE) FOR OWNERSHIP, CONTROL AND MAINTENANCE RESPONSIBILITY. THE PERMANENT EASEMENT OVER THE MAIN TRUNK LINE WILL NEED TO BE CREATED, APPROVED BY BWPCA AND RECORDED IN THE TOWN OF BROOKLYN LAND RECORDS PRIOR TO ANY CONNECTIONS TO THE SYSTEM.
  3. THE EASTERN TERMINUS MANHOLE IN LOUISE BERRY DRIVE BE A MINIMUM OF 8 FEET DEEP FROM TOP OF FRAME TO INVERT AND AN 8 INCH SDR 35 STUB BE INSTALLED A MINIMUM OF 1 FEET LENGTH (20 FEET) AT 0.4 FT/FT SLOPE AND CAPPED IN THE EAST FACING INVERT.
  4. THE ENTIRE SYSTEM BE CONSTRUCTED/INSTALLED IN ACCORDANCE WITH THE TOWN OF BROOKLYN WPCA CONSTRUCTION STANDARDS BY THE DEVELOPER. THE SYSTEM TO BE INSPECTED BY BWPCA REPRESENTATIVES DURING CONSTRUCTION, TESTED BY THE DEVELOPER AND CERTIFIED BY HIS ENGINEER AND "CLEARED FOR USE" BY BWPCA REPRESENTATIVES BEFORE THE SYSTEM CAN BE USED.
  5. UNLESS PROVIDED WITH DOCUMENTED PROOF OF ANTICIPATED USAGE, THE BWPCA IS CALCULATING THE ANTICIPATED USAGE AT 22,500 GALLONS PER DAY (51 UNITS X 450 GPD/PER UNIT).
  6. PRIOR TO THE COMMENCEMENT OF CONSTRUCTION OF THE SEWER SYSTEM, THE BWPCA REQUIRES A PRE-CONSTRUCTION MEETING BE SCHEDULED BY THE DEVELOPER, TO INCLUDE AT A MINIMUM, AN INVITE TO THE BWPCA 72 HOURS MINIMUM IN ADVANCE OF THE MEETING AND ATTENDANCE BY THE DEVELOPER, HIS ENGINEER, THE GENERAL CONTRACTOR AND UTILITY CONTRACTOR (IF DIFFERENT ENTITIES).
  7. IT IS UNDERSTOOD THAT ALL COSTS RELATING TO THE CREATION OF THIS UTILITY EXTENSION, AND THE LEGAL CONTROL AND DOCUMENTATION OF IT SHALL BE BORNE ENTIRELY BY THE DEVELOPER.
  8. IT IS EXPECTED THAT CONNECTION FEES PER UNIT, BE PAID PRIOR TO THE ISSUANCE OF A BUILDING PERMIT AND THE ONLY GUARANTEE OF SYSTEM CAPACITY AVAILABILITY IS RECEIPT OF THE CONNECTION FEES BY THE BWPCA.

- GENERAL NOTES:**
1. An as-built plan showing locations of all roadways, drainage and utilities shall be completed and filed with the town at the completion of the project infrastructure.
  2. Ownership of the stormwater basin and drainage system shall be the Homeowner's Association. The Town of Brooklyn will not assume responsibility as such.
  3. There shall be no parking along the main access roadway or side drives. Appropriate signage shall be installed accordingly.

DATE	DESCRIPTION
08/29/2022	INVC APPLICATION RESUBMISSION
10/26/2021	PHASING / EAS
10/15/2021	CONSULTANT REVIEW & COMMISSION
09/15/2021	TOWN ROAD FRONTAGE
04/20/2021	INVC APPROVAL CONDITIONS
DATE	DESCRIPTION
	REVISIONS

**EROSION CONTROL AND UTILITIES PLAN**

PREPARED FOR  
**SHANE POLLOCK**



LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT

**Killingly Engineering Associates**  
Civil Engineering & Surveying



114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 779-7299  
[www.killinglyengineering.com](http://www.killinglyengineering.com)

DATE: 4/23/2020	DRAWN: DNE
SCALE: 1" = 40'	DESIGN: NET
SHEET: 6 OF 16	CHK BY: GG
DWG. No: CLIENT FILE	JOB No: 20014

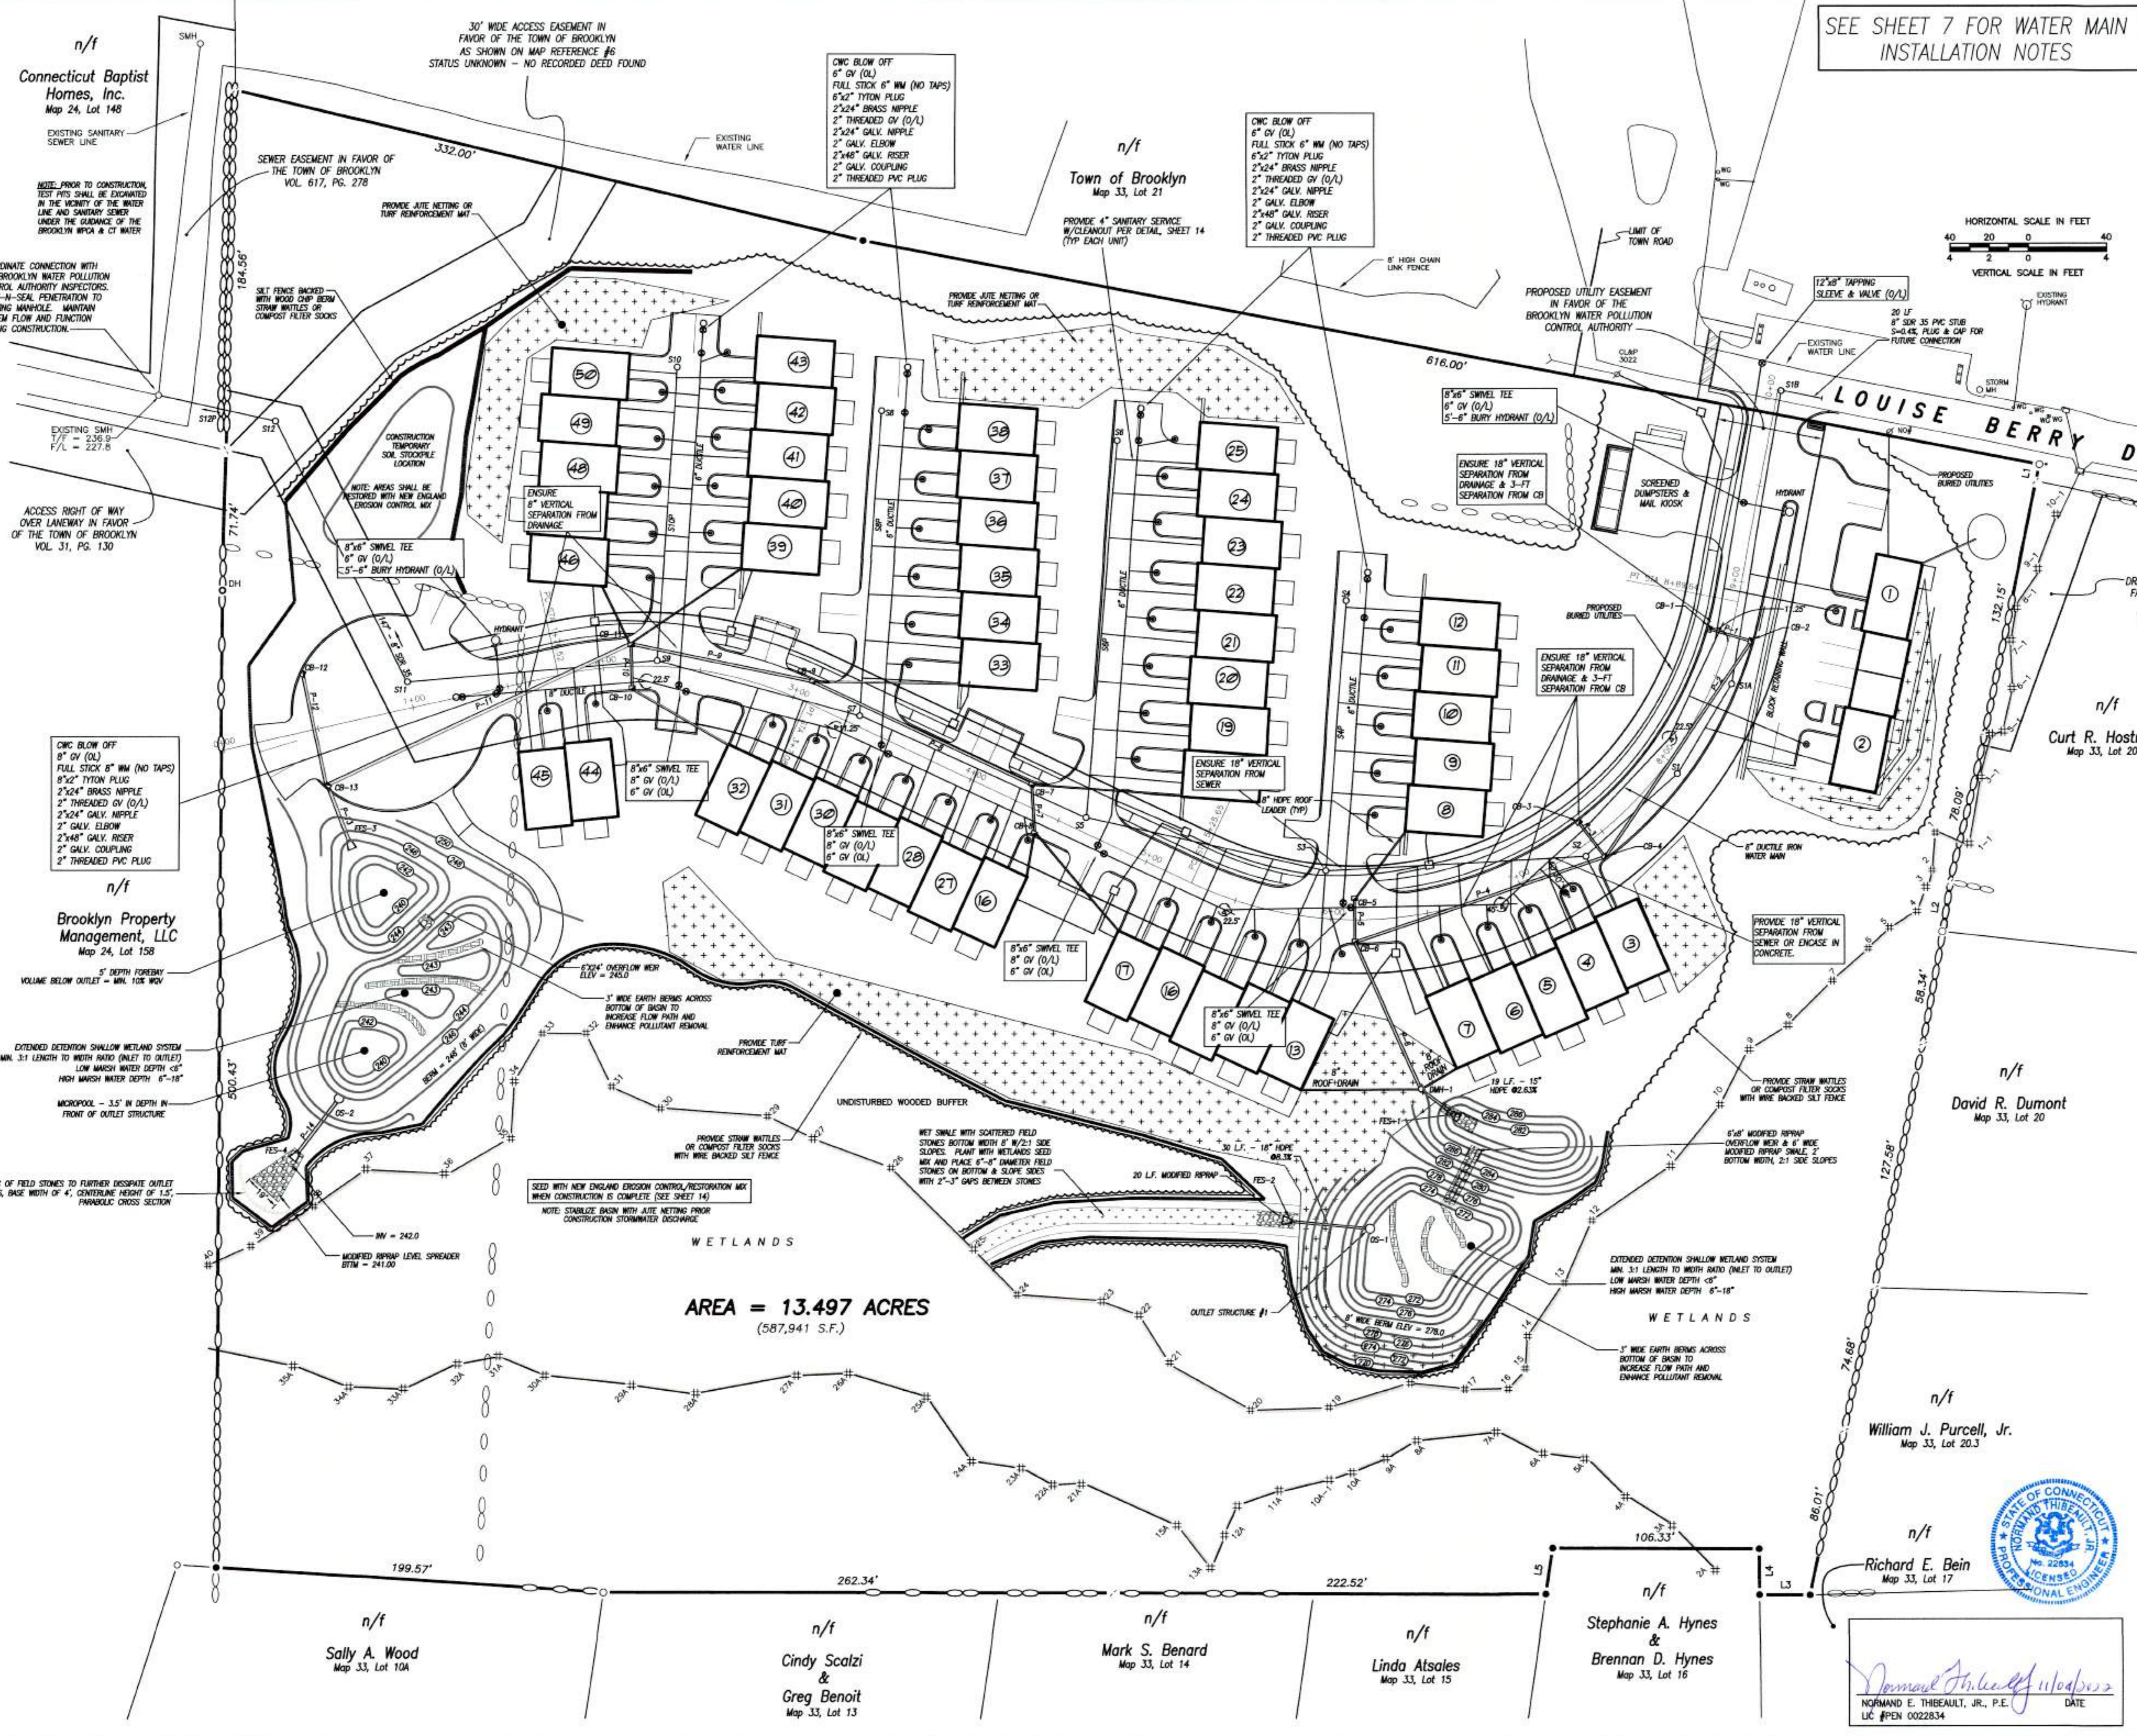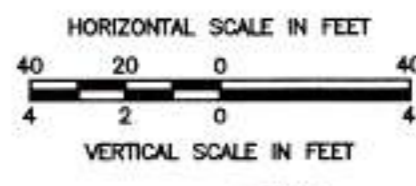

**AREA = 13.497 ACRES**  
(587,941 S.F.)

n/f  
**Connecticut Baptist Homes, Inc.**  
Map 24, Lot 148

n/f  
**Town of Brooklyn**  
Map 33, Lot 21

n/f  
**Brooklyn Property Management, LLC**  
Map 24, Lot 158

n/f  
**Curt R. Hostman**  
Map 33, Lot 20.1

n/f  
**David R. Dumont**  
Map 33, Lot 20

n/f  
**William J. Purcell, Jr.**  
Map 33, Lot 20.3

n/f  
**Richard E. Bein**  
Map 33, Lot 17

n/f  
**Stephanie A. Hynes & Brennan D. Hynes**  
Map 33, Lot 16

n/f  
**Mark S. Benard**  
Map 33, Lot 14

n/f  
**Linda Atsales**  
Map 33, Lot 15



n/f  
**Sally A. Wood**  
Map 33, Lot 10A

n/f  
**Cindy Scalz & Greg Benoit**  
Map 33, Lot 13



*Norman E. Thebaault, Jr.*  
NORMAN E. THEBAULT, JR., P.E.  
LIC #PEN 0022834



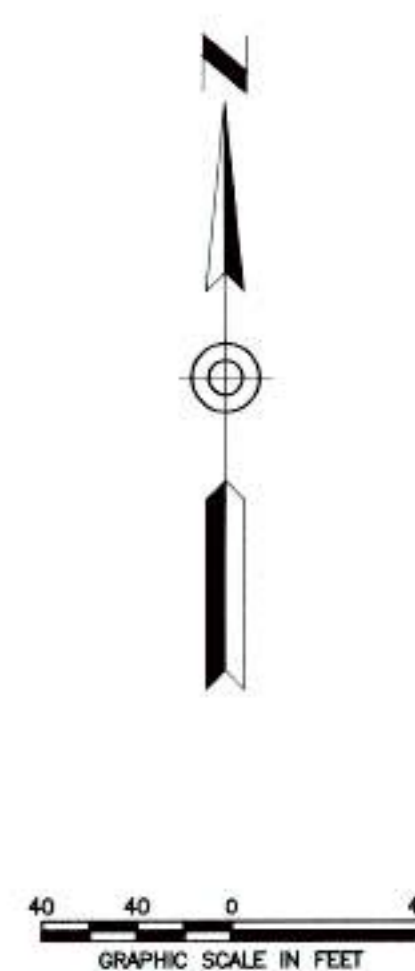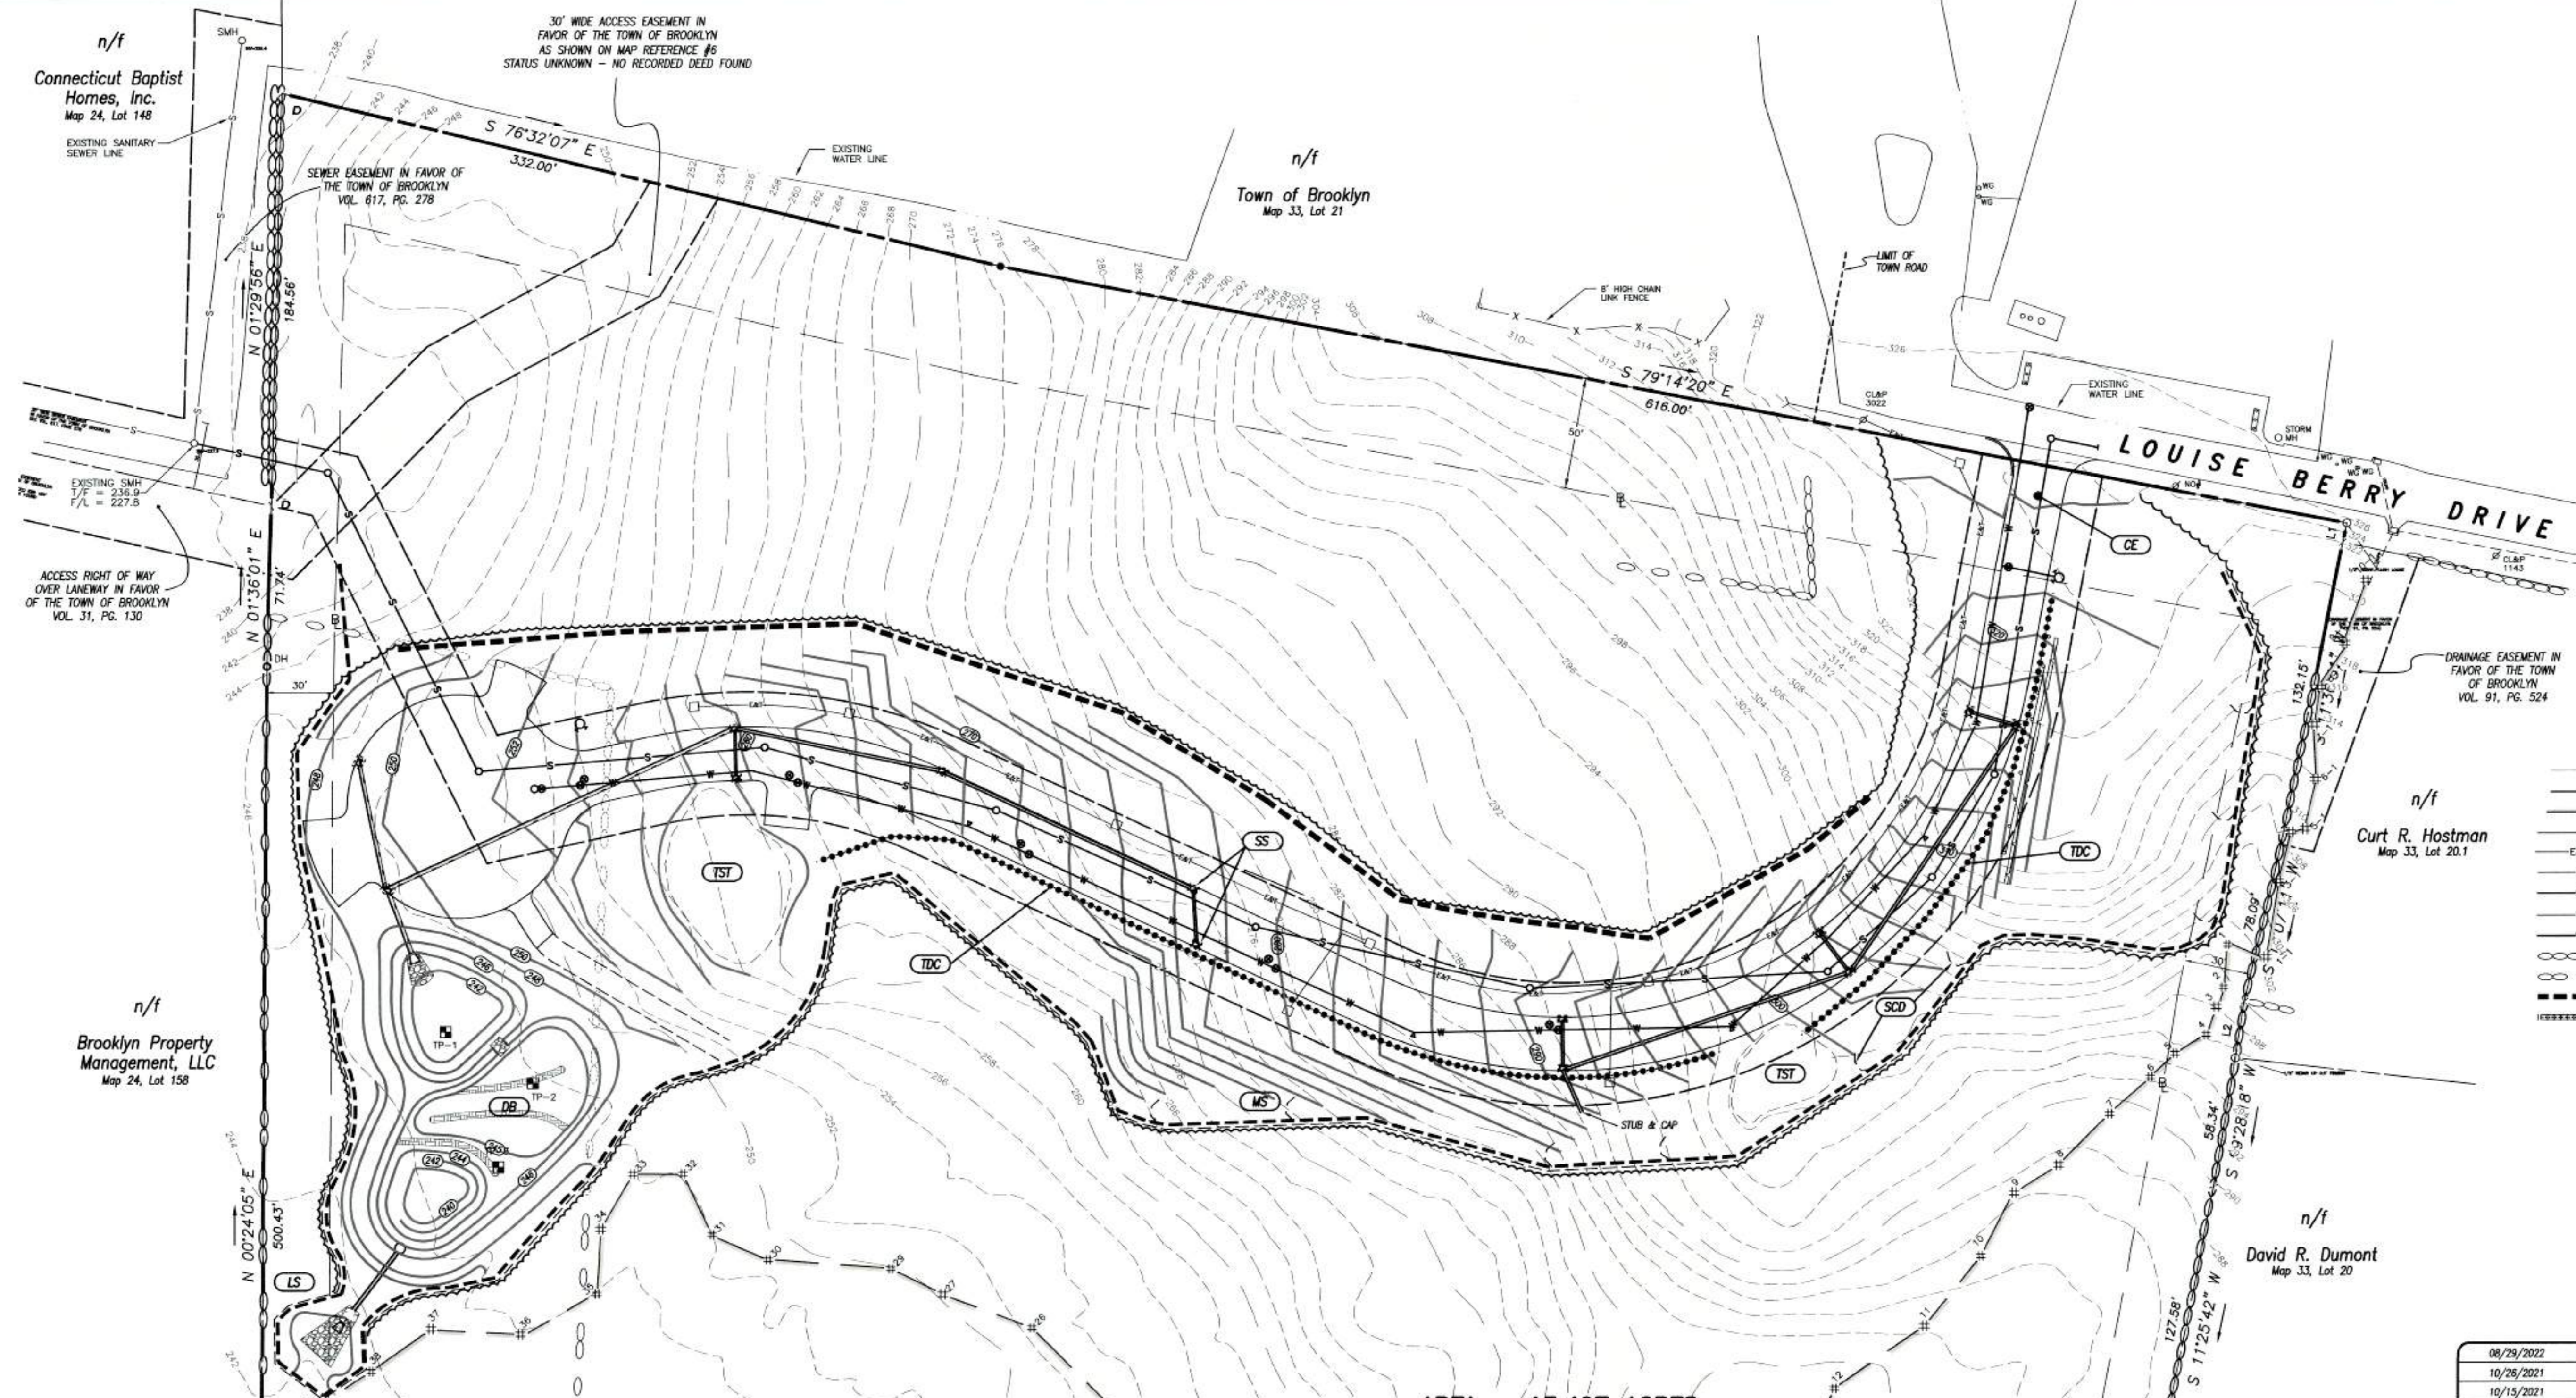

**LEGEND**

●	IRON PIN TO BE SET
○	IRON PIN FOUND
○ DH	DRILL HOLE FOUND
□ CB	CATCH BASIN
⊙	UTILITY POLE
○ SMH	EXISTING SANITARY MANHOLE
○	PROPOSED CONTOURS
—	INLAND WETLANDS FLAG
—	BUILDING SETBACK LINE
—	PROPOSED BURIED UTILITIES
—	EXISTING SANITARY SEWER LINE
—	PROPOSED SANITARY SEWER LINE
—	EXISTING WATER LINE
—	PROPOSED WATER LINE
—	STONE WALL
—	STONE WALL COURSE SETBACK
—	SILT FENCE
—	STAKED HAYBALES

08/29/2022	INVC APPLICATION RESUBMISSION
10/26/2021	PHASING / ERS
10/15/2021	CONSULTANT REVIEW & COMMISSION
09/15/2021	TOWN ROAD FRONTAGE
04/20/2021	INVC APPROVAL CONDITIONS
DATE	DESCRIPTION
	REVISIONS

MEASURE	KEY	DESCRIPTION
Permanent Seeding	PS	Establishment of permanent stand of grass and/or legumes by seeding and mulching exposed soils with a seed mixture appropriate for long term stabilization. See Erosion Control Narrative for seed mix requirements.
Mulch for Seed	MS	Application of a mulch that will protect the soil surface on a temporary basis and promote the establishment of temporary or permanent seedings.
Construction Entrance	CE	A stone stabilized pad sometimes associated with a mud rack, automotive spray, or other measures located at points of vehicular ingress and egress on a construction site.
Geotextile Silt Fence	GSF	A temporary sediment barrier consisting of a geotextile fabric pulled taut and attached to supporting posts and entrenched.
Haybale Barrier	HB	A temporary sediment barrier consisting of a row of entrenched and anchored bales of hay or straw.
Silt Sock	SS	A cylindrical erosion control device used for slope interruption, perimeter control and inlet protection.
Stone Check Dam	SCD	A temporary or permanent stone dam placed across a drainageway.
Temporary Diversion Channel	TDC	A channel designed to convey flows on a short term basis and lined with an erosion resistant covering.
Temporary Sediment Trap	TST	A temporary ponding area with a stone outlet formed by excavation and/or constructing an earthen embankment.
Detention Basin	DB	An impoundment made by constructing a dam or an embankment (embankment detention basin) or by excavating a pit or dugout (excavated detention basin).
Level Spreader	LS	An outlet for diversions and other water conveyances consisting of an excavated depression with a broad stable point of discharge constructed at zero grade across a slope.
Permanent Turf Reinforcement Mat	TRM	A manufactured mat composed of non-biodegradable polymer or synthetic fibers mechanically, structurally, or chemically bound to form a continuous matrix.

PHASING PLAN - PHASE 1  
 PREPARED FOR  
**SHANE POLLOCK**  
 LOUISE BERRY DRIVE  
 BROOKLYN, CONNECTICUT

**Killingly Engineering Associates**  
 Civil Engineering & Surveying


114 Weston Road  
 P.O. Box 421  
 Killingly, Connecticut 06241  
 (860) 779-7299  
 www.killinglyengineering.com

DATE: 4/23/2020	DRAWN: DNE
SCALE: 1" = 40'	DESIGN: NET
SHEET: 8 OF 16	CHK BY: GG
DWG. No: CLIENT FILE	JOB No: 20014



*Norman Thibault, Jr.*  
 NORMAN THIBAUT, JR., P.E. No. 22531 DATE

K:\2021\Drawings\09\_2021\4\_PHASE 2.dwg Nov 03, 2022 3:44 PM

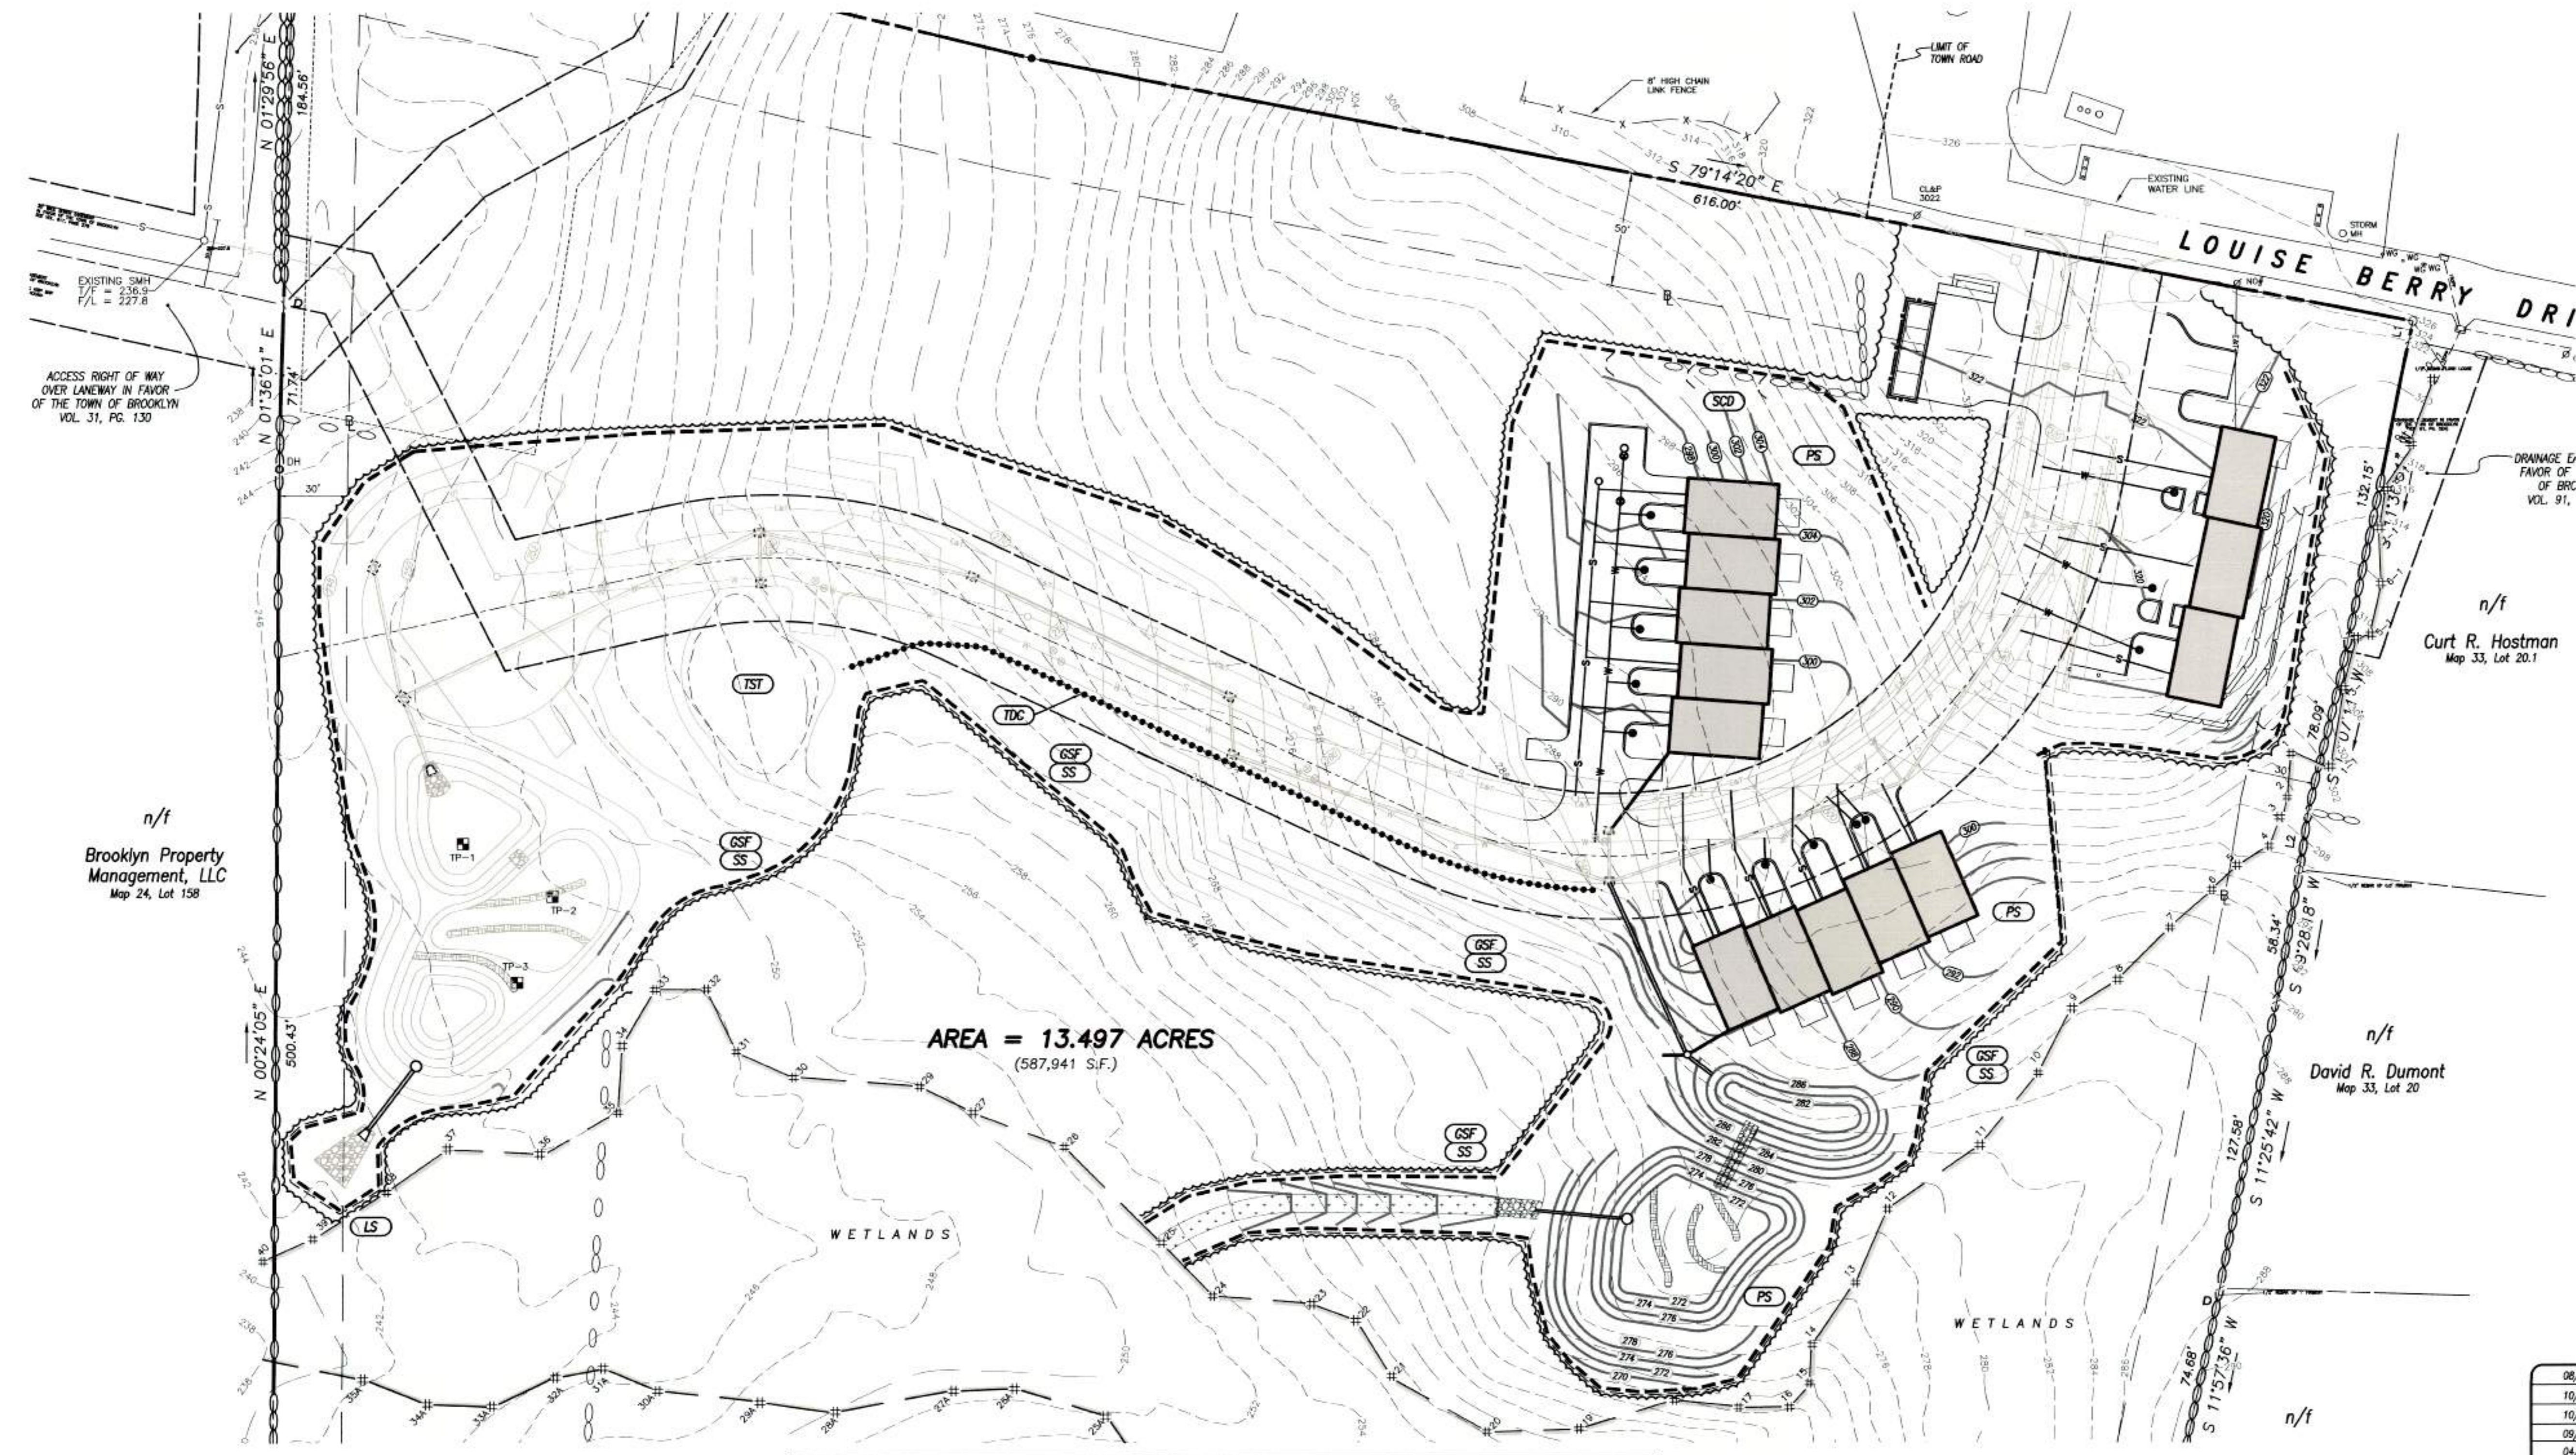

- LEGEND**
- IRON PIN TO BE SET
  - IRON PIN FOUND
  - DH DRILL HOLE FOUND
  - CB CATCH BASIN
  - UP UTILITY POLE
  - SMH EXISTING SANITARY MANHOLE
  - PROPOSED CONTOURS
  - ▨ INLAND WETLANDS FLAG
  - BUILDING SETBACK LINE
  - PROPOSED BURIED UTILITIES
  - EXISTING SANITARY SEWER LINE
  - PROPOSED SANITARY SEWER LINE
  - EXISTING WATER LINE
  - PROPOSED WATER LINE
  - STONE WALL
  - STONE WALL W/RETAINERS
  - STONE WALL W/RETAINERS SETBACK
  - SILT FENCE
  - STAKED HAYBALES

**AREA = 13.497 ACRES**  
(587,941 S.F.)

n/f  
Brooklyn Property Management, LLC  
Map 24, Lot 158

n/f  
Curt R. Hostman  
Map 33, Lot 20.1

n/f  
David R. Dumont  
Map 33, Lot 20

MEASURE	KEY	DESCRIPTION
Permanent Seeding	PS	Establishment of permanent stand of grass and/or legumes by seeding and mulching exposed soils with a seed mixture appropriate for long term stabilization. See Erosion Control Narrative for seed mix requirements.
Mulch for Seed	MS	Application of a mulch that will protect the soil surface on a temporary basis and promote the establishment of temporary or permanent seedings.
Construction Entrance	CE	A stone stabilized pad sometimes associated with a mud rack, automotive spray, or other measures located at points of vehicular ingress and egress on a construction site.
Geotextile Silt Fence	GSF	A temporary sediment barrier consisting of a geotextile fabric pulled taut and attached to supporting posts and entrenched.
Haybale Barrier	HB	A temporary sediment barrier consisting of a row of entrenched and anchored bales of hay or straw.
Silt Sock	SS	A cylindrical erosion control device used for slope interruption, perimeter control and inlet protection.
Stone Check Dam	SCD	A temporary or permanent stone dam placed across a drainage way.
Temporary Diversion Channel	TDC	A channel designed to convey flows on a short term basis and lined with an erosion resistant covering.
Temporary Sediment Trap	TST	A temporary ponding area with a stone outlet formed by excavation and/or constructing on earthen embankment.
Detention Basin	DB	An impoundment made by constructing a dam or an embankment (embankment detention basin) or by excavating a pit or dugout (excavated detention basin).
Level Spreader	LS	An outlet for diversions and other water conveyances consisting of an excavated depression with a broad stable point of discharge constructed at zero grade across a slope.
Permanent Turf Reinforcement Mat	TRM	A manufactured mat composed of non-biodegradable polymer or synthetic fibers mechanically, structurally, or chemically bound to form a continuous matrix.

DATE	DESCRIPTION
08/29/2022	INVC APPLICATION RESUBMISSION
10/26/2021	PHASING / E&S
10/15/2021	CONSULTANT REVIEW & COMMISSION
09/15/2021	TOWN ROAD FRONTAGE
04/20/2021	INVC APPROVAL CONDITIONS
	REVISIONS

PHASING PLAN - PHASE 2  
PREPARED FOR  
**SHANE POLLOCK**  
LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT



Norman Thibault, Jr., P.E.  
NORMAN THIBAUT, JR., P.E. No. 22834 DATE


**Killingly Engineering Associates**  
Civil Engineering & Surveying

114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 779-7299  
www.killinglyengineering.com



DATE: 4/23/2020	DRAWN: DNE
SCALE: 1" = 40'	DESIGN: NET
SHEET: 9 OF 16	CHK BY: GG
DWG. No: CLIENT FILE	JOB No: 20014



K:\2001\Drawings\10\_20014\_PHASE\_3.dwg Nov 03, 2022 3:47 PM

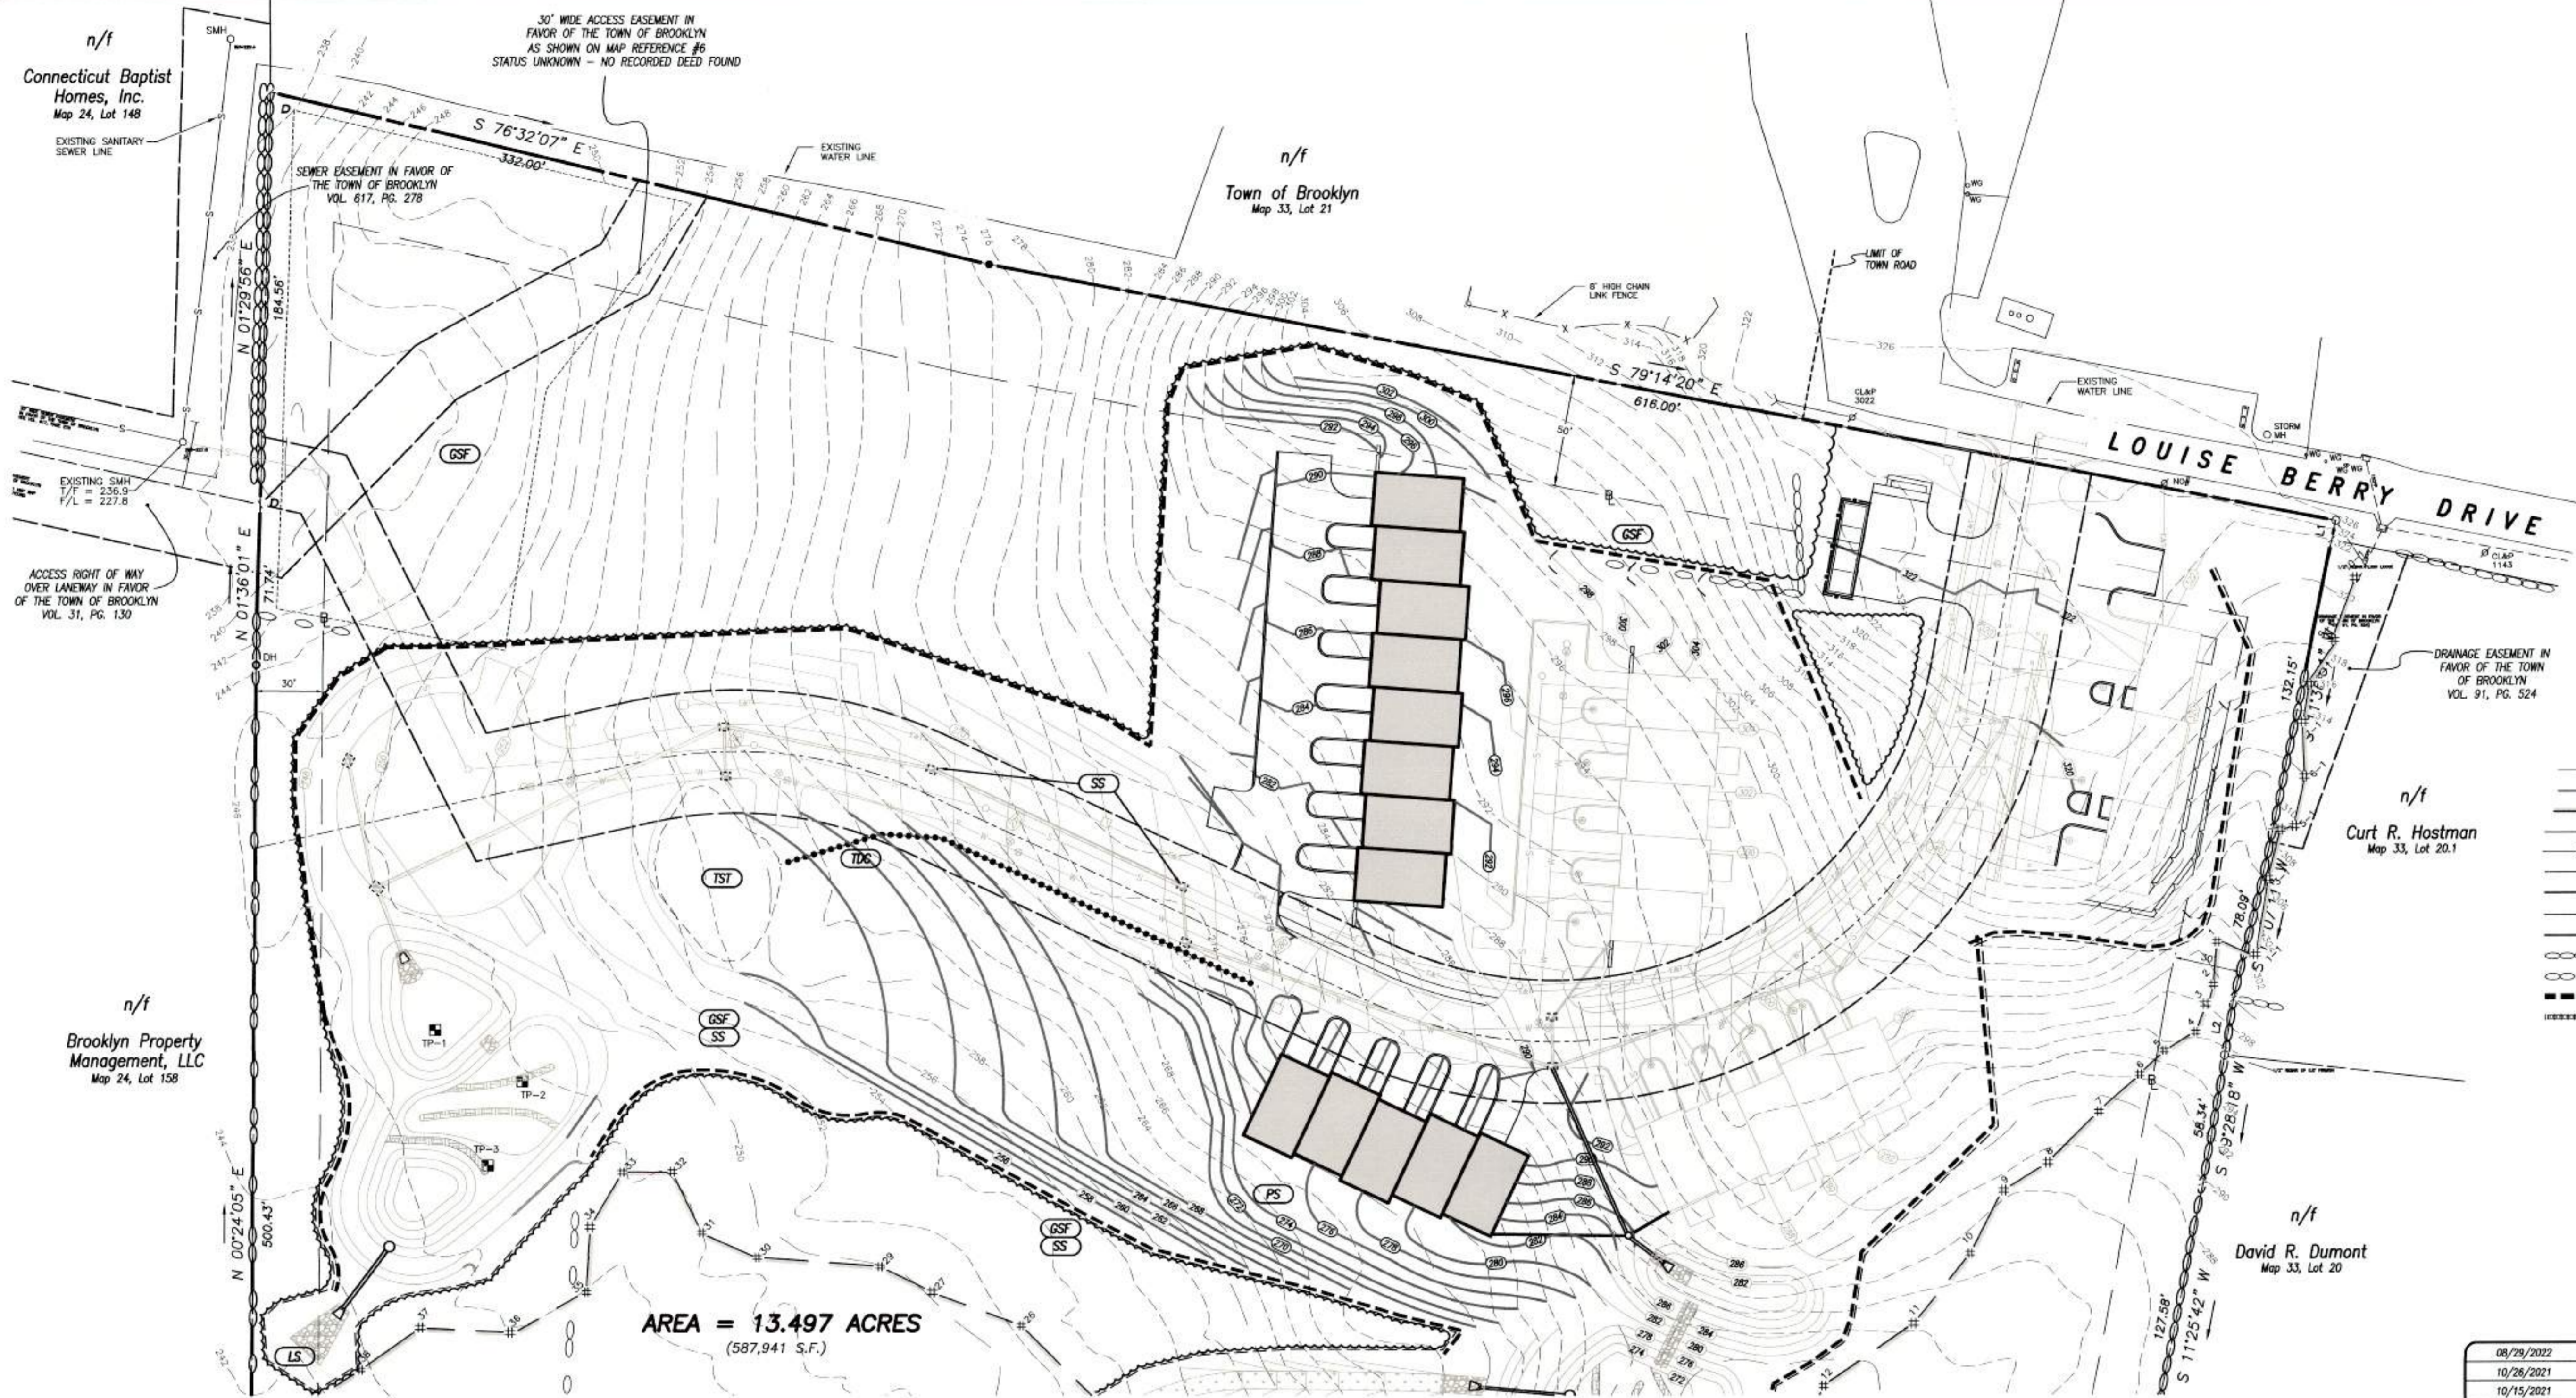

AREA = 13.497 ACRES  
(587,941 S.F.)

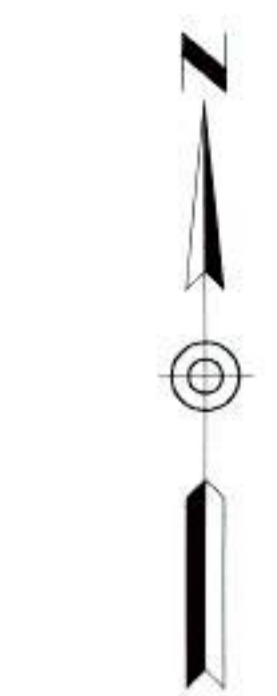

**LEGEND**

●	IRON PIN TO BE SET
○	IRON PIN FOUND
○ DH	DRILL HOLE FOUND
□ CB	CATCH BASIN
⊗	UTILITY POLE
○ SMH	EXISTING MANHOLE
○ SMH	PROPOSED MANHOLE
—	PROPOSED CONTOURS
—	INLAND WETLANDS FLAG
—	BUILDING SETBACK LINE
—	PROPOSED BURIED UTILITIES
—	EXISTING SANITARY SEWER LINE
—	PROPOSED SANITARY SEWER LINE
—	EXISTING WATER LINE
—	PROPOSED WATER LINE
—	STONE WALL
—	STONE WALL WATERCOURSE SETBACK
—	SILT FENCE
—	STAKED HAYBALES

DATE	DESCRIPTION
08/29/2022	MHC APPLICATION RESUBMISSION
10/26/2021	PHASING / E&S
10/15/2021	CONSULTANT REVIEW & COMMISSION
09/15/2021	TOWN ROAD FRONTAGE
04/20/2021	MHC APPROVAL CONDITIONS
DATE	DESCRIPTION

REVISIONS

MEASURE	KEY	DESCRIPTION
Permanent Seeding	PS	Establishment of permanent stand of grass and/or legumes by seeding and mulching exposed soils with a seed mixture appropriate for long term stabilization. See Erosion Control Narrative for seed mix requirements.
Mulch for Seed	MS	Application of a mulch that will protect the soil surface on a temporary basis and promote the establishment of temporary or permanent seedings.
Construction Entrance	CE	A stone stabilized pad sometimes associated with a mud rack, automotive spray, or other measures located at points of vehicular ingress and egress on a construction site.
Geotextile Silt Fence	GSF	A temporary sediment barrier consisting of a geotextile fabric pulled taut and attached to supporting posts and entrenched.
Haybale Barrier	HB	A temporary sediment barrier consisting of a row of entrenched and anchored bales of hay or straw.
Silt Sock	SS	A cylindrical erosion control device used for slope interruption, perimeter control and inlet protection.
Stone Check Dam	SCD	A temporary or permanent stone dam placed across a drainageway.
Temporary Diversion Channel	TDC	A channel designed to convey flows on a short term basis and lined with an erosion resistant covering.
Temporary Sediment Trap	TST	A temporary ponding area with a stone outlet formed by excavation and/or constructing an earthen embankment.
Detention Basin	DB	An impoundment made by constructing a dam or an embankment (embankment detention basin) or by excavating a pit or dugout (excavated detention basin).
Level Spreader	LS	An outlet for diversions and other water conveyances consisting of an excavated depression with a broad stable point of discharge constructed at zero grade across a slope.
Permanent Turf Reinforcement Mat	TRM	A manufactured mat composed of non-biodegradable polymer or synthetic fibers mechanically, structurally, or chemically bound to form a continuous matrix.



PHASING PLAN - PHASE 3  
PREPARED FOR  
**SHANE POLLOCK**  
LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT

**Killingly Engineering Associates**  
Civil Engineering & Surveying  
114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 779-7299  
www.killinglyengineering.com



*Norman Thibault, Jr.*  
NORMAN THIBAUT, JR., P.E. No. 22834 DATE

DATE: 4/23/2020	DRAWN: DNE
SCALE: 1" = 40'	DESIGN: NET
SHEET: 10 OF 16	CHK BY: GG
DWG. No: CLIENT FILE	JOB No: 20014

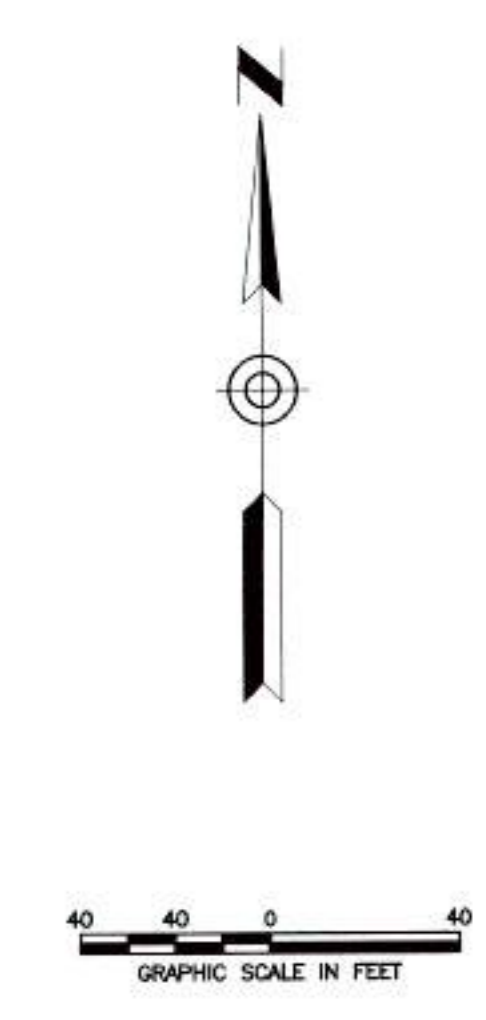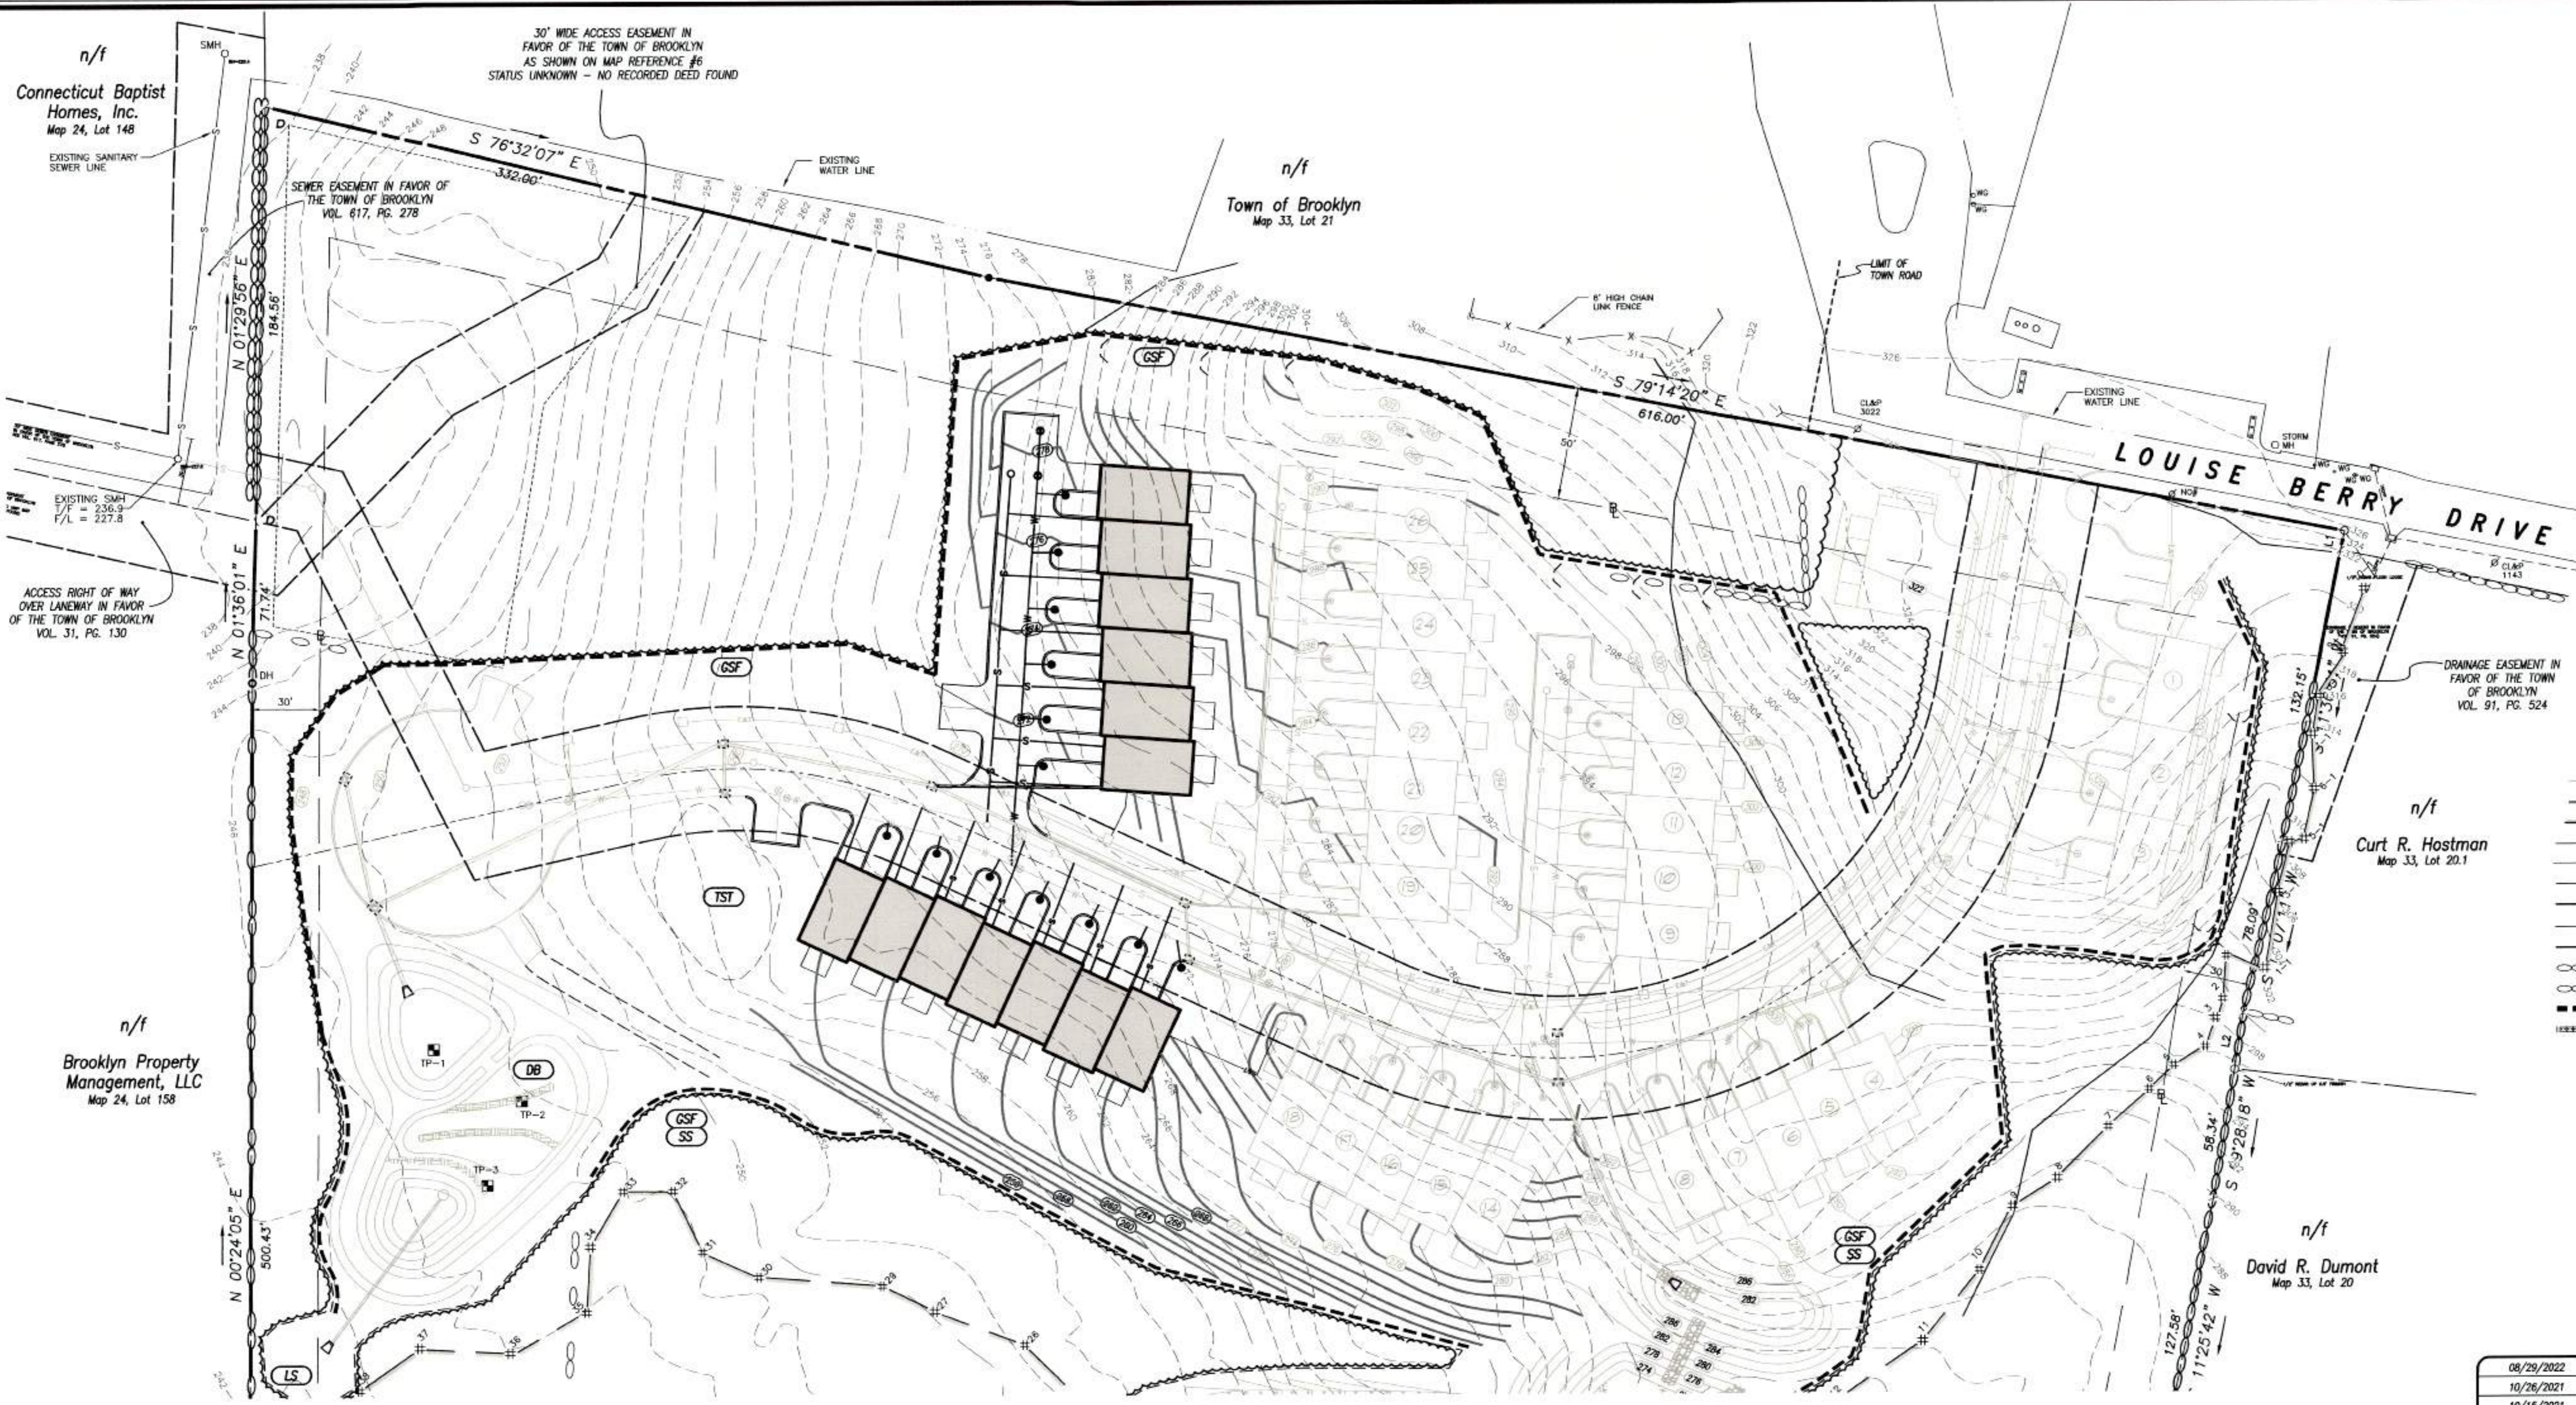

**LEGEND**

- IRON PIN TO BE SET
- IRON PIN FOUND
- DH DRILL HOLE FOUND
- CB CATCH BASIN
- U UTILITY POLE
- SMH EXISTING MANHOLE
- PROPOSED MANHOLE
- PROPOSED CONTOURS
- INLAND WETLANDS FLAG
- BUILDING SETBACK LINE
- PROPOSED BURIED UTILITIES
- EXISTING SANITARY SEWER LINE
- PROPOSED SANITARY SEWER LINE
- EXISTING WATER LINE
- PROPOSED WATER LINE
- STONE WALL
- STONE WALL WITH MAINLINE SETBACK
- SILT FENCE
- STAKED HAYBALES

MEASURE	KEY	DESCRIPTION
Permanent Seeding	PS	Establishment of permanent stand of grass and/or legumes by seeding and mulching exposed soils with a seed mixture appropriate for long term stabilization. See Erosion Control Narrative for seed mix requirements.
Mulch for Seed	MS	Application of a mulch that will protect the soil surface on a temporary basis and promote the establishment of temporary or permanent seedings.
Construction Entrance	CE	A stone stabilized pad sometimes associated with a mud rack, automotive spray, or other measures located at points of vehicular ingress and egress on a construction site.
Geotextile Silt Fence	GSF	A temporary sediment barrier consisting of a geotextile fabric pulled taut and attached to supporting posts and entrenched.
Haybale Barrier	HB	A temporary sediment barrier consisting of a row of entrenched and anchored bales of hay or straw.
Silt Sock	SS	A cylindrical erosion control device used for slope interruption, perimeter control and inlet protection.
Stone Check Dam	SCD	A temporary or permanent stone dam placed across a drainageway.
Temporary Diversion Channel	TDC	A channel designed to convey flows on a short term basis and lined with an erosion resistant covering.
Temporary Sediment Trap	TST	A temporary ponding area with a stone outlet formed by excavation and/or constructing an earthen embankment.
Detention Basin	DB	An impoundment made by constructing a dam or an embankment (embankment detention basin) or by excavating a pit or dugout (excavated detention basin).
Level Spreader	LS	An outlet for diversions and other water conveyances consisting of an excavated depression with a broad stable point of discharge constructed at zero grade across a slope.
Permanent Turf Reinforcement Mat	TRM	A manufactured mat composed of non-biodegradable polymer or synthetic fibers mechanically, structurally, or chemically bound to form a continuous matrix.

DATE	DESCRIPTION
08/29/2022	INVC APPLICATION RESUBMISSION
10/26/2021	PHASING / E&S
10/15/2021	CONSULTANT REVIEW & COMMISSION
09/15/2021	TOWN ROAD FRONTAGE
04/20/2021	INVC APPROVAL CONDITIONS

PHASING PLAN - PHASE 4

PREPARED FOR

**SHANE POLLOCK**

LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT

**Killingly Engineering Associates**  
Civil Engineering & Surveying



114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 775-7299  
www.killinglyengineering.com

DATE: 4/23/2020	DRAWN: DNE
SCALE: 1" = 40'	DESIGN: NET
SHEET: 11 OF 16	CHK BY: GC
DWC No: CLIENT FILE	JOB No: 20014



*Norman Thibault, Jr.*  
NORMAN THIBAUT, JR., P.E. No. 22834 DATE

K:\20014\Drawings\11\_20014 PHASE 4.dwg Nov 03, 2022 - 3:47 PM

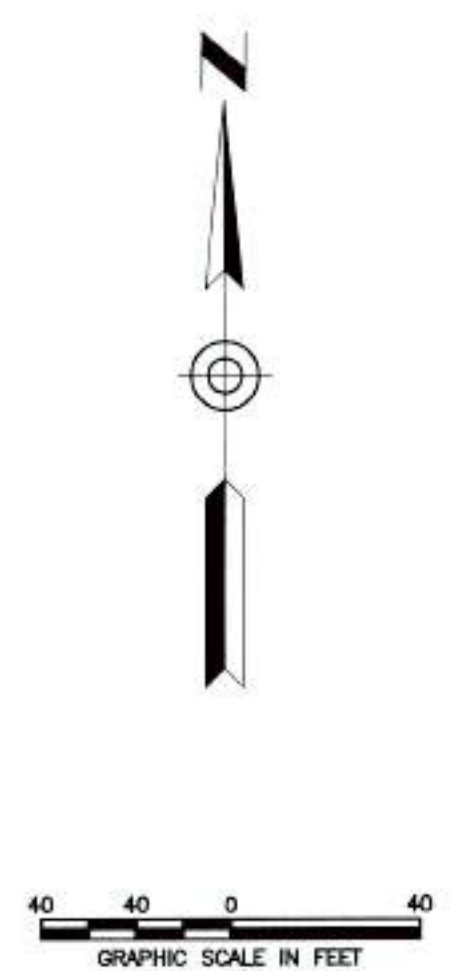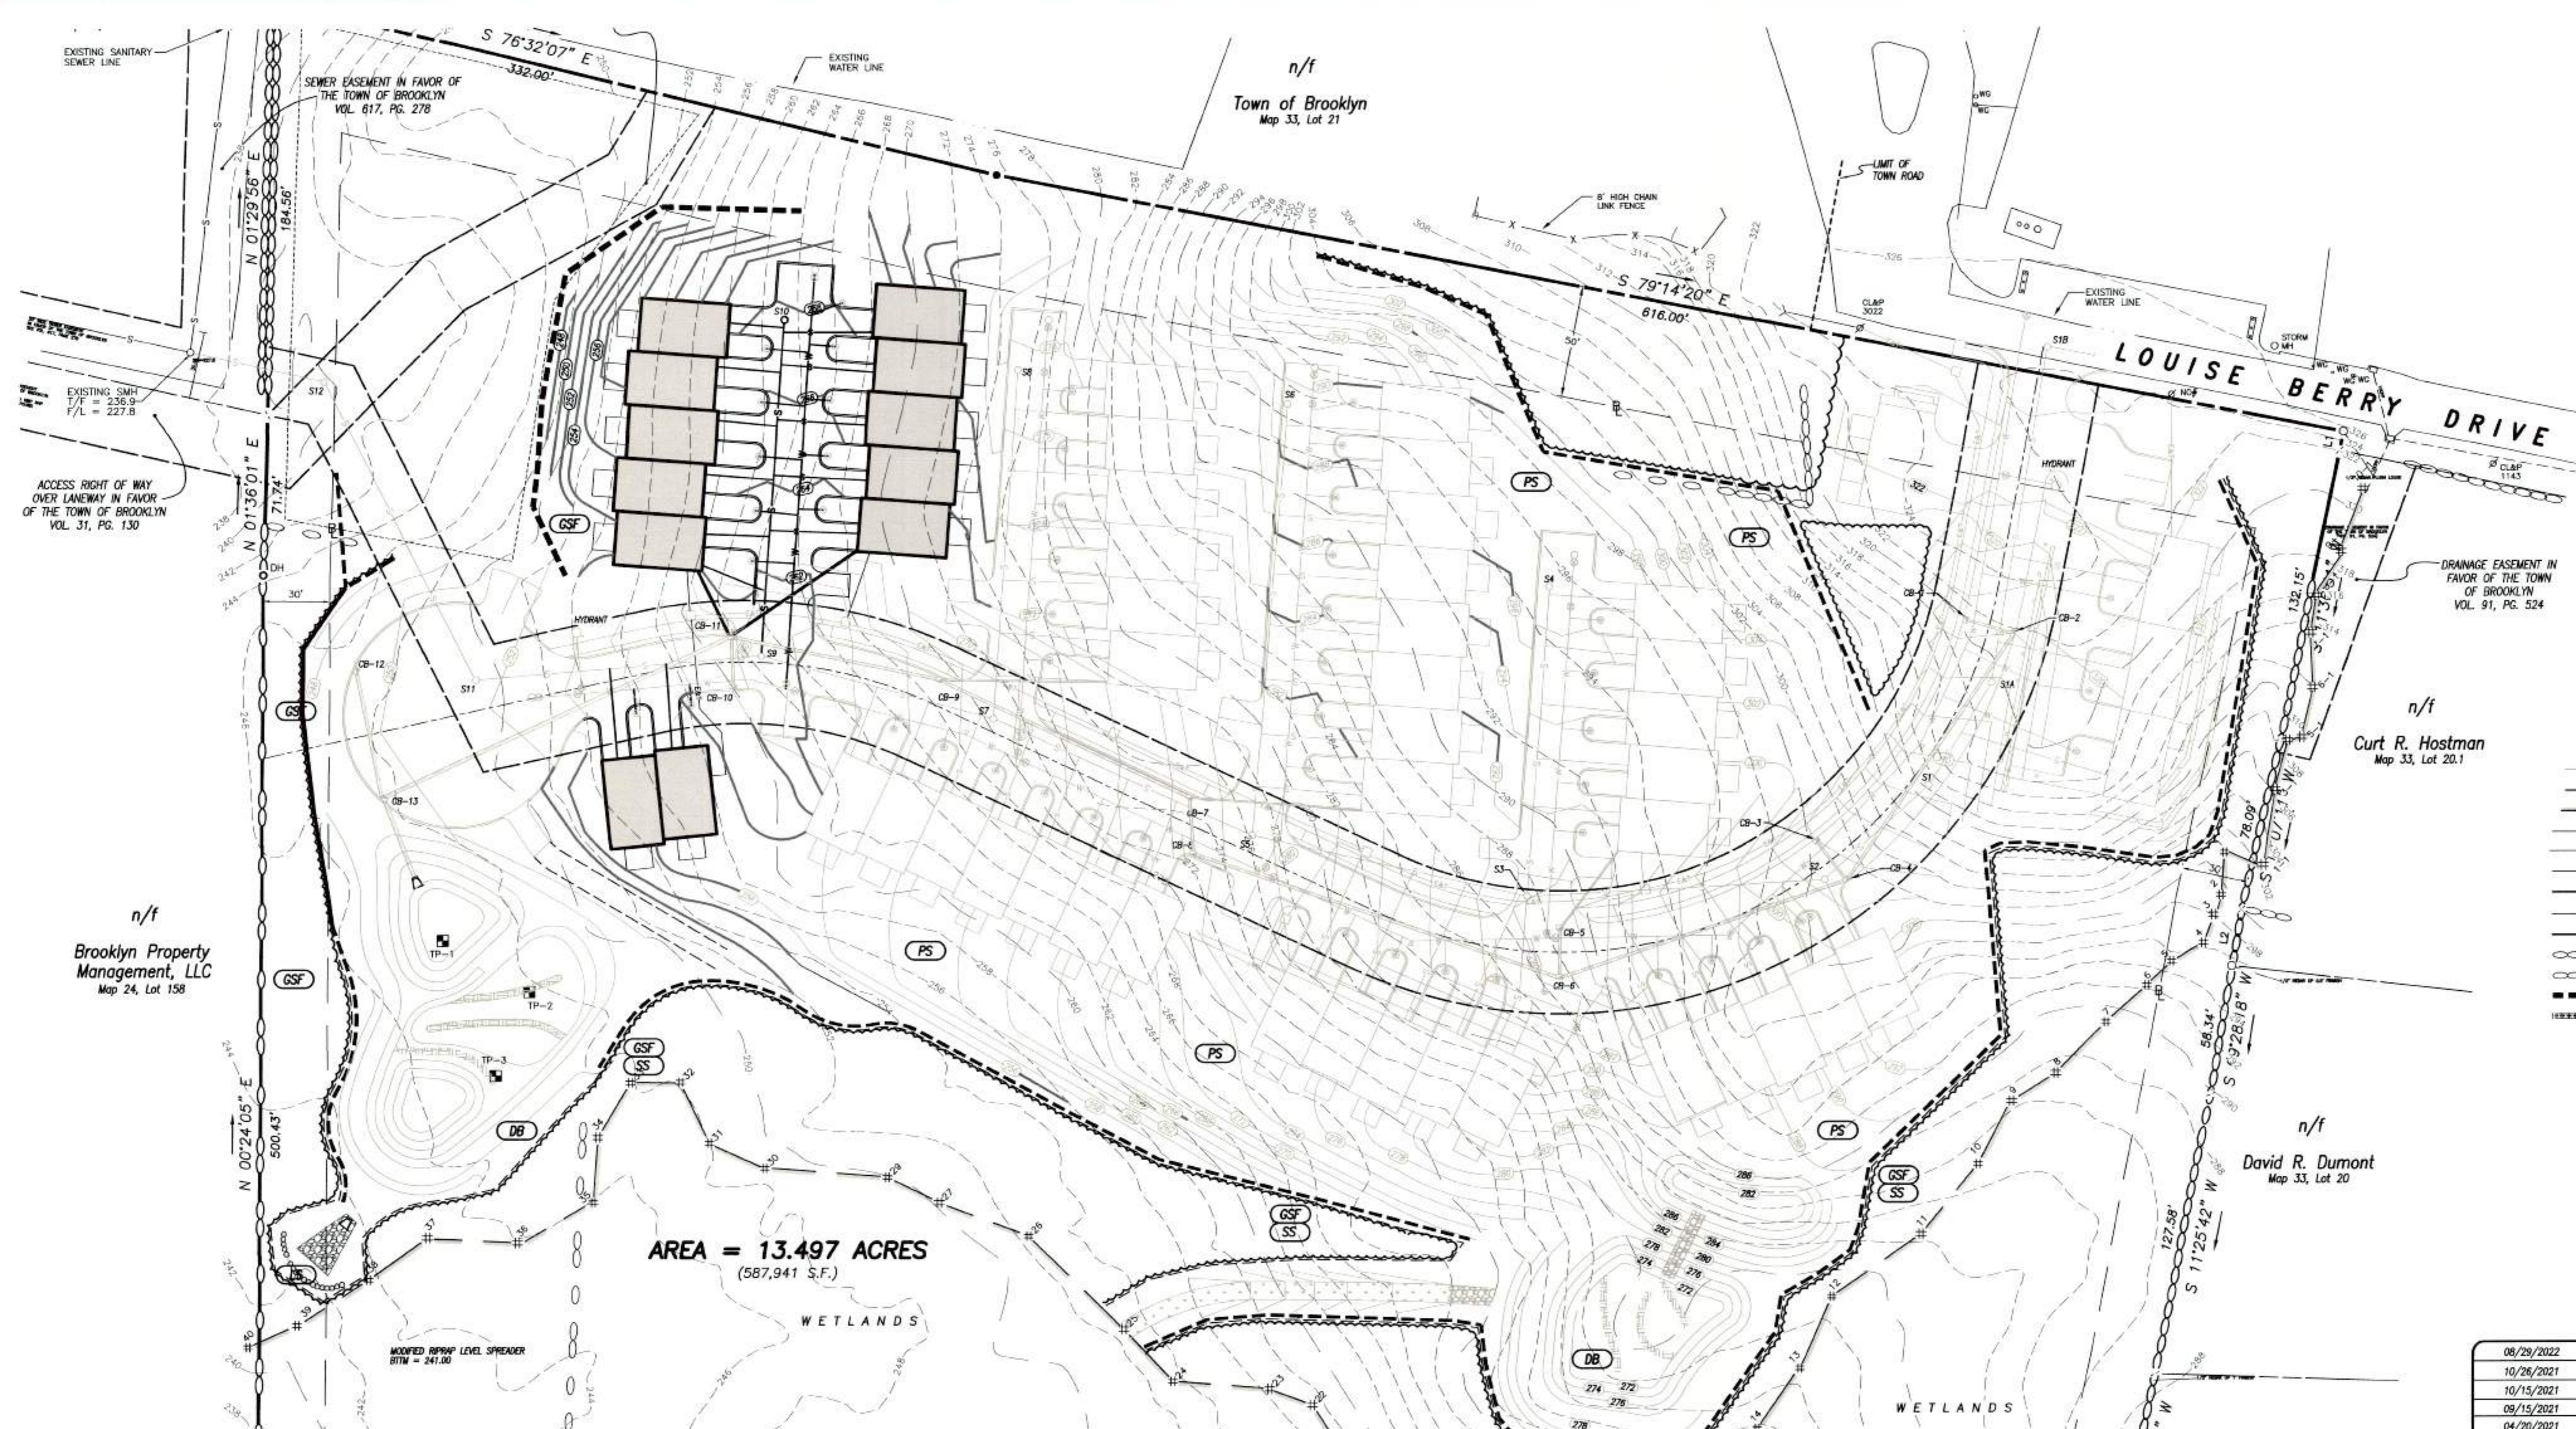

- LEGEND**
- IRON PIN TO BE SET
  - IRON PIN FOUND
  - DH DRILL HOLE FOUND
  - CB CATCH BASIN
  - UTILITY POLE
  - SMH EXISTING OR PROPOSED MANHOLE
  - PROPOSED CONTOURS
  - INLAND WETLANDS FLAG
  - BUILDING SETBACK LINE
  - PROPOSED BURIED UTILITIES
  - EXISTING SANITARY SEWER LINE
  - PROPOSED SANITARY SEWER LINE
  - EXISTING WATER LINE
  - PROPOSED WATER LINE
  - STONE WALL
  - STONE WALL/WAREHOUSE SETBACK
  - SILT FENCE
  - STAKED HAYBALES

**AREA = 13.497 ACRES**  
(587,941 S.F.)

MEASURE	KEY	DESCRIPTION
Permanent Seeding	PS	Establishment of permanent stand of grass and/or legumes by seeding and mulching exposed soils with a seed mixture appropriate for long term stabilization. See Erosion Control Narrative for seed mix requirements.
Mulch for Seed	MS	Application of a mulch that will protect the soil surface on a temporary basis and promote the establishment of temporary or permanent seedings.
Construction Entrance	CE	A stone stabilized pad sometimes associated with a mud rack, automotive spray, or other measures located at points of vehicular ingress and egress on a construction site.
Geotextile Silt Fence	GSF	A temporary sediment barrier consisting of a geotextile fabric pulled taut and attached to supporting posts and entrenched.
Haybale Barrier	HB	A temporary sediment barrier consisting of a row of entrenched and anchored bales of hay or straw.
Silt Sock	SS	A cylindrical erosion control device used for slope interruption, perimeter control and inlet protection.
Stone Check Dam	SCD	A temporary or permanent stone dam placed across a drainage way.
Temporary Diversion Channel	TDC	A channel designed to convey flows on a short term basis and lined with an erosion resistant covering.
Temporary Sediment Trap	TST	A temporary ponding area with a stone outlet formed by excavation and/or constructing an earthen embankment.
Detention Basin	DB	An impoundment made by constructing a dam or an embankment (embankment detention basin) or by excavating a pit or dugout (excavated detention basin).
Level Spreader	LS	An outlet for diversions and other water conveyances consisting of an excavated depression with a broad stable point of discharge constructed at zero grade across a slope.
Permanent Turf Reinforcement Mat	TRM	A manufactured mat composed of non-biodegradable polymer or synthetic fibers mechanically, structurally, or chemically bound to form a continuous matrix.

DATE	DESCRIPTION
08/29/2022	INVC APPLICATION RESUBMISSION
10/26/2021	PHASING / E&S
10/15/2021	CONSULTANT REVIEW & COMMISSION
09/15/2021	TOWN ROAD FRONTAGE
04/20/2021	INVC APPROVAL CONDITIONS
DATE	DESCRIPTION
	REVISIONS

**PHASING PLAN - PHASE 5**  
PREPARED FOR  
**SHANE POLLOCK**  
LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT

**Killingly Engineering Associates**  
Civil Engineering & Surveying  
114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 779-7299  
www.killinglyengineering.com

DATE: 4/23/2020	DRAWN: DNE
SCALE: 1" = 40'	DESIGN: NET
SHEET: 12 OF 16	CHK BY: GG
DWG. No: CLIENT FILE	JOB No: 20014



*Norman Thibault, Jr.*  
NORMAN THIBAUT, JR., P.E. No. 22834 DATE

**EROSION AND SEDIMENT CONTROL PLAN:**

REFERENCE IS MADE TO:

1. Connecticut Guidelines for Soil Erosion and Sediment Control 2002 (2002 Guidelines).
2. U.S.D.A. N.R.C.S. Web Soil Survey.

The project will require registration under the "GENERAL PERMIT FOR THE DISCHARGE OF STORMWATER AND DOWNSLOPE WASTEWATERS ASSOCIATED WITH CONSTRUCTION ACTIVITIES" with the CTDEEP. 60 days prior to any activity on site, the developer or his representative shall submit the registration to the CTDEEP. The Town of Brooklyn shall be given a copy of the registration approval.

**DEVELOPMENT CONTROL PLAN:**

1. Development of the site will be performed by the Contractor, who will be responsible for the installation and maintenance of erosion and sediment control measures required throughout construction.
2. The sedimentation control mechanisms shall remain in place from start of construction until permanent vegetation has been established. The representative for the Town of Brooklyn will be notified when sediment and erosion control structures are initially in place. Any additional soil & erosion control measures requested by the Town or its agent, shall be installed immediately. Once the proposed development, seeding and planting have been completed, the representative shall again be notified to inspect the site. The control measures will not be removed until this inspection is complete.
3. All stripping is to be confined to the immediate construction area. Topsoil shall be stockpiled so that slopes do not exceed 2 to 1. A hay bale sediment barrier is to surround each stockpile and a temporary vegetative cover shall be provided.
4. Dust control will be accomplished by spraying with water. The application of calcium chloride is not permitted adjacent to wetland resource areas or within 100' of these areas.
5. The proposed planting schedule is to be adhered to during the planting of disturbed areas throughout the proposed construction site.
6. Final stabilization of the site is to follow the procedures outlined in "Permanent Vegetative Cover". If necessary a temporary vegetative cover is to be provided until a permanent cover can be applied.

**SILT FENCE INSTALLATION AND MAINTENANCE:**

1. Dig a 6" deep trench on the uphill side of the barrier location.
2. Position the posts on the downhill side of the barrier and drive the posts 1.5 feet into the ground.
3. Lay the bottom 6" of the fabric in the trench to prevent undermining and backfill.
4. Inspect and repair barrier after heavy rainfall.
5. Inspections will be made at least once per week and within 24 hours of the end of a storm with a rainfall amount of 0.5 inch or greater to determine maintenance needs.
6. Sediment deposits are to be removed when they reach a height of 1 foot behind the barrier or half the height of the barrier and are to be deposited in an area which is not regulated by the inland wetlands commission.
7. Replace or repair the fence within 24 hours of observed failure. Failure of the fence has occurred when sediment falls to be retained by the fence because:
  - the fence has been overtopped, undercut or bypassed by runoff water.
  - the fence has been moved out of position (knocked over), or
  - the geotextile has decomposed or been damaged.

**HAY BALE INSTALLATION AND MAINTENANCE:**

1. Bales shall be placed as shown on the plans with the ends of the bales tightly abutting each other.
2. Each bale shall be securely anchored with at least 2 stakes and gaps between bales shall be wedged with straw to prevent water from passing between the bales.
3. Inspect bales at least once per week and within 24 hours of the end of a storm with a rainfall amount of 0.5 inches or greater to determine maintenance needs.
4. Remove sediment behind the bales when it reaches half the height of the bale and deposit in an area which is not regulated by the Inland Wetlands Commission.
5. Replace or repair the barrier within 24 hours of observed failure. Failure of the barrier has occurred when sediment falls to be retained by the barrier because:
  - the barrier has been overtopped, undercut or bypassed by runoff water.
  - the barrier has been moved out of position, or
  - the hay bales have deteriorated or been damaged.

**TEMPORARY VEGETATIVE COVER:**

**SEED SELECTION**  
Grass species shall be appropriate for the season and site conditions. Appropriate species are outlined in Figure TS-2 in the 2002 Guidelines.

**TIMING CONSIDERATIONS**

Seed with a temporary seed mixture within 7 days after the suspension of grading work in disturbed areas where the suspension of work is expected to be more than 30 days but less than 1 year.

**SITE PREPARATION**

Install needed erosion control measures such as diversions, grade stabilization structures, sediment basins and grading waterways.

**SEEDING PREPARATION**

Loosen the soil to a depth of 3-4 inches with a slightly roughened surface. If the area has been recently loosened or disturbed, no further roughening is required. Soil preparation can be accomplished by tracking with a bulldozer, discing, harrowing, rolling or dragging with a section of chain link fence. Avoid excessive compaction of the surface by equipment traveling back and forth over the surface. If the slope is tracked, the track marks shall be perpendicular to the anticipated direction of the flow of surface water.

If soil testing is not practical or feasible on small or variable sites, or where timing is critical, fertilizer may be applied at the rate of 300 pounds per acre or 7.5 pounds per 1,000 square feet of 10-10-10 or equivalent. Additionally, lime may be applied using rates given in Figure TS-1 in the 2002 Guidelines.

**SEEDING**

Apply seed uniformly by hand cyclone seeder, drill, cutlifter type seeder or hydroseeder at a minimum rate for the selected species. Increase seeding rates by 10% when hydroseeding.

**MULCHING**

Temporary seedings made during optimum seeding dates shall be mulched according to the recommendations in the 2002 Guidelines. When seeding outside of the recommended dates, increase the application of mulch to provide 95%-100% coverage.

**MAINTENANCE**

Inspect seeded area at least once a week and within 24 hours of the end of a storm with a rainfall amount of 0.5 inch or greater for seed and mulch movement and fill erosion.

Where seed has moved or where soil erosion has occurred, determine the cause of the failure. Repair eroded areas and install additional controls if required to prevent recurrence of erosion.

Continue inspections until the grasses are firmly established. Grasses shall not be considered established until a ground cover is achieved which is mature enough to control soil erosion and to survive severe weather conditions (approximately 80% vegetative cover).

**PERMANENT VEGETATIVE COVER:**

Refer to Permanent Seeding Measure in the 2002 Guidelines for specific applications and details related to the installation and maintenance of a permanent vegetative cover. In general, the following sequence of operations shall apply:

1. Topsoil will be replaced once the excavation and grading has been completed. Topsoil will be spread at a minimum compacted depth of 4".
2. Once the topsoil has been spread, all stones 2" or larger in any dimension will be removed as well as debris.
3. Apply agricultural ground limestone at a rate of 2 tons per acre or 100 lbs. per 1000 s.f. Apply 10-10-10 fertilizer or equivalent at a rate of 300 lbs. per acre or 7.5 lbs. per 1000 s.f. Work lime and fertilizer into the soil to a depth of 4".
4. Inspect seeded before seeding. If traffic has compacted the soil, refill compacted areas.
5. Apply the chosen grass seed mix. The recommended seeding dates are: April 1 to June 15 & August 15 - October 1.
6. Following seeding, firm seeded with a roller. Mulch immediately following seeding. If a permanent vegetative stand cannot be established by September 30, apply a temporary cover on the topsoil such as netting, mat or organic mulch.

**DEVELOPMENT SCHEDULE/SEQUENCE OF OPERATIONS:**


1. Flag the limits of disturbance and schedule pre-construction meeting with Town of Brooklyn wetlands Agent.
2. The only work that shall be permitted prior to installation of perimeter erosion controls shall be clearing of vegetation. No grubbing shall be conducted until the perimeter erosion and sediment controls have been installed per the plan and inspected by the Town of Brooklyn Agent. Written approval for installation of the erosion and sedimentation controls shall be obtained from the Town of Brooklyn NWC Agent prior to commencing with any other work.
3. Contact utility companies for scheduling installation of utilities and connections.
4. Install the anti-tracking construction entrance.
5. Cut trees within the defined clearing limits and remove the cut wood.
6. Install perimeter erosion and sedimentation controls in accordance with the site development plan.
7. Chip brush and slash, stockpile chips for use on site or remove off site.
8. Box out driveway and stockpile topsoil in locations shown on the plans. Install erosion controls around stockpile and apply temporary seeding.
9. Contact utility companies (CT Water and the Brooklyn WPCA) to coordinate water main and sanitary sewer connections. Install water and sanitary sewer lines beginning from the lowest elevation.
10. Excavate stormwater basin to be utilized as a temporary sedimentation basin during construction. Install drainage structures and pipe and provide inlet protection at catch basins.
11. Install and compact processed gravel for roadway base.
12. Remove tree stumps and dispose of at an approved disposal site. Alternatively, stumps may be chipped in place. No stumps shall be buried on site.
13. Strip and stockpile topsoil that is within the footprint of the site. Surround stockpile with silt fence or stacked haybales, and apply temporary seeding in accordance with recommended mixtures. Divert runoff around the perimeter of the stockpile.
14. Make all required cuts and fills. Establish the subgrade for the driveway as required and install additional erosion controls as necessary and as shown on the plans.
15. Inspect perimeter erosion and sedimentation controls weekly and after rain events in excess of 0.5". Repair any damaged erosion controls and install additional erosion control devices as necessary to address areas of concentrated runoff that may develop as a result of the construction activities. The contractor shall review discharge conditions with the design engineer or the Town of Brooklyn prior to installing additional erosion controls. Apply water as necessary for dust control.
16. Install utilities to in the locations shown on the plans.
17. Prepare sub-base for roadway for final grading.
18. Excavate for building footings, stockpile soil and pour footings & slab. Begin phased building construction.
19. Place topsoil where required and install any proposed landscaping upon completion of each building.
20. Install first course of pavement to each building as they are completed and required landscaping.
21. When the remainder of the site work is near completion, sweep all paved areas for the final course of paving. Inspect erosion controls and remove any accumulated sediment.
22. Install final course of pavement upon the completion of the final structure.
23. Fine grade, rake, seed and mulch to within 2' of the pavement.
24. Remove and dispose of all silt fence and hay bales after the site has been stabilized to the satisfaction of the Town of Brooklyn.

**RESPONSIBLE PARTY FOR E&S MAINTENANCE:**

Shane Pollock  
101 Mackin Drive  
Griswold, CT 06351  
(860) 888-3129

**CONSTRUCTION NOTES/GENERAL PROVISIONS**

1. The locations of existing utilities are based upon visible field observations, record mapping and interviews with the property owner and abutting property owners. They are shown for informational purposes only. Contractor shall coordinate exploratory test hole excavation with the Engineer if necessary to verify and/or determine actual locations of some utilities & structures. It is the responsibility of the contractor to verify the location and elevation of all utilities. Contact "CALL BEFORE YOU DIG" at 1-800-922-4455, and obtain all applicable permits, prior to any excavation around utilities.
2. All existing site features not scheduled to remain shall be removed and disposed of in a proper manner, by the contractor.
3. All Materials and methods of construction shall conform to "State of Connecticut, Department of Transportation, Standard Specifications for Roads, Bridges and Incidental Construction, Form 818", and supplements thereto.
4. The Contractor shall obtain copies of all regulatory agency permits from the Owner prior to any site disturbance.
5. Unless otherwise noted on the plans, the contractor shall use the geometry provided on the construction plans. Benchmark information shall be provided to the contractor by the Owner or the Owner's surveyor. Any discrepancies between field measurements and the construction plan information shall be brought to the attention of the Engineer or Surveyor immediately.
6. The Contractor shall not revise elevations or locations of items shown on the plans without written consent of the project Engineer or Surveyor.
7. The Contractor shall protect benchmarks, property corners, and other survey monuments from damage or displacement. If a marker needs to be removed, it shall be referenced by a licensed land surveyor and replaced as necessary by the same.
8. The Contractor shall be responsible for preparing and compacting base for proposed pavement. Owner shall provide general fill to establish subgrade - contractor shall spread and compact. Contractor shall provide, spread and compact required processed aggregate.
9. The entire project site shall be thoroughly cleaned at the completion of the work. Clean all installed paved areas, accumulated silt and sediment shall be removed from the stormwater system, silt fence removed and disposed of, excess construction materials removed, plus all adjacent areas affected by the construction activities as directed by the Owner or the jurisdictional Agency. Any material removed from the site shall be relocated to an approved off-site disposal area.
10. Upon completion of construction, accumulated sediment and other deleterious materials shall be thoroughly removed catch basins, manholes, pipes and swales and disposed of off site. Additionally, the stormwater detention basin bottom and structures shall be cleaned and restored to "like new" condition.

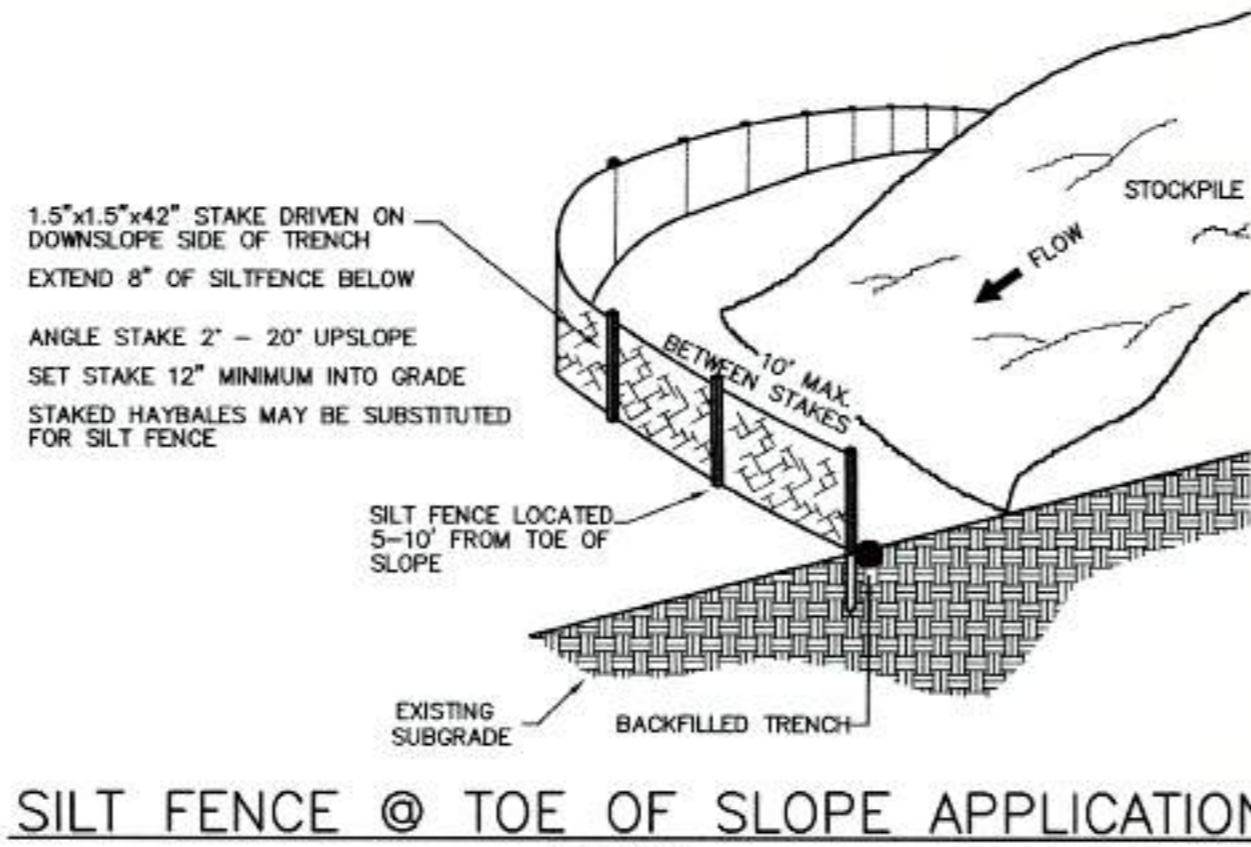


**SILT FENCE @ TOE OF SLOPE APPLICATION**  
NOT TO SCALE


**DEEP TEST HOLE EVALUATION - November 25, 2020**  
Normand Thibault, J.R., P.E., Killingly Engineering Associates

TEST PIT	DEPTH	PROFILE
1	0" - 10"	Topsoil
	10" - 18"	Orange-brown fine sandy loam
	18" - 44"	Gray fine silty sand w/rocks
	44" - 72"	Gray rocky gravel - compact
	72" - 44"	N/A
2	0" - 9"	Topsoil
	9" - 21"	Orange-brown fine sandy loam
	21" - 41"	Gray fine silty sand/rocks
	41" - 74"	Gray rocky sandy gravel - compact
	74" - 41"	N/A
3	0" - 10"	Topsoil
	10" - 24"	Orange-brown fine sandy loam
	24" - 41"	Gray fine silty sand/rocks
	41" - 71"	Hardpan
	71" - 41"	N/A


**HAYBALE INSTALLATION AT CATCH BASIN**  
NOT TO SCALE

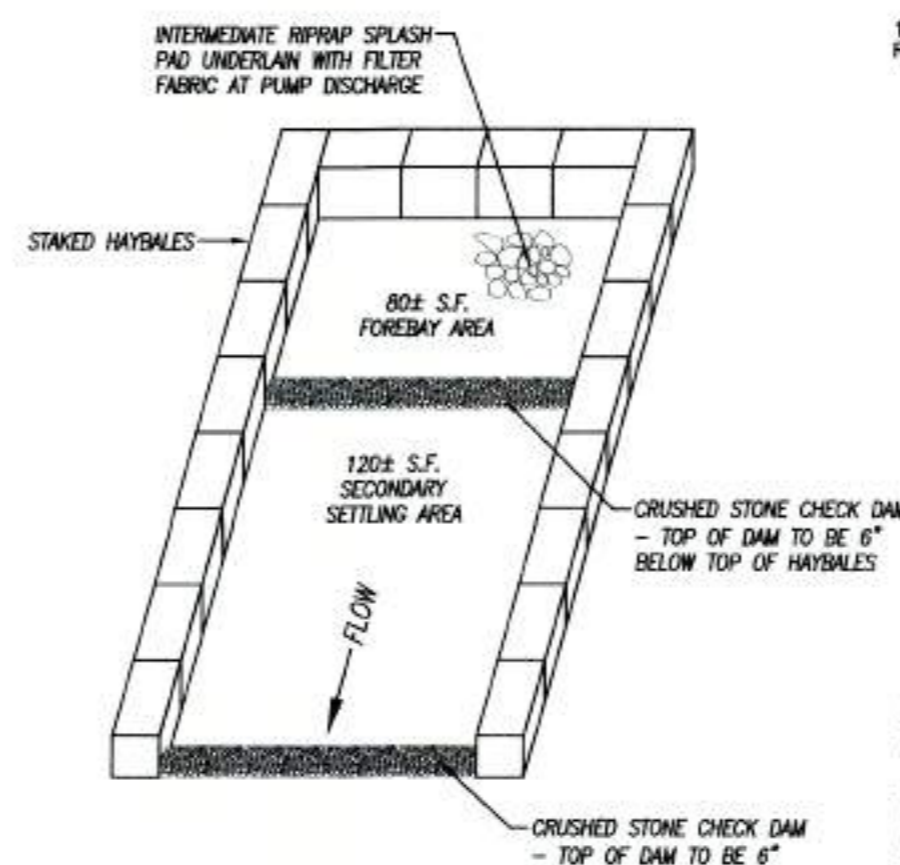

**PUMPING OUTLET BASIN**  
NOT TO SCALE

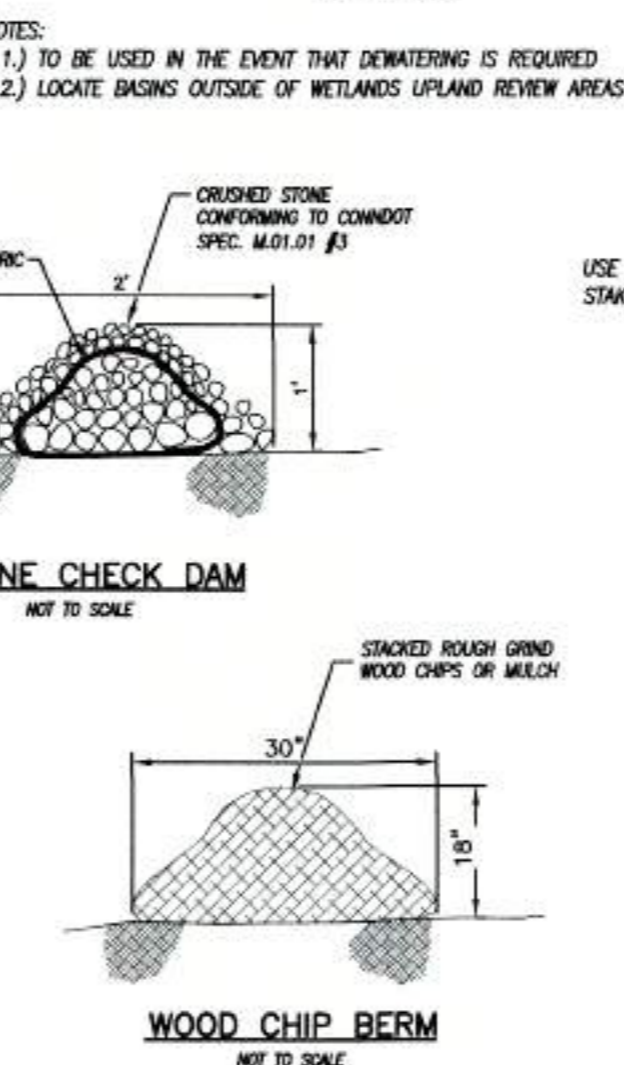

**STANDARD GRAVEL BAG CURB INLET PROTECTION**

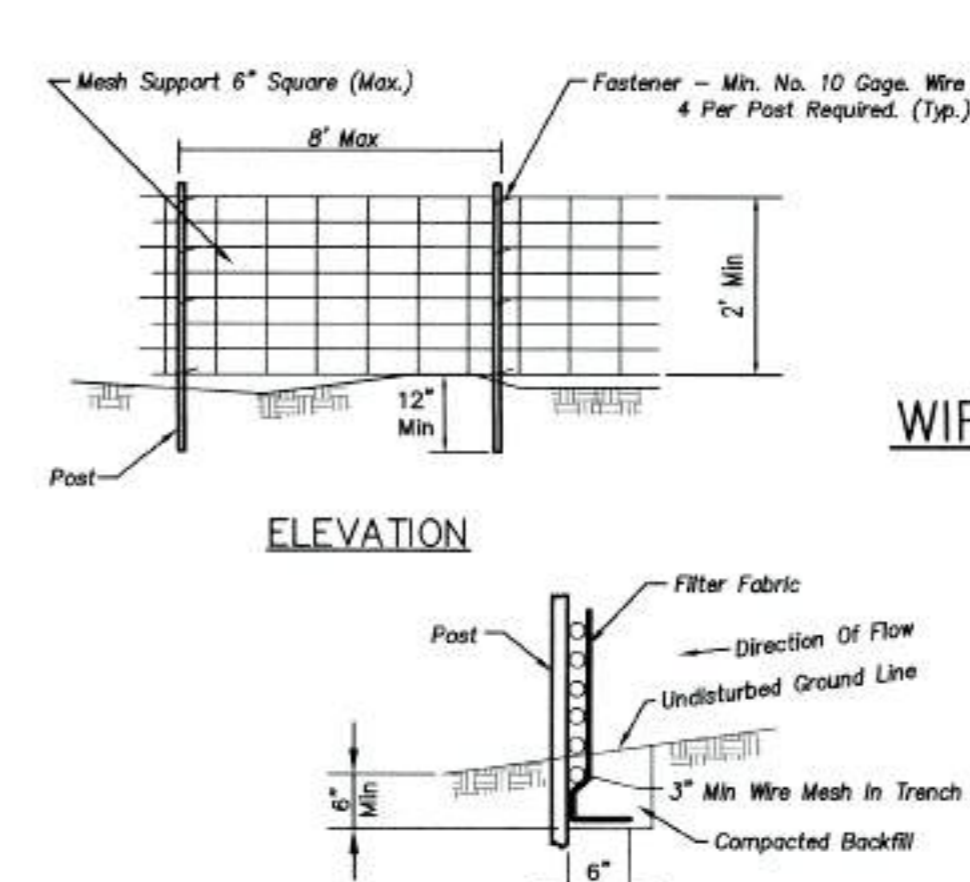


**WIRE BACKED SILT FENCE**


NOTES:

1. Wires of mesh support shall be min. gage no. 12.
2. Temporary sediment fence shall be installed prior to any grading work in the area to be protected. They shall be maintained throughout the construction period and removed in conjunction with the final grading and site stabilization.
3. Filter fabric shall meet the requirements of material specification 502 Geotextile Table 1 or 2, Class 1 with equivalent opening size of at least 30 for nonwoven and 50 for woven.
4. Fence posts shall be either wood post with a minimum cross-sectional area of 3.0 sq. in. or a standard steel post.


**FABRIC ANCHOR DETAIL**

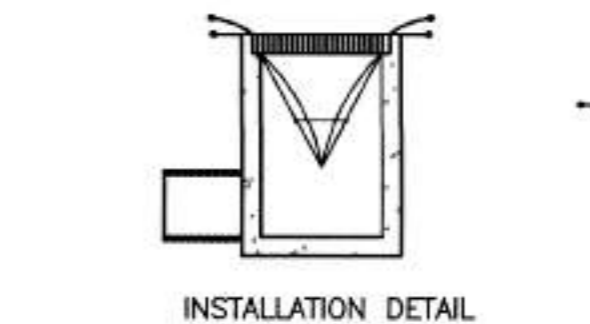

**HAYBALE BARRIER**  
NOT TO SCALE

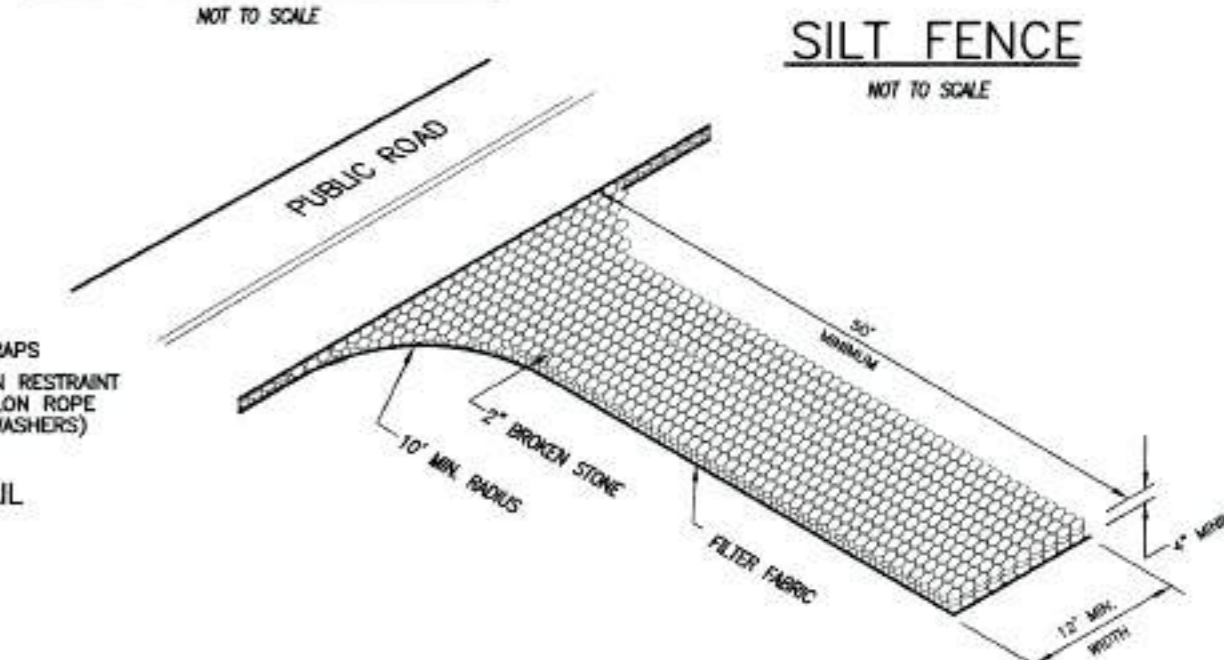

**SILT FENCE**  
NOT TO SCALE

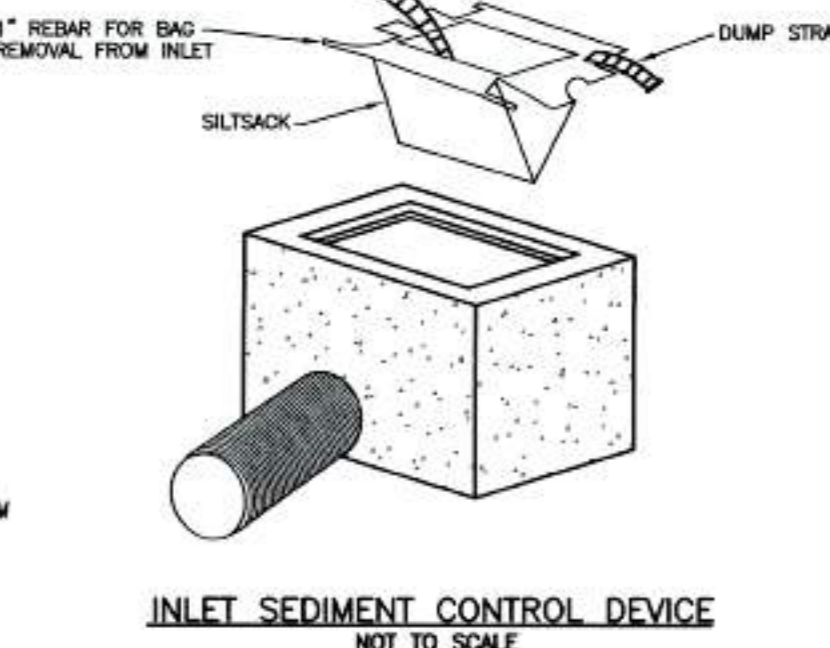


**INLET SEDIMENT CONTROL DEVICE**  
NOT TO SCALE

**INSTALLATION & MAINTENANCE**

1. Install as directed by manufacturer.
2. Inspect the catch basin sediment device at least once a week (preferably twice) and after rainfall events of 0.5" or greater.
3. Remove sediment when the siltsack is 1/2 full. Sediment shall be deposited in an area which is not regulated by the inland Wetlands Commission.
4. Replace or repair within 24-hours of observed failure. Failure may include:
  - Overtopping, or bypassed by runoff water.
  - The geotextile has decomposed or been damaged.

**CONSTRUCTION ENTRANCE**  
NOT TO SCALE

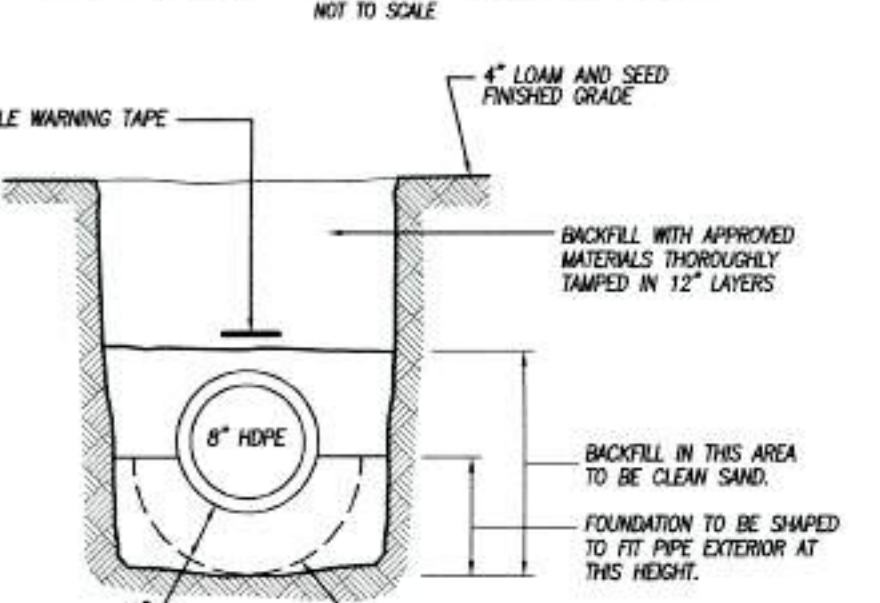

**ROOF LEADER PIPE IN TRENCH DETAIL**  
NOT TO SCALE

NOTE: MINIMUM SLOPE OF ROOF LEADERS SHALL BE 2%

DATE	DESCRIPTION
08/29/2022	NWC APPLICATION RESUBMISSION
10/26/2021	PHASING / E&S
10/15/2021	CONSULTANT REVIEW & COMMISSION
09/15/2021	TOWN ROAD FRONTAGE
04/20/2021	NWC APPROVAL CONDITIONS
DATE	DESCRIPTION
	REVISIONS

**DETAIL SHEET**

PREPARED FOR

**SHANE POLLOCK**

LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT


**Killingly Engineering Associates**  
Civil Engineering & Surveying



114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 779-7299  
www.killinglyengineering.com

DATE: 4/23/2020	DRAWN: DNE
SCALE: NOT TO SCALE	DESIGN: NET
SHEET: 13 OF 16	CHK BY: GC
DWG. No: CLIENT FILE	JOB No: 20014

**COMPOST FILTER SOCK APPLICATION**  
NOT TO SCALE

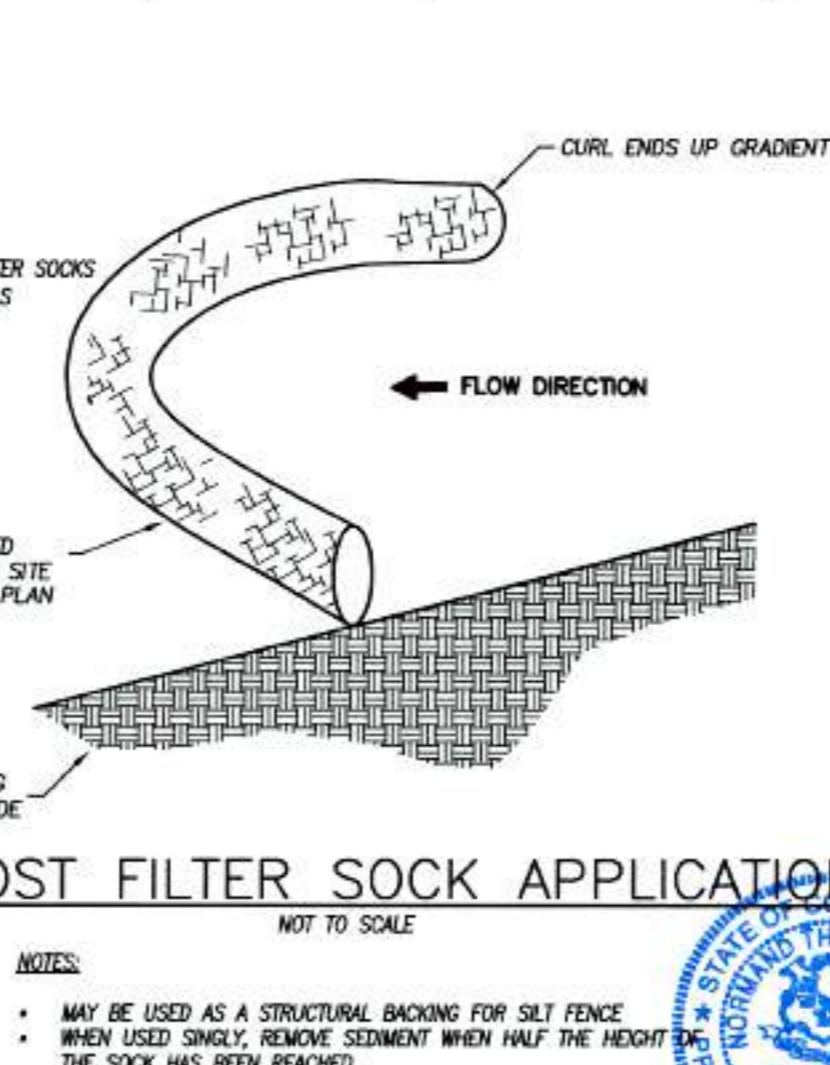


**COMPOST FILTER SOCK APPLICATION**  
NOT TO SCALE

**NOTES:**


1. MAY BE USED AS A STRUCTURAL BACKING FOR SILT FENCE
2. WHEN USED SIMPLY, REMOVE SEDIMENT WHEN HALF THE HEIGHT OF THE SOCK HAS BEEN REACHED
3. PROVIDE SOCK AS MANUFACTURED BY "TILTROCK" OR ENGINEER APPROVED EQUAL.

Normand Thibault, Jr., P.E.  
DATE

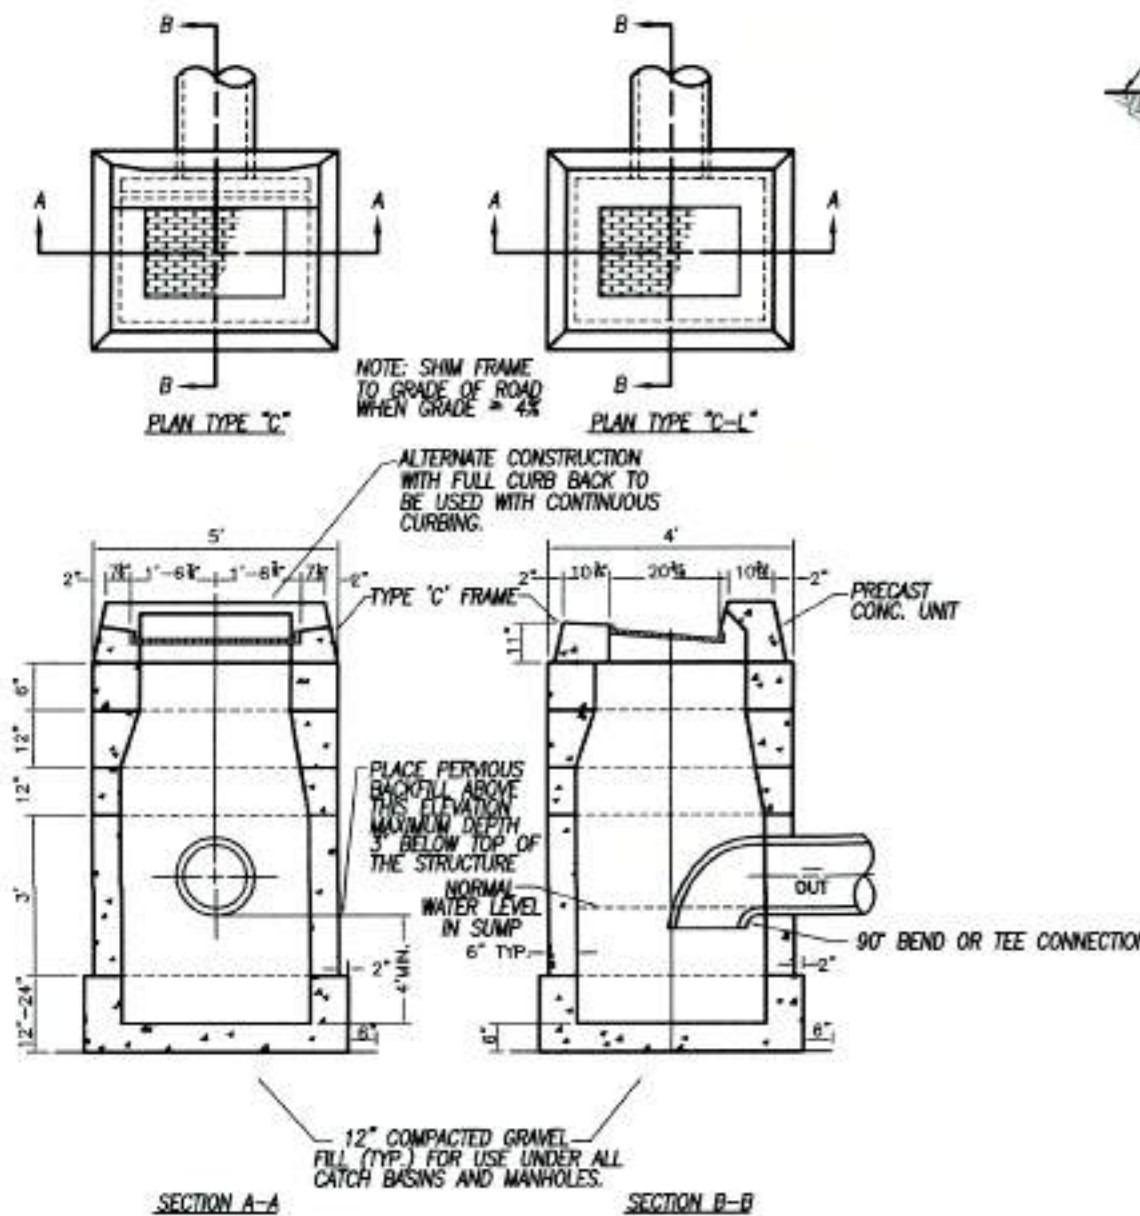


**HOODED CATCH BASIN DETAIL**  
NOT TO SCALE


NOTES:  
 \* TO BE INSTALLED AT FINAL CATCH BASIN WITH OUTLET TO STORMWATER BASIN.  
 \* A CATCH BASIN HOOD MAY BE SUBSTITUTED WITH THE PRE-APPROVAL OF THE TOWN ENGINEER.

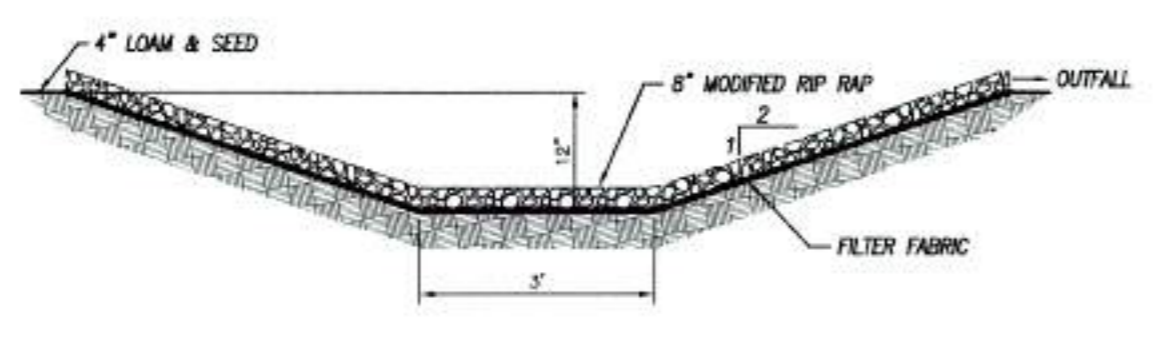


**SECTION THROUGH LEVEL SPREADER**  
NOT TO SCALE

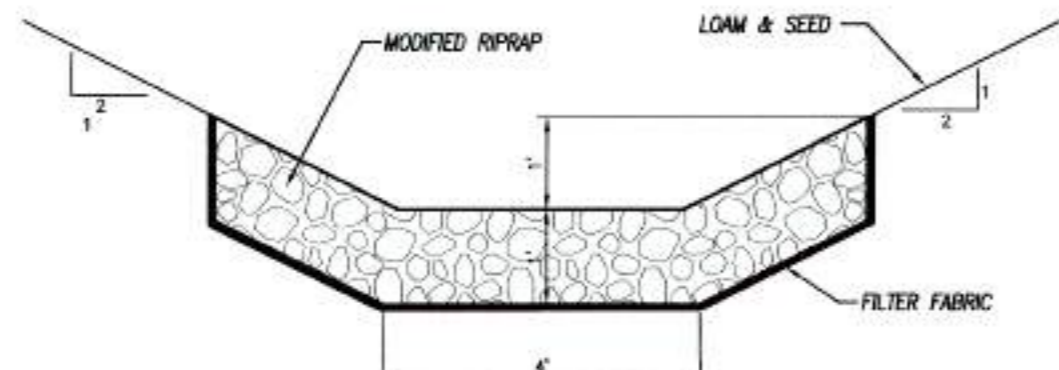

**MODIFIED RIPRAP SWALE**  
NOT TO SCALE

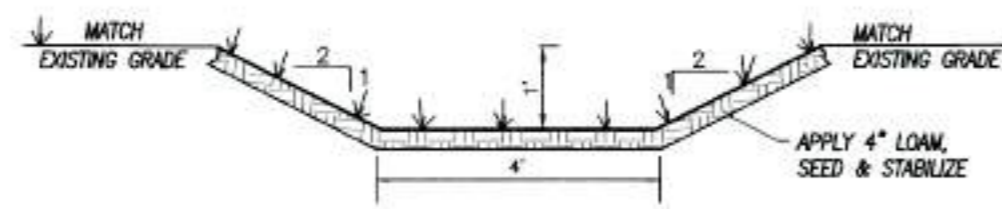

**GRASS LINED SWALE**  
NOT TO SCALE

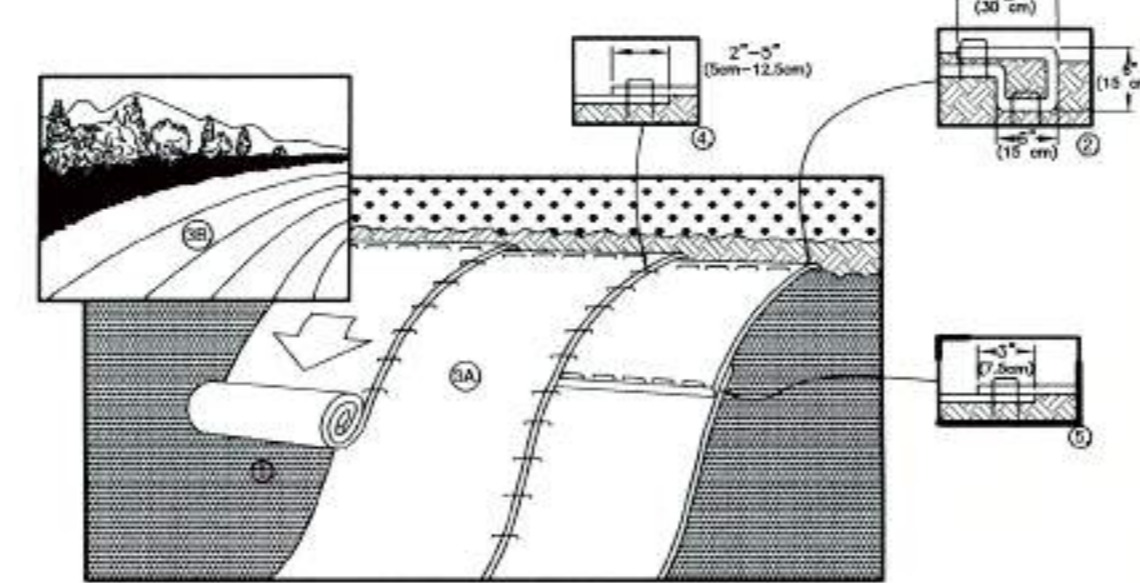

**TURF REINFORCEMENT MAT INSTALLATION**  
NOT TO SCALE

1. PREPARE SOIL BEFORE INSTALLING BLANKETS, INCLUDING ANY NECESSARY APPLICATION OF LIME, FERTILIZER, AND SEED. NOTE: WHEN USING CELL-O-SEED DO NOT SEED PREPARED AREA. CELL-O-SEED MUST BE INSTALLED WITH PAPER SIDE DOWN.


2. BEGIN AT THE TOP OF THE SLOPE BY ANCHORING THE BLANKET IN A 6" (150mm) DEEP X 6" (150mm) WIDE TRENCH WITH APPROXIMATELY 12" (300mm) OF BLANKET EXTENDING BEYOND THE UP-SLOPE PORTION OF THE TRENCH. ANCHOR THE BACKFILL AND COMPACT THE TRENCH AFTER STAPLING. APPLY SEED TO COMPACTED SOIL AND FILL REMAINING 12" (300mm) PORTION OF BLANKET BACK OVER SEED AND COMPACTED SOIL. SECURE BLANKET OVER COMPACTED SOIL WITH A ROW OF STAPLES/STAKES SPACED APPROXIMATELY 12" (300mm) APART ACROSS THE WIDTH OF THE BLANKET.

3. ROLL THE BLANKETS (A) DOWN OR (B) HORIZONTALLY ACROSS THE SLOPE. BLANKETS WILL UNROLL WITH APPROPRIATE SIDE AGAINST THE SOIL SURFACE. ALL BLANKETS MUST BE SECURELY FASTENED TO SOIL SURFACE BY PLACING STAPLES/STAKES IN APPROPRIATE LOCATIONS AS SHOWN IN THE STAPLE PATTERN GUIDE. WHEN USING OPTIONAL DOT SYSTEM, STAPLES/STAKES SHOULD BE PLACED THROUGH DOTS OF THE COLORED DOTS CORRESPONDING TO THE APPROPRIATE STAPLE PATTERN.

4. THE EDGES OF PARALLEL BLANKETS MUST BE STAPLED WITH APPROXIMATELY 2"-5" (50mm-125mm) OVERLAP DEPENDING ON BLANKET TYPE. TO ENSURE PROPER SEAM ALIGNMENT, PLACE THE EDGE OF THE OVERLAPPING BLANKET (BLANKET BEING INSTALLED ON TOP) DOWN WITH THE COLORED SEAM STRICH ON THE PREVIOUSLY INSTALLED BLANKET.

5. CONSECUTIVE BLANKETS SPICED DOWN THE SLOPE MUST BE PLACED END OVER END (SHINGLE STYLE) WITH AN APPROXIMATE 3" (75mm) OVERLAP. STAPLE THROUGH OVERLAPPED AREA, APPROXIMATELY 12" (300mm) APART ACROSS ENTIRE BLANKET WIDTH.

NOTES:  
 1. IN LOOSE SOIL CONDITIONS, THE USE OF STAPLE OR STAKE LENGTHS GREATER THAN 6" (150mm) MAY BE NECESSARY TO PROPERLY SECURE THE BLANKETS.  
 2. TURF REINFORCEMENT MAT SHALL BE NORTH AMERICAN GREEN BIOMAT 50-100BN OR APPROVED BIODEGRADABLE EQUIVALENT.

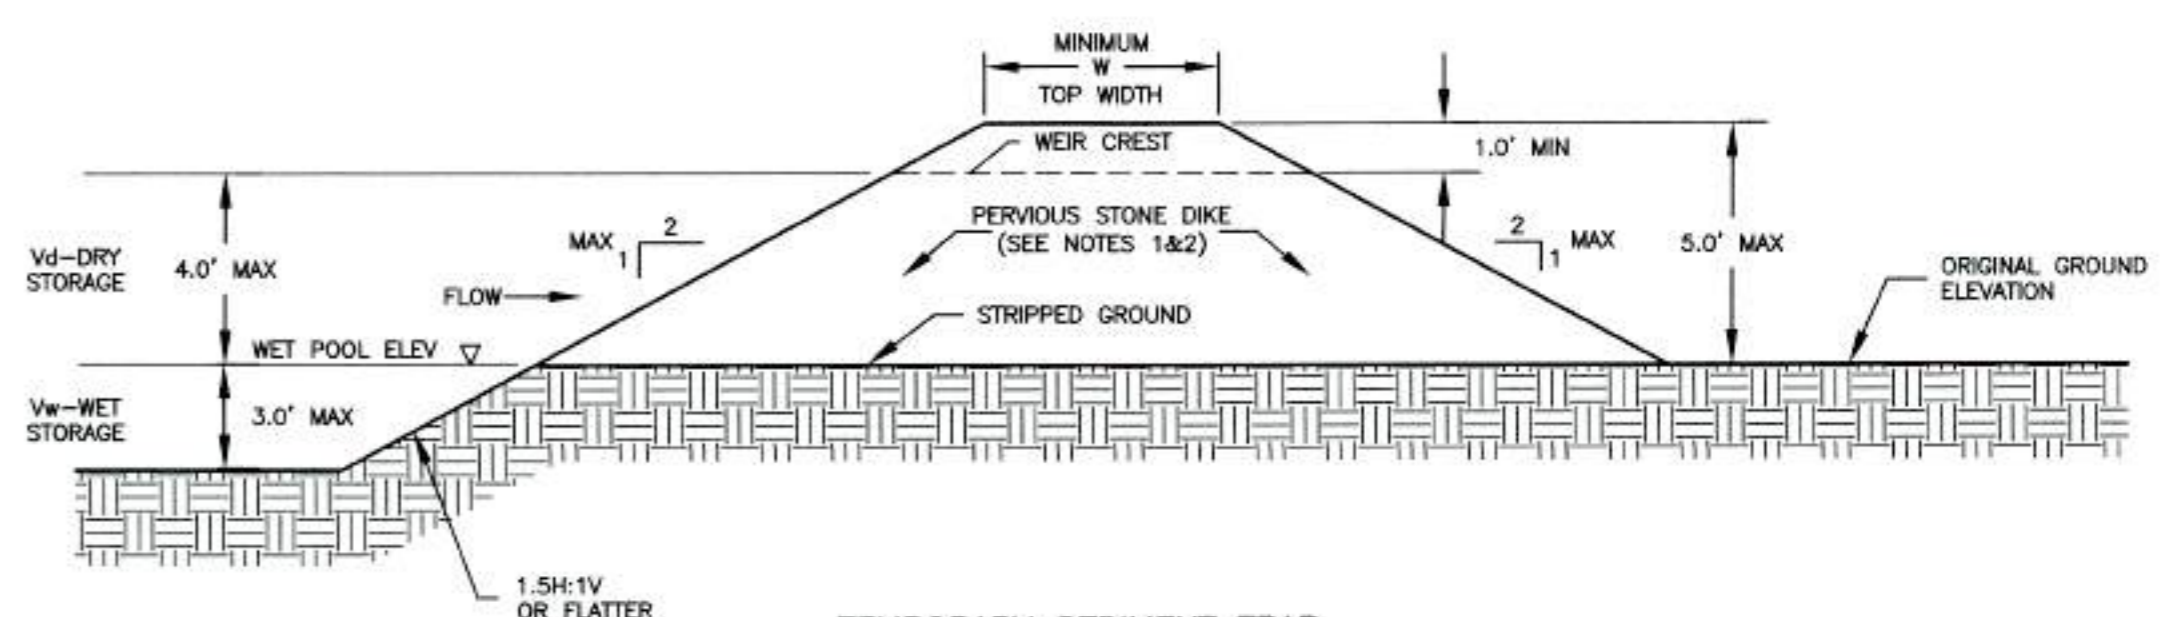

**TEMPORARY SEDIMENT TRAP EMBANKMENT CROSS SECTION**  
NOT TO SCALE

**TOP WIDTH VS. HEIGHT**

H (ft)	W (ft)
1.5	2.0
2.0	2.0
2.5	2.5
3.0	2.5
3.5	3.0
4.0	3.0
4.5	4.0
5.0	4.5

**NOTES:**

- ALL CONSTRUCTION AND MATERIALS SHALL BE IN ACCORDANCE WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL AND EROSION CONTROL, SECTIONS 5-11-25 THRU 5-11-29.
- PERVIOUS STONE DIKE SHALL BE CONSTRUCTED OF MODIFIED RIPRAP (CTDOT M.12.02) WITH #3 STONE ON FACE (CTDOT M.51.01).
- NON-OVERFLOW PORTIONS AND ABUTMENTS OF TEMPORARY SEDIMENT TRAPS MAY BE CONSTRUCTED OF ENGINEER APPROVED BACKFILL COMPACTED IN 9" LAYERS. USE ONLY MATERIAL FOR THE EMBANKMENT THAT IS FREE FROM EXCESSIVE ORGANICS, DEBRIS, ROCKS OVER 6" IN DIAMETER OR OTHER UNSUITABLE MATERIALS.
- IF, IN THE JUDGEMENT OF THE ENGINEER, MATERIALS FROM ON-SITE EXCAVATION ACTIVITIES ARE NOT SUITABLE FOR CONSTRUCTION OF SEDIMENT TRAP EMBANKMENTS, MATERIALS SHALL BE IMPORTED TO THE SITE.
- EARTHEN EMBANKMENTS SHALL BE STABILIZED WITH TEMPORARY SEEDING, PERMANENT SEEDING OR STONE SLOPE PROTECTION IMMEDIATELY AFTER INSTALLATION.
- TEMPORARY SEDIMENT TRAP(S) SHALL BE INSPECTED AT LEAST ONCE PER WEEK AND WITHIN 24 HOURS OF THE END OF A STORM OF 0.5 INCHES OF RAINFALL OR GREATER. REMOVE ACCUMULATED SEDIMENT WHEN ONE HALF OF THE MINIMUM WET STORAGE VOLUME HAS BEEN FILLED. DISPOSE OF REMOVED SEDIMENT IN A SUITABLE AREA AND IN SUCH A MANNER THAT IT WILL NOT ERODE.

**SEED MIX REQUIREMENTS:**


AREA	SPECIES	SEEDING RATE (lbs/acre)
Mowed & maintained banks	Creeping Red Fescue (Pennlawn, Wintergreen)	20
	Bird's-foot Trefoil (Empire, Viking) with inoculant	8
	Tall Fescue (Kentucky 31)	20
	<b>TOTAL</b>	<b>48</b>
Unmowed banks & slopes	Tall Fescue (Kentucky 31)	20
	Flatpea (Lathco) with inoculant	30
	<b>TOTAL</b>	<b>50</b>
Diversions & channels	Creeping Red Fescue (Pennlawn, Wintergreen)	20
	Redtop (Sreeker, Common)	2
	Tall Fescue (Kentucky 31)	20
	<b>TOTAL</b>	<b>42</b>
Lawns & high maintenance areas	Turf type Tall Fescue	<b>TOTAL 150</b>

\*\*Alternative seed mixes may be used. Alternative seed mix selections shall be in accordance with Figures PS-2 and PS-3 in the 2002 Guidelines for Soil Erosion and Sediment Control or as specified by and coordinated with the landscape designer.


**New England Erosion Control/Restoration Mix For Detention Basins and Moist Sites**

The New England Erosion Control/Restoration Mix for Detention Basins and Moist Sites contains a selection of native grasses and wildflowers designed to colonize generally moist, recently disturbed sites where quick growth of vegetation is desired to stabilize the soil surface. It is an appropriate seed mix for ecologically sensitive restorations that require stabilization as well as long-term establishment of native vegetation. This mix is particularly appropriate for detention basins that do not hold standing water for extended periods. Many of the plants in this mix can tolerate infrequent inundation, but not constant flooding. The mix may be applied by hand, by mechanical spreader, or by hydro-seeder. After sowing, lightly rake, roll or cultipack to insure good seed to soil contact. Best results are obtained with a Spring or late Summer seeding. Late Fall and Winter dormant seeding requires an increase in the application rate. A light mulching of clean, weed-free straw is recommended.

**SPECIES:** Riverbank Wild Rye (*Elymus riparius*), Creeping Red Fescue (*Festuca rubra*), Little Bluestem (*Schizachyrium scoparium*), Big Bluestem (*Andropogon gerardii*), Switch Grass (*Panicum virgatum*), Upland Bantgrass (*Agrostis perennans*), Nodding Bur Marigold (*Bidens cernua*), Hollow-Stem Joe Pye Weed (*Eupatorium fistulosum/Eutrochium fistulosum*), New England Aster (*Aster novae-angliae*), Boneset (*Eupatorium perfoliatum*), Blue Vervain (*Verbena hastata*), Soft Rush (*Juncus effusus*), Wool Grass (*Scirpus cyperinus*).</P>

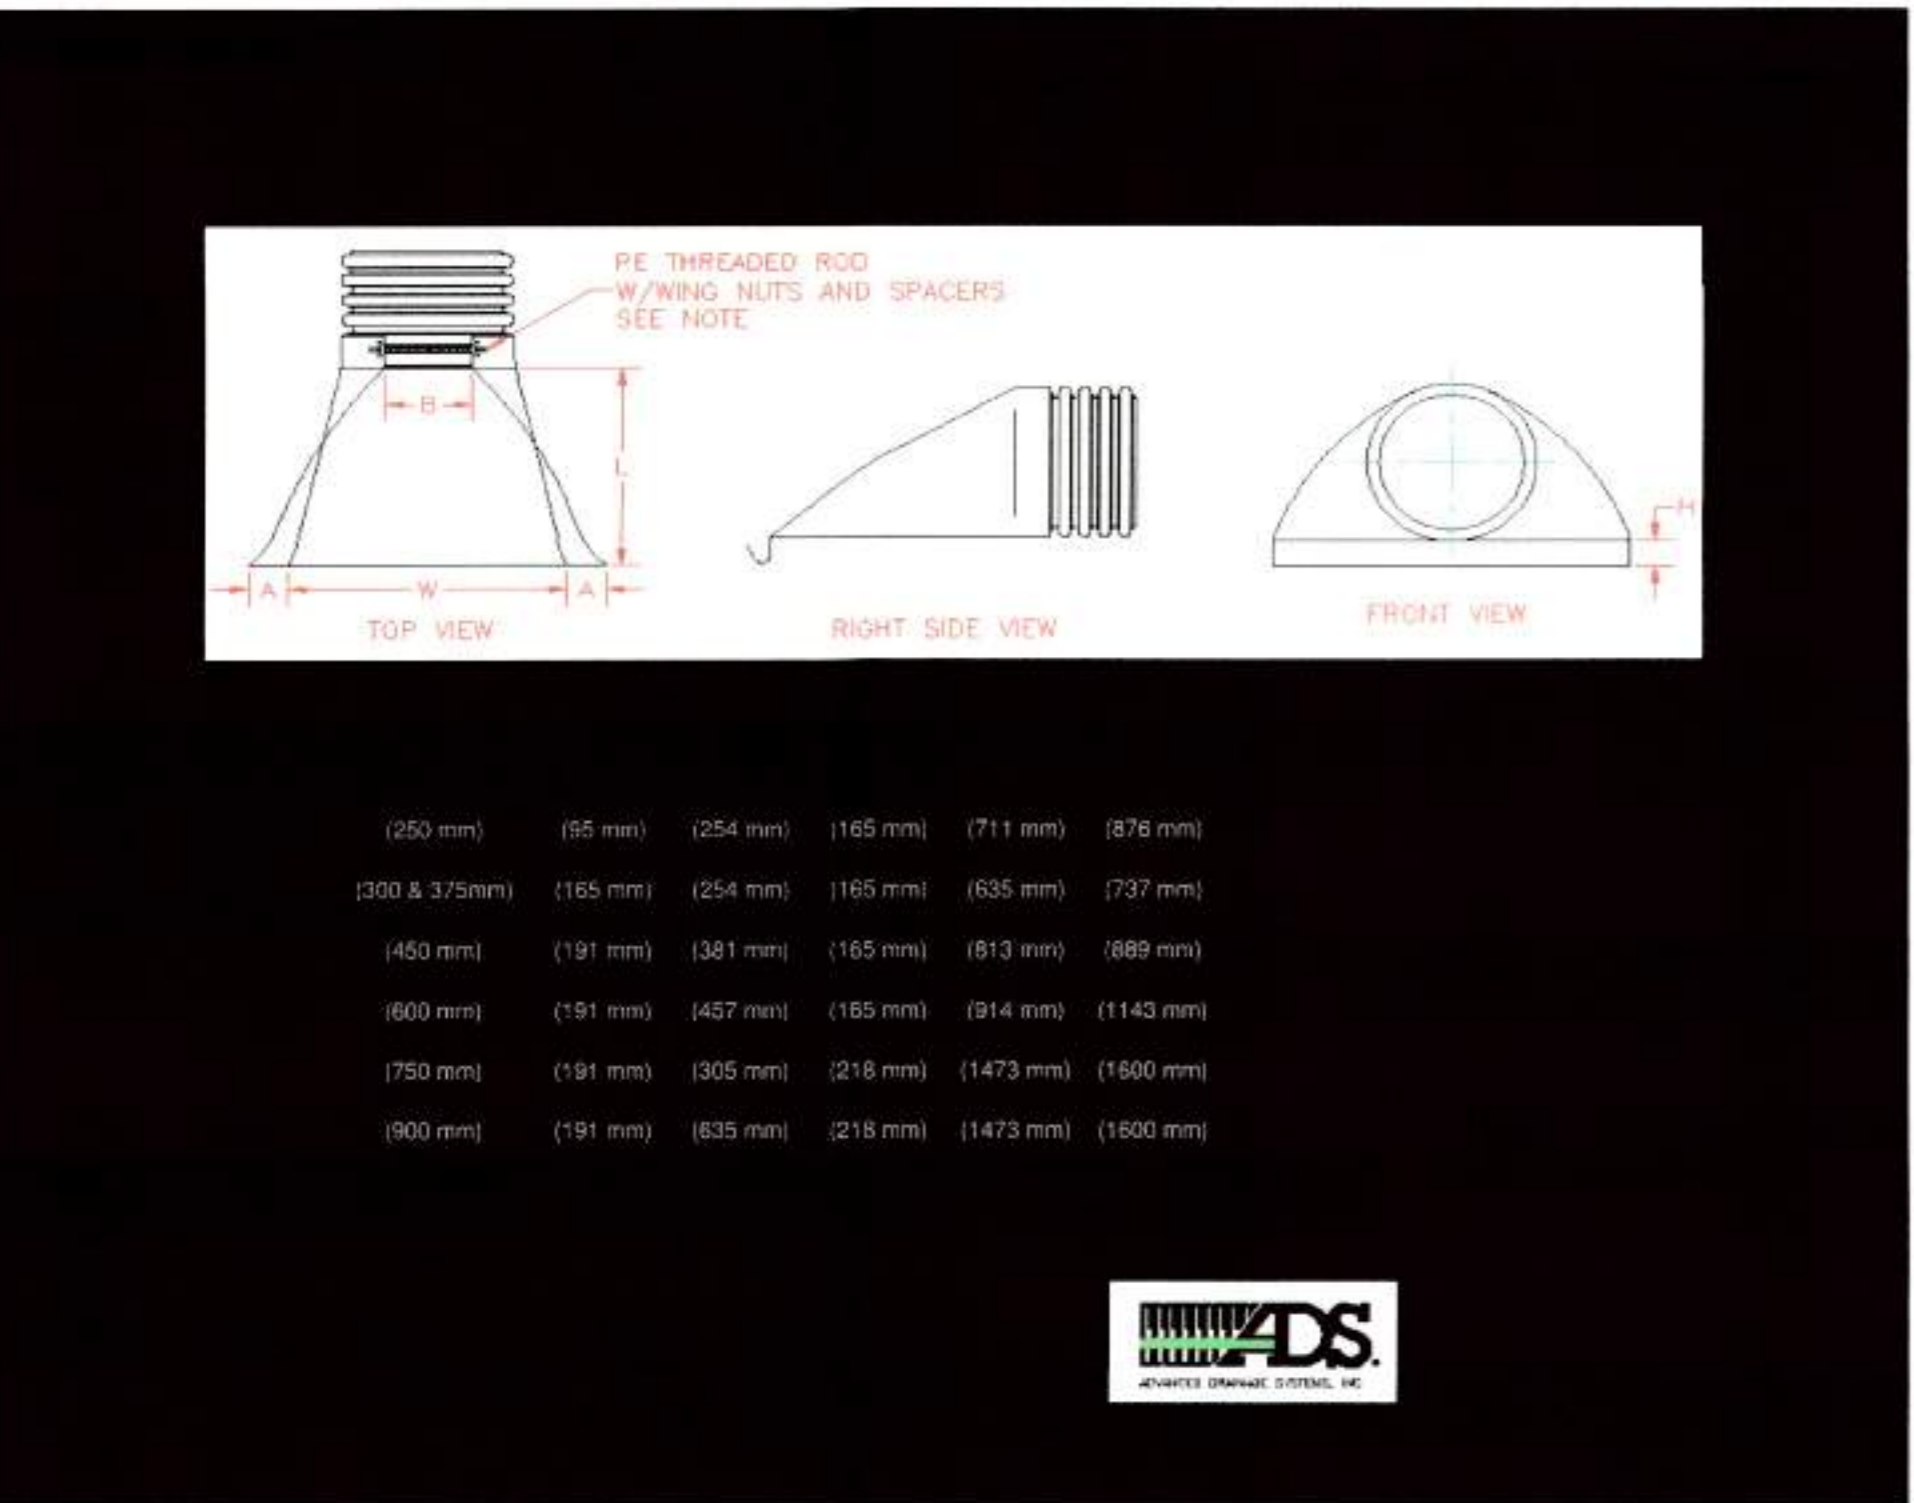


**TEMPORARY DIVERSION**  
NOT TO SCALE

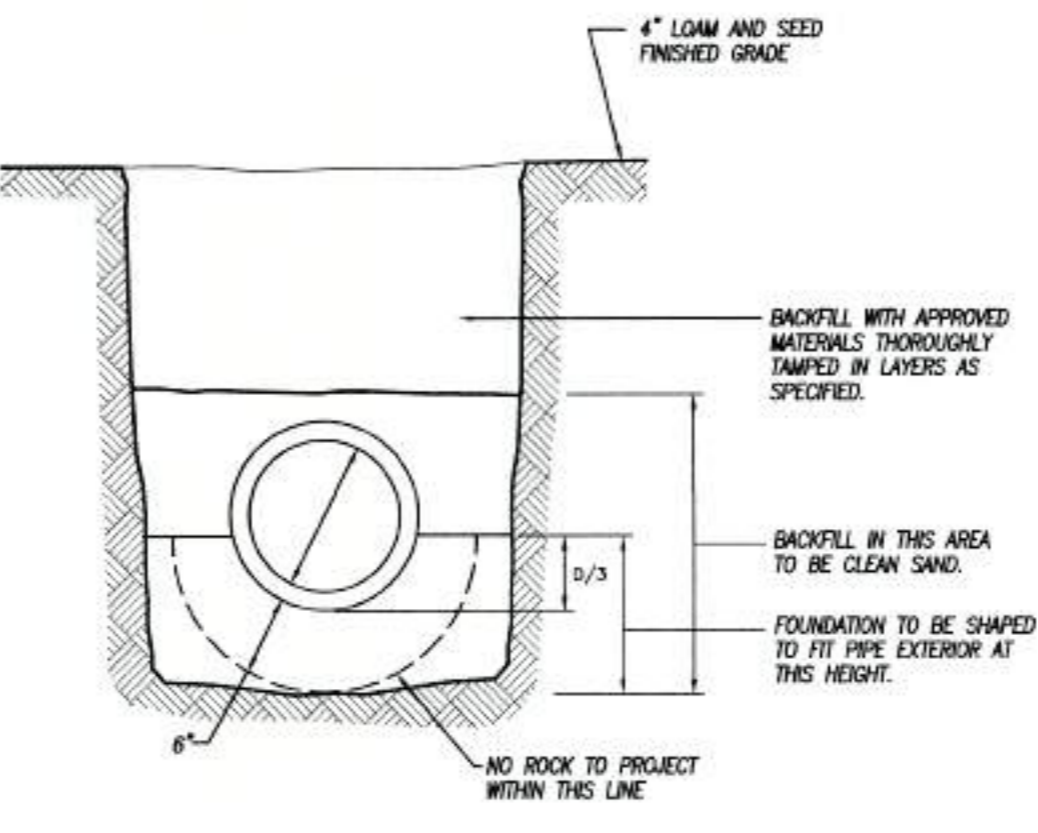


**STORM DRAIN PIPE IN TRENCH DETAIL**  
NOT TO SCALE




**STONE BERM**  
NOT TO SCALE  
NOTE: TO BE UTILIZED IN STORMWATER BASIN

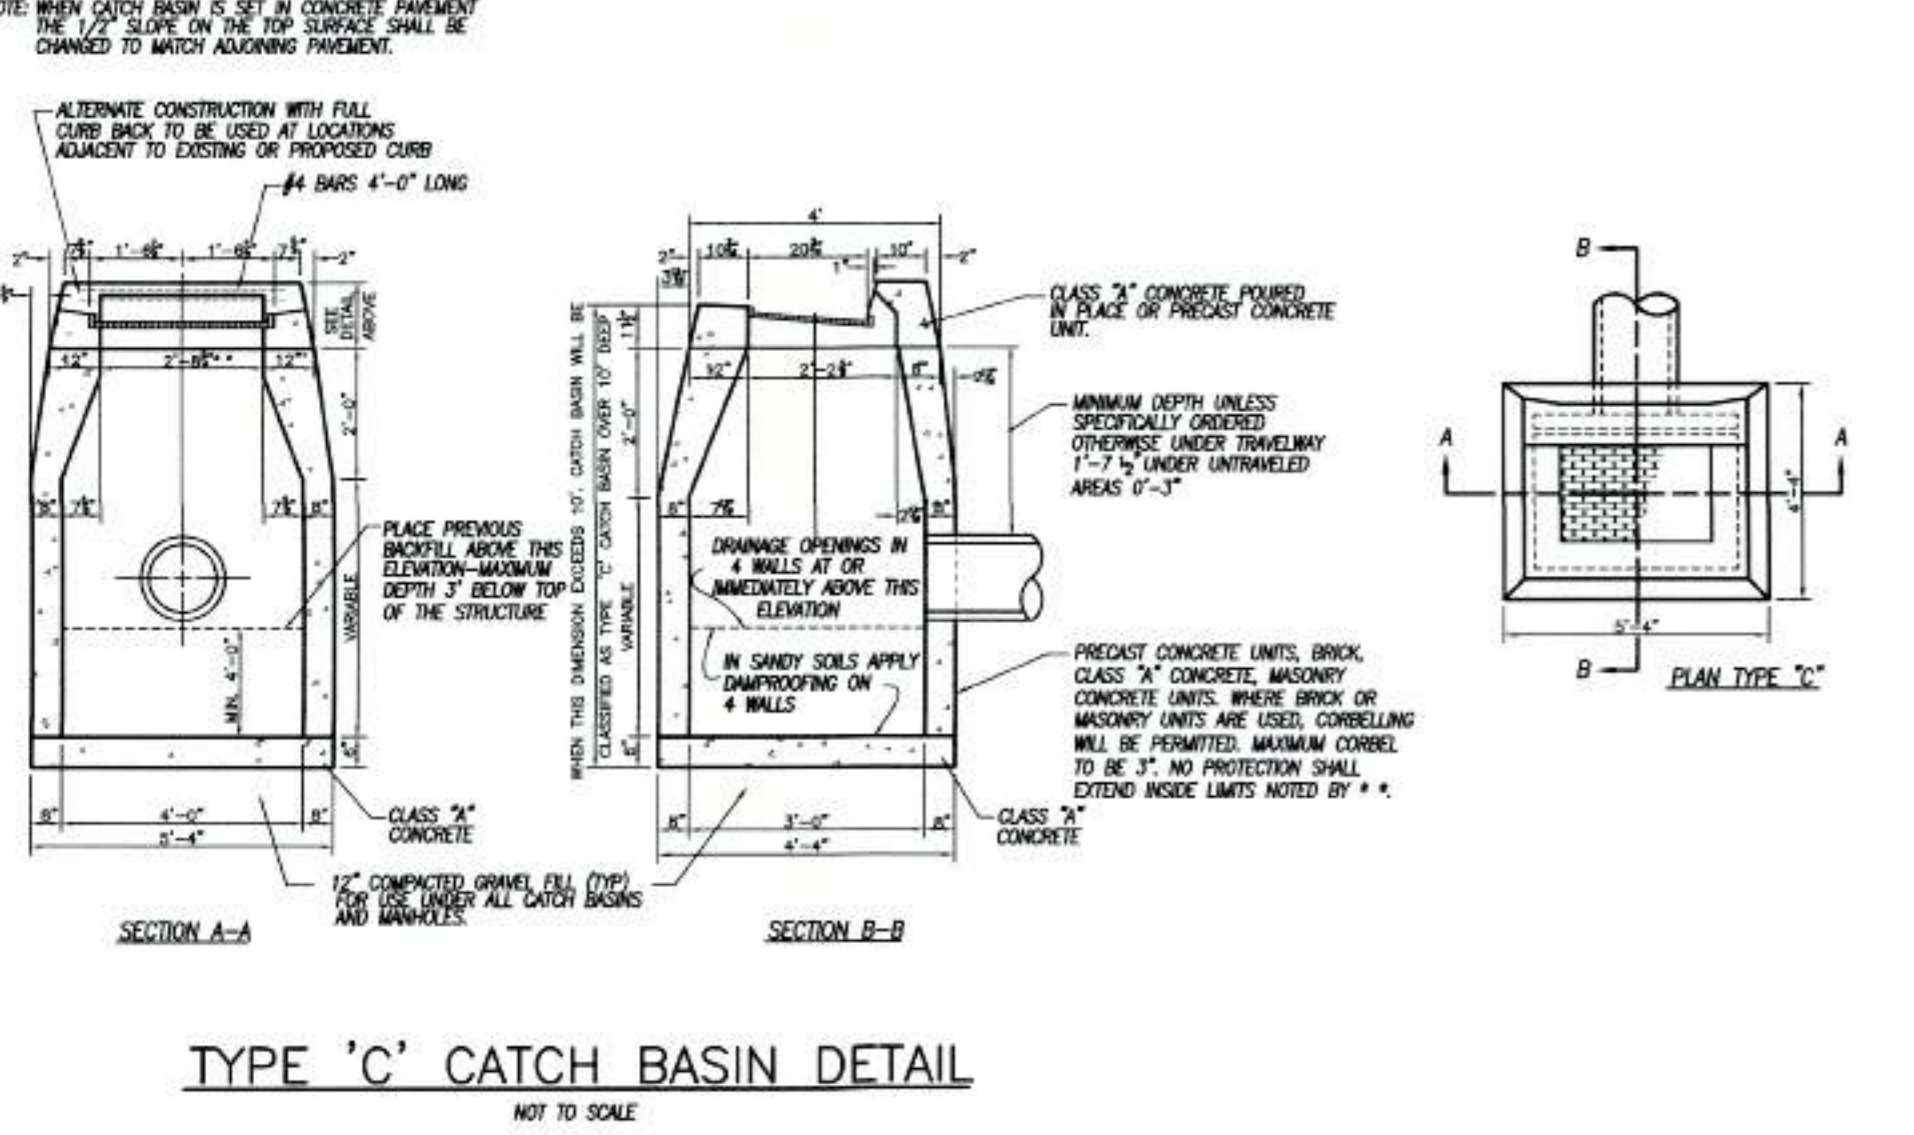

**TYPE 'C' CATCH BASIN DETAIL**  
NOT TO SCALE

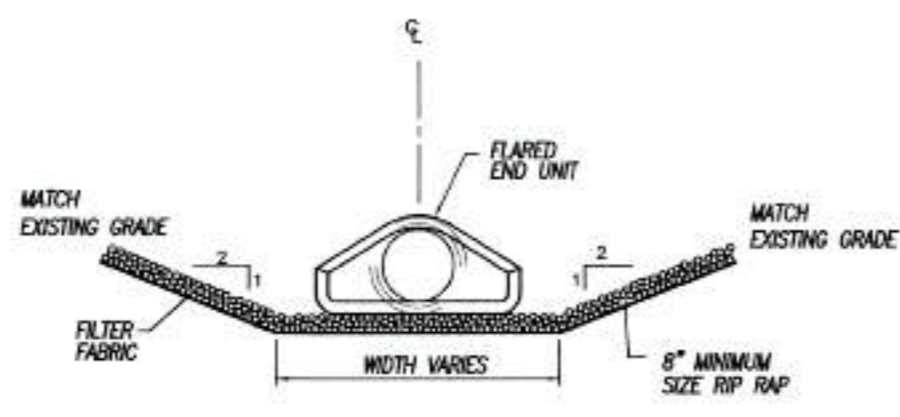

**SECTION**  
**RIP RAP OUTFALL**  
NOT TO SCALE

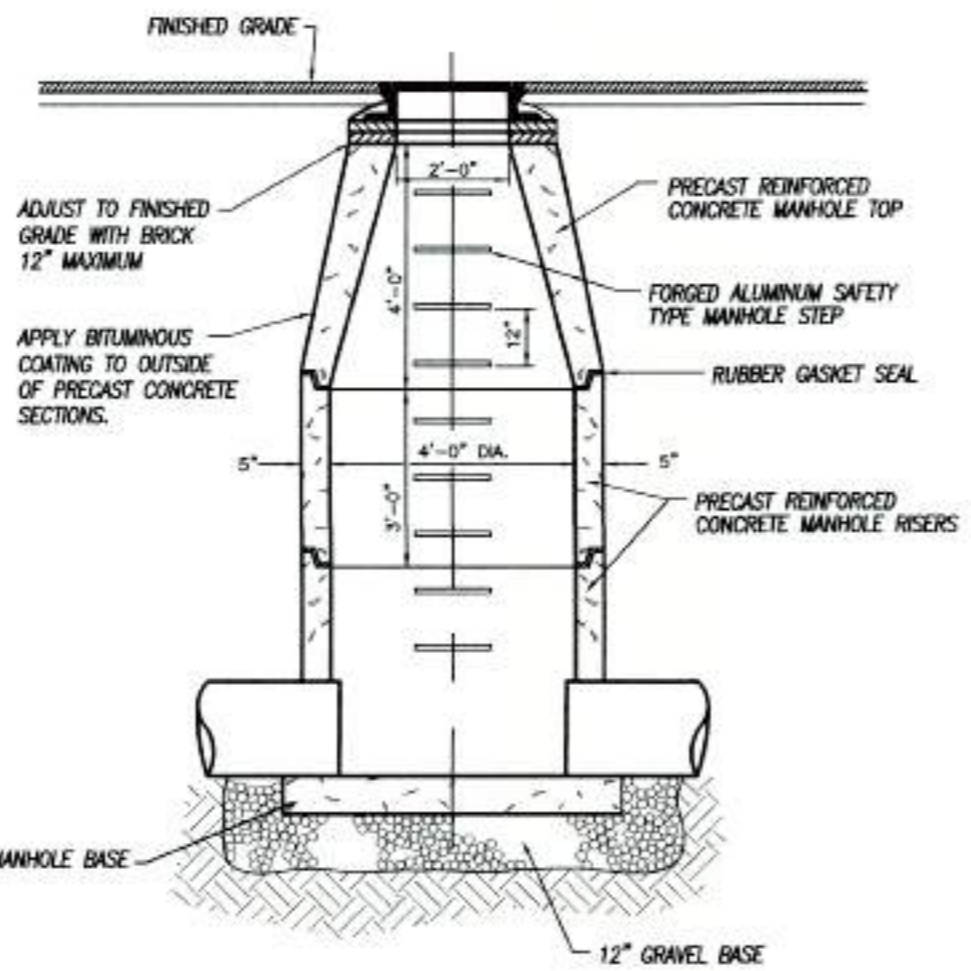

**TYPICAL MANHOLE CROSS SECTION**  
NOT TO SCALE



Norman E. Thibault, Jr., P.E.  
 DATE: \_\_\_\_\_  
 Licensure No. 0022834

DATE	DESCRIPTION
08/29/2022	INVC APPLICATION RESUBMISSION
10/26/2021	PHASING / ERS
10/15/2021	CONSULTANT REVIEW & COMMISSION
09/15/2021	TOWN ROAD FRONTAGE
04/20/2021	INVC APPROVAL CONDITIONS
DATE	DESCRIPTION
REVISIONS	


**DETAIL SHEET 2**  
**PREPARED FOR**  
**SHANE POLLOCK**

LOUISE BERRY DRIVE  
 BROOKLYN, CONNECTICUT


**Killingly Engineering Associates**  
 Civil Engineering & Surveying

114 Westcott Road  
 P.O. Box 421  
 Killingly, Connecticut 06241  
 (860) 779-7299  
 www.killinglyengineering.com


DATE: 4/23/2020	DRAWN: DNE
SCALE: NOT TO SCALE	DESIGN: NET
SHEET: 14 OF 16	CHK BY: GG
DWG. No: CLIENT FILE	JOB No: 20014

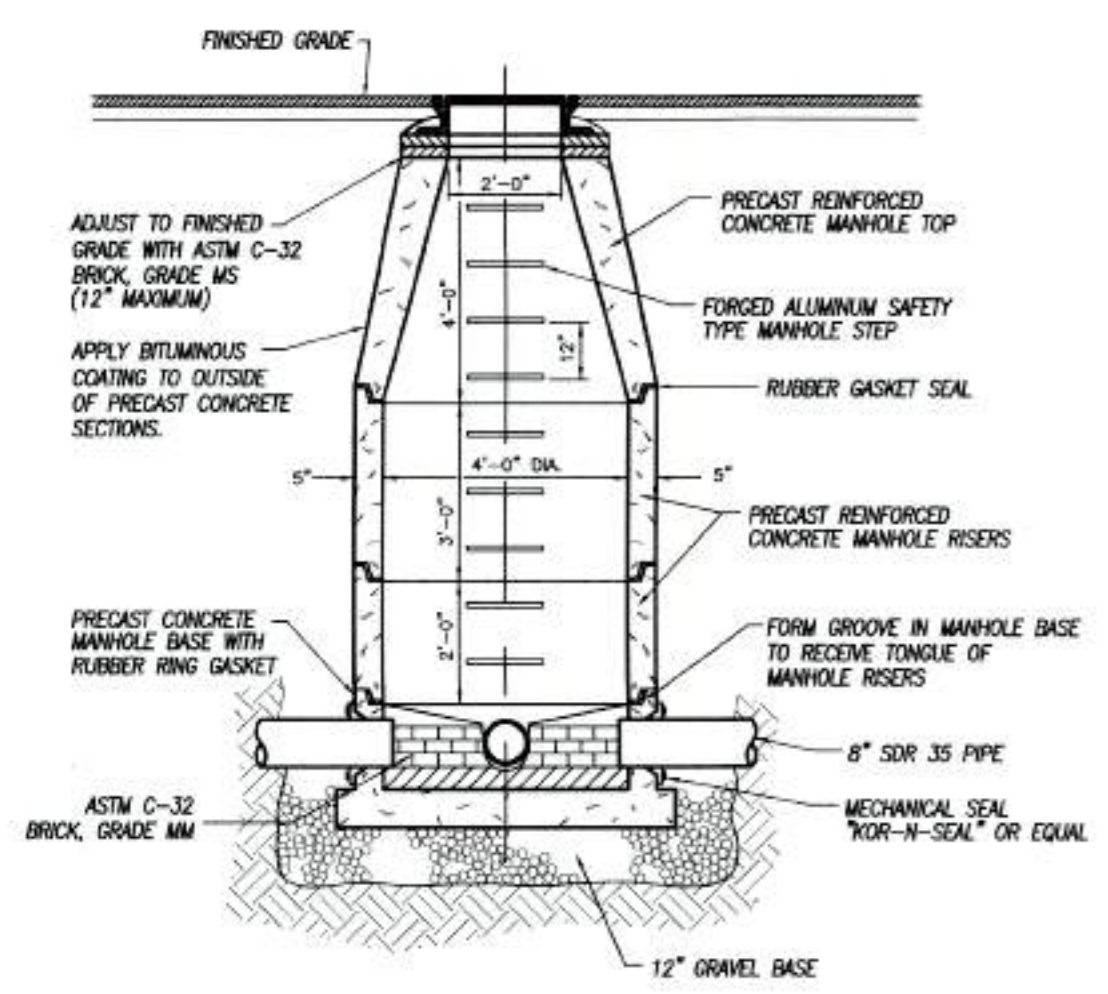

**TYPICAL SANITARY MANHOLE CROSS SECTION**  
NOT TO SCALE

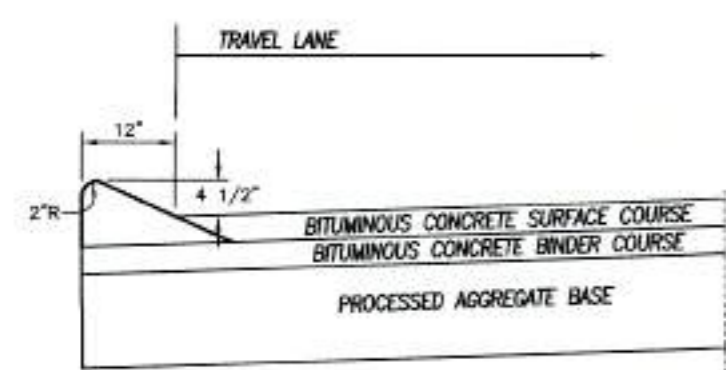


**ALTERNATE 1 - CURB ON BINDER**

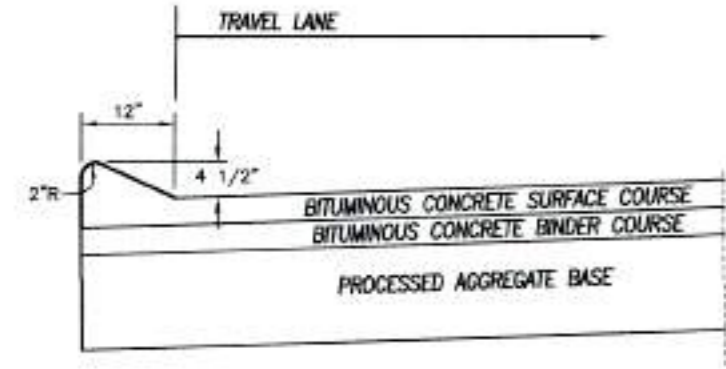


**ALTERNATE 2 - MONOLITHIC CONSTRUCTION**


**CAPE COD CURBING**  
NOT TO SCALE

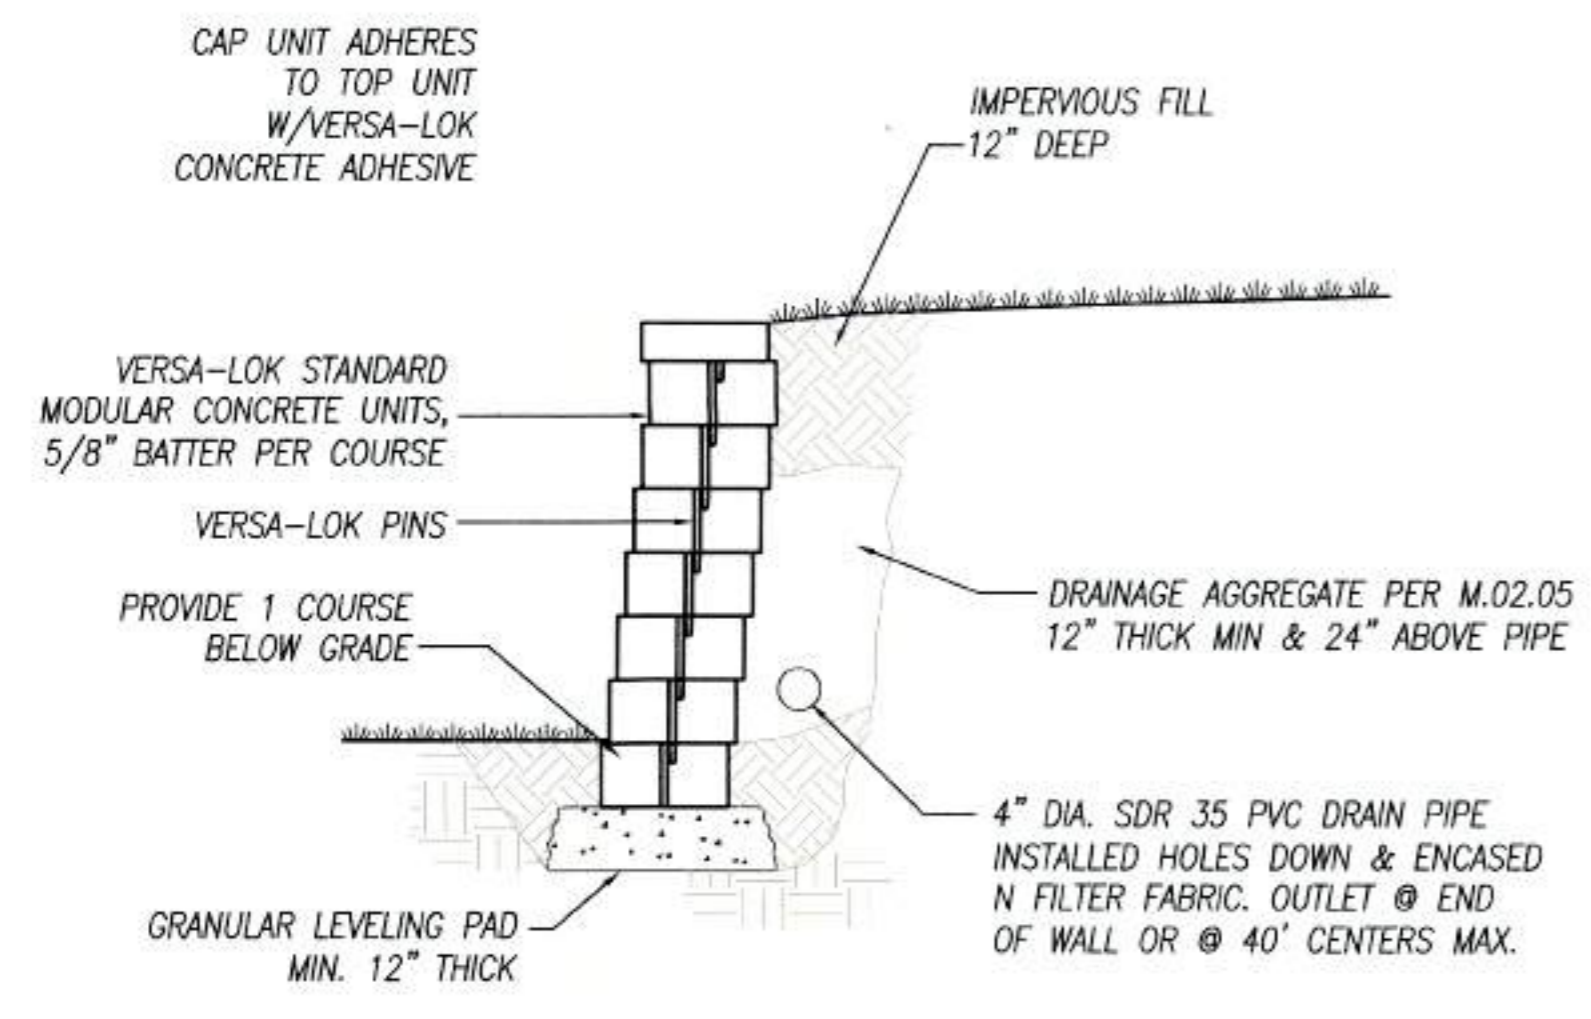


**TYPICAL SECTION - UNREINFORCED RETAINING WALL**  
VERSA-LOK OR APPROVED EQUAL

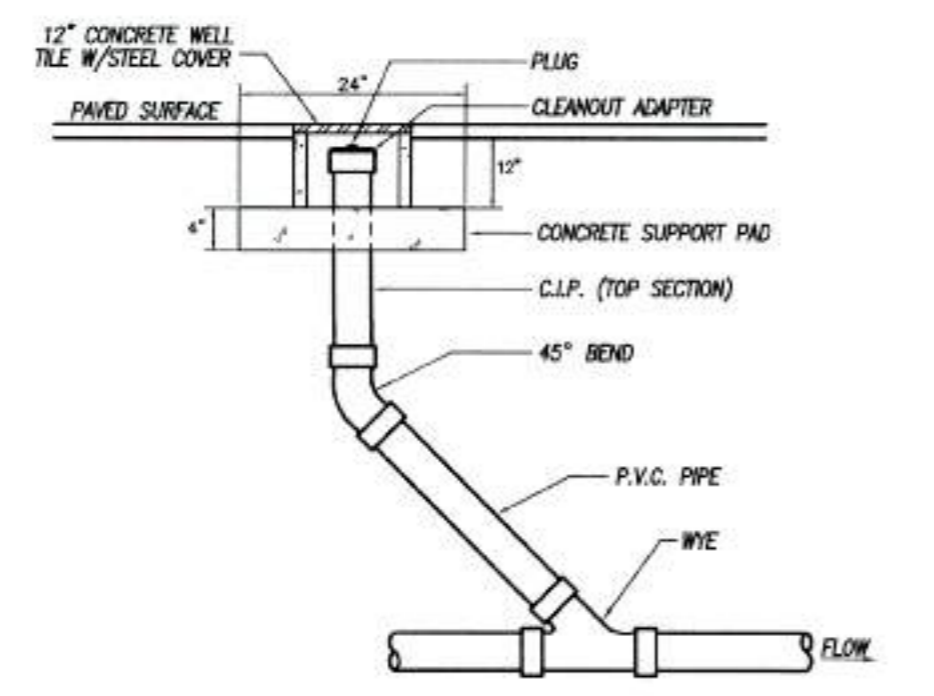


**SANITARY CLEANOUT DETAIL**  
NOT TO SCALE

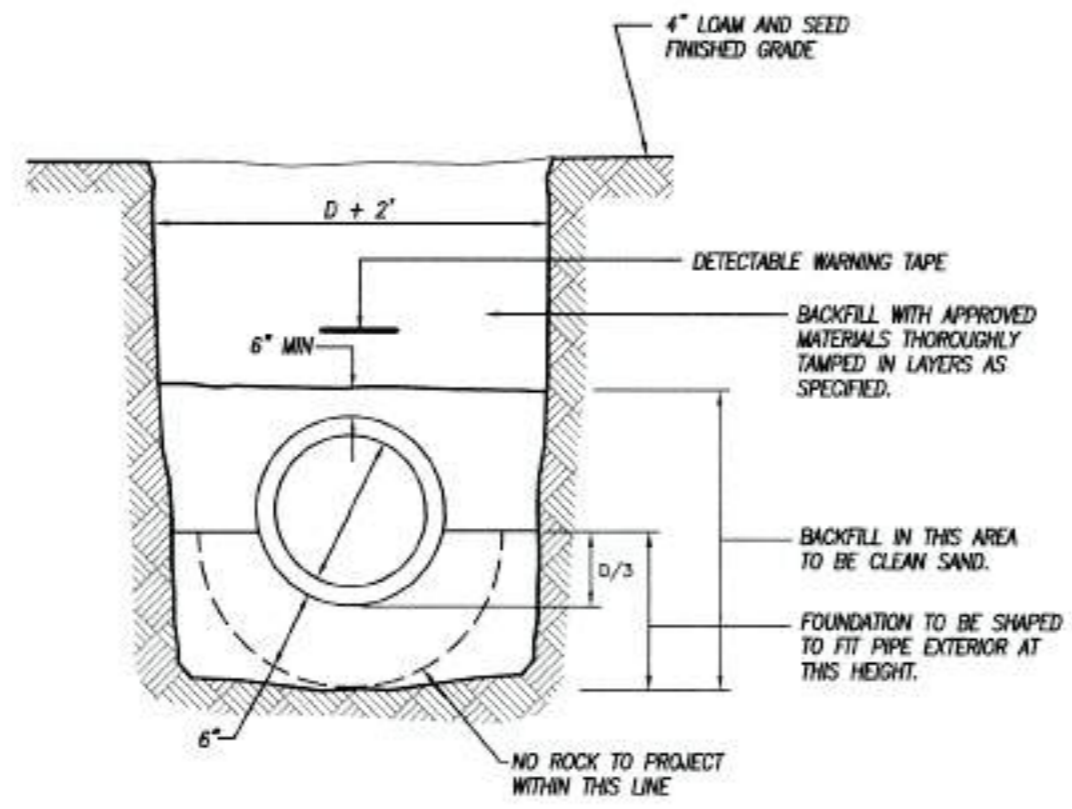


**SANITARY SEWER PIPE IN TRENCH DETAIL**  
NOT TO SCALE

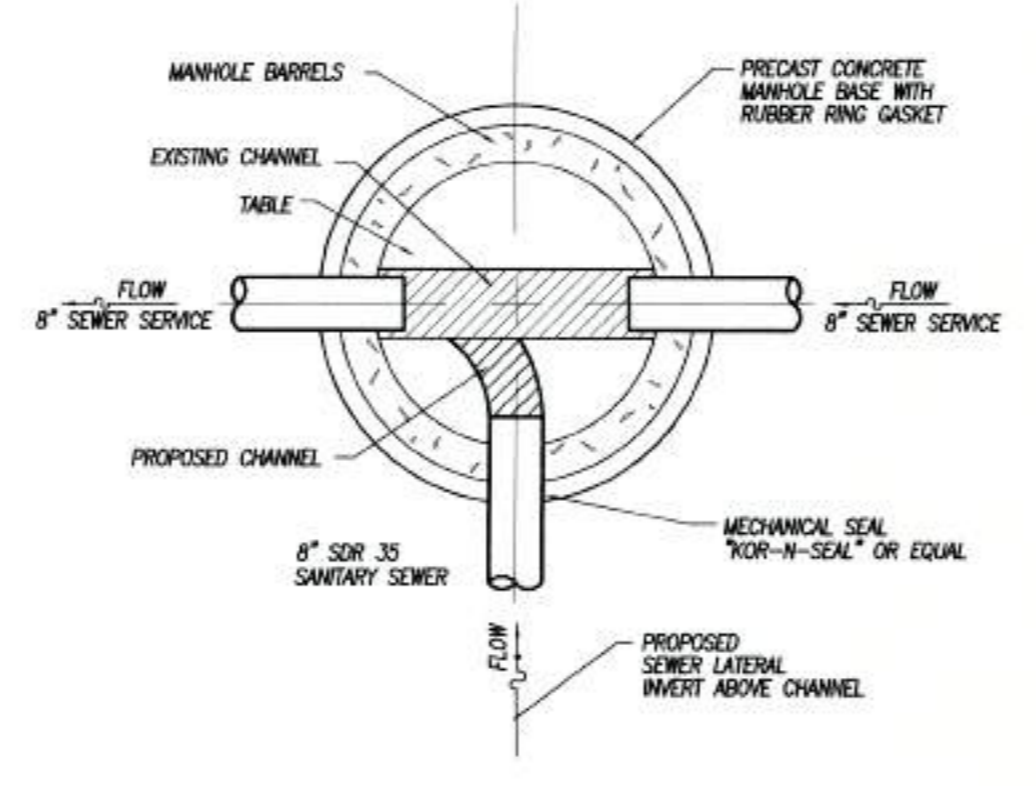


**SEWER CONNECTION AT MANHOLE**  
NOT TO SCALE

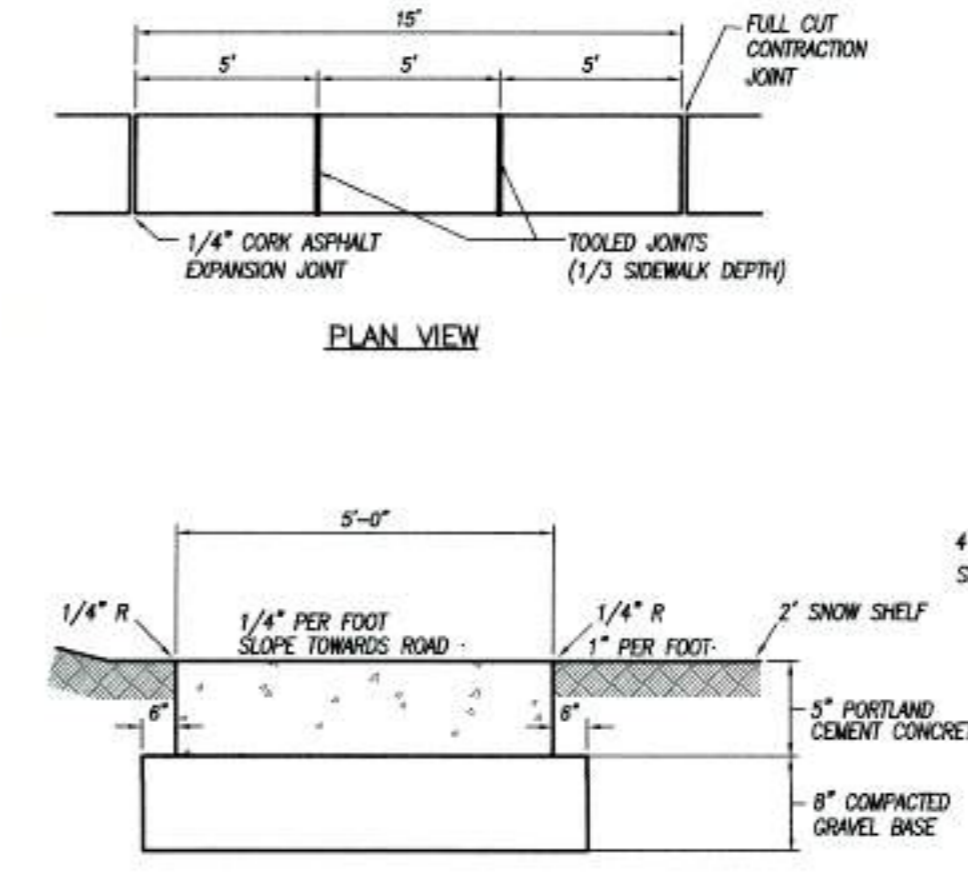


**CONCRETE SIDEWALK DETAIL**  
NOT TO SCALE

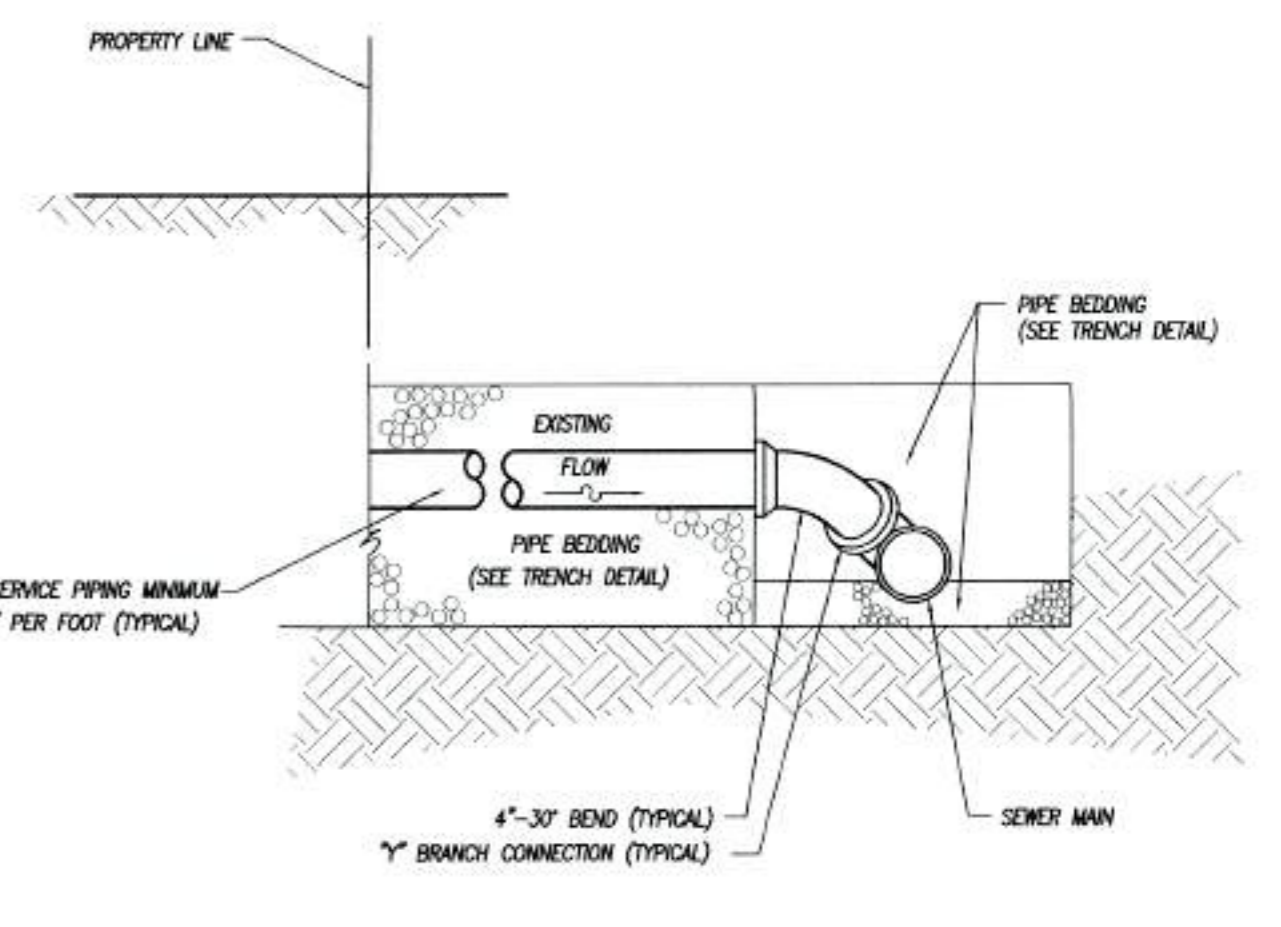

**SEWER CONNECTION DETAIL**  
NOT TO SCALE

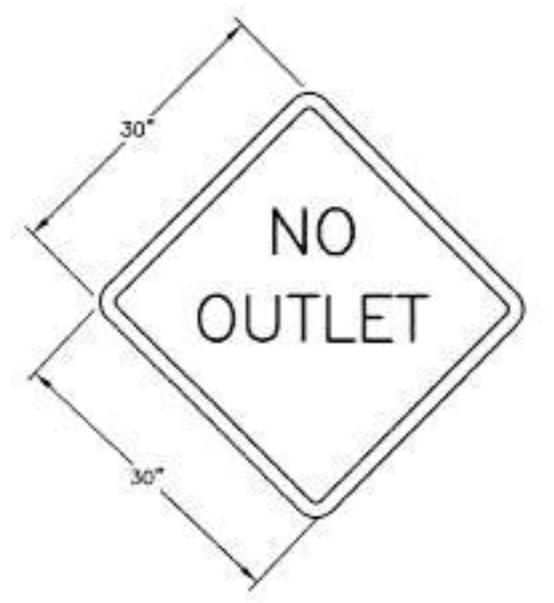


**NO OUTLET SIGN DETAIL**  
NOT TO SCALE  
CTDOT W14-2 (41-4605)  
SETON #44851

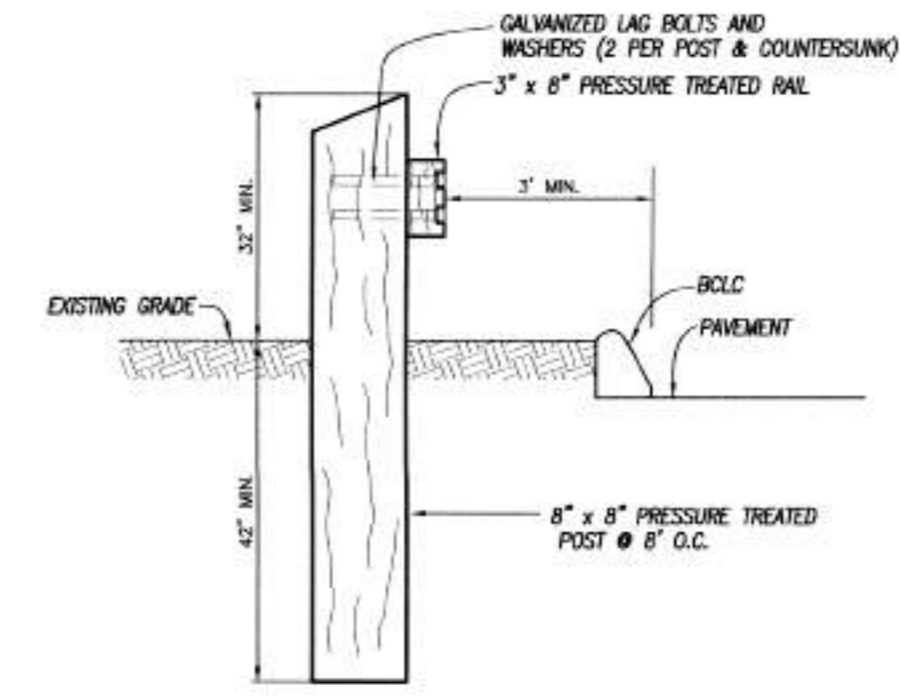


**WOOD GUIDE RAIL**  
NOT TO SCALE

- WOOD POST COMPONENTS SHALL BE SPRUCE OR HEMLOCK, GRADE #2 PRIME OR BETTER.
- POST SHALL BE CERTIFIED 0.6 DCF PRESERVATIVE RETENTION RATE, ANPA CATEGORY U04C.
- PRESERVATIVE SHALL BE WATER BASED AND CONSIST OF COPPER AZOLE TYPE B OR C.

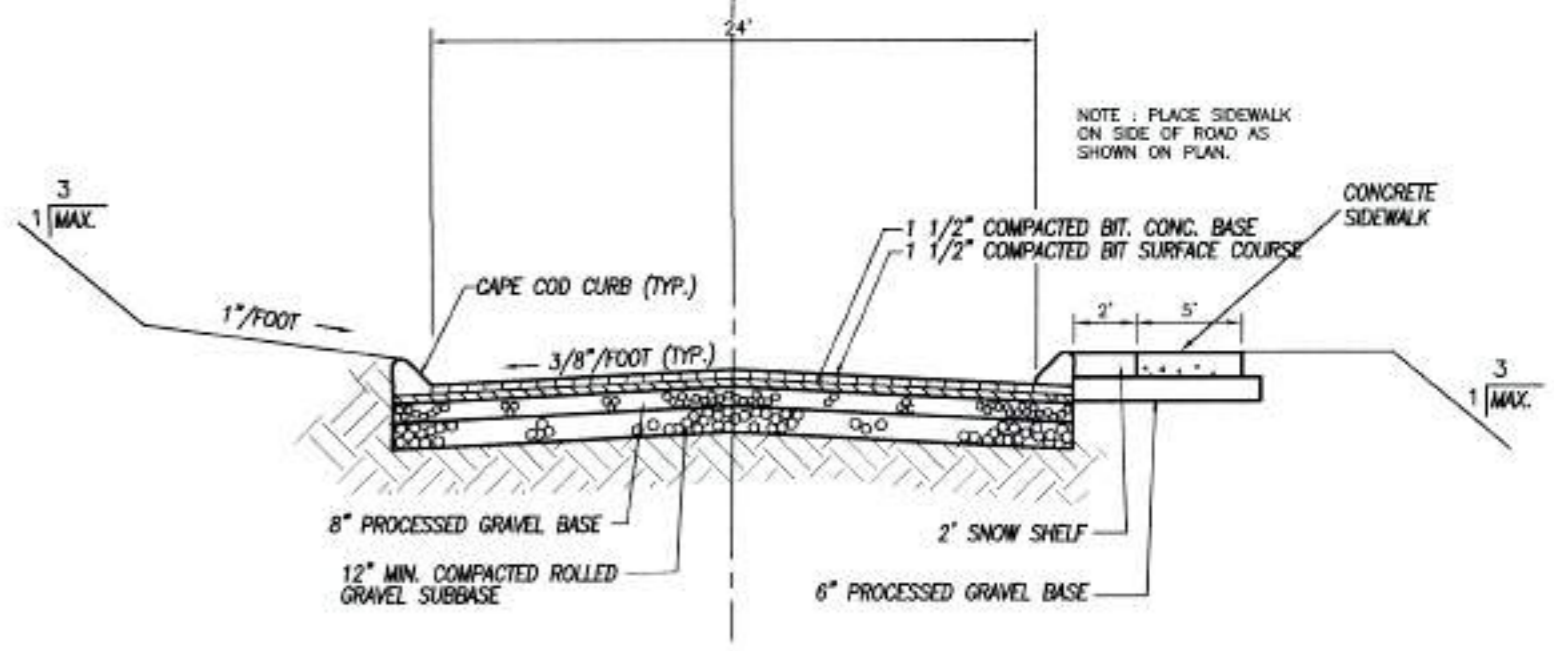

**ROADWAY CROSS SECTION**  
NOT TO SCALE

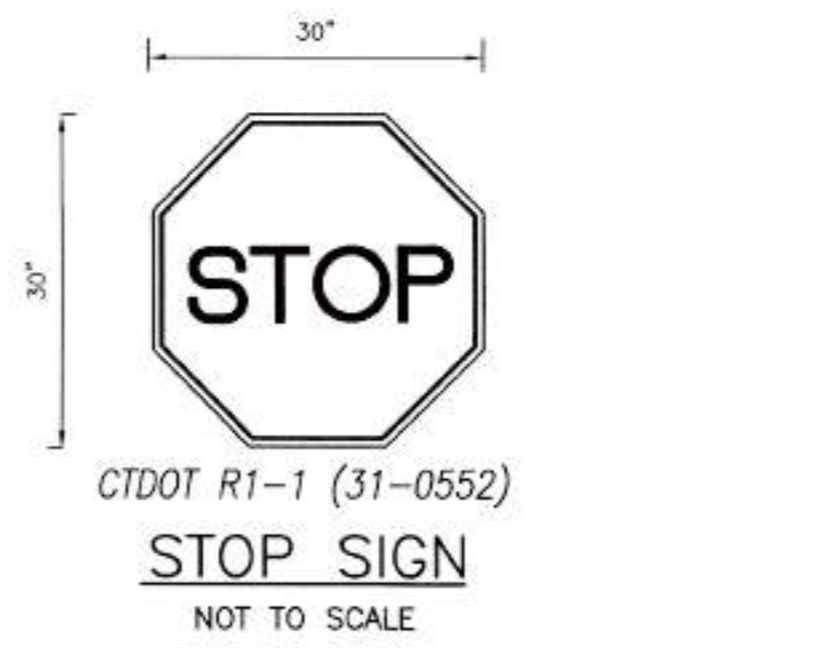


**STOP SIGN**  
NOT TO SCALE  
CTDOT R1-1 (31-0552)



**SPEED LIMIT SIGN DETAIL**  
NOT TO SCALE  
31-5505

- BOLTS - HEX HEAD, INTEGRAL FLANGE CONFORMING TO ASTM A354. -18 UNC X 1.75", GRADE BC FOR 3.00 LBS./FT. POSTS -18 UNC X 2.0", GRADE BD FOR 4.00 LB./FT. POSTS.
- NUTS -18 UNC HEX HEAD, INTEGRAL FLANGE CONFORMING TO ASTM A563, GRADE DH.
- LOCKWASHERS - HEAVY DUTY EXTERNAL TYPE.

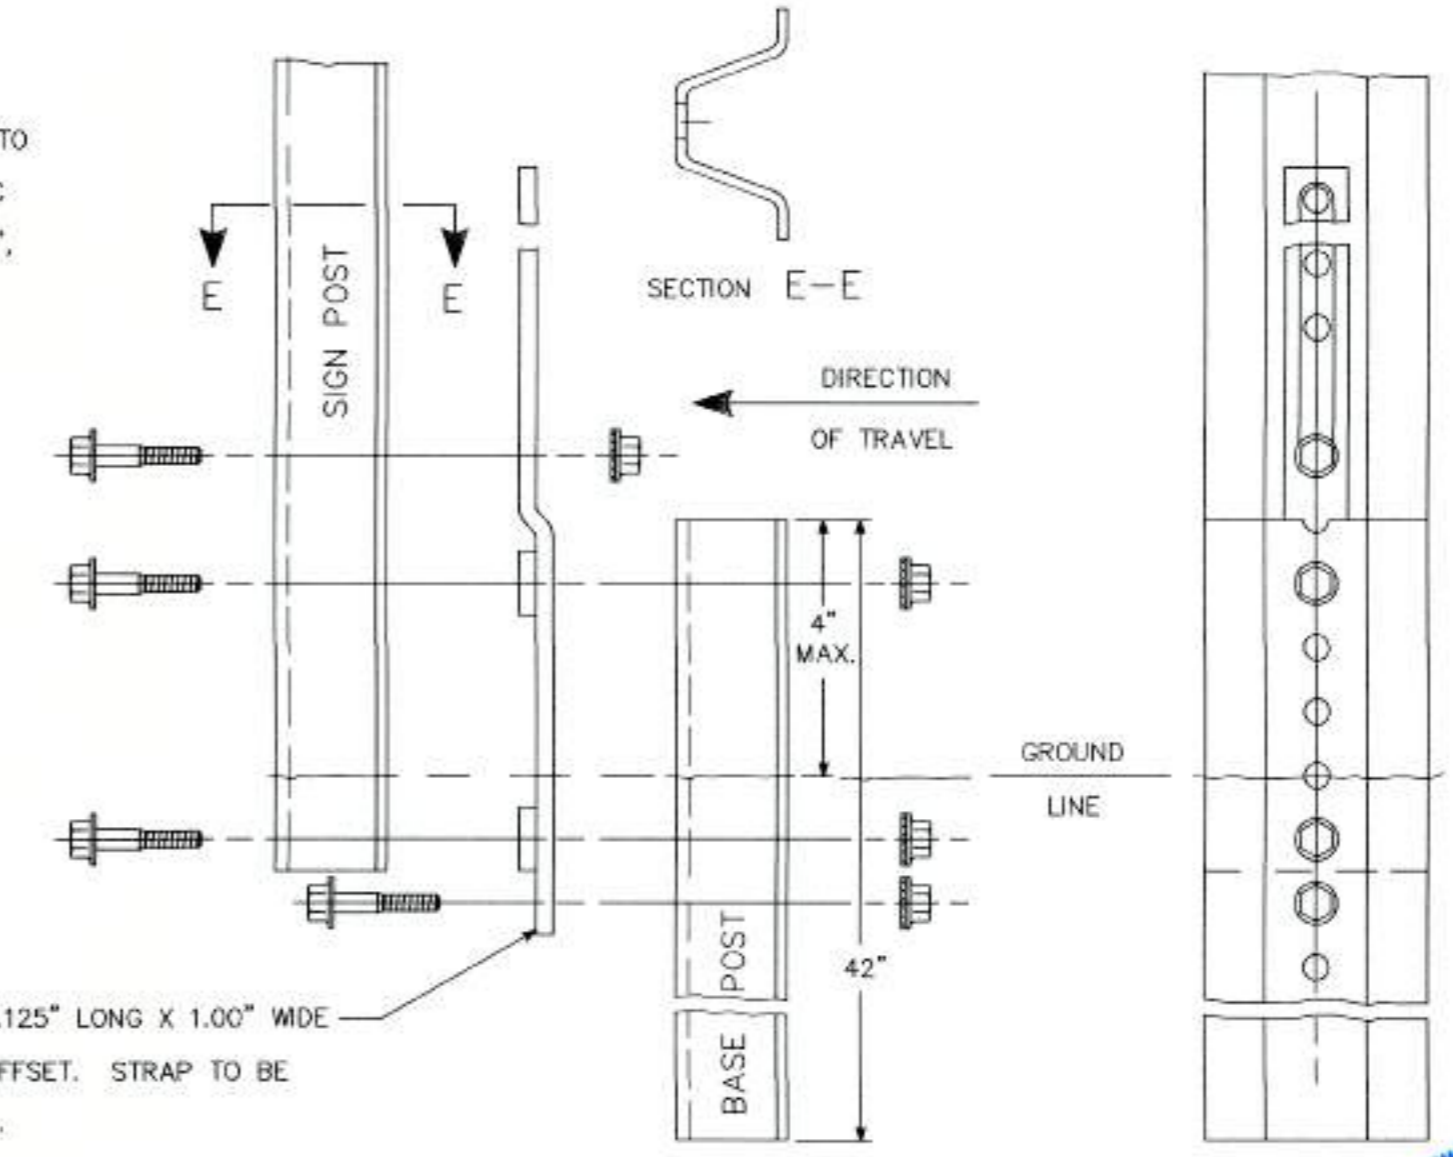

**BREAKAWAY TYPE I INSTALLATION - FOR 3 & 4 LB. POSTS**

RETAINER-SPACER STRAP 17.125" LONG X 1.00" WIDE X .375" THICK WITH .375" OFFSET. STRAP TO BE GALVANIZED TO ASTM A 123.



DATE	DESCRIPTION
08/29/2022	INVC APPLICATION RESUBMISSION
10/26/2021	PHASING / E&S
10/15/2021	CONSULTANT REVIEW & COMMISSION
09/15/2021	TOWN ROAD FRONTAGE
04/20/2021	INVC APPROVAL CONDITIONS
DATE	DESCRIPTION
	REVISIONS


DETAIL SHEET 3  
PREPARED FOR  
**SHANE POLLOCK**  
LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT

**Killingly Engineering Associates**  
Civil Engineering & Surveying

114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 799-7299  
www.killinglyengineering.com


DATE: 4/23/2020	DRAWN: DNE
SCALE: NOT TO SCALE	DESIGN: NET
SHEET: 15 OF 16	CHK BY: GG
DWG. No: CLIENT FILE	JOB No: 20014

K:\2021\15\00014\001\15-20014-001-3.dwg Nov 03, 2022 3:48 PM

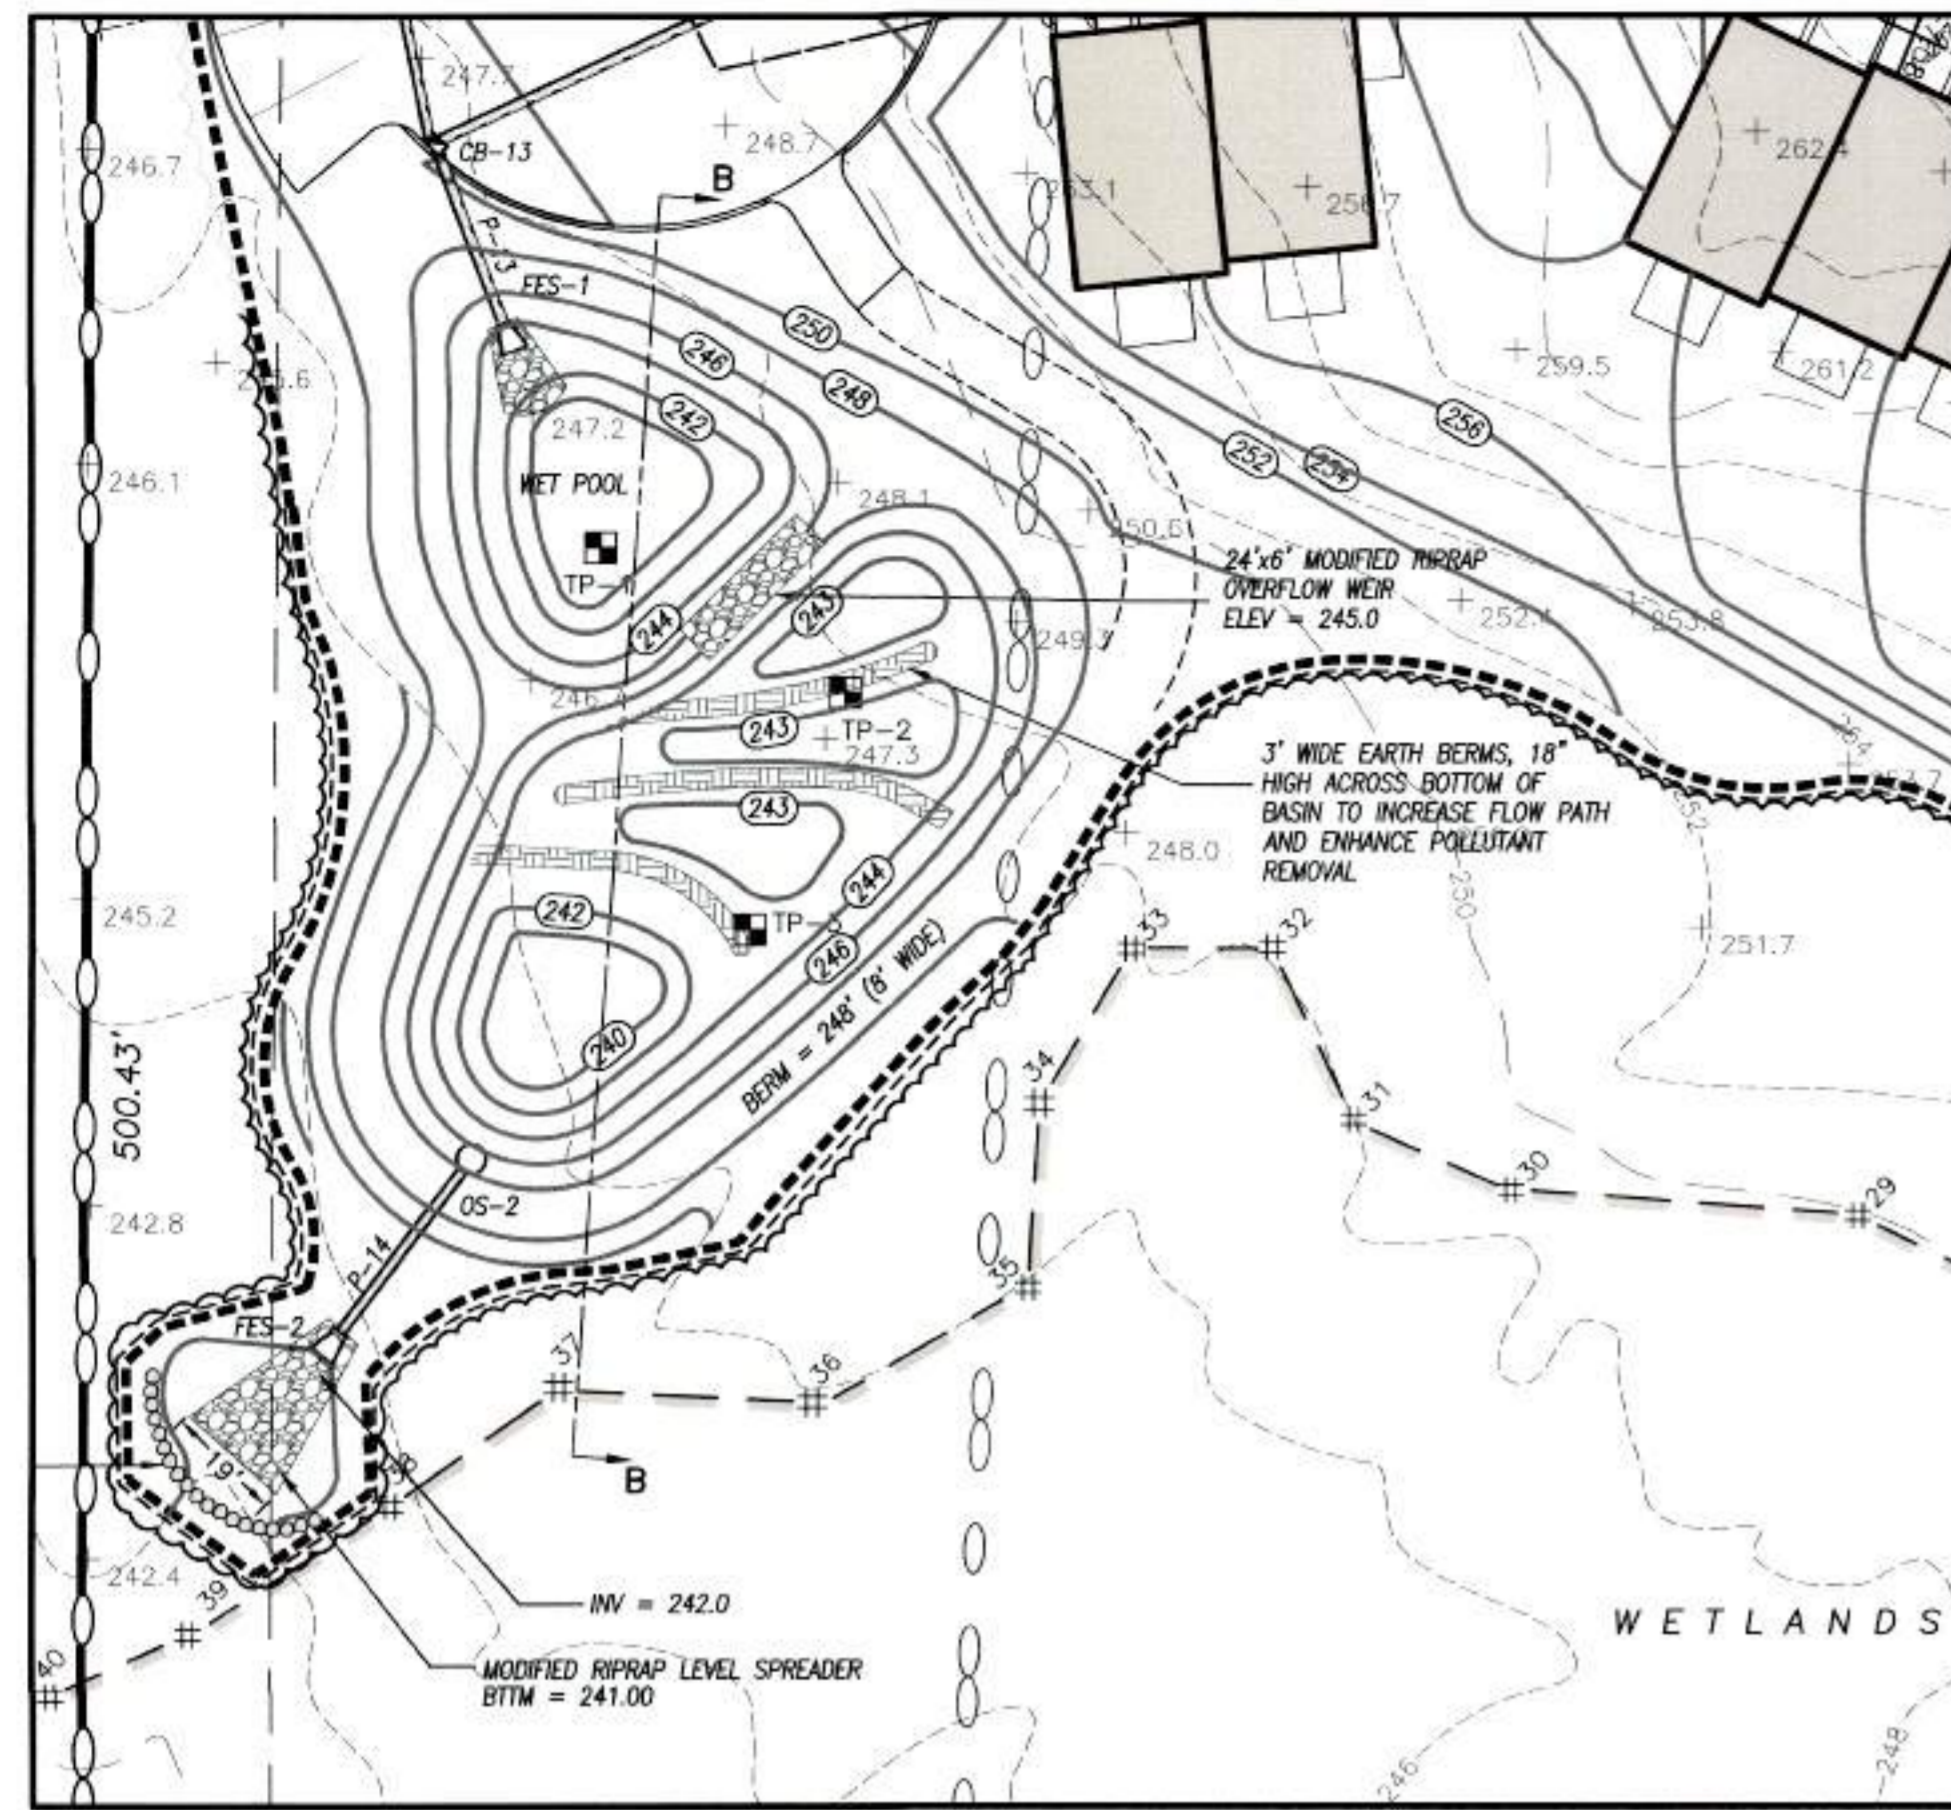


STORMWATER BASIN 2 DETAIL

SCALE: 1"=30'

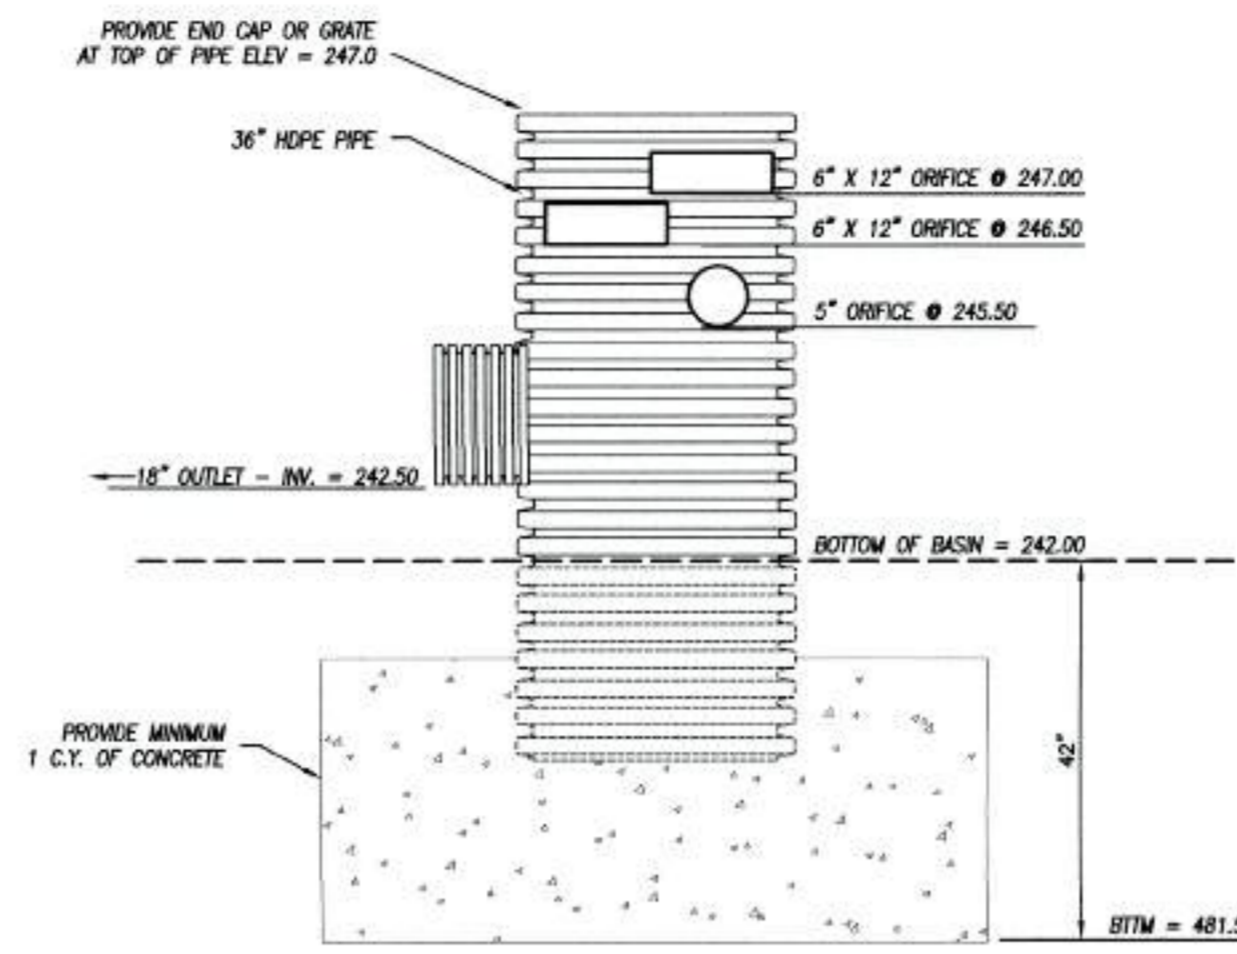


OUTLET STRUCTURE 2 DETAIL


NOT TO SCALE

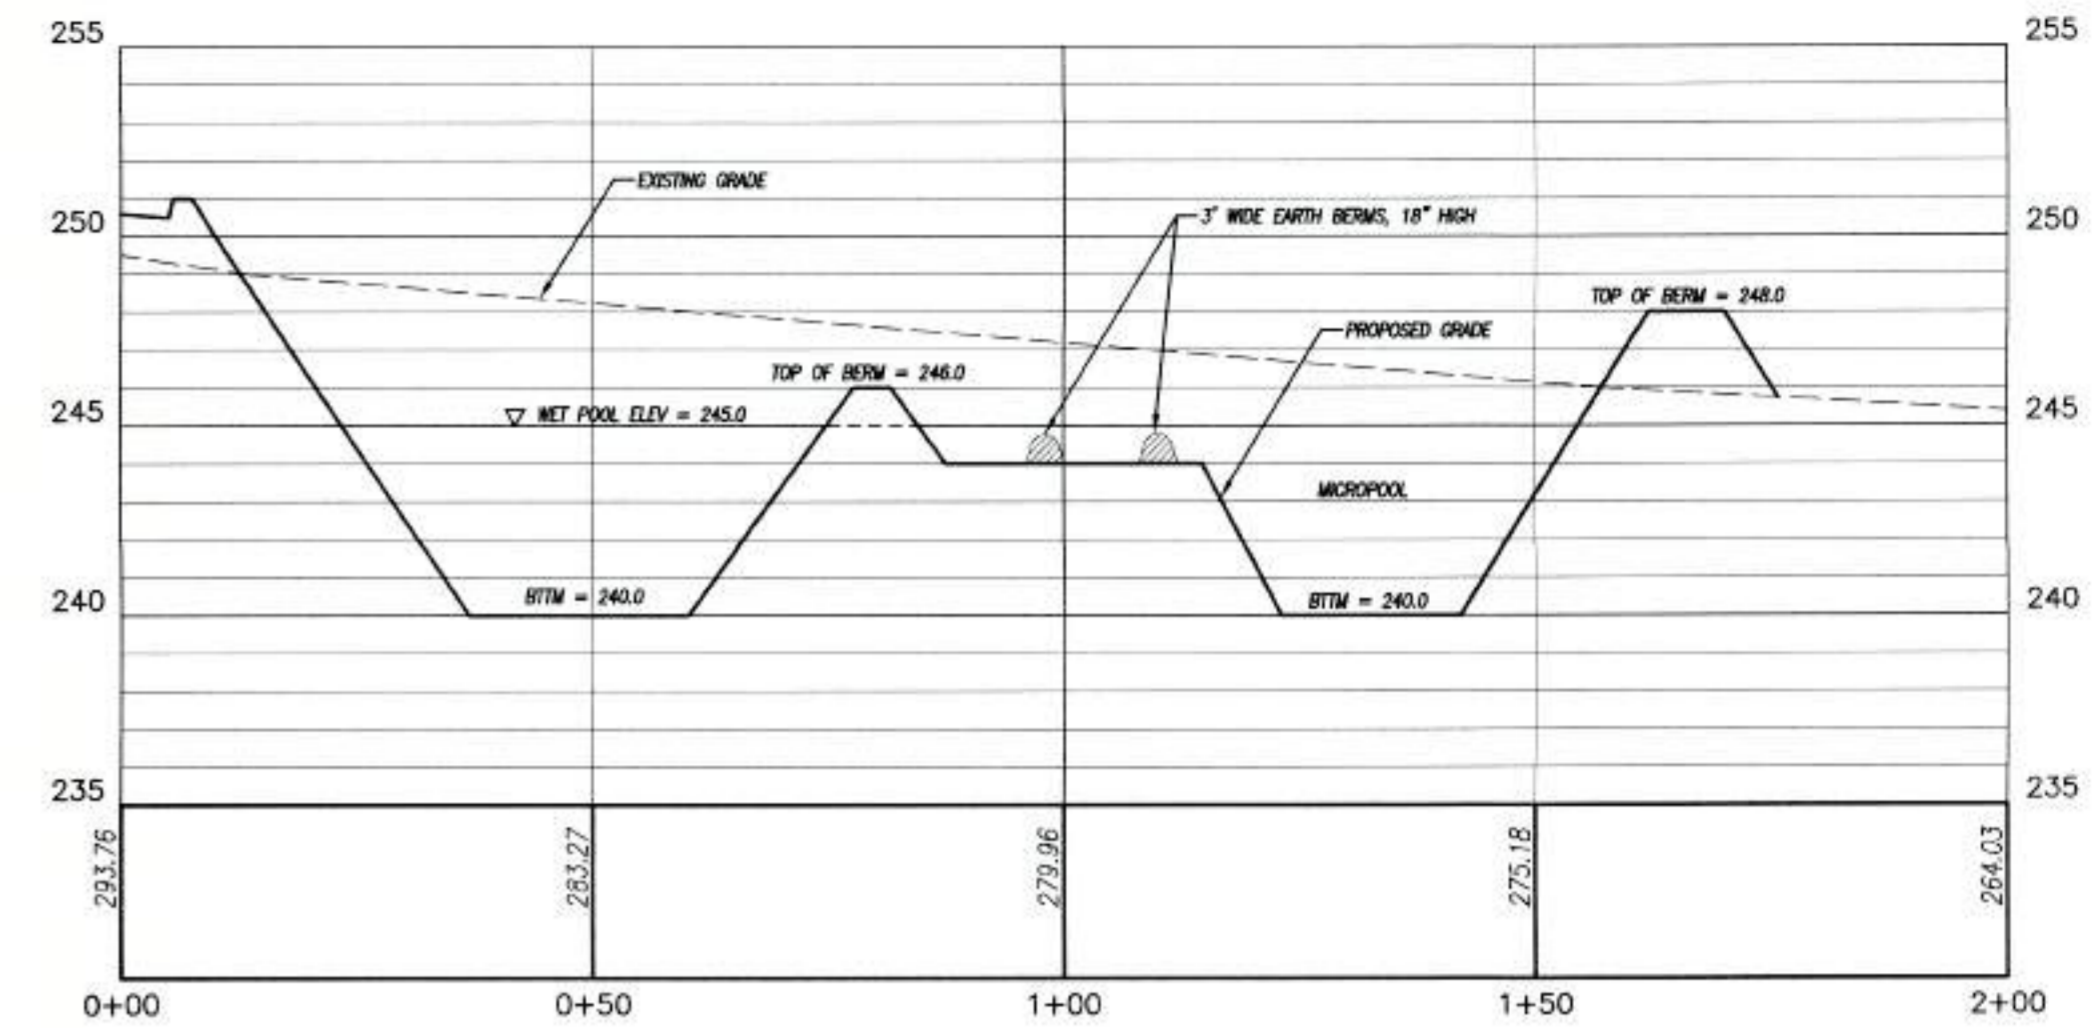

STORMWATER BASIN 2 CROSS SECTION B-B

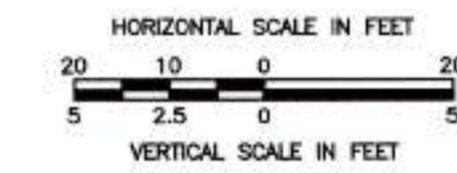


NOTE: THE CONDOMINIUM ASSOCIATION SHALL BE RESPONSIBLE FOR THE MAINTENANCE OF THE ENTIRE STORMWATER SYSTEM

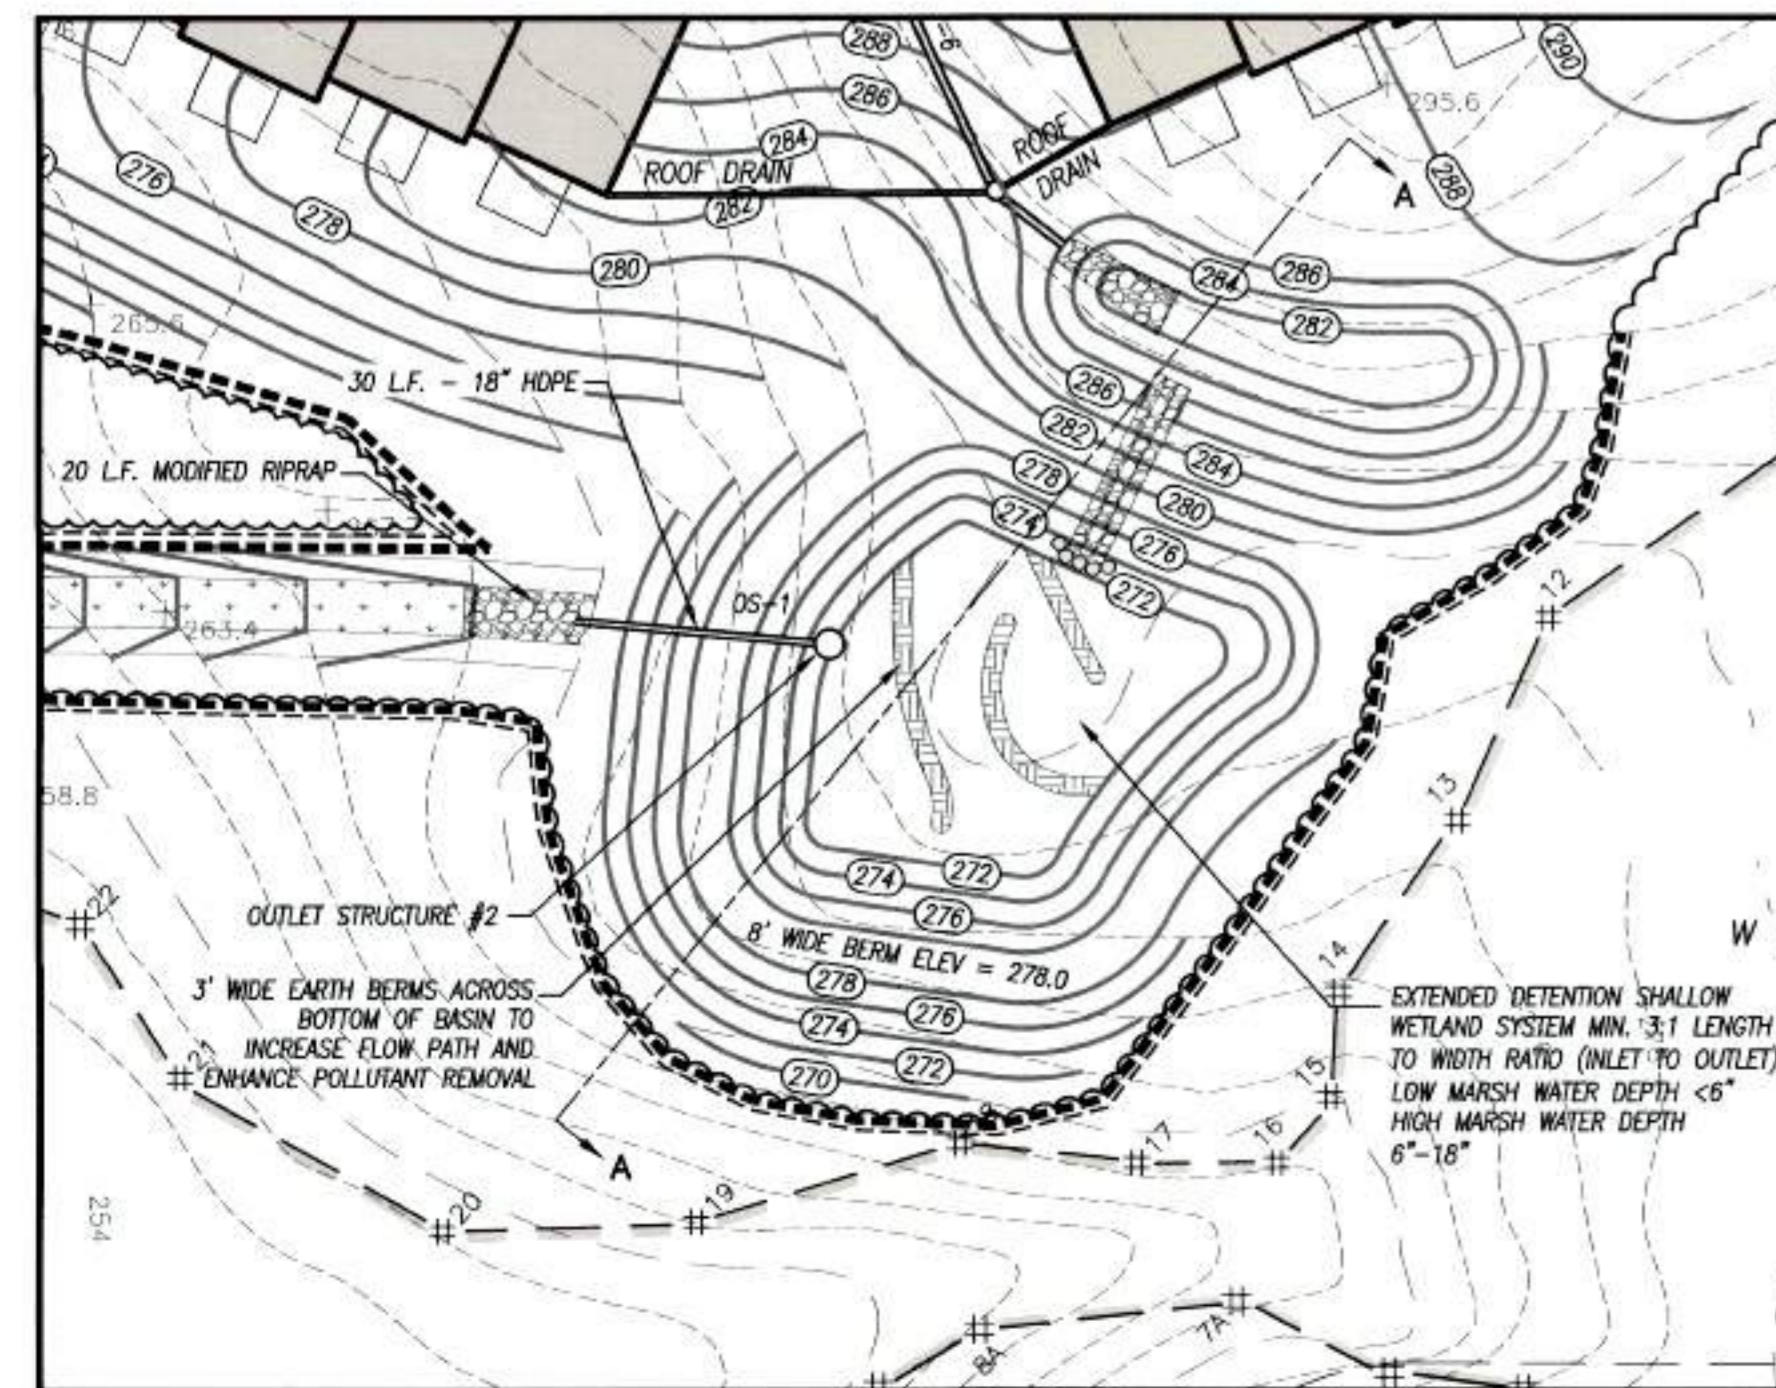


STORMWATER BASIN 1 DETAIL

SCALE: 1"=30'

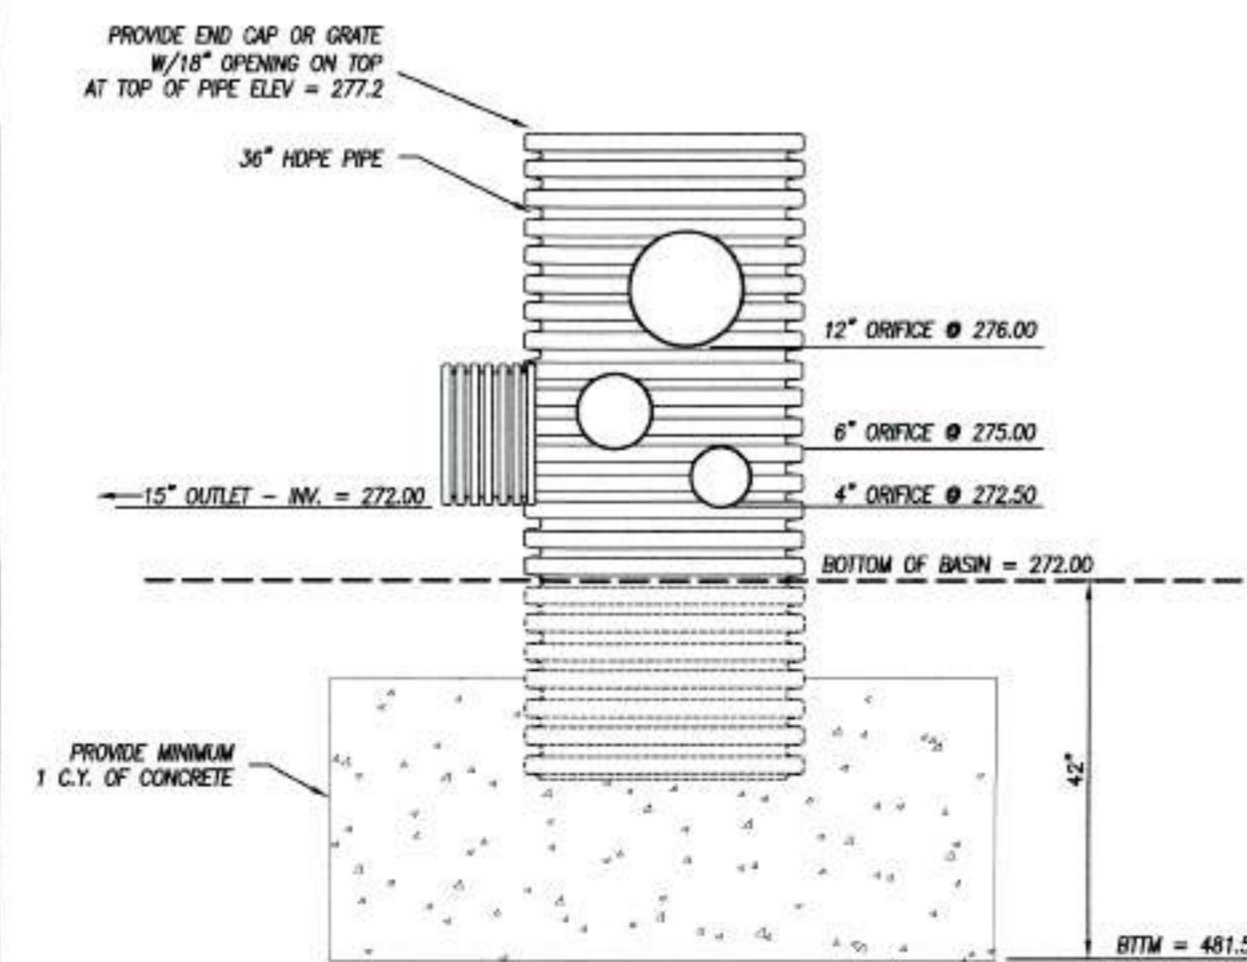


OUTLET STRUCTURE 1 DETAIL

NOT TO SCALE

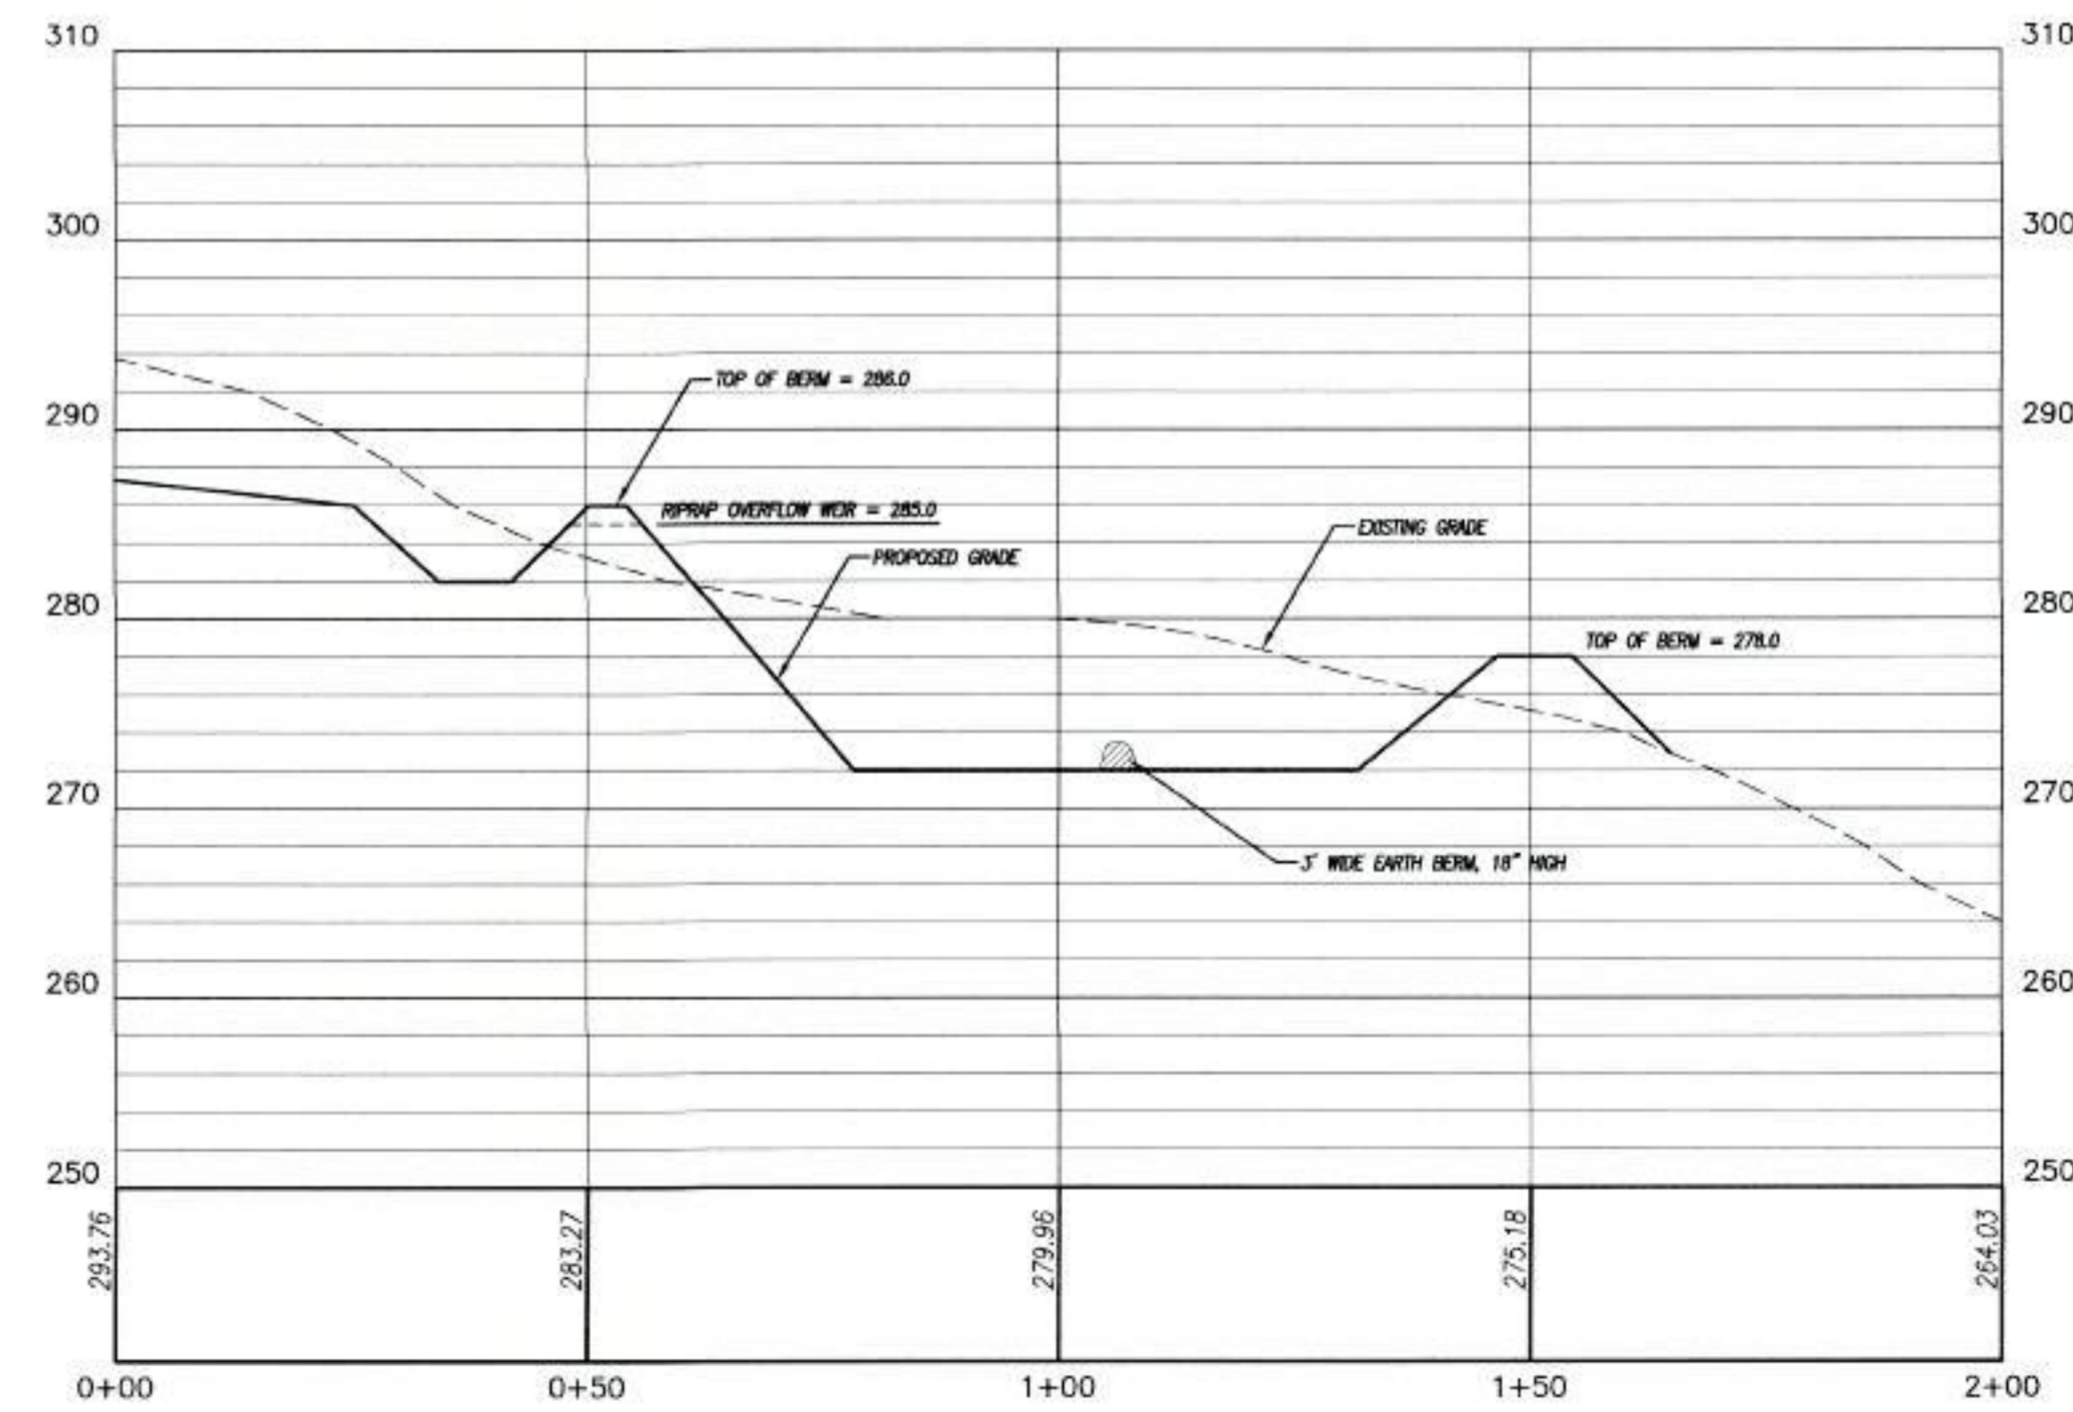

STORMWATER BASIN 1 CROSS SECTION A-A

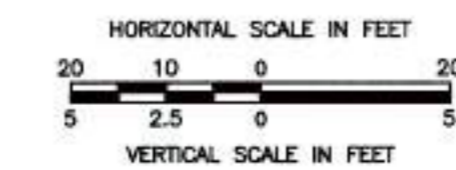

DATE	DESCRIPTION
08/29/2022	INVC APPLICATION RESUBMISSION
10/26/2021	PHASING / EAS
10/15/2021	CONSULTANT REVIEW & COMMISSION
09/15/2021	TOWN ROAD FRONTAGE
04/20/2021	INVC APPROVAL CONDITIONS
DATE	DESCRIPTION
	REVISIONS

DETAIL SHEET 4  
PREPARED FOR  
**SHANE POLLOCK**

LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT

**Killingly Engineering Associates**  
Civil Engineering & Surveying


114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 779-7299  
www.killinglyengineering.com

DATE: 4/23/2020	DRAWN: DNE
SCALE: NOT TO SCALE	DESIGN: NET
SHEET: 16 OF 16	CHK BY: GG
DWG. No: CLIENT FILE	JOB No: 20014

*Norman E. Thebaault, Jr.*  
NORMAN E. THEBAULT, JR., P.E.  
LIC #PEN 0022834






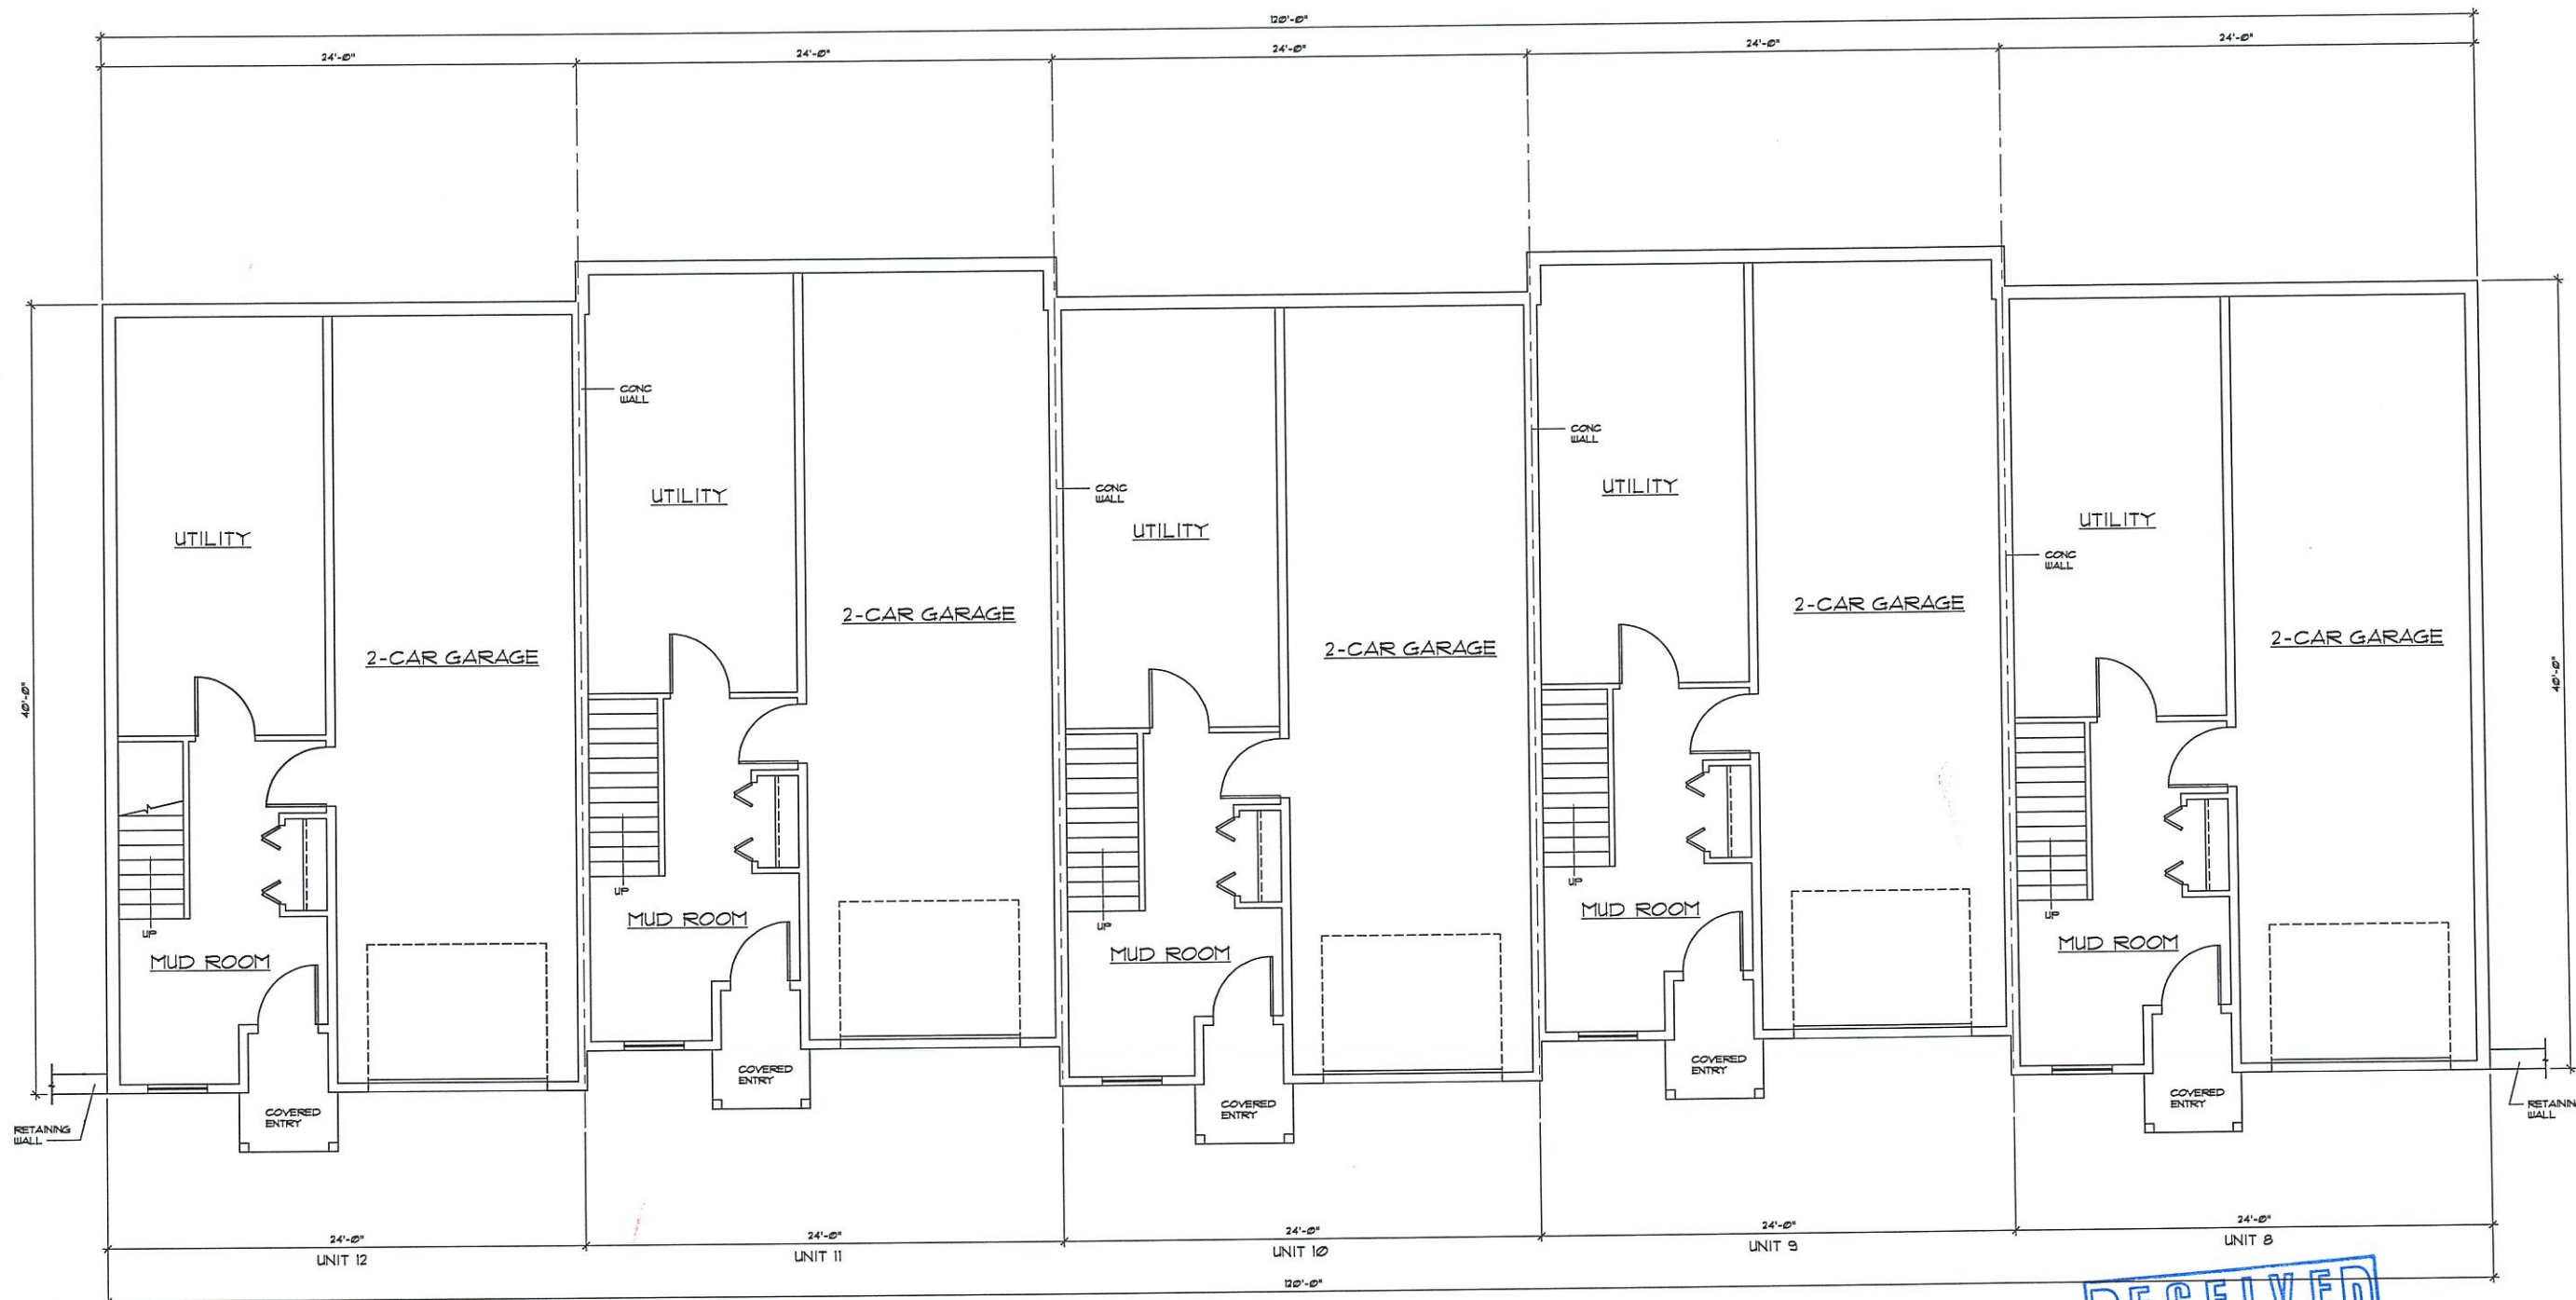


LOWER LEVEL


**RECEIVED**  
 DEC 06 2022  
 By \_\_\_\_\_

USE GROUP: R-2	 <b>NTH</b> DESIGN, LLC BROOKLYN, CONNECTICUT 1-860-450-6443	UNITS 8-12 FOR <b>SHANE POLLOCK</b> LOUISE BERRY DRIVE, BROOKLYN, CONNECTICUT	SCALE: 1/4"=1'-0"
CONSTRUCTION TYPE: 5-B UNPROTECTED		LOWER LEVEL FLOOR PLAN	DATE: 7-26-22 JOB NO: 21000 SHEET NUMBER: <b>A-1</b>

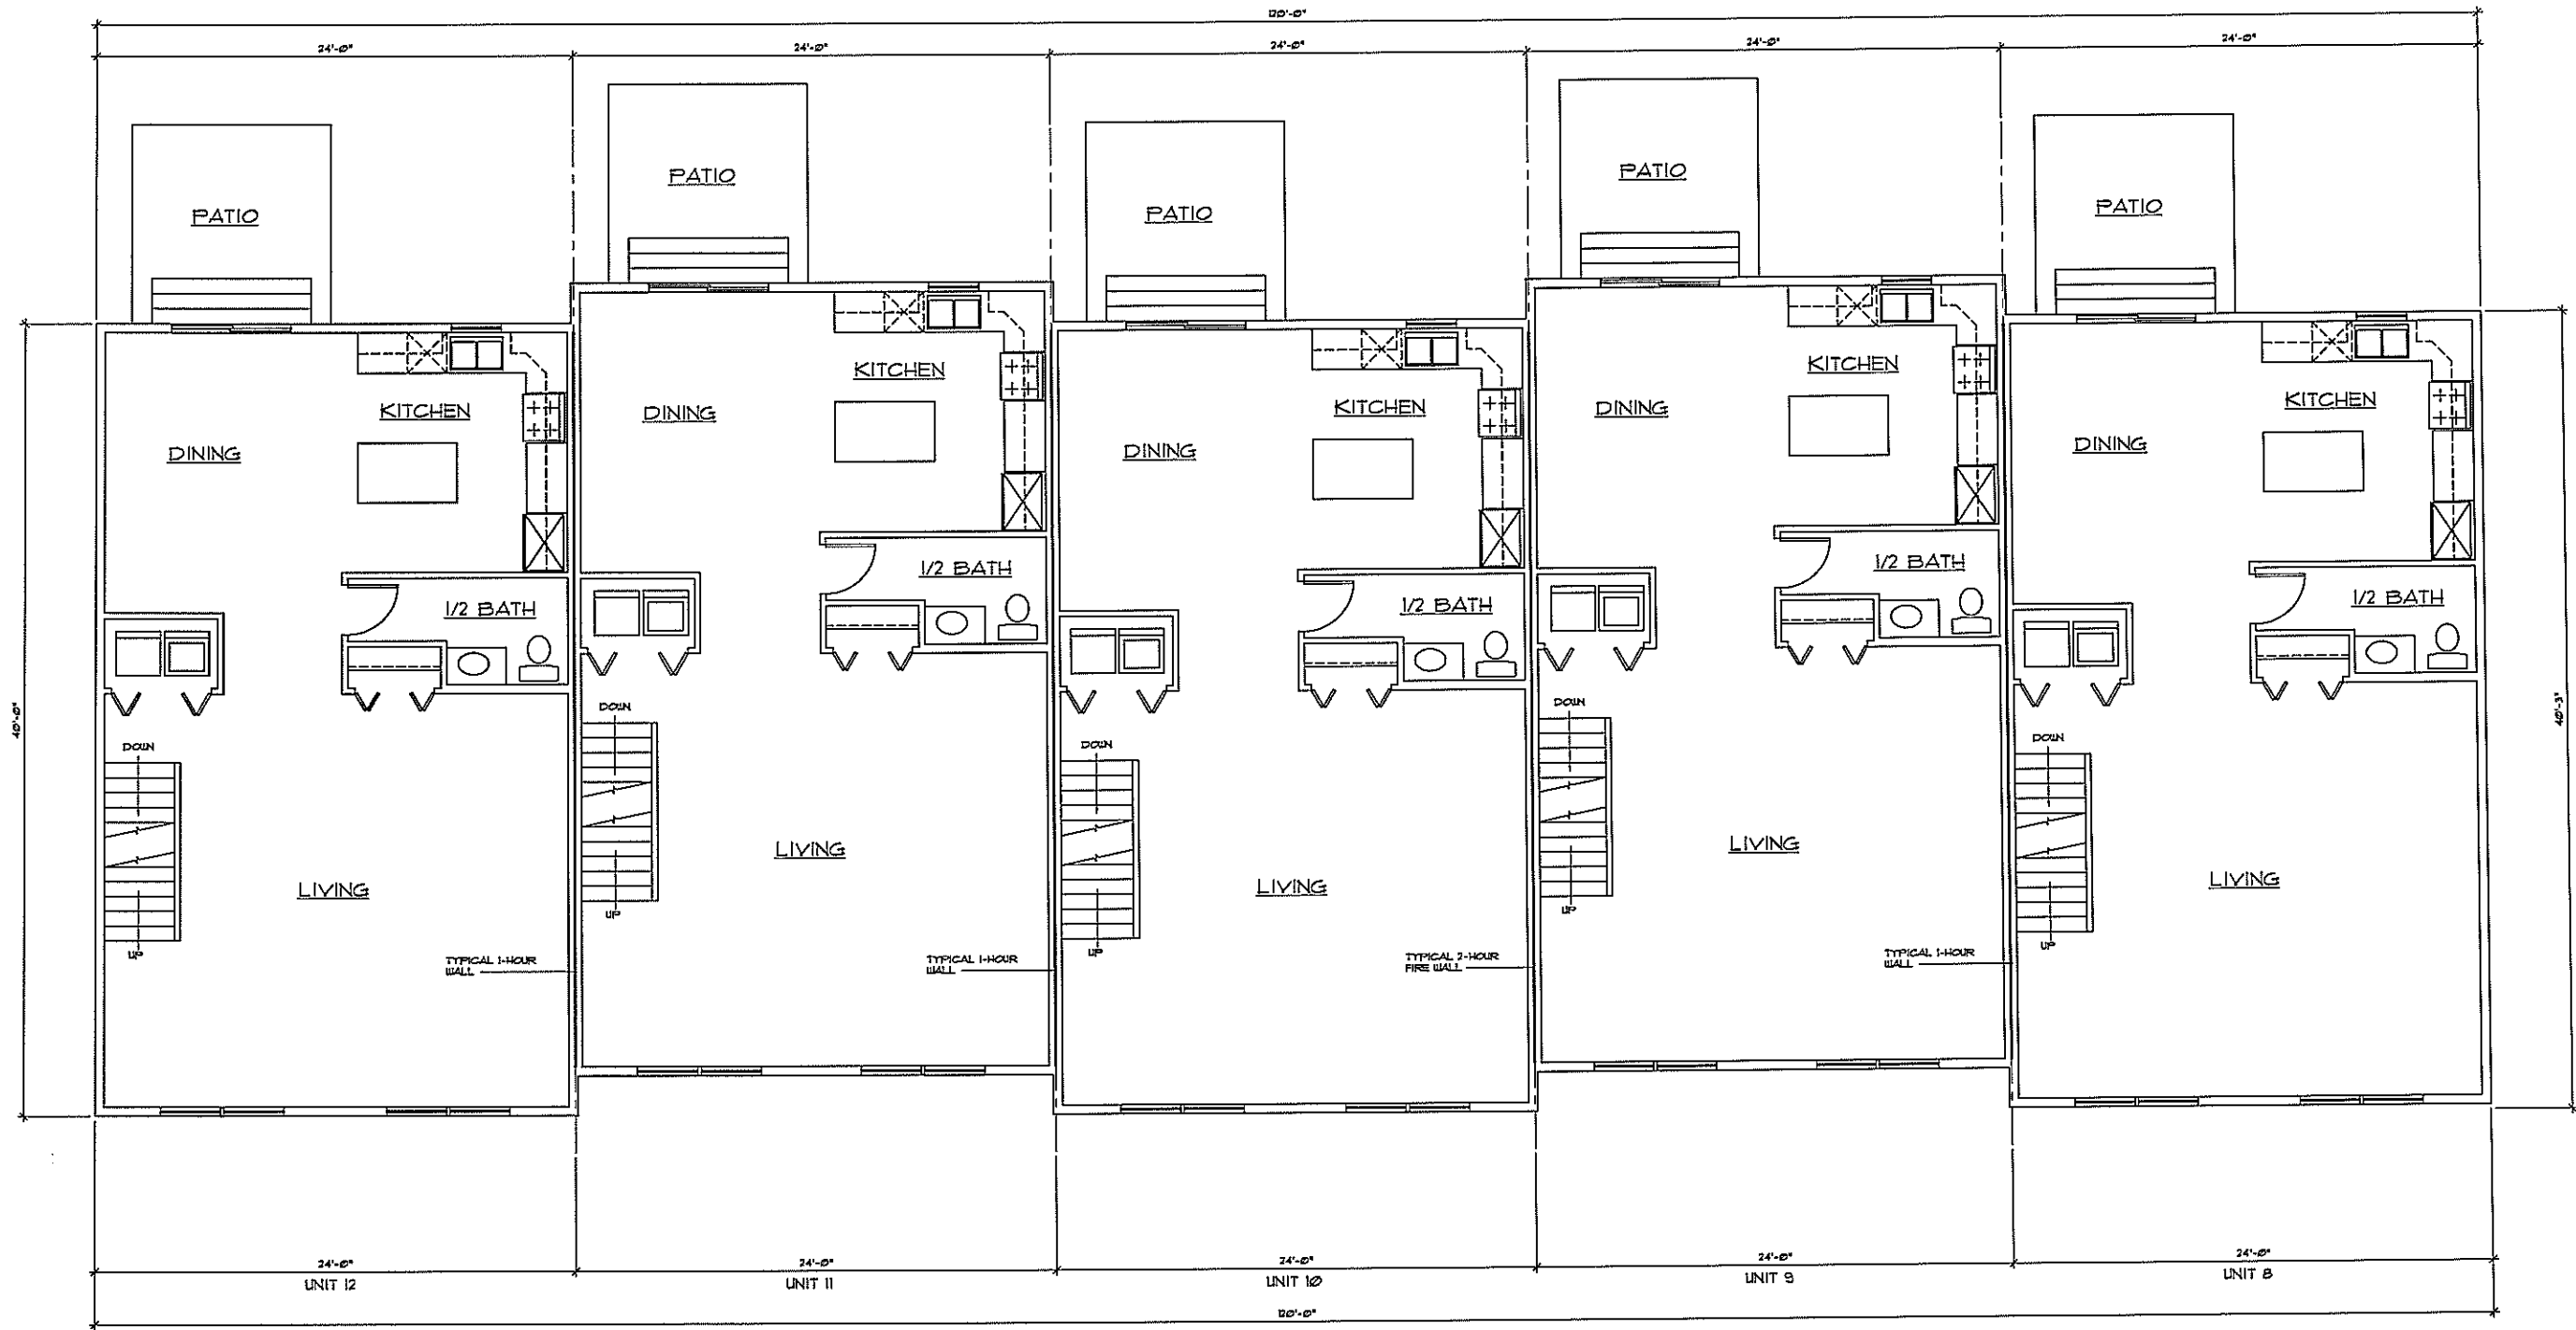


MAIN LEVEL

USE GROUP: R-2	 BROOKLYN, CONNECTICUT 1-860-450-6443	UNITS 8-12 FOR <b>SHANE POLLOCK</b> LOUISE BERRY DRIVE, BROOKLYN, CONNECTICUT	SCALE: 1/4"=1'-0"
CONSTRUCTION TYPE: 5-B UNPROTECTED		MAIN LEVEL FLOOR PLAN	DATE: 7-26-22 JOB NO: 21000 SHEET NUMBER: A-2

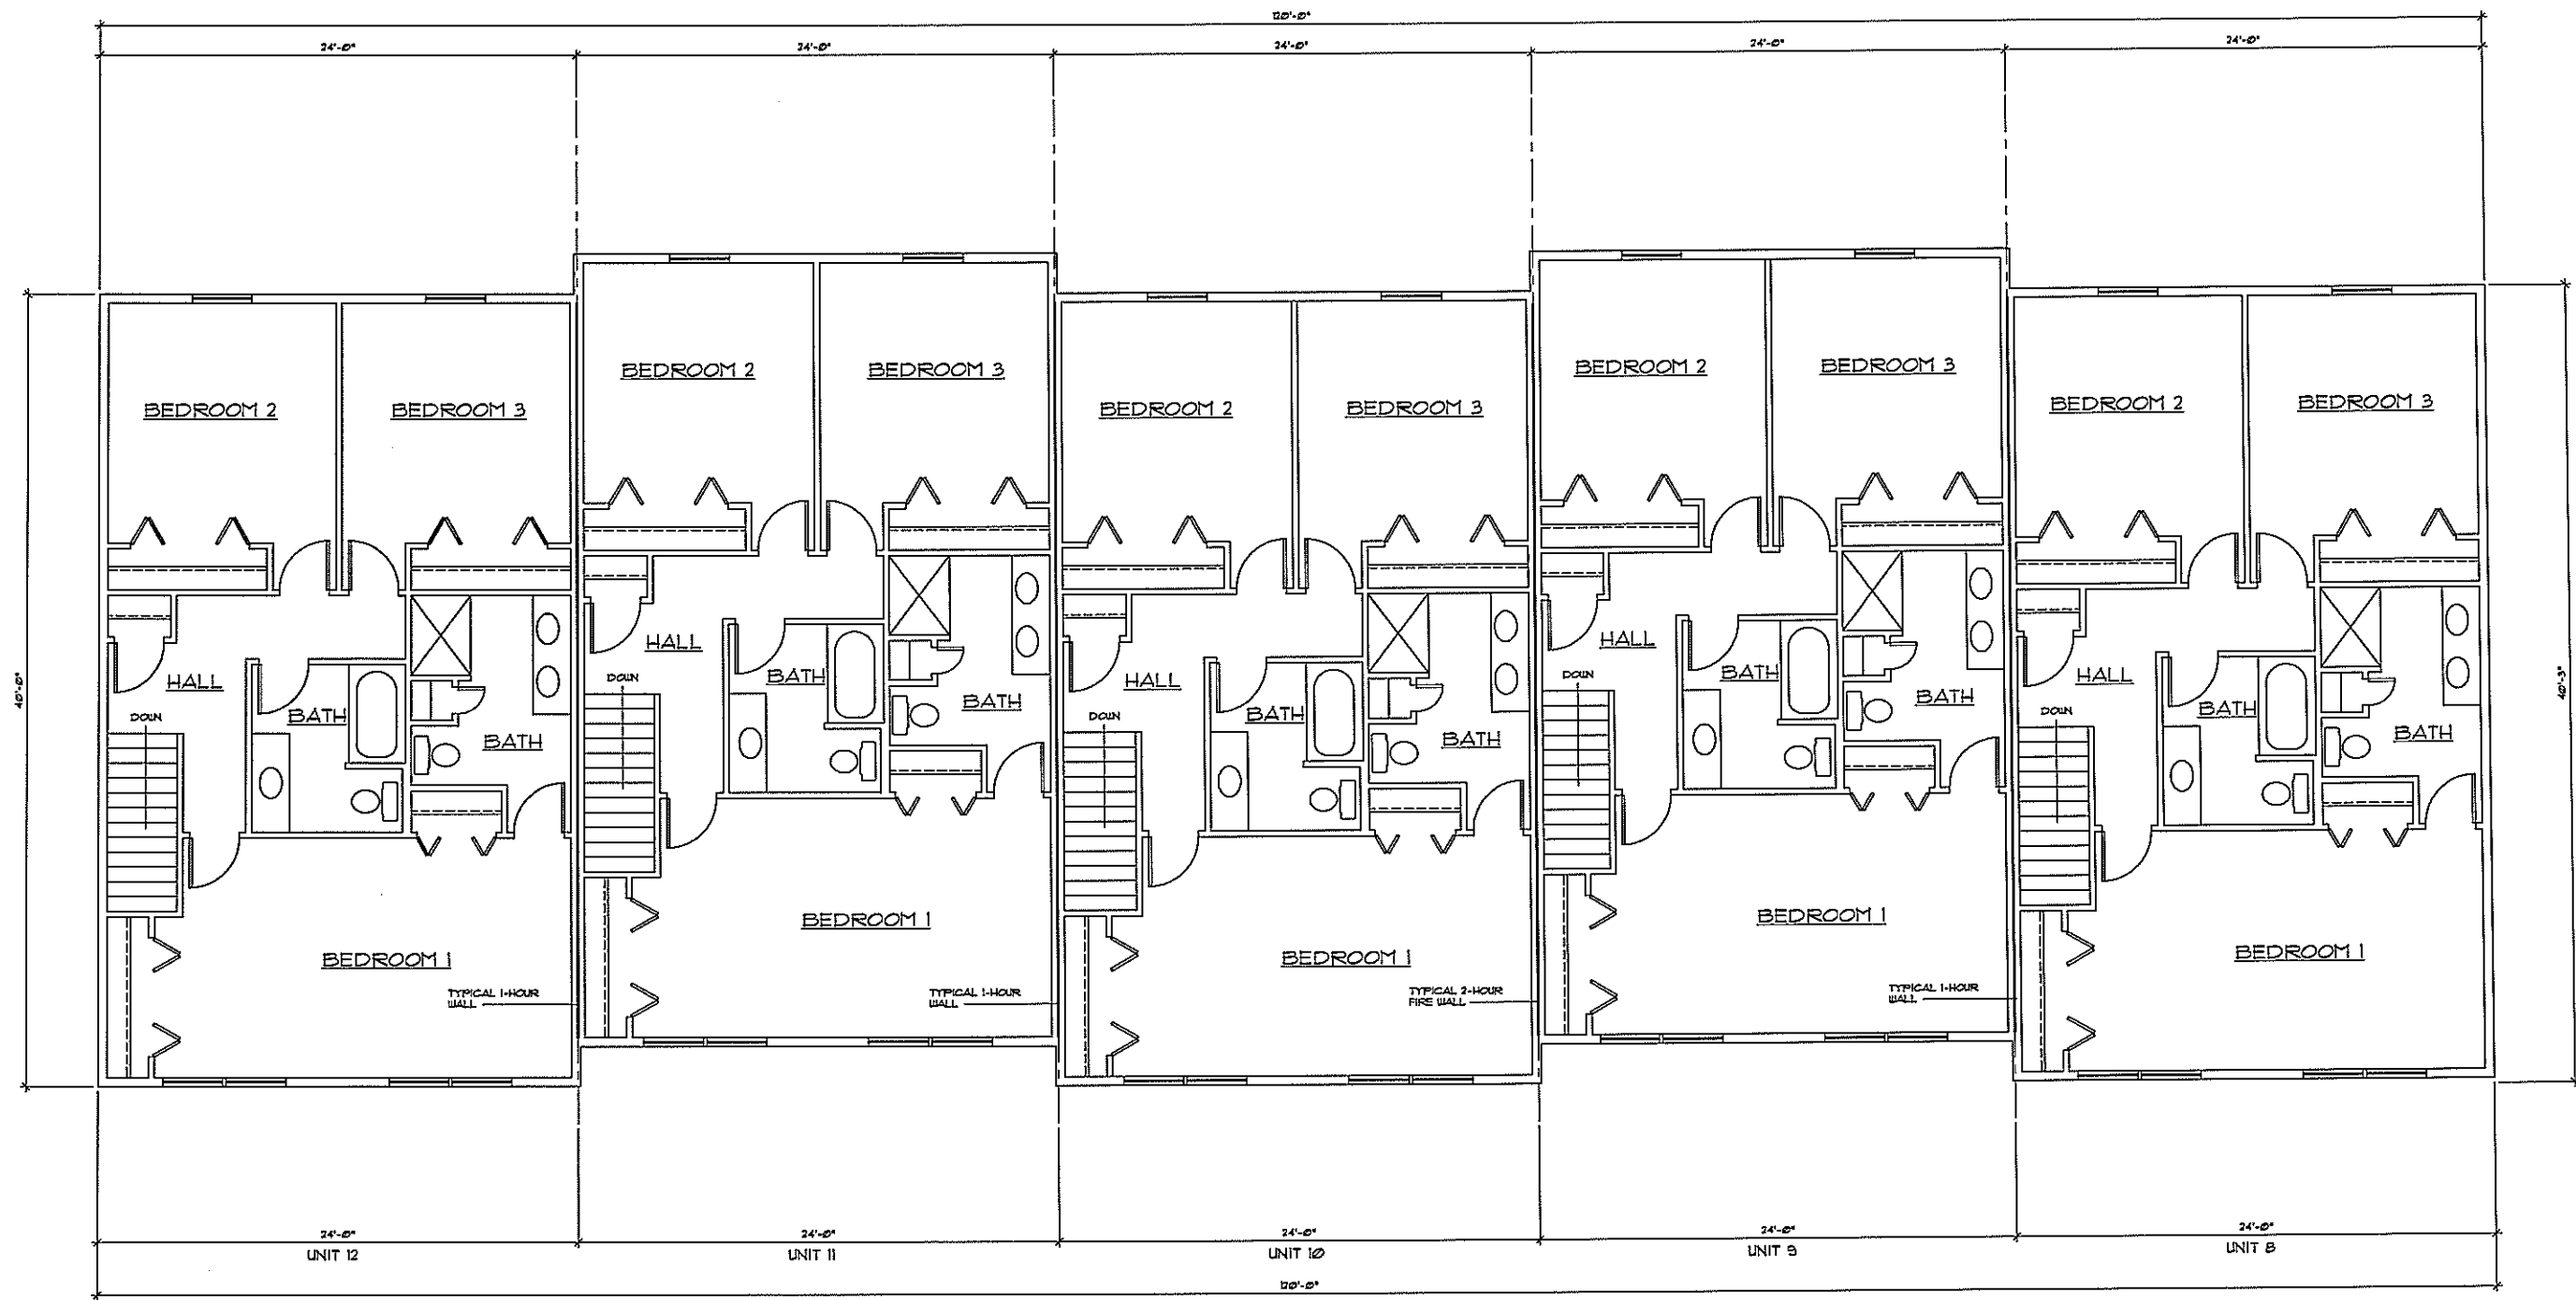


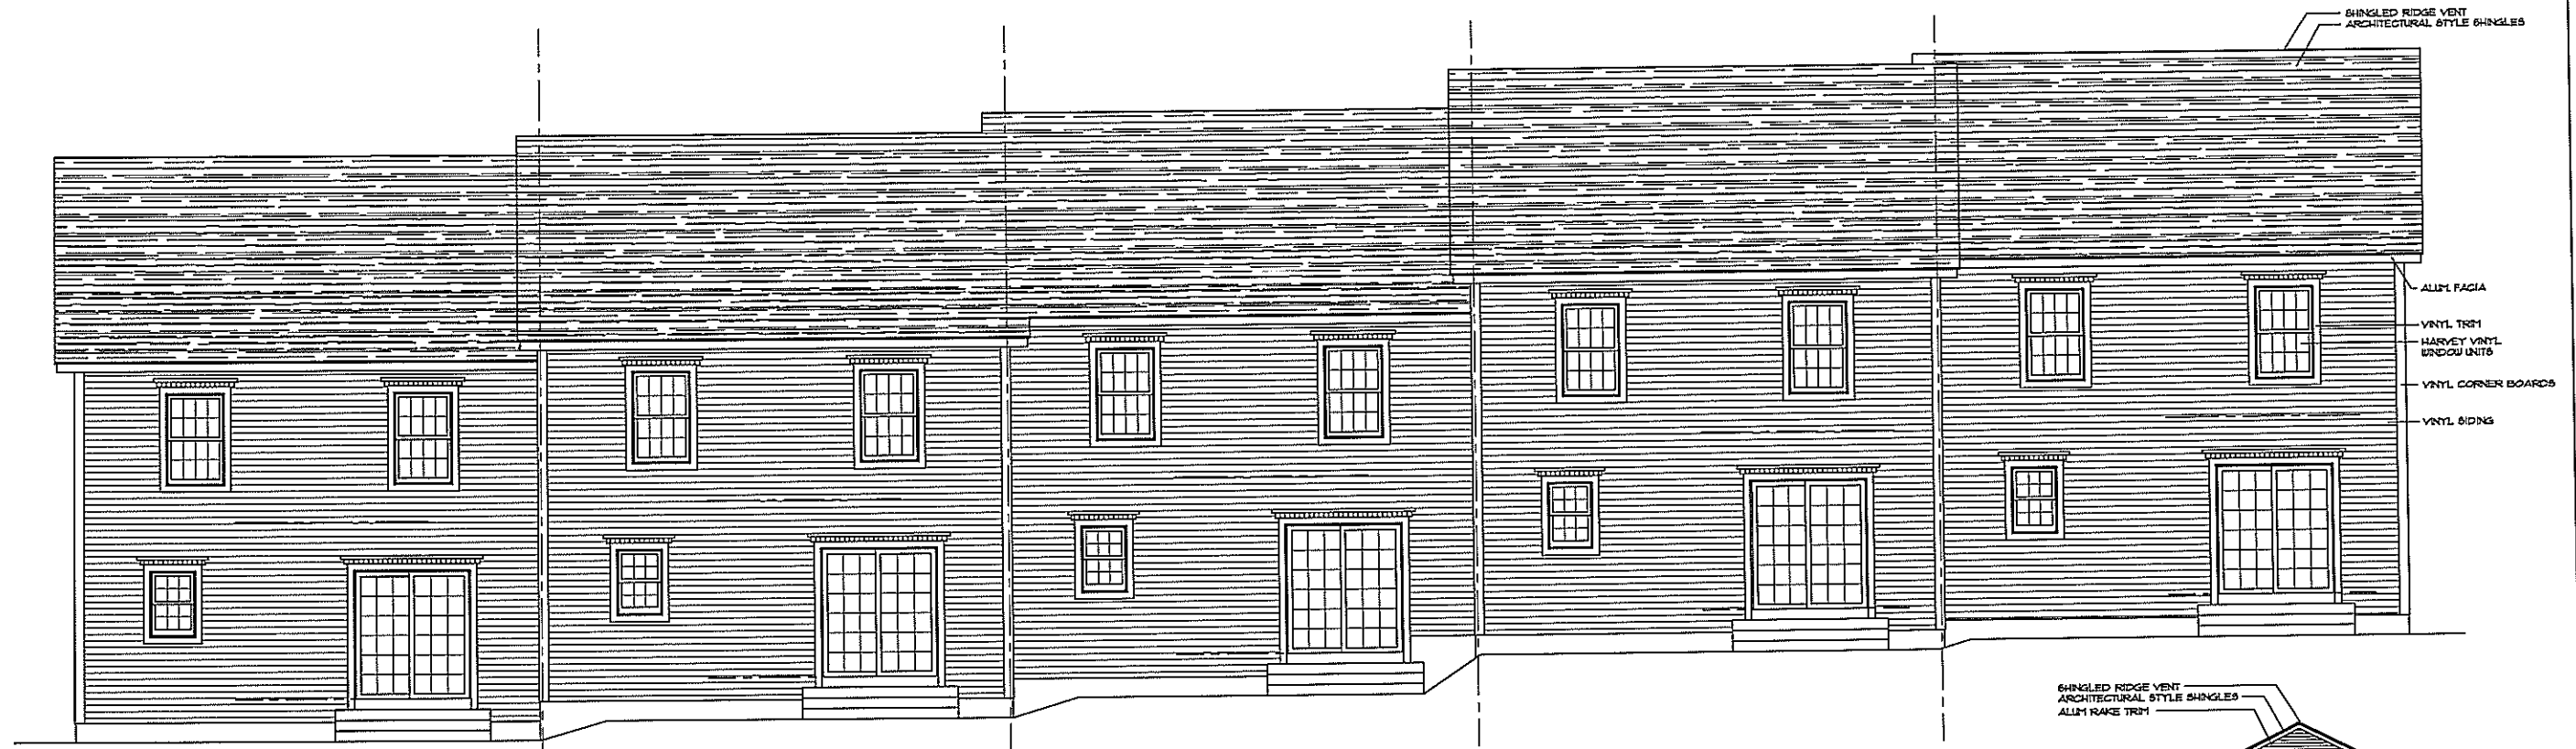
UPPER LEVEL

USE GROUP: R-2	 NTH DESIGN, LLC BROOKLYN, CONNECTICUT 1-860-450-6443	UNITS 8-12 FOR <b>SHANE POLLOCK</b> LOUISE BERRY DRIVE, BROOKLYN, CONNECTICUT	SCALE: 1/4"=1'-0"
CONSTRUCTION TYPE: 5-B UNPROTECTED		UPPER LEVEL FLOOR PLAN	DATE: 7-26-22 JOB NO: 21000 SHEET NUMBER: <b>A-3</b>




FRONT ELEVATION

USE GROUP: R-2	 BROOKLYN, CONNECTICUT 1-860-450-6443	UNITS 8-12 FOR <b>SHANE POLLOCK</b> LOUISE BERRY DRIVE, BROOKLYN, CONNECTICUT	SCALE: 1/4"=1'-0"
CONSTRUCTION TYPE: 5-B UNPROTECTED		FRONT ELEVATION	DATE: 7-26-22
		JOB NO: 21000	
		SHEET NUMBER: A-4	




REAR ELEVATION

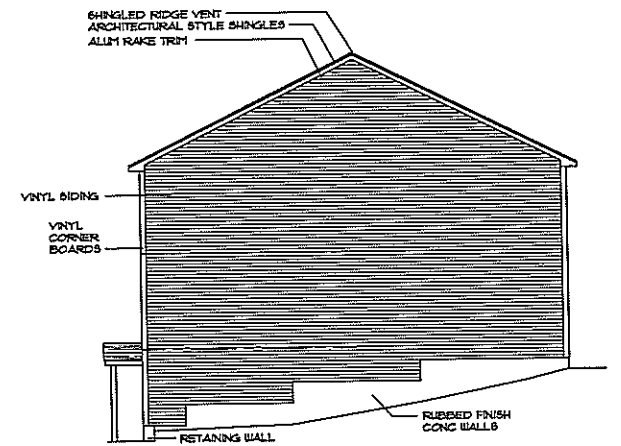


SIDE ELEVATION

SCALE: 1/8"=1'-0"

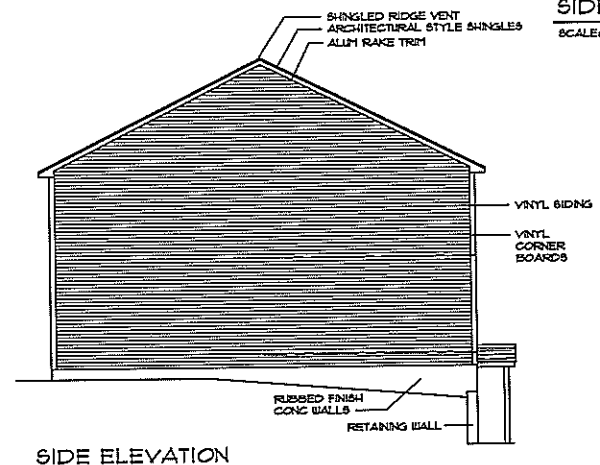

SIDE ELEVATION


SCALE: 1/8"=1'-0"

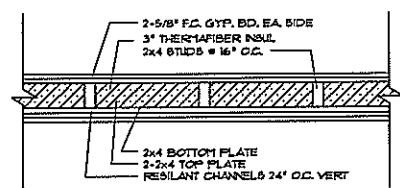

TYPICAL 2 HR FIRE WALL DETAIL

SCALE: 1/4"=1'-0"


UL DESIGN U334

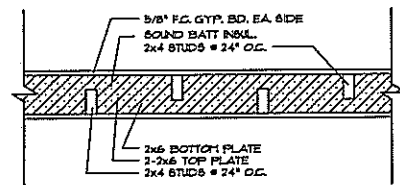

TYPICAL 1 HR PARTY WALL DETAIL

SCALE: 1/4"=1'-0"

DESIGN NO U340

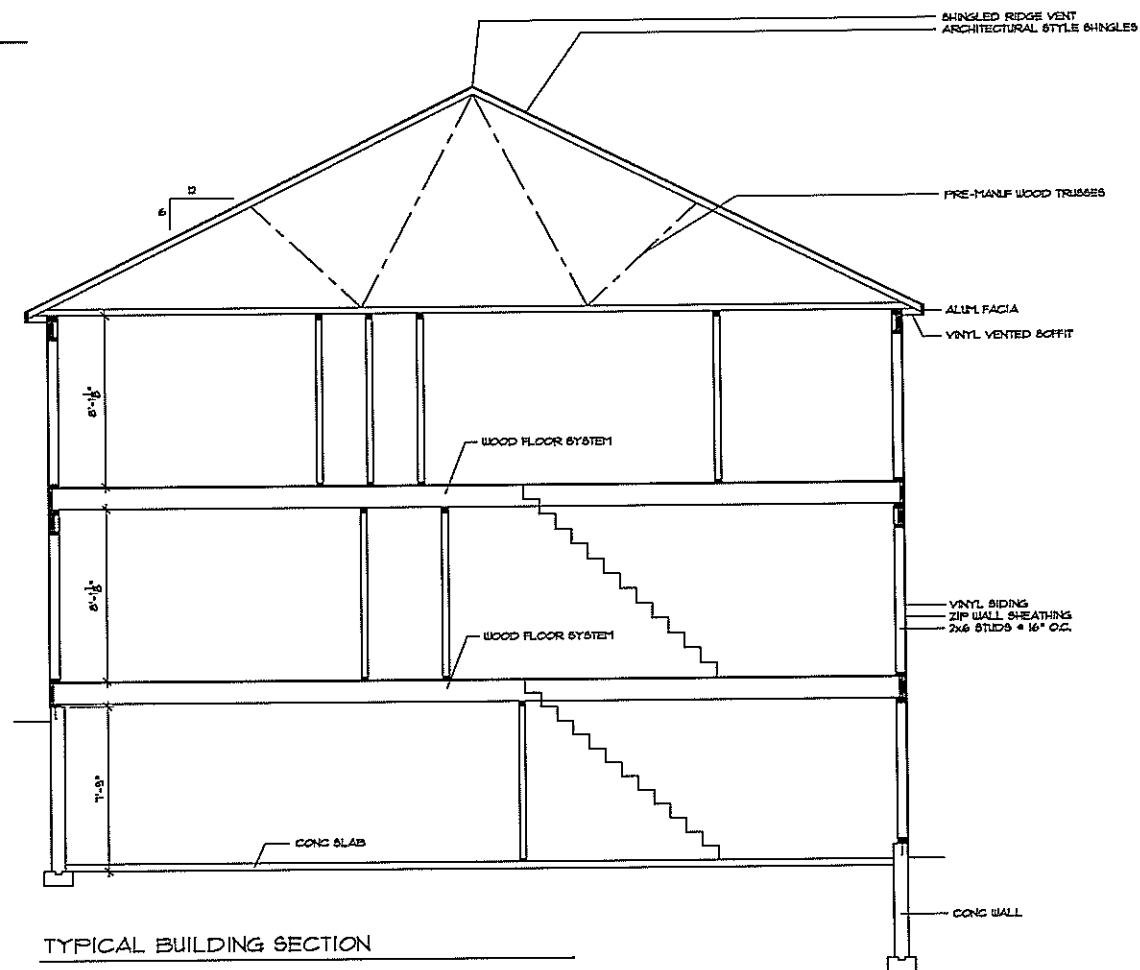

TYPICAL BUILDING SECTION

USE GROUP:  
R-2

CONSTRUCTION  
TYPE:  
5-B UNPROTECTED

**NTH** DESIGN, LLC  
BROOKLYN, CONNECTICUT  
1-860-450-6443

UNITS 8-12 FOR  
**SHANE POLLOCK**  
LOUISE BERRY DRIVE, BROOKLYN, CONNECTICUT


BUILDING SECTION, TYPICAL SIDE & REAR ELEVATIONS

SCALE: 1/4"=1'-0"


DATE: 7-26-22


JOB NO: 21000

SHEET NUMBER:  
**A-5**

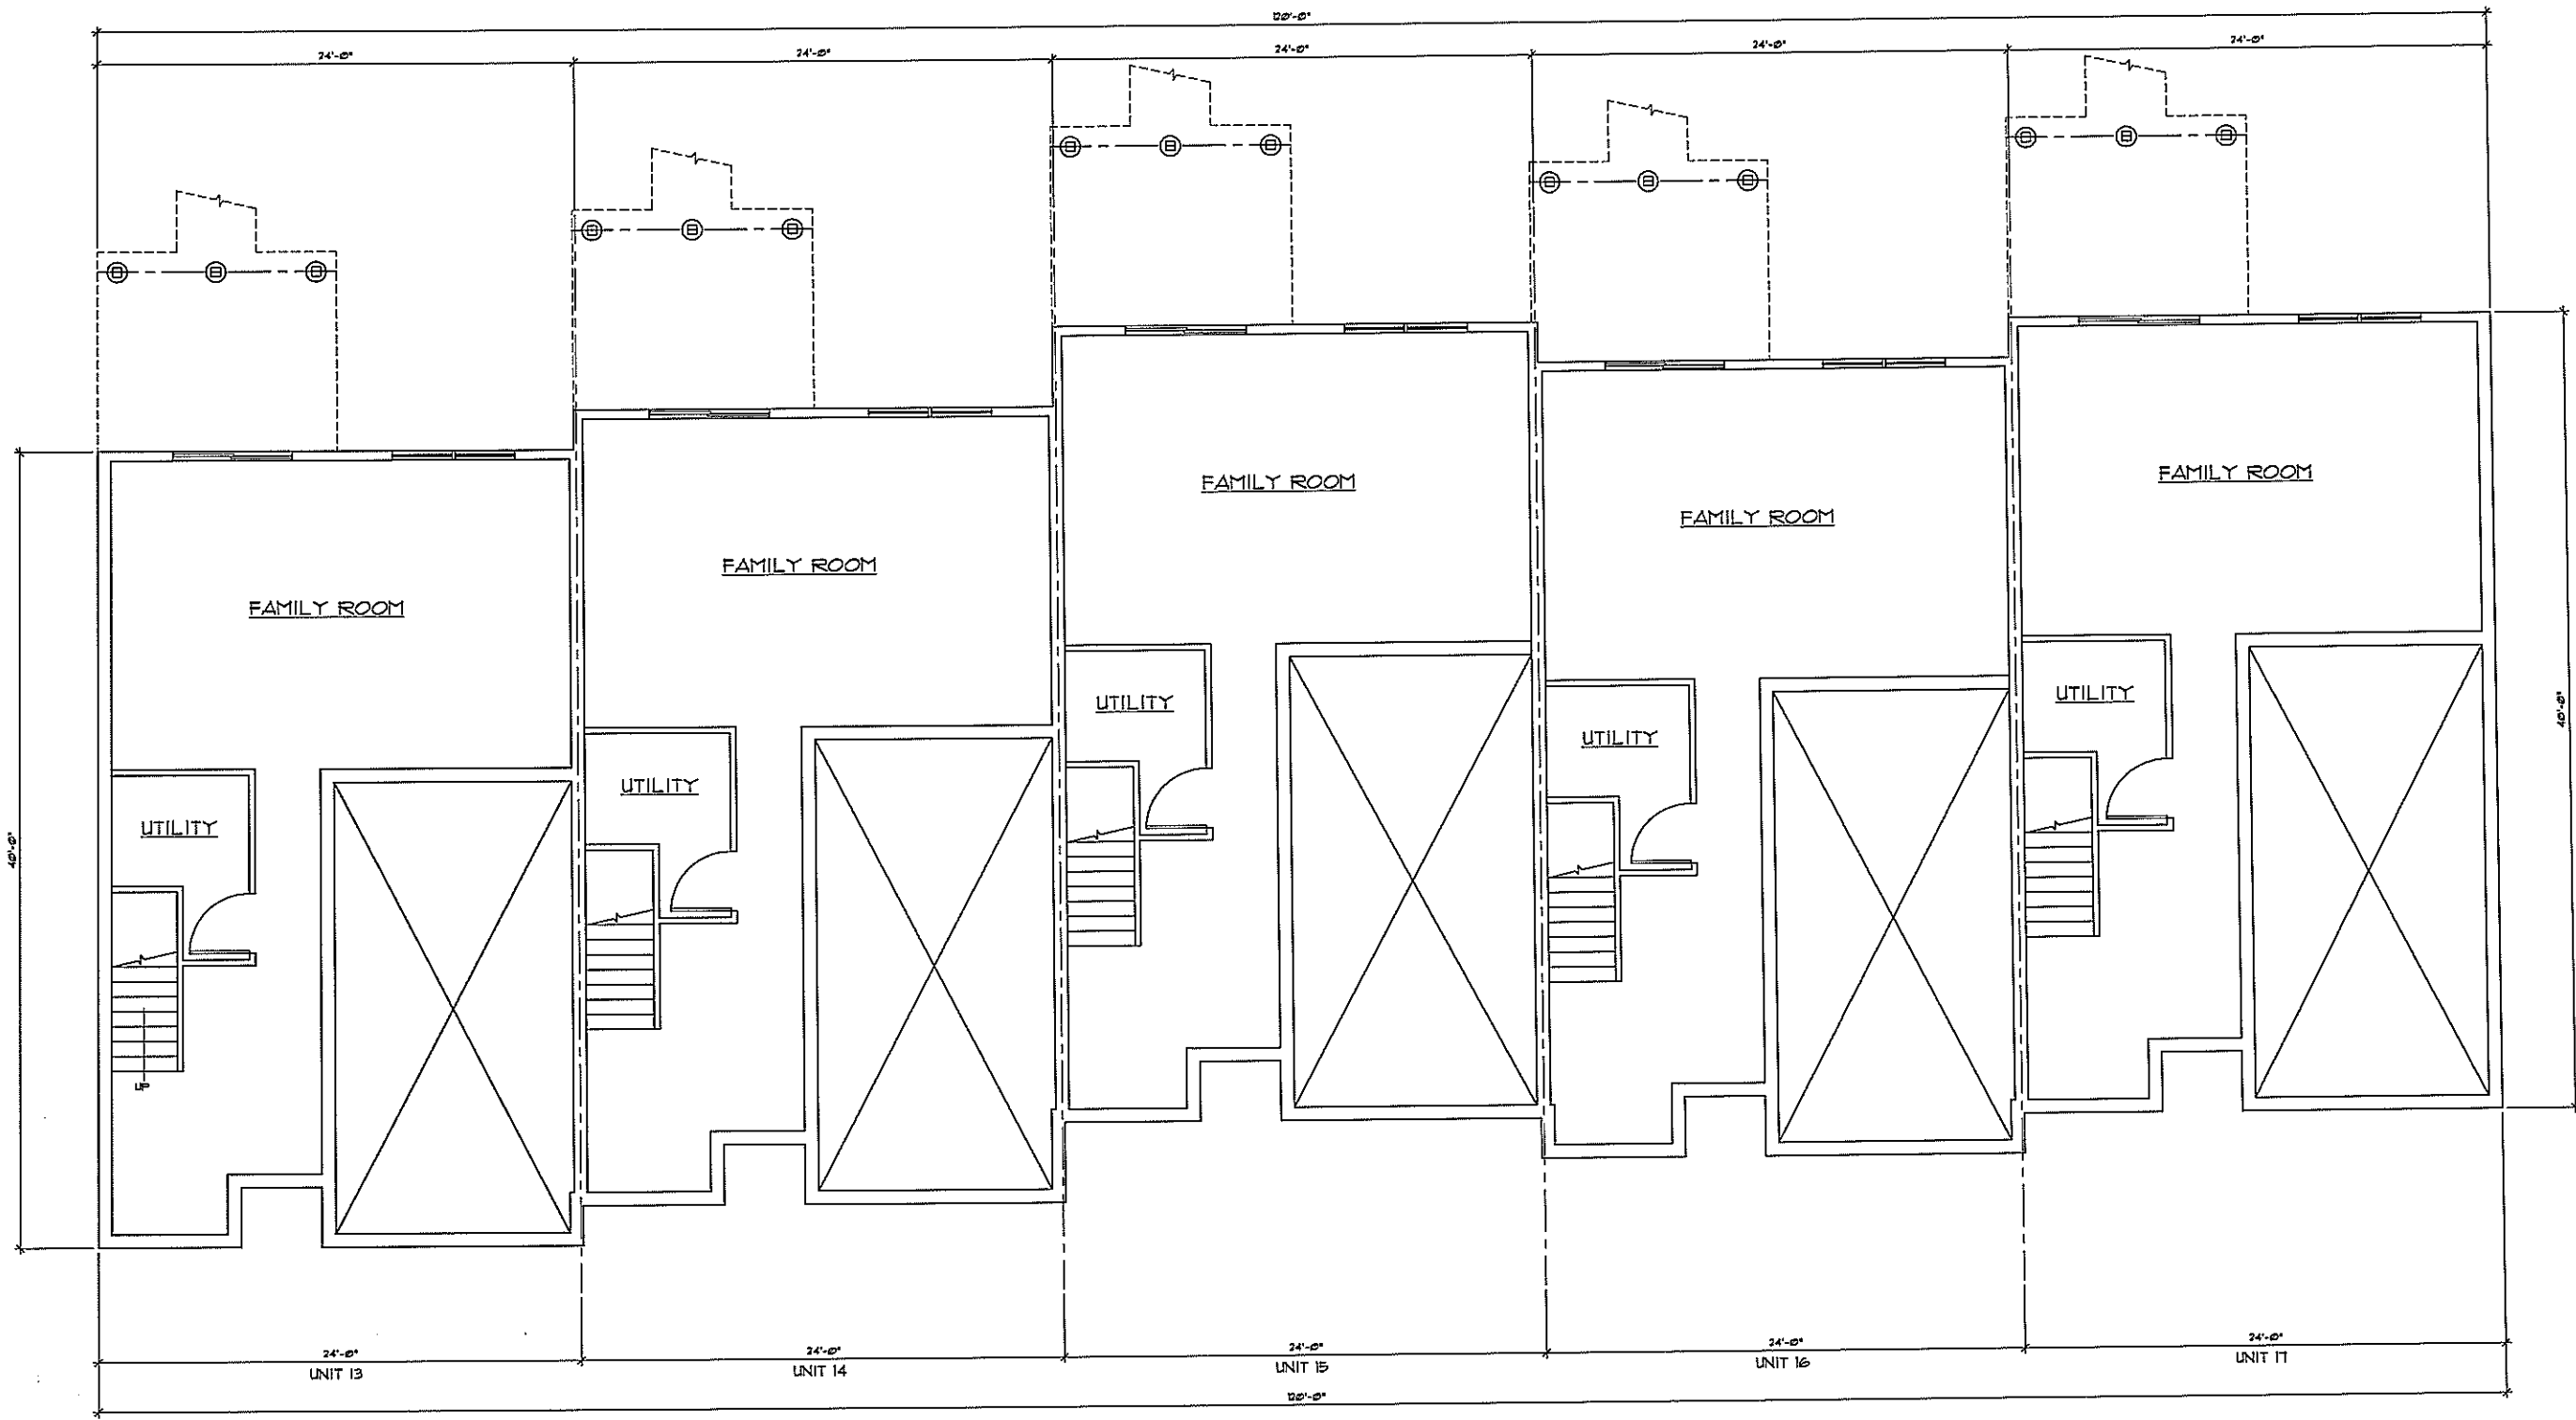


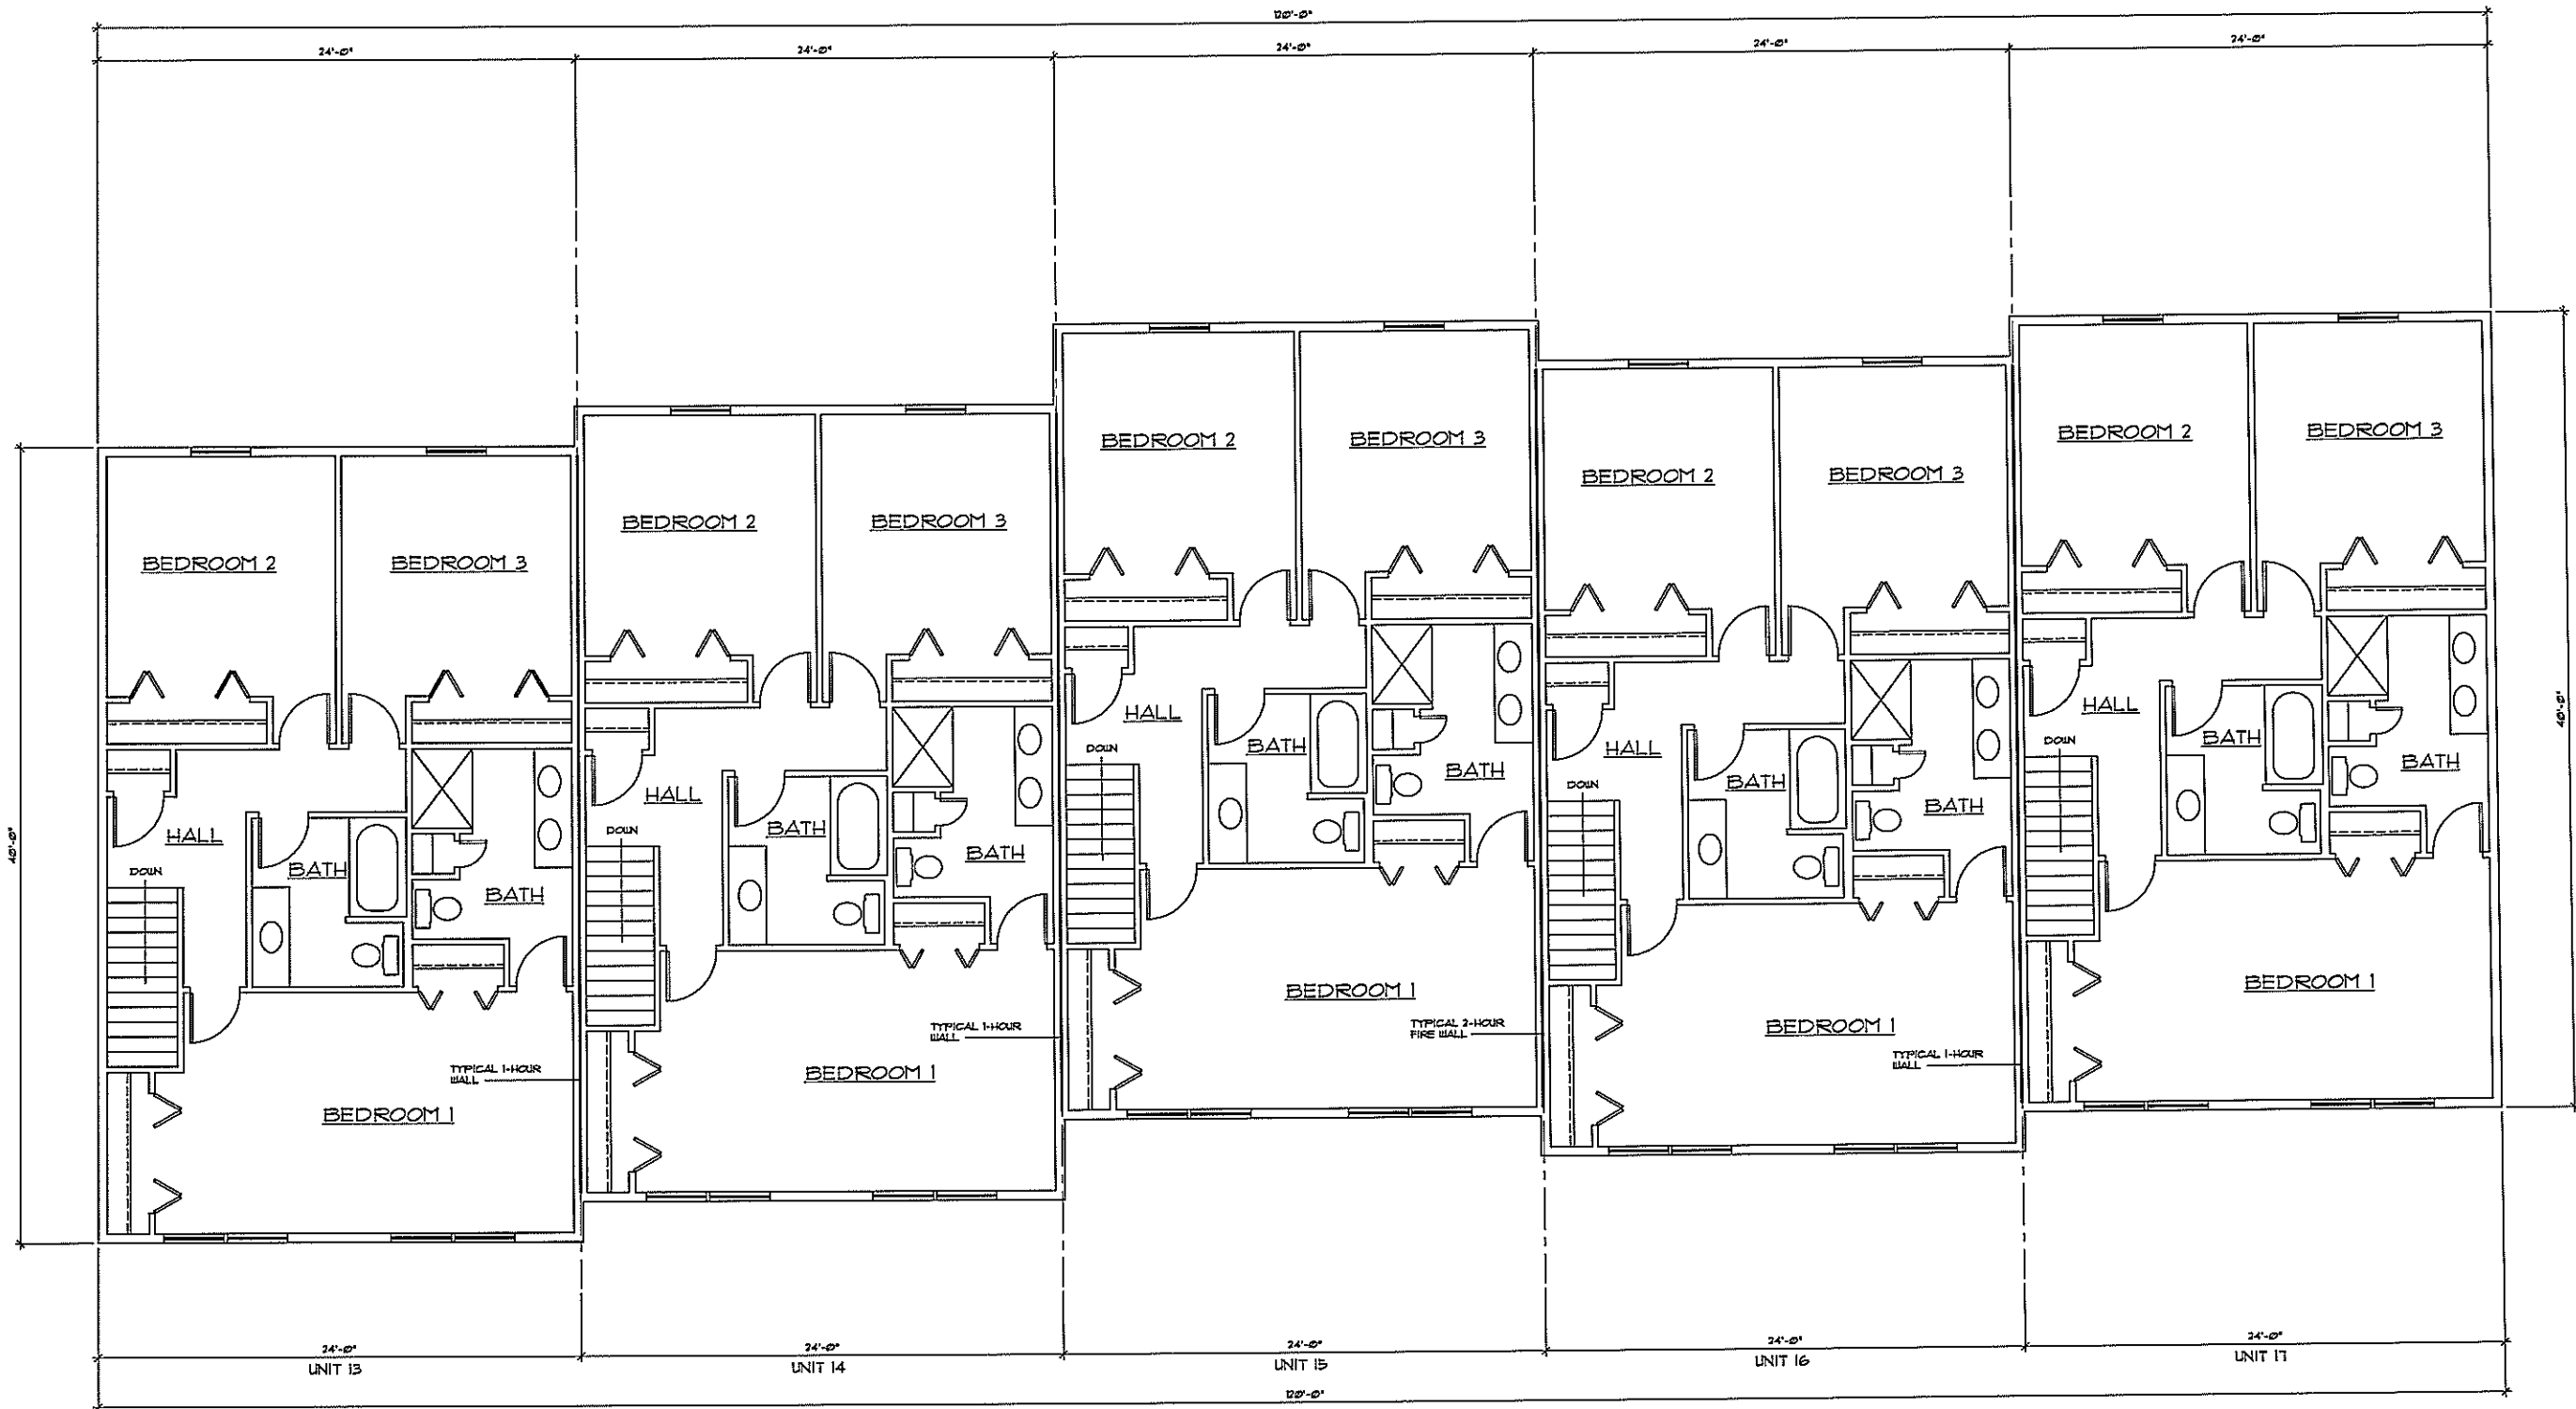
LOWER LEVEL

USE GROUP: R-2	 NTH DESIGN, LLC BROOKLYN, CONNECTICUT 1-860-450-6443	UNITS 13-17 FOR <b>SHANE POLLOCK</b> LOUISE BERRY DRIVE, BROOKLYN, CONNECTICUT	SCALE: 1/4"=1'-0"
CONSTRUCTION TYPE: 5-B UNPROTECTED		LOWER LEVEL FLOOR PLAN	DATE: 1-26-22 JOB NO: 21000 SHEET NUMBER: <b>A-6</b>

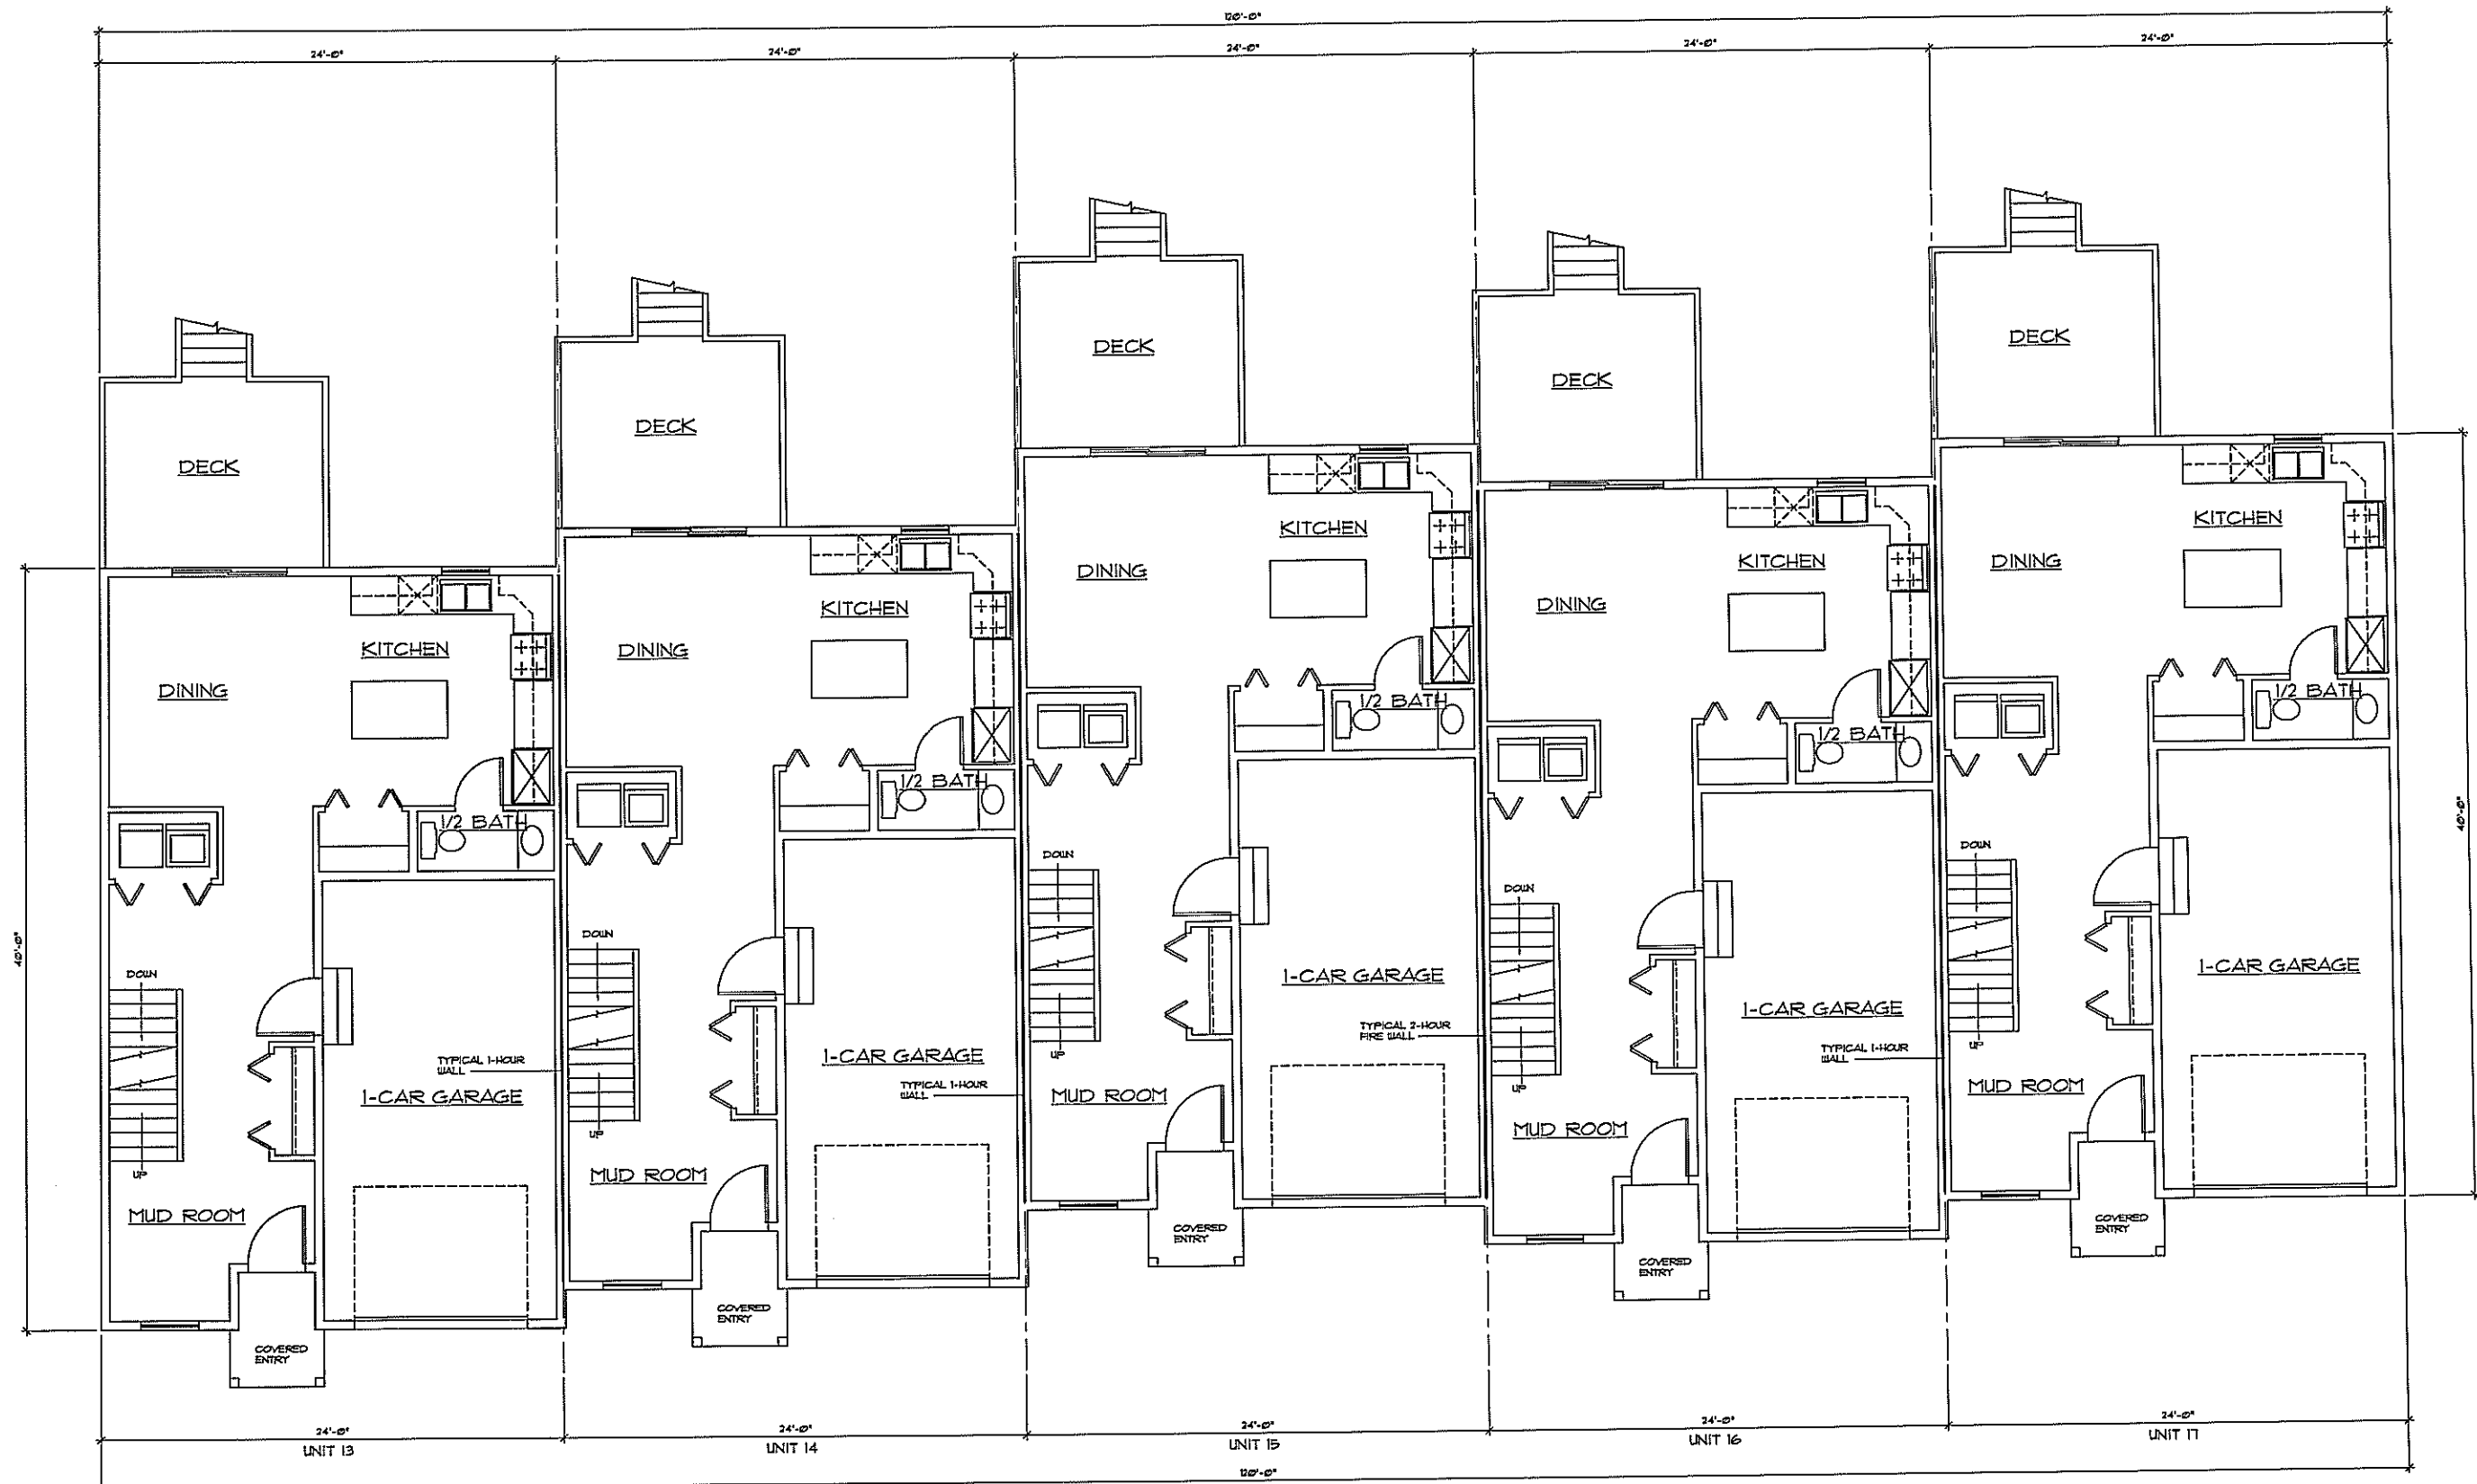


MAIN LEVEL

USE GROUP: R-2	 BROOKLYN, CONNECTICUT 1-860-450-6443	UNITS 13-17 FOR SHANE POLLOCK LOUISE BERRY DRIVE, BROOKLYN, CONNECTICUT	SCALE: 1/4"=1'-0"
CONSTRUCTION TYPE: 5-B UNPROTECTED		MAIN LEVEL FLOOR PLAN	DATE: 7-26-22 JOB NO: 21000 SHEET NUMBER: A-7




UPPER LEVEL

USE GROUP: R-2	 BROOKLYN, CONNECTICUT 1-860-450-6443	UNITS 13-17 FOR <b>SHANE POLLOCK</b> LOUISE BERRY DRIVE, BROOKLYN, CONNECTICUT	SCALE: 1/4"=1'-0"
CONSTRUCTION TYPE: 5-B UNPROTECTED		UPPER LEVEL FLOOR PLAN	DATE: 7-26-22 JOB NO: 21000 SHEET NUMBER: <b>A-8</b>






FRONT ELEVATION


USE GROUP: R-2	 NTH DESIGN, LLC BROOKLYN, CONNECTICUT 1-860-450-6443	UNITS 13-17 FOR SHANE POLLOCK LOUISE BERRY DRIVE, BROOKLYN, CONNECTICUT	SCALE: 1/4"=1'-0"
CONSTRUCTION TYPE: 5-B UNPROTECTED		FRONT ELEVATION	DATE: 7-26-22 JOB NO: 21000 SHEET NUMBER: A-9




REAR ELEVATION

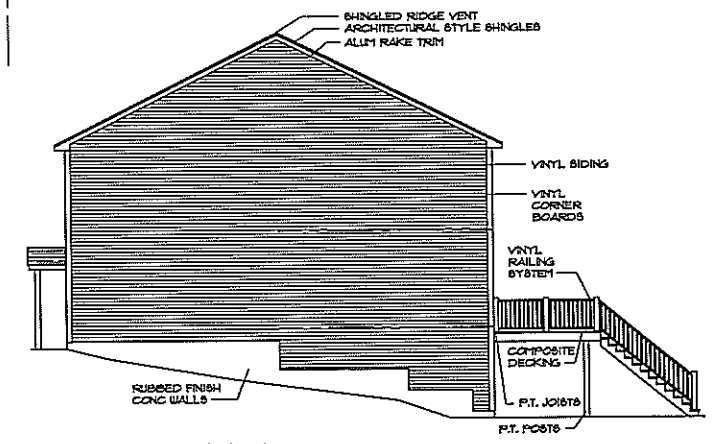


SIDE ELEVATION  
SCALE: 1/8"=1'-0"

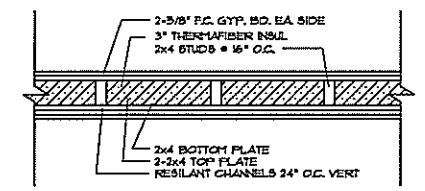


TYPICAL 2 HR FIRE WALL DETAIL  
SCALE: 1"=1'-0" UL DESIGN U334

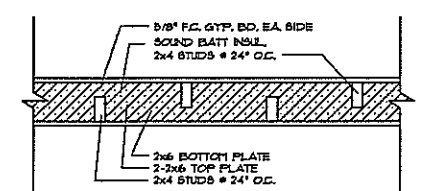

TYPICAL 1 HR PARTY WALL DETAIL  
SCALE: 1"=1'-0" DESIGN NO U346

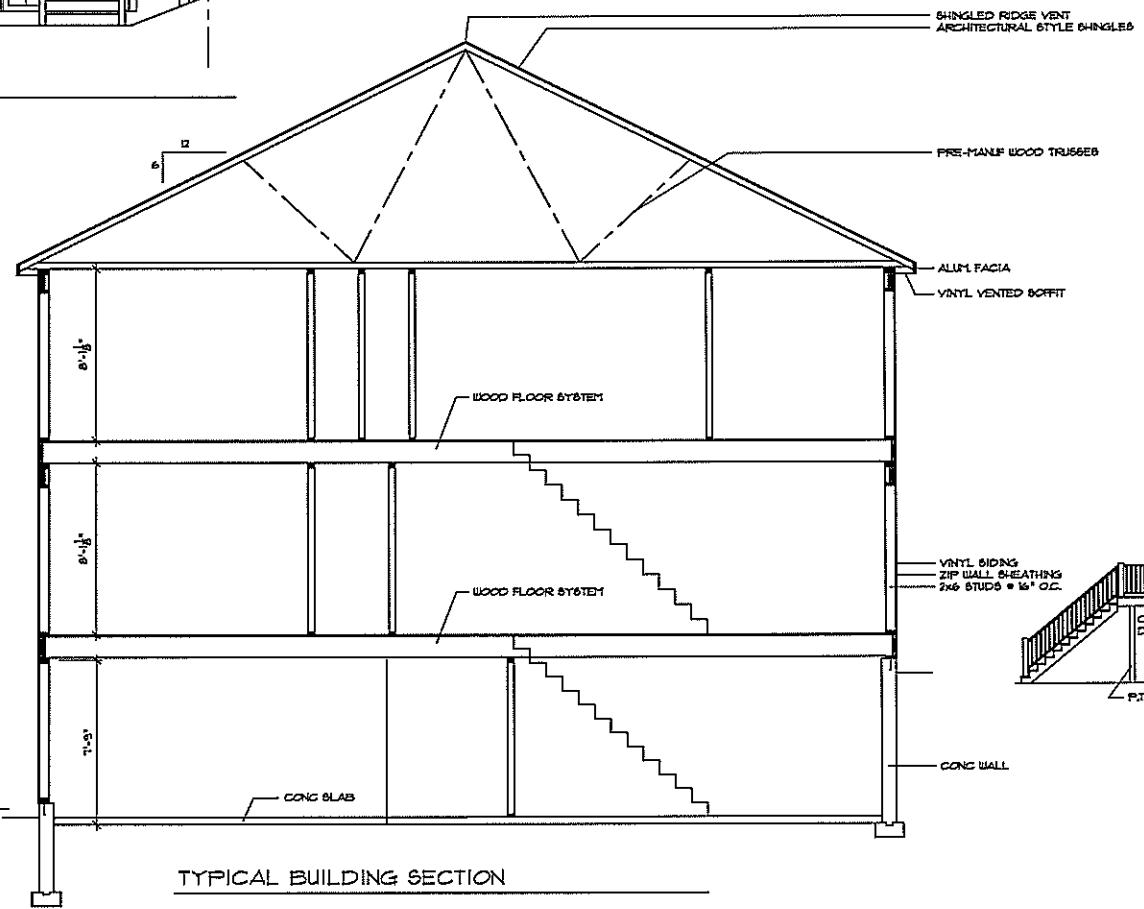


TYPICAL BUILDING SECTION

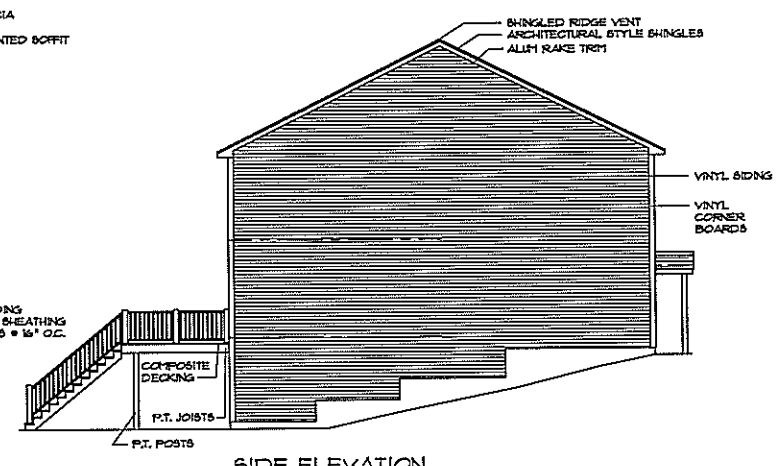


SIDE ELEVATION  
SCALE: 1/8"=1'-0"

USE GROUP: R-2	 NTH DESIGN, LLC BROOKLYN, CONNECTICUT 1-860-450-6443	UNITS B-11 FOR <b>SHANE POLLOCK</b> LOUISE BERRY DRIVE, BROOKLYN, CONNECTICUT	SCALE: 1/4"=1'-0"
CONSTRUCTION TYPE: B-B UNPROTECTED		BUILDING SECTION, TYPICAL SIDE & REAR ELEVATIONS	DATE: 7-26-22 JOB NO: 21000 SHEET NUMBER: A-10

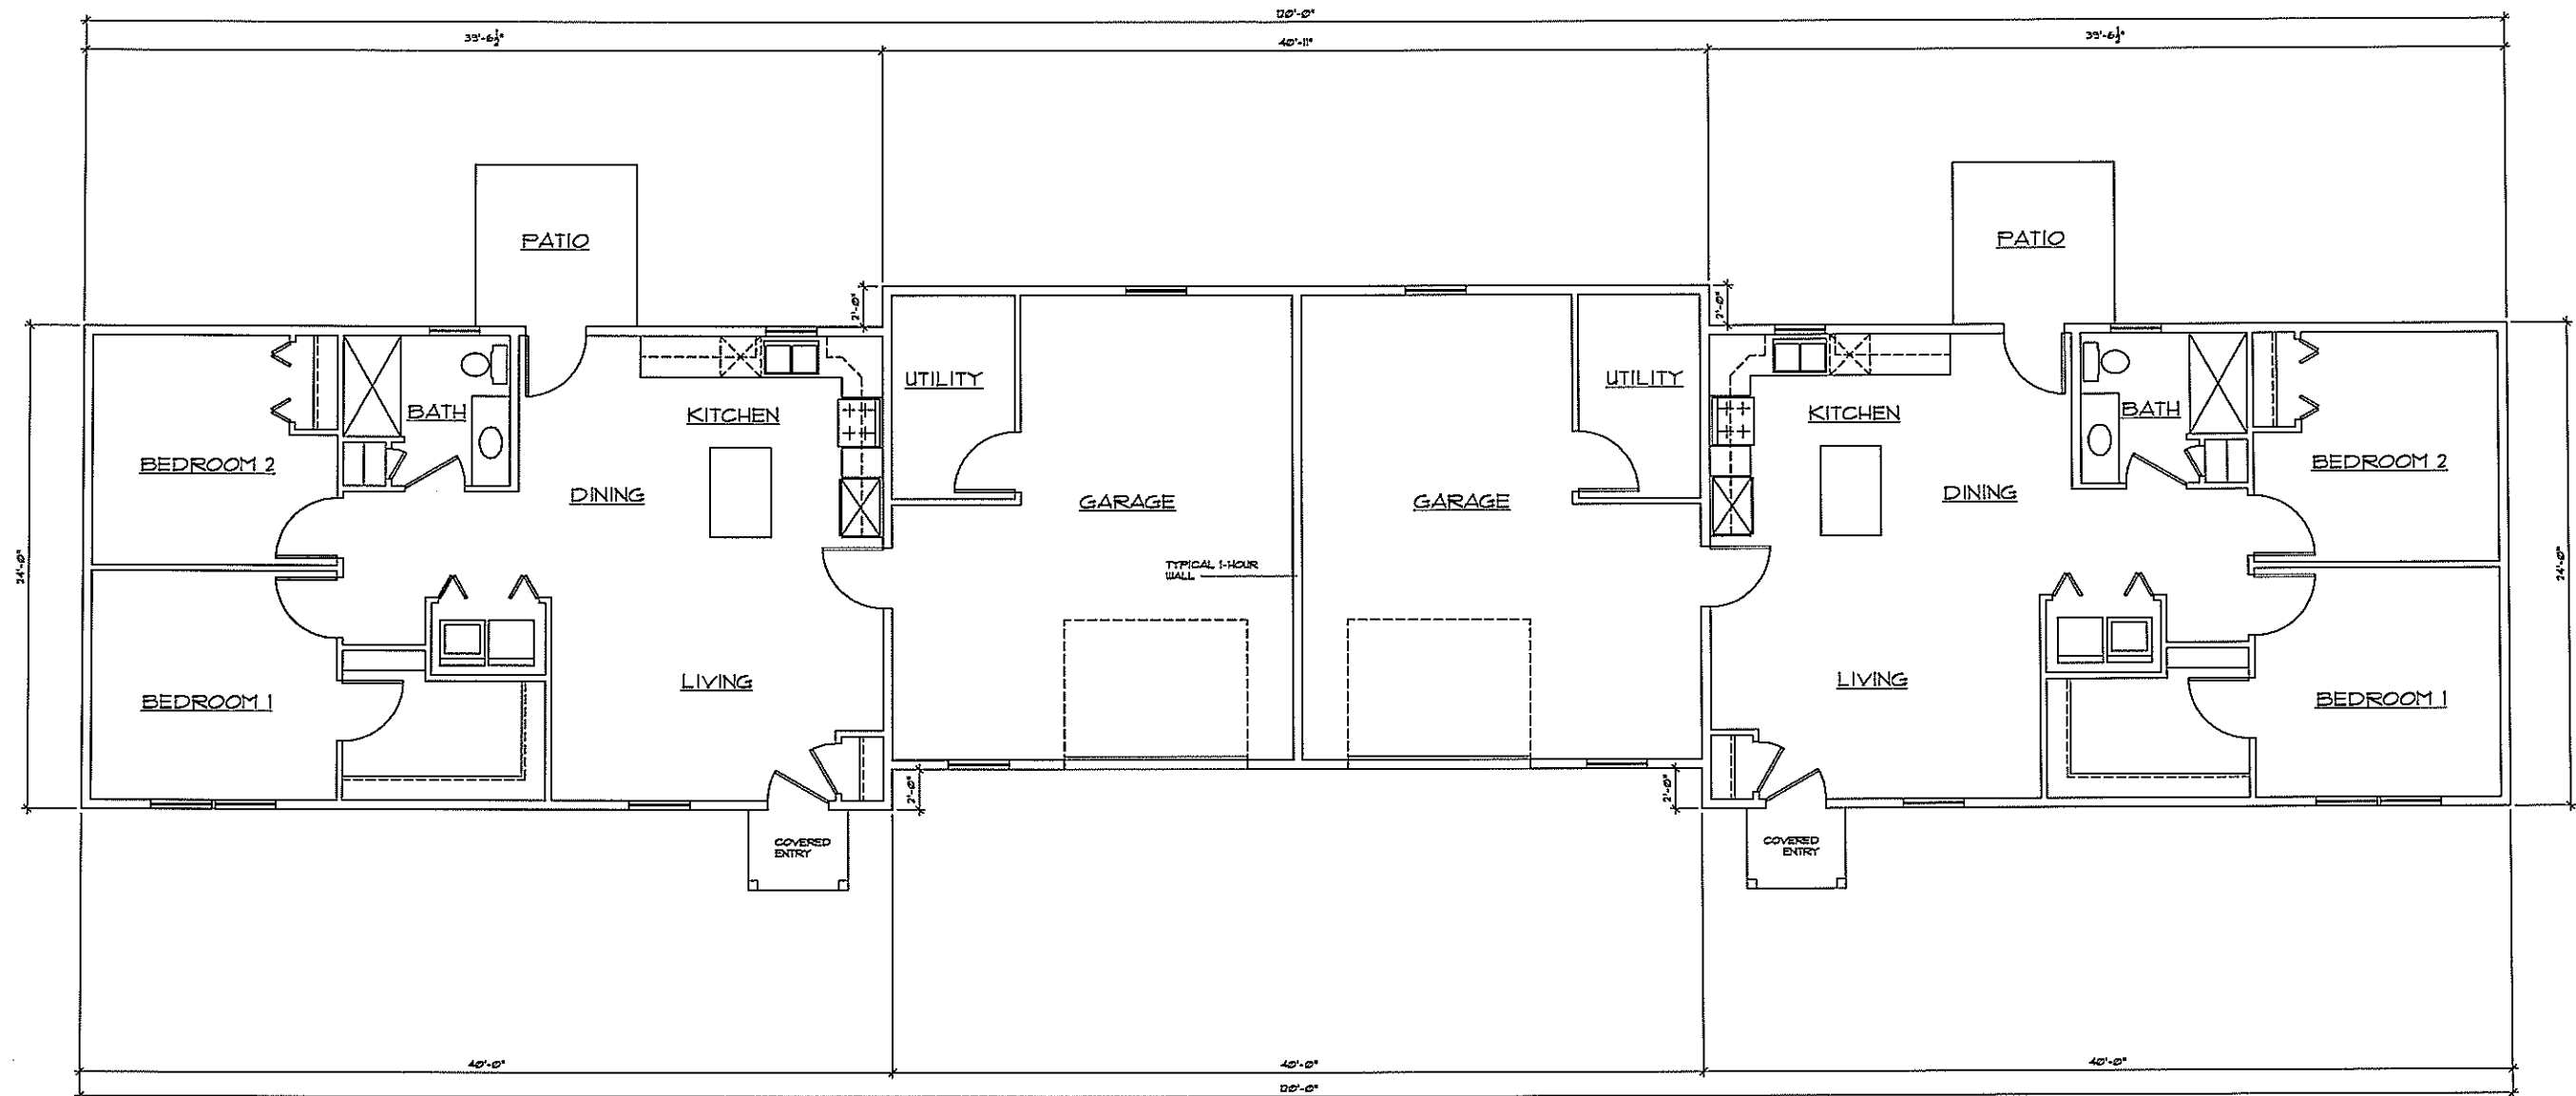

MAIN LEVEL

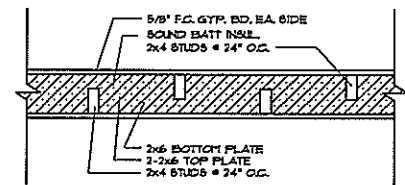


TYPICAL 1 HR PARTY WALL DETAIL


SCALE: 1/4"=1'-0"

DESIGN NO US40


USE GROUP: R-2	 BROOKLYN, CONNECTICUT 1-860-450-6443	UNITS 1-3 FOR <b>SHANE POLLOCK</b> LOUISE BERRY DRIVE, BROOKLYN, CONNECTICUT	SCALE: 1/4"=1'-0"
CONSTRUCTION TYPE: 5-B UNPROTECTED		MAIN LEVEL FLOOR PLAN	DATE: 1-26-22 JOB NO: 21000 SHEET NUMBER: A-11

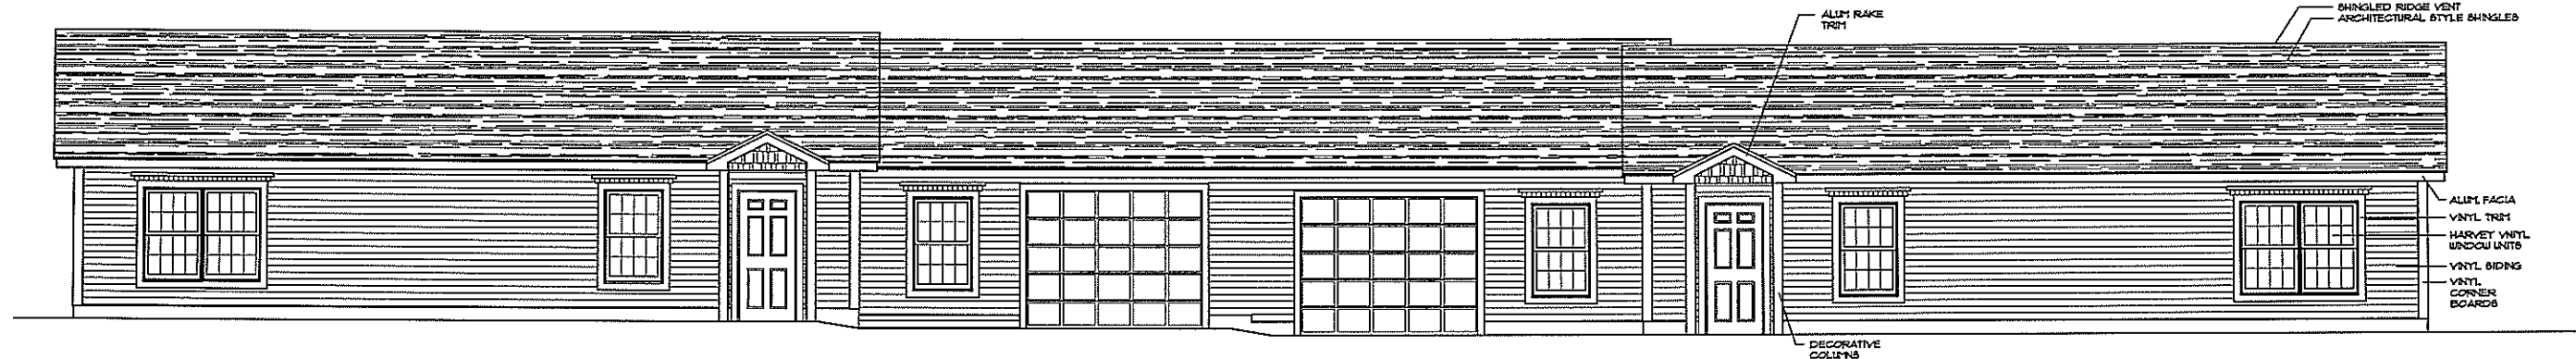

FRONT ELEVATION

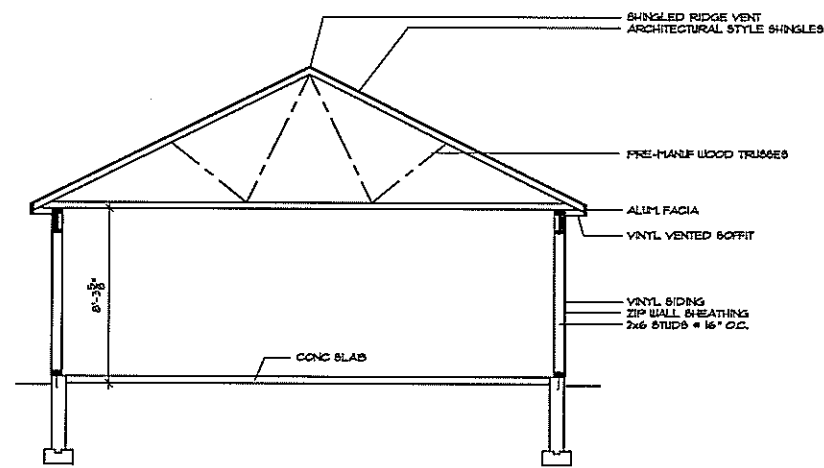


TYPICAL BUILDING SECTION

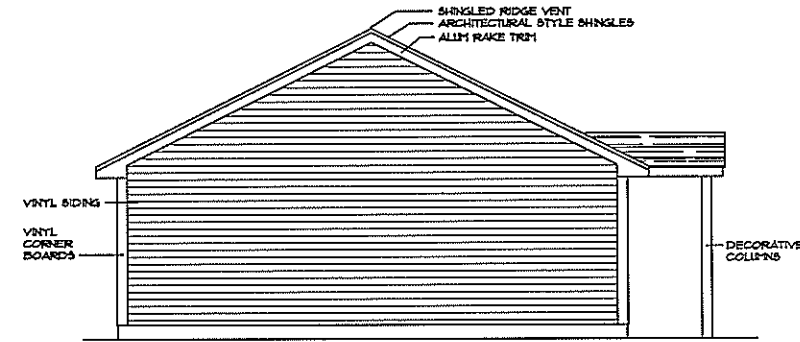

TYPICAL SIDE ELEVATION



REAR ELEVATION

USE GROUP: R-2	 BROOKLYN, CONNECTICUT 1-860-450-6443	UNITS 1-3 FOR SHANE POLLOCK LOUISE BERRY DRIVE, BROOKLYN, CONNECTICUT	SCALE: 1/4"=1'-0"
CONSTRUCTION TYPE: 5-B UNPROTECTED		BUILDING SECTION, EXTERIOR ELEVATIONS	DATE: 1-26-22 JOB NO: 21000 SHEET NUMBER: A-12

November 30, 2022

Mr. Shane Pollock  
101 Mackin Drive  
Griswold, CT 06351

**RE: Proposed Residential Development  
Louise Berry Drive  
Brooklyn, Connecticut  
Our File # 21154**

Dear Mr. Pollock:

Pursuant to your request our office has prepared this report to document our findings related to the potential traffic impact of a proposed 50-unit residential development located on Louise Berry Drive in the Town of Brooklyn, Connecticut. The site location is presented in Figure 1 with respect to the surrounding roadway network. This report presents our findings.

### **Site Plan**

The site plan, prepared by Killingly Engineering Associates and dated April 23, 2020 and revised through August 29, 2022, shows 50 residential units with a total of 136 parking spaces. Access to the site is proposed from Louise Berry Drive at a point approximately 550 feet west of Gorman Road. The site access drive extends south into the site and then turns to the west extending a distance of approximately 900 feet, terminating in a cul-de-sac.

### **Description of Area**

The site proposed for development is located on Louise Berry Drive. Louise Berry Drive is a local roadway that originates at an unsignalized intersection with Gorman Road and extends in a westerly direction approximately 600 feet, where it terminates in a parking lot for the Louise Berry elementary School. The roadway provides 22 feet of pavement with a single travel lane in each direction. The Louise Berry Drive approach to Gorman Road operates under stop-sign control.



Gorman Road is a local roadway that originates at a T-intersection with Prince Hill Road and extends in a southerly direction past Louise Berry Drive and then continuing to its terminus at an unsignalized intersection with Route 205 and Baily Woods Road. The west approach of Prince Hill Road operates under stop-sign control. Gorman Road typically provides approximately 24 feet of pavement with a single travel lane in each direction separated by a double yellow centerline. The posted speed limit is 25 miles per hour. Land use in the area is primarily residential. The Town of Brooklyn Elementary and Middle Schools are located on the roadway.

### **Current Traffic Volumes**

The Connecticut DOT maintains a traffic volume count program on all state highways and some local roadways. Included within the DOT database is a count conducted on Gorman Road located south of Prince Hill Road. The count was conducted during September 2019 and indicates Gorman Road carries an average daily traffic volume (ADT) of 2,000 vehicles with peak hour volumes of 346 vehicles during the a.m. peak hour (8:00 a.m.) and 309 vehicles during the p.m. peak hour (3:00 p.m.). The ConnDOT counts are presented in Table 1.

Manual turning movement counts were conducted during the morning and afternoon school peak hours on Tuesday September 21, 2021. Counts were not conducted during the afternoon commuter peak hour. To represent the afternoon commuter peak hours we have used the ConnDOT counts for Gorman Road and ITE trip generation data for the school for Louis Berry Drive. The ConnDOT Counts and turning movement counts are presented in Figure 2R-1 for the morning and afternoon school peak hours as well as for the afternoon commuter peak hour.

In addition to the ConnDOT counts described above, our office has reviewed the files of OSTA and the Town of Brooklyn to determine if there have been any recent approvals or submissions that may have an impact on traffic volumes in the vicinity. It is our understanding that there are no such developments. Figure 2A presents the background traffic volumes for the morning and afternoon school peak hours as well as the afternoon commuter peak hour.

### **Site Generated Traffic**

The proposal is to consist of a total of 50 residential units. To determine the trip generation for the proposed site, the Institute of Transportation Engineers (ITE) *Trip Generation* Report was

consulted. *Trip Generation* presents trip generation estimates for many land uses based on counts conducted at existing facilities throughout the country. Included within the ITE database are several land uses that could be applicable to the proposed development. There are several land uses that could be applicable to the proposed development. Among them are: Land Use Code (LUC): 210 – Single Family Detached Housing; LUC 215 – Single Family Attached Housing; and LUC 220 – Multifamily Housing (Low rise). The report presents data based on the number of units. Trip generation was run for 50 units. Single Family Attached Housing seems most appropriate for the proposed development. Single Family Detached Housing returns the highest trip generation. However, based on comments received from KHW Engineering related to the previous application, we have presented the trip generation for Multifamily Housing (Low Rise). Based on this methodology, the proposed 50-unit development has a trip generation potential of 396 trips daily with a morning peak hour volume of 38 trips, an afternoon school peak hour volume of 21 trips, and an afternoon commuter peak hour volume of 42 trips. The results are presented in Table 2R-1.

Table 2R-1 also presents the trip generation observed for the existing elementary and middle schools for the morning and afternoon school peak hours. This volume is the observed volume on Louise Berry Drive only, and those staff and/or parents that utilized that roadway. The table also presents the ITE Trip generation for the elementary school and middle school based on the, square footage and the number of students. The Town of Brooklyn Board of Education website indicates that the town has approximately 1,000 students. No information on how many students attend each of the schools. It is reasonable to assume that each school has 500 students. The ITE Trip generation based on square footage, appears very high for the morning peak hour. The afternoon peak hour numbers appeared more reasonable. The trip generation based on the number of students appears to be more consistent with the observed volumes during a recent site counts. These volumes were used for the afternoon commuter peak hour volumes for Louis Berry Drive in Figure 2R-1.

The site generated traffic was then applied to the existing roadway network with a directional distribution of 70% oriented to and from the north along Gorman Road and 30% oriented to and from the south along Gorman Road. 100% of the site generated traffic will enter the site via a left-hand turn from Louise Berry Drive, and 100% will exit the site drive via right-hand turn. The

directional distribution is presented in Figure 3. Based on the directional distribution, the site generated traffic volumes for the morning peak hour are presented in Figure 4-R1. By adding these volumes to the background traffic volumes from Figure 2A, the combined traffic volumes, upon completion of the development, can be represented. The volumes present the combined traffic volumes as presented in Figure 5R-1.

### **Intersection Capacity**

To determine the impact of the site generated traffic on the existing roadway network, capacity analyses were conducted for the background and combined traffic volume conditions for the morning, mid-day and afternoon peak hours. The computer program *SYNCHRO*, which is based on the methodology in the Highway Capacity Manual, was utilized for this purpose. The general method determines how much of the capacity available for each movement is being utilized. This is converted into a delay for each movement, and the delay is rated on a level of service (LOS) scale from A to F, with A being the best level of service with low delays and F being the poorest level of service with high delays. An analysis was completed for the unsignalized intersections of Gorman Road at Louise Berry Drive and for the proposed site driveway at Louise Berry Drive. The level of service results are summarized in Table 3R-1.

**Gorman Road at Louise Berry Drive/Private** - This is an existing un-signalized intersection with Gorman Road oriented in the north/south direction, Louise Berry Drive approaches from the west, and a private drive approaches from the east. Each approach provides a single lane. Louise Berry Drive and the private drive operate under stop-sign control. The analysis indicates that the northbound and southbound approaches operate at a LOS A during all peak hours under the background traffic volume conditions. The eastbound approach operates at a LOS C during peak hours. The westbound approach operates at a LOS B during the morning and afternoon peak hours and at a LOS A during the mid-day peak. With the introduction of the site generated traffic, the northbound and southbound approaches will continue to operate at a LOS A. The eastbound approach will operate at a LOS C during the morning and mid-day peak and at a LOS D during the afternoon peak hour. The westbound approach will operate at a LOS C during the morning peak hour, at a LOS A during the mid-day peak hour and at a LOS B during the afternoon peak hour. A peak hour factor of 0.25 was used for the Louise Berry Drive approach based on observations made during the morning peak hour count. This indicates that



most traffic on that approach occurred during a single 15 - minute period. The calculated LOS describes that peak 15 - minute period. The Intersection LOS during the remaining 45 minutes would be likely be a LOS A for all approaches.

**Louise Berry Drive at Site Driveway** - This is a proposed un-signalized "T" intersection with Louise Berry Drive oriented in the east/west direction. The proposed site driveway approaches from the south. All approaches provide a single lane approach. The proposed site driveway will operate under stop sign control. An analysis indicates that all eastbound and westbound approaches will operate at a LOS A during peak hours. The site driveway approach will operate at a LOS B during the morning and mid-day peak hour and at a LOS A during the afternoon peak hour. Again, this condition would last for only 15 minutes, with the remaining 45 minutes operating at a LOS A.

#### **Site Driveway Location and Design**

The proposed site driveway is located on Louise Berry Drive, approximately 550 feet west of Gorman Road. The proposed driveway will provide 26 feet of pavement with a single 13 foot lane for both entering and exiting traffic. The driveway approach will operate under stop sign control. We recommend a 12" white stop bar and stop sign be installed on the site driveway. The available intersection sight distance, with some clearing of vegetation across the subject parcel, extends to the intersection of Gorman Road looking to the right and to the end of the roadway looking to the left. The available sight distance meets the current ConnDOT criteria for an approach speed more than 45 miles per hour. Louise Berry Drive is assumed to posted at 25 mph.

The site driveway is located opposite from an existing 12 space parking area for the Louise Berry Elementary School. The spaces are used by staff during school hours.

#### **School Operations**

Observations of the school traffic patterns were made during the morning peak hour count. Louise Berry Drive is used by staff and some parents for both entering and exiting traffic. Staff begin arriving at about 8:15 A.M. A significant proportion of parents enter the school grounds from one of the school's northerly driveways from Gorman Road. These parents proceed

behind the school and queue along the east side of the parking lot, behind the school. Parents begin to line up starting at about 9:00. Students are not allowed to exit their vehicles until 9:15 A.M. and the drop off period is completed by 9:30 A.M. Once a student has been dropped off, the parent exits the parking lot to Louise Berry Drive and then to Gorman Road. School buses do not use Louise Berry Drive. Although we did not review operations during the afternoon school peak period, we assume that the operation works in the same manner.

Since most people begin work by 9:00 a.m. and work until 4:00 P.M., at a minimum, and the peak period of school activity on Louise Berry Drive does not begin until 9:15 A.M. and likely ends by 4:00 P.M., the peak hours of the proposed residential development should not occur during the peak periods of the elementary school.

### **Accident Experience**

The University of Connecticut gathers and compiles traffic accident data for all state highways and some major local roadways. A list of accidents occurring in the area from October 1, 2019 through October 1, 2022 includes the most recent 3 years of available data. In the appendix are the UConn tables relating the accidents to various conditions including date, time, roadway and weather conditions, collision types, and other variables as well as a short description of each accident.

Accident records were obtained for the entirety of Gorman Road. In total four (4) accidents involving a total of eight (8) vehicles, occurred in the defined area over the past 3 years. Of those accidents, there were three rear end accidents and one fixed object accident. All accidents were listed as property damage only. There were no reported fatalities.

### **Conclusion**

Based on the available traffic volume data, the projected site generated traffic volumes and the analysis as outlined in this report, it is our professional opinion that the traffic volumes associated with the proposed 50-unit residential development can readily be accommodated by the existing roadway network. The proposed site driveway is properly located with respect to adjacent intersections and with respect to available sight distances and are properly designed to

Mr. Shane Pollock  
November 30, 2022  
Page 7

accommodate the anticipated driveway volumes. It is our opinion that the proposed development will not result in a detrimental impact to the health, safety and welfare of the general public.

We appreciate the opportunity to provide this analysis to you. We will be available to offer testimony in support of your application before local planning agencies upon your request. If you require additional information regarding this application, please do not hesitate to contact our office.


Very truly yours,  
**F. A. Hesketh & Associates, Inc.**

  
Scott F. Hesketh, P.E.  
Manager of Transportation Engineering

cc: Mr. Norm Thibault, Killingly Engineering

T:\pfl21154\report.2022.11.28.doc

# FIGURE 1

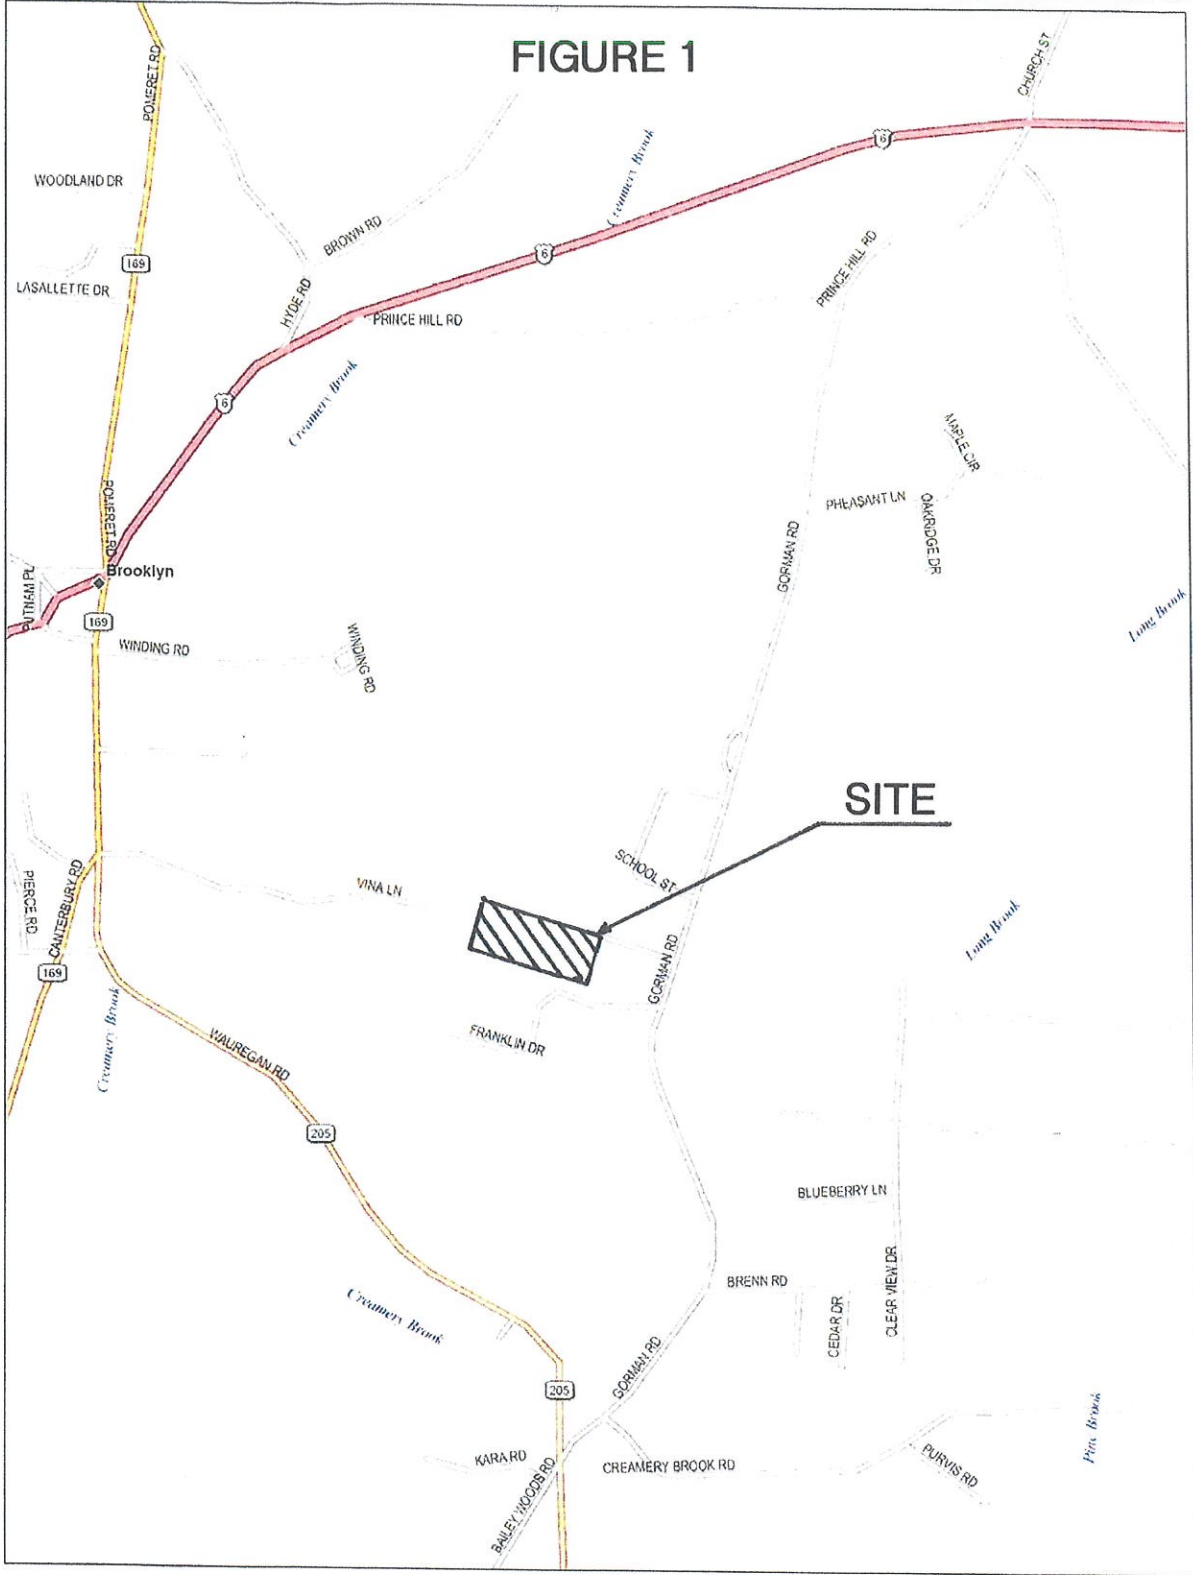

**SITE**

Data use subject to license.  
© 2005 DeLorme, Street Atlas USA© 2006 Plus.  
www.delorme.com






TABLE 1  
 ConnDOT TRAFFIC VOLUMES  
 Gorman Road south of Prince Hill Road  
 STATION NO. 058

	27-Sep-19 Friday			28-Sep-19 Saturday			29-Sep-19 Sunday			30-Sep-19 Monday			1-Oct-19 Tuesday			2-Oct-19 Wednesday			3-Oct-19 Thursday		
	NB	SB	Total	NB	SB	Total	NB	SB	Total	NB	SB	Total	NB	SB	Total	NB	SB	Total	NB	SB	Total
12:00																					
1:00																					
2:00																					
3:00																					
4:00																					
5:00																					
6:00																					
7:00																					
8:00																					
9:00																					
10:00																					
11:00																					
12:00																					
1:00																					
2:00																					
3:00																					
4:00																					
5:00																					
6:00																					
7:00																					
8:00																					
9:00																					
10:00																					
11:00																					
	788	842	1630	863	844	1707	740	742	1482	1151	1137	2288	1159	1234	2393	1081	1102	2183	365	329	694


2019 ADT = 2,000 for station 058 in Brooklyn

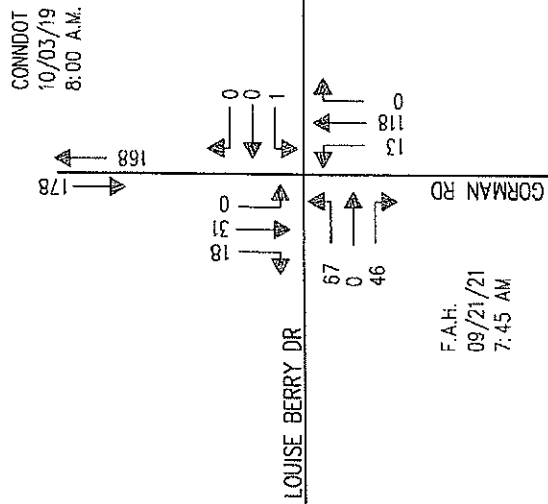

A.M. PEAK HOUR

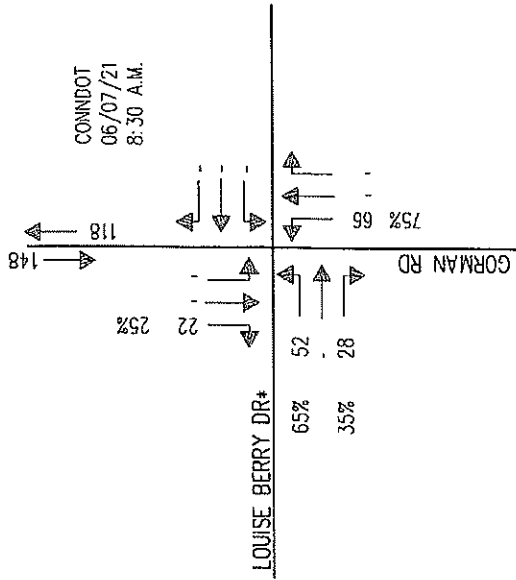

P.M. PEAK HOUR

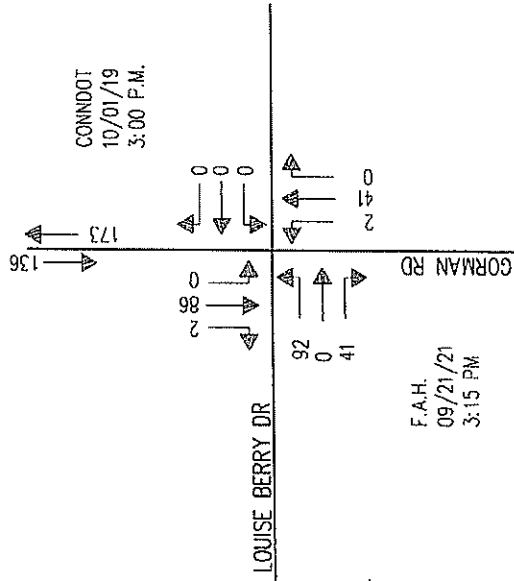

SCHOOL PM PEAK HOUR

\* VOLUMES TAKEN FROM ITE TRIP GENERATION PROJECTIONS FOR THE PM PEAK HOUR OF ADJACENT STREET TRAFFIC VOLUMES REPRESENT 75% OF THE SUM OF THE ELEMENTARY PLUS MIDDLE SCHOOL TRAFFIC


FIGURE 2R-1  
9-22-2021

OBSERVED TRAFFIC VOLUMES  
AM, SCHOOL & PM PEAK HOURS  
PROPOSED RESIDENTIAL  
DEVELOPMENT  
LOUISE BERRY DRIVE  
BROOKLYN, CT


**F. A. Heskeith & Associates, Inc.**  
TRAFFIC PLANNING ENGINEERING DESIGN

**FAH**


NOT TO SCALE

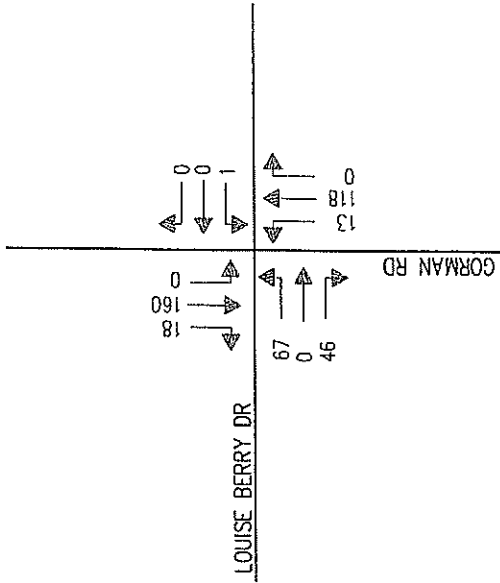

A.M. PEAK HOUR

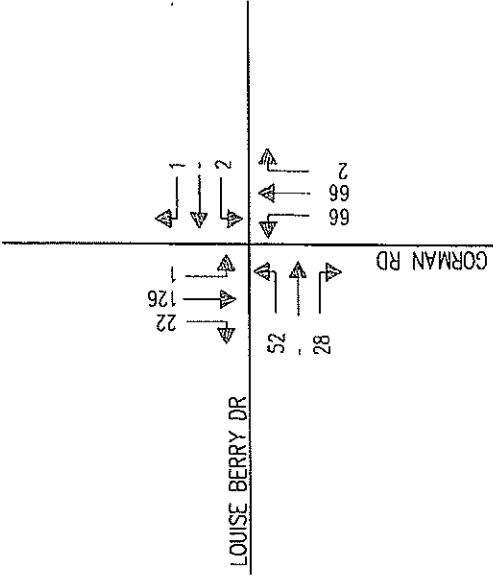

P.M. PEAK HOUR

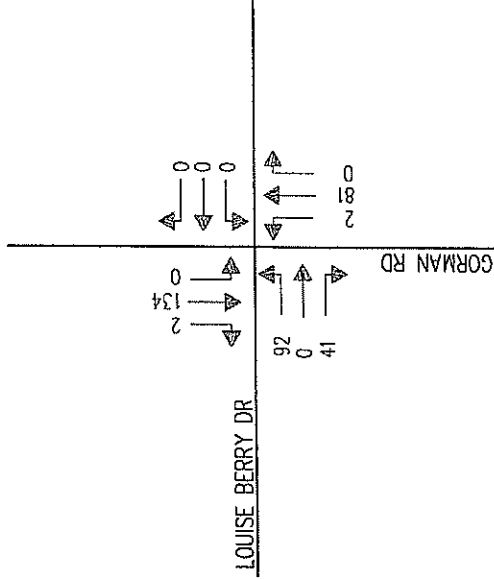

SCHOOL PM PEAK HOUR

FIGURE 2A 9-22-2021

BACKGROUND TRAFFIC VOLUMES  
AM, SCHOOL & PM PEAK HOURS  
PROPOSED RESIDENTIAL  
DEVELOPMENT  
LOUISE BERRY DRIVE  
BROOKLYN, CT

**F. A. Heeketh & Associates, Inc.**  
6 CREAMERY BROOK EAST GRANET, CT 06026

**FAH**  
TRAFFIC  
PLANNING  
ENGINEERING  
DESIGN

NOT TO SCALE

**Table 2R-1  
Trip Generation  
Proposed Residential Development  
Louise Berry Drive - Brooklyn, CT**

Land Use	Size	ADT	A.M. Peak Hour			School PM Peak Hour			P.M. Peak Hour		
			Enter	Exit	Total	Enter	Exit	Total	Enter	Exit	Total
Single Family Detached	50 units*	533	10	30	40	13	13	26	33	19	52
Single Family Attached	50 units*	360	7	17	24	7	7	14	16	12	28
Multi Family Housing Low Rise	50 units*	396	9	29	38	10	11	21	26	16	42
School Complex	Observed#		31	113	144	4	133	137	-	-	-
	Based on ITE Data										
Elementary School	87,100 s.f. 500 Students	1,700 945	334 181	273 154	607 335	121 76	154 94	275 170	53 41	66 44	119 85
Middle School	88,100 s.f. 500 Students	1,775 1,236	325 192	267 158	592 350	132 80	161 95	293 175	54 42	51 43	105 85

\* - School PM Peak hour volumes assumed to be 50% of the PM Peak hour volume with a 50/50 split  
# - Observed volumes are those observed on Louise Berry Drive during the AM and PM school peak hours



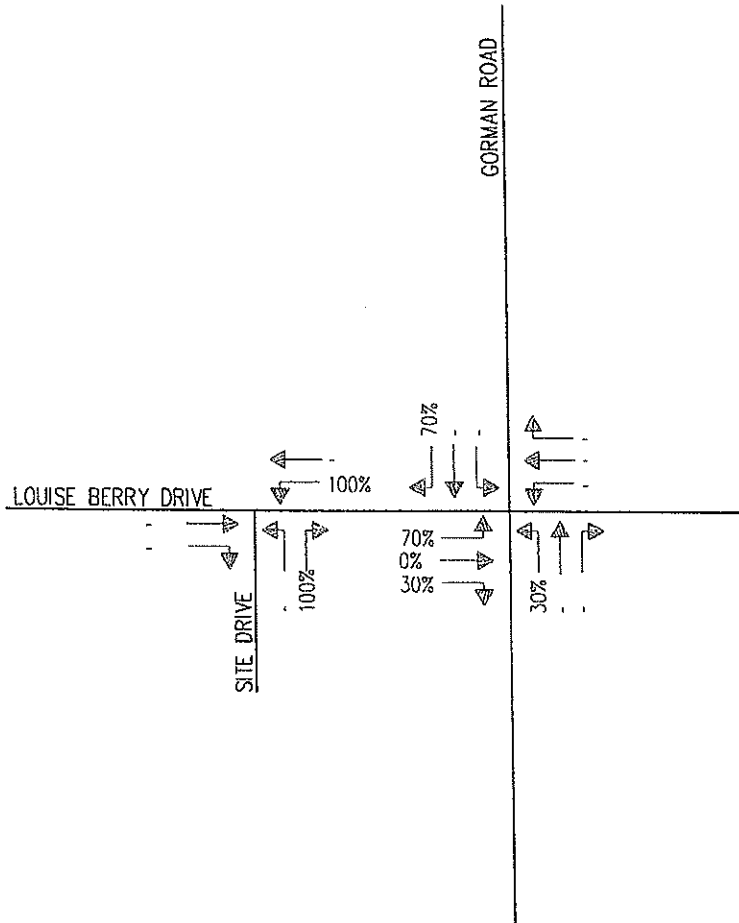


FIGURE 3

06-11-21

<p>DIRECTIONAL DISTRIBUTION OF SITE GENERATED TRAFFIC PROPOSED RESIDENTIAL DEVELOPMENT LOUISE BERRY DRIVE BROOKLYN, CT</p>	<p><b>F. A. Hesketh &amp; Associates, Inc.</b> 6 CREAMERY BROOK, EAST GRANBY, CT 06026</p> <p><b>FAH</b> TRAFFIC PLANNING ENGINEERING DESIGN</p> <p>NOT TO SCALE</p>
--	--

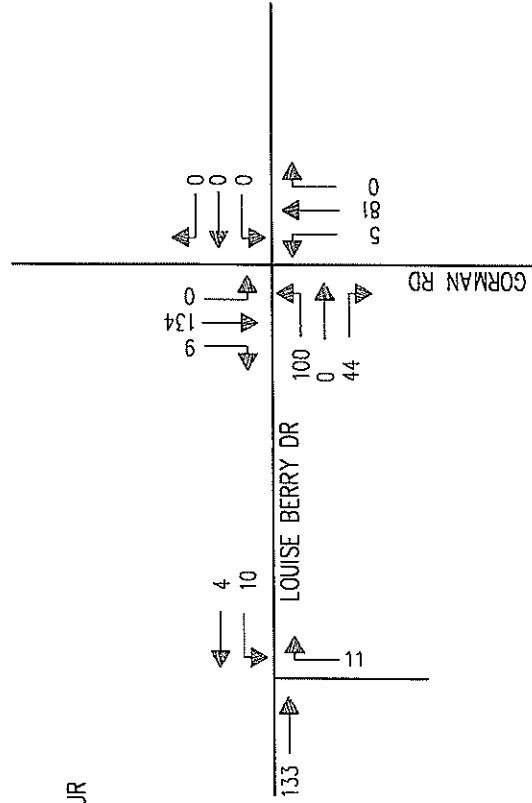
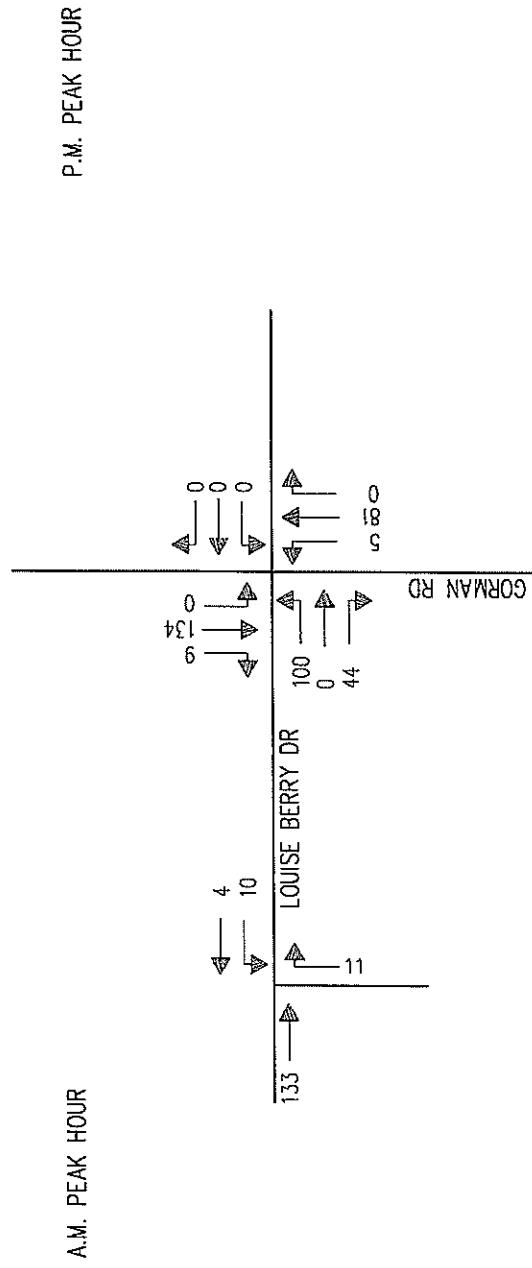
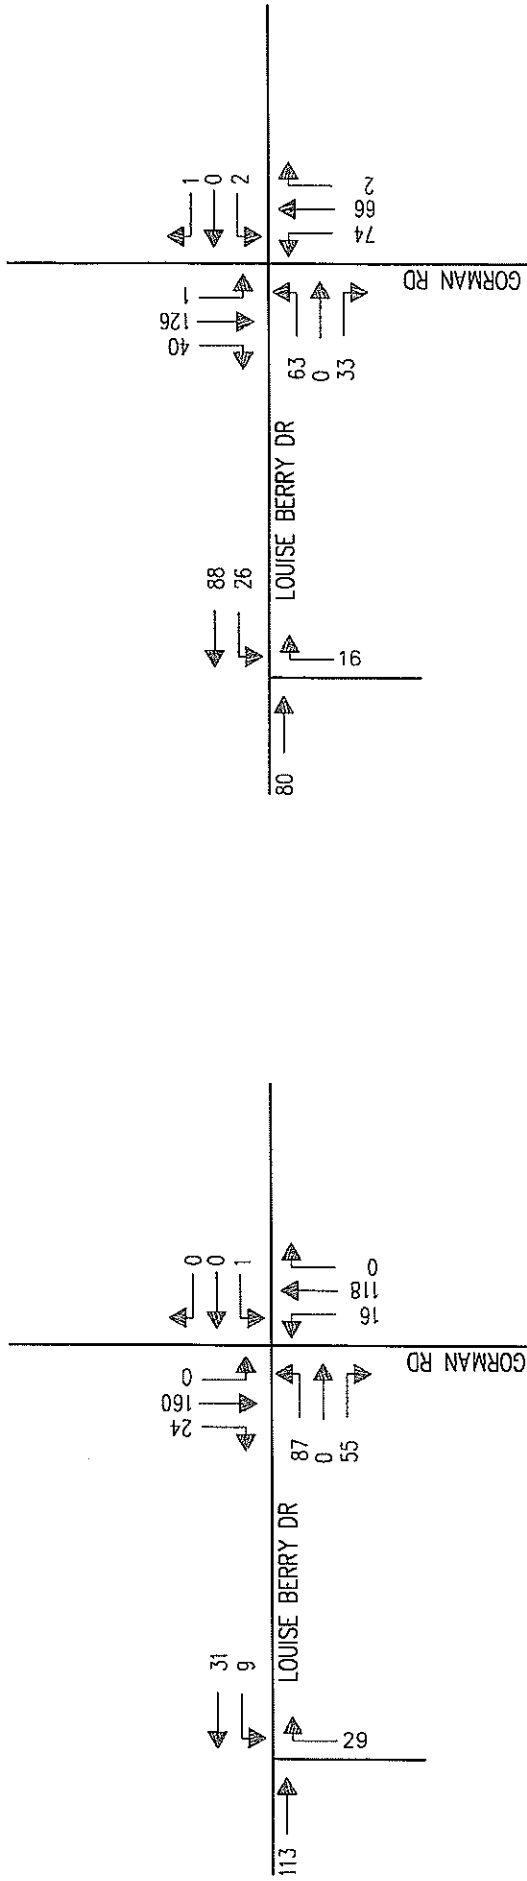


FIGURE 5R-1

11-28-2022



**F. A. Hekeith & Associates, Inc.**  
 6 CREMERT BROOK EAST GRANBY, CT 06026

**FAH**


TRAFFIC  
 PLANNING  
 ENGINEERING  
 DESIGN

COMBINED TRAFFIC VOLUMES  
 A.M., SCHOOL & PM PEAK HOURS  
 PROPOSED RESIDENTIAL  
 DEVELOPMENT  
 LOUISE BERRY DRIVE  
 BROOKLYN, CT

NOT TO SCALE

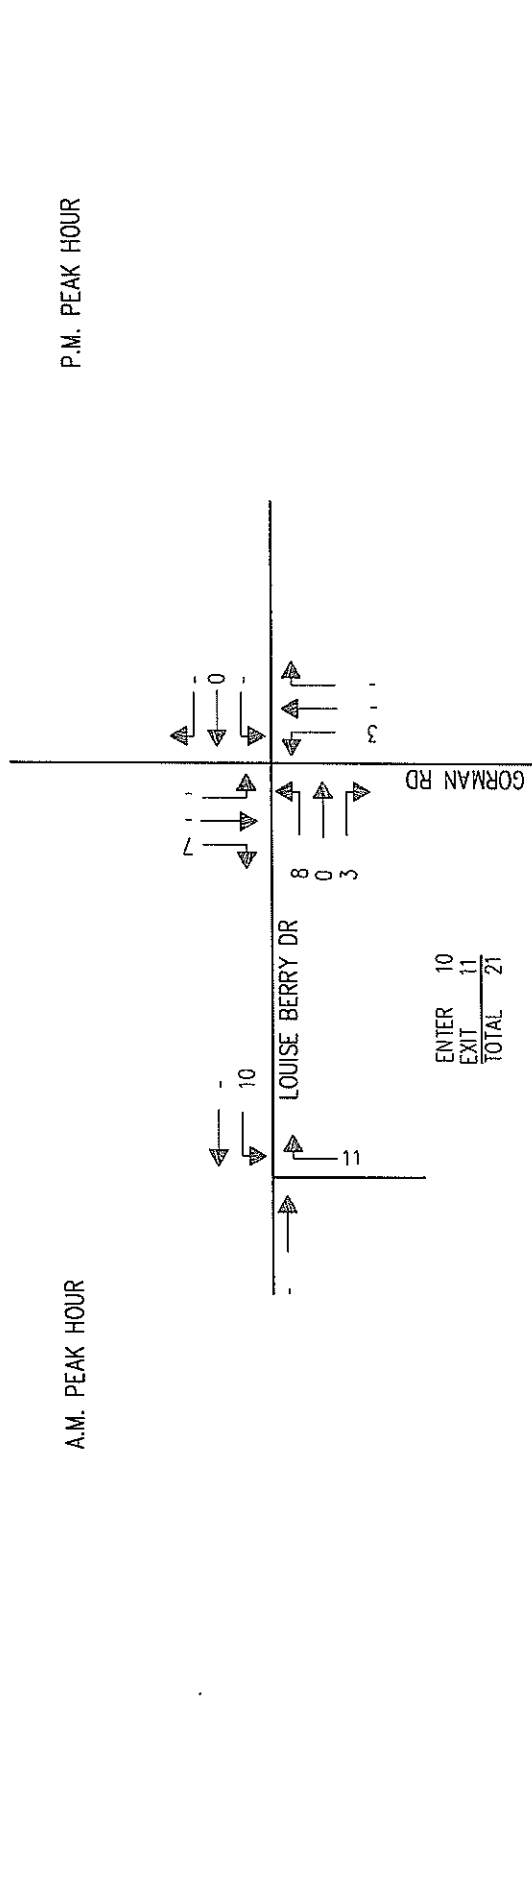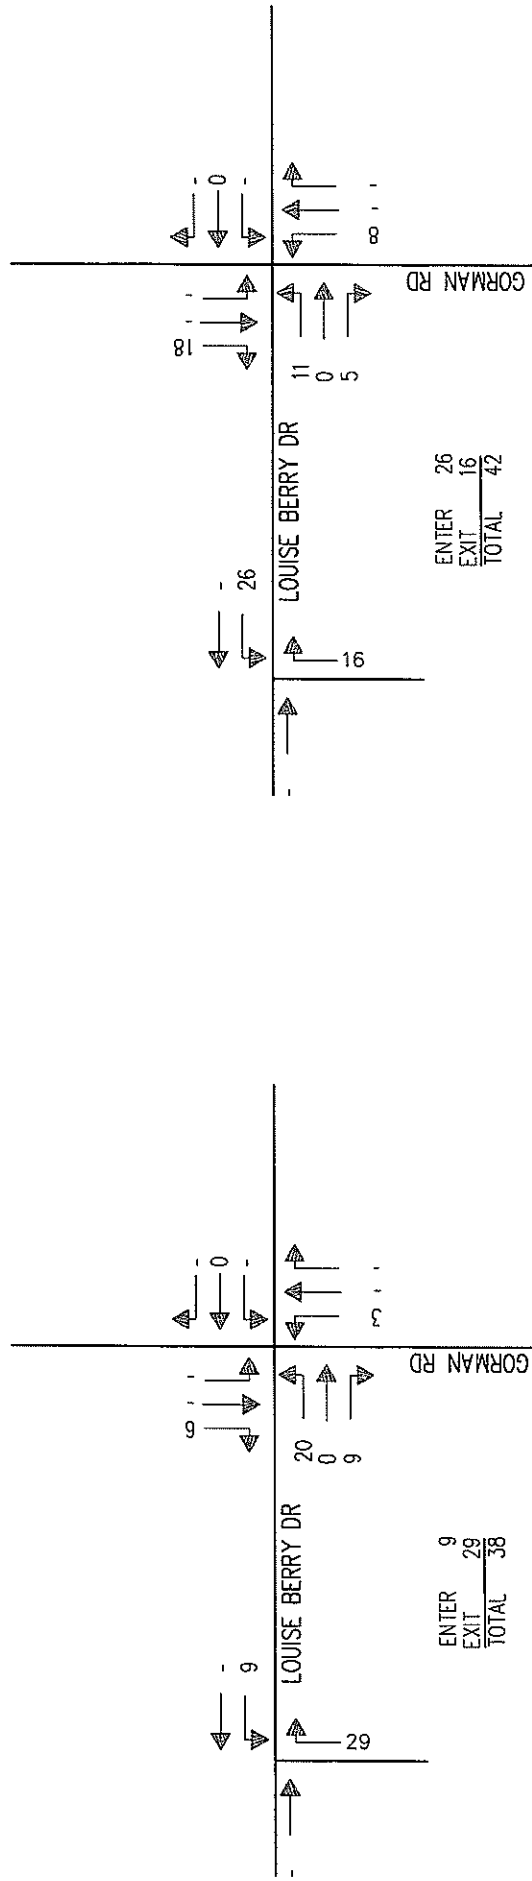

SCHOOL PM PEAK HOUR

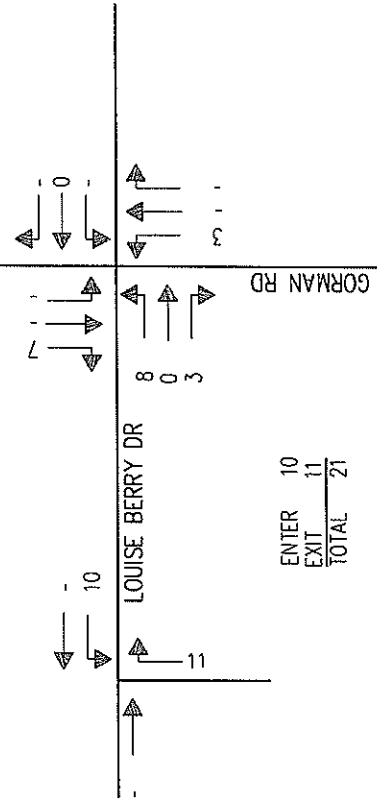

11-28-2022

**F. A. Heskeith & Associates, Inc.**  
 6 CREAMERY BROOK, EAST GRANBY, CT 06026

**FAH** TRAFFIC PLANNING ENGINEERING DESIGN

FIGURE 4R-1 SITE GENERATED TRAFFIC AM, SCHOOL & PM PEAK HOURS PROPOSED RESIDENTIAL DEVELOPMENT LOUISE BERRY DRIVE BROOKLYN, CT

NOT TO SCALE



**APPENDIX**

**ConnDOT Traffic Counts**

Status: OK North Combined South Class Speed

BROL-058 - Combined - n/s

[37]-Gorman Road - 1.46 mi South of Prince Hill Road

Town	27-Sep Fri	28-Sep Sat	29-Sep Sun	30-Sep Mon	01-Oct Tue	02-Oct Wed	03-Oct Thu
Station	17	14	14	7	8	7	10
Location	7	7	6	0	1	1	2
Posted Speed Limit	2	5	5	0	0	0	1
2015-Major Collector	3	4	4	2	3	3	2
Start Report	0	2	2	7	7	5	7
End Report	7	8	8	33	27	23	23
24-Hour Count	20	23	23	75	65	70	75
Day 1	57	41	41	158	165	165	142
Day 2	9	70	70	323	338	328	346
Day 3	133	94	94	75	87	87	86
Day 4	126	109	109	75	75	71	X
Day 5	166	120	120	97	120	99	
UnRounded AADT	145	140	140	106	119	113	
OK 2019 Fri 27-Sep	144	117	117	85	104	72	
OK 2016 Wed 25-May	153	119	119	153	167	132	
REV 2010 Wed 05-May	126	118	118	295	309	268	
	113	114	114	266	260	240	
	101	101	99	216	222	184	
	92	92	99	131	120	133	
	85	65	63	78	83	79	
	60	65	57	45	39	44	
	51	35	32	36	39	31	
	34	24	14	13	18	21	
	20	15	12	12	17	7	
Totals	1630	1707	1482	2288	2393	2183	694

Status: OK North Combined South Class Speed

BROL-058 - North

[37]-Gorman Road - 1.46 mi South of Prince Hill Road

	27-Sep Fri	28-Sep Sat	29-Sep Sun	30-Sep Mon	01-Oct Tue	02-Oct Wed	03-Oct Thu
Town.....							
Station.....							
Location.....	7	4	4	3	4	3	6
Posted Speed Limit.....	2	1	1	0	0	1	0
2015-Major Collector	0	2	2	0	0	0	0
Start Report.....	1	2	2	2	3	2	2
End Report.....	0	1	1	6	5	4	6
24-Hour Count.....	4	5	5	25	19	18	19
Day 1.....	13	18	18	52	45	49	52
Day 2.....	40	27	27	83	81	78	67
Day 3.....	56	44	44	155	168	167	168
Day 4.....	92	56	56	44	43	42	45
Day 5.....	80	74	74	37	33	39	x
UnRounded AADT.....	75	59	59	40	61	50	
OK 2019 Fri 27-Sep	81	62	62	56	67	63	
OK 2016 Wed 25-May	71	55	55	40	46	34	
REV 2010 Wed 05-May	71	61	61	55	61	48	
Totals	786	863	740	1151	1159	1081	365



Status: OK

North

Combined

South

Class

Speed

**BROL-058 - South** [37]-Gorman Road - 1.46 mi South of Prince Hill Road

	27-Sep Fri	28-Sep Sat	29-Sep Sun	30-Sep Mon	01-Oct Tue	02-Oct Wed	03-Oct Thu
Town.....							
Station.....							
Location.....							
Posted Speed Limit.....							
2015-Major Collector							
Start Report.....							
End Report.....							
24-Hour Count....	1010	* G4(0.88) = 888.8					
Day 1.....	644	* G4(1.03) = 1758.8					
Day 2.....	742	* G4(1.20) = 2648.5					
Day 3.....	1137	* G4(0.96) = 3740.0					
Day 4.....	1234	* G4(0.95) = 4912.3					
Day 5.....	1102	* G4(0.95) = 5959.2					
UnRounded AADT.....	5959.2	/ 6 = 993.2					
OK 2019 Fri 27-Sep -this report...	2000						
OK 2016 Wed 25-May .....	2300						
REV 2010 Wed 05-May .....	2300						
Totals	842	844	742	1137	1234	1102	329

**Manual Turning Movement Counts**

F.A. Hesketh & Associates, Inc.  
3 Creamery Brook

Gorman Road at  
Louise Berry Drive & Residential Drive  
Brooklyn, CT 06234  
Job No.21154

East Granby, CT 06026  
Phone: (860) 653 - 8000

File Name : AM Count 09.21.2021  
Site Code : 00000000  
Start Date : 9/21/2021  
Page No : 1

Groups Printed- Unshifted

Start Time	Gorman Road From North				Residential Drive From East				Gorman Road From South				Louise Berry Dr From West				Int. Total
	Right	Thru	Left	App. Total	Right	Thru	Left	App. Total	Right	Thru	Left	App. Total	Right	Thru	Left	App. Total	
Factor	1.0	1.0	1.0		1.0	1.0	1.0		1.0	1.0	1.0		1.0	1.0	1.0		
07:00 AM	3	3	0	6	0	0	1	1	0	11	4	15	2	0	1	3	25
07:15 AM	2	4	0	6	1	0	0	1	0	11	1	12	5	0	4	9	28
07:30 AM	5	2	0	7	0	0	0	0	0	13	3	16	1	0	2	3	26
07:45 AM	5	5	0	10	0	0	0	0	0	18	4	22	1	0	9	10	42
Total	15	14	0	29	1	0	1	2	0	53	12	65	9	0	16	25	121
08:00 AM	7	5	0	12	0	0	1	1	0	30	6	36	2	0	1	3	52
08:15 AM	6	11	0	17	0	0	0	0	0	44	3	47	12	0	19	31	95
08:30 AM	0	10	0	10	0	0	0	0	0	26	0	26	31	0	38	69	105
08:45 AM	0	7	0	7	0	0	0	0	0	6	0	6	0	0	3	3	16
Total	13	33	0	46	0	0	1	1	0	106	9	115	45	0	61	106	268
Grand Total	28	47	0	75	1	0	2	3	0	159	21	180	54	0	77	131	389
Approch %	37.3	62.7	0.0		33.3	0.0	66.7		0.0	88.3	11.7		41.2	0.0	58.8		
Total %	7.2	12.1	0.0	19.3	0.3	0.0	0.5	0.8	0.0	40.9	5.4	46.3	13.9	0.0	19.8	33.7	

Start Time	Gorman Road From North				Residential Drive From East				Gorman Road From South				Louise Berry Dr From West				Int. Total
	Right	Thru	Left	App. Total	Right	Thru	Left	App. Total	Right	Thru	Left	App. Total	Right	Thru	Left	App. Total	
Peak Hour From 07:00 AM to 08:45 AM - Peak 1 of 1																	
Intersection	07:45 AM																
Volume	18	31	0	49	0	0	1	1	0	118	13	131	46	0	67	113	294
Percent	36.7	63.3	0.0		0.0	0.0	100.0		0.0	90.1	9.9		40.7	0.0	59.3		
08:30 Volume	0	10	0	10	0	0	0	0	0	26	0	26	31	0	38	69	105
Peak Factor																	0.700
High Int.	08:15 AM				08:00 AM				08:15 AM				08:30 AM				
Volume	6	11	0	17	0	0	1	1	0	44	3	47	31	0	38	69	
Peak Factor	0.721				0.250				0.697				0.409				
Peak Hour From 07:00 AM to 08:45 AM - Peak 1 of 1																	
By Approach	07:45 AM				07:00 AM				07:45 AM				07:45 AM				
Volume	18	31	0	49	1	0	1	2	0	118	13	131	46	0	67	113	
Percent	36.7	63.3	0.0		50.0	0.0	50.0		0.0	90.1	9.9		40.7	0.0	59.3		
High Int.	08:15 AM				07:00 AM				08:15 AM				08:30 AM				
Volume	6	11	0	17	0	0	1	1	0	44	3	47	31	0	38	69	
Peak Factor	0.721				0.500				0.697				0.409				

F.A. Hesketh & Associates, Inc.  
3 Creamery Brook

Gorman Road at  
Louise Berry Drive & Residential Drive  
Brooklyn, CT 06234  
Job No.21154

East Granby, CT 06026  
Phone: (860) 653 - 8000

File Name : PM Count 09.21.2021  
Site Code : 00000000  
Start Date : 9/21/2021  
Page No : 1

Groups Printed- Unshifted


Start Time	Gorman Road From North				Residential Drive From East				Gorman Road From South				Louise Berry Drive From West				Int. Total
	Right	Thru	Left	App. Total	Right	Thru	Left	App. Total	Right	Thru	Left	App. Total	Right	Thru	Left	App. Total	
Factor	1.0	1.0	1.0		1.0	1.0	1.0		1.0	1.0	1.0		1.0	1.0	1.0		
02:30 PM	2	10	0	12	1	0	0	1	0	15	0	15	0	0	1	1	29
02:45 PM	0	10	0	10	0	0	0	0	0	24	1	25	1	0	1	2	37
Total	2	20	0	22	1	0	0	1	0	39	1	40	1	0	2	3	66
03:00 PM	1	8	0	9	0	0	0	0	0	16	0	16	2	0	6	8	33
03:15 PM	1	31	0	32	0	0	0	0	0	15	2	17	21	0	64	85	134
03:30 PM	0	15	0	15	0	0	0	0	0	3	0	3	15	0	22	37	55
03:45 PM	0	22	0	22	0	0	0	0	0	10	0	10	2	0	3	5	37
Total	2	76	0	78	0	0	0	0	0	44	2	46	40	0	95	135	259
04:00 PM	1	18	0	19	0	0	0	0	0	13	0	13	3	0	3	6	38
04:15 PM	0	14	0	14	1	0	0	1	1	6	0	7	4	0	6	10	32
Grand Total	5	128	0	133	2	0	0	2	1	102	3	106	48	0	106	154	395
Apprch %	3.8	96.2	0.0		100.0	0.0	0.0		0.9	96.2	2.8		31.2	0.0	68.8		
Total %	1.3	32.4	0.0	33.7	0.5	0.0	0.0	0.5	0.3	25.8	0.8	26.8	12.2	0.0	26.8	39.0	

Start Time	Gorman Road From North				Residential Drive From East				Gorman Road From South				Louise Berry Drive From West				Int. Total
	Right	Thru	Left	App. Total	Right	Thru	Left	App. Total	Right	Thru	Left	App. Total	Right	Thru	Left	App. Total	
Peak Hour From 02:30 PM to 04:15 PM - Peak 1 of 1																	
Intersection	03:15 PM				2:15:00 PM				03:15 PM				03:15 PM				
Volume	2	86	0	88	0	0	0	0	0	41	2	43	41	0	92	133	264
Percent	2.3	97.7	0.0		0.0	0.0	0.0		0.0	95.3	4.7		30.8	0.0	69.2		
03:15	1	31	0	32	0	0	0	0	0	15	2	17	21	0	64	85	134
Volume																	
Peak Factor	0.688								0.632				0.391				0.493
High Int.	03:15 PM				2:15:00 PM				03:15 PM				03:15 PM				
Volume	1	31	0	32	0	0	0	0	0	15	2	17	21	0	64	85	
Peak Factor	0.688								0.632				0.391				
Peak Hour From 02:30 PM to 04:15 PM - Peak 1 of 1																	
By	03:15 PM				02:30 PM				02:30 PM				03:00 PM				
Approach																	
Volume	2	86	0	88	1	0	0	1	0	70	3	73	40	0	95	135	
Percent	2.3	97.7	0.0		100.0	0.0	0.0		0.0	95.9	4.1		29.6	0.0	70.4		
High Int.	03:15 PM				02:30 PM				02:45 PM				03:15 PM				
Volume	1	31	0	32	1	0	0	1	0	24	1	25	21	0	64	85	
Peak Factor	0.688				0.250				0.730				0.397				

**Brooklyn School Drop Off / Pick Up  
Procedures**

## Brooklyn Middle School Drop Off and Pick Up


BMS Drop Off/Pick Up Map Key	
Buses	Buses will drop off and pick up students at the elementary entrance loop. Middle school students will follow the sidewalk to the Maroon entrances listed on the map for their grade level. This is where they will enter the building in the morning and exit the building in the afternoon.
Morning Drop Off	
Middle School ONLY Drop Off	Cars will enter on the right hand side of the middle school entrance and follow traffic pattern (see map) When dropping off only a middle school student, you will drop off at the side of the gymnasium and exit out the main entrance to the middle school
Elementary and Middle Drop Off	Follow the same traffic flow as listed for Middle School only, go around the loop a second time to follow the driveway to the elementary school
Afternoon Pick Up	
To maximize the efficiency of afternoon dismissal please make sure your child knows they will be picked up at the end of the school day. OR if an unforeseen circumstance arises call the main office to notify the school <u>no later than 3:00 pm</u> . Any student who is unsure of the dismissal procedure will be put on the bus home.	
Middle School ONLY Pick Up	Following the same traffic pattern. Park in designated spots in the gymnasium parking lot and along the field.
Elementary and Middle Pick Up	Proceed to the back parking lot following the traffic pattern pull into the center parking area.

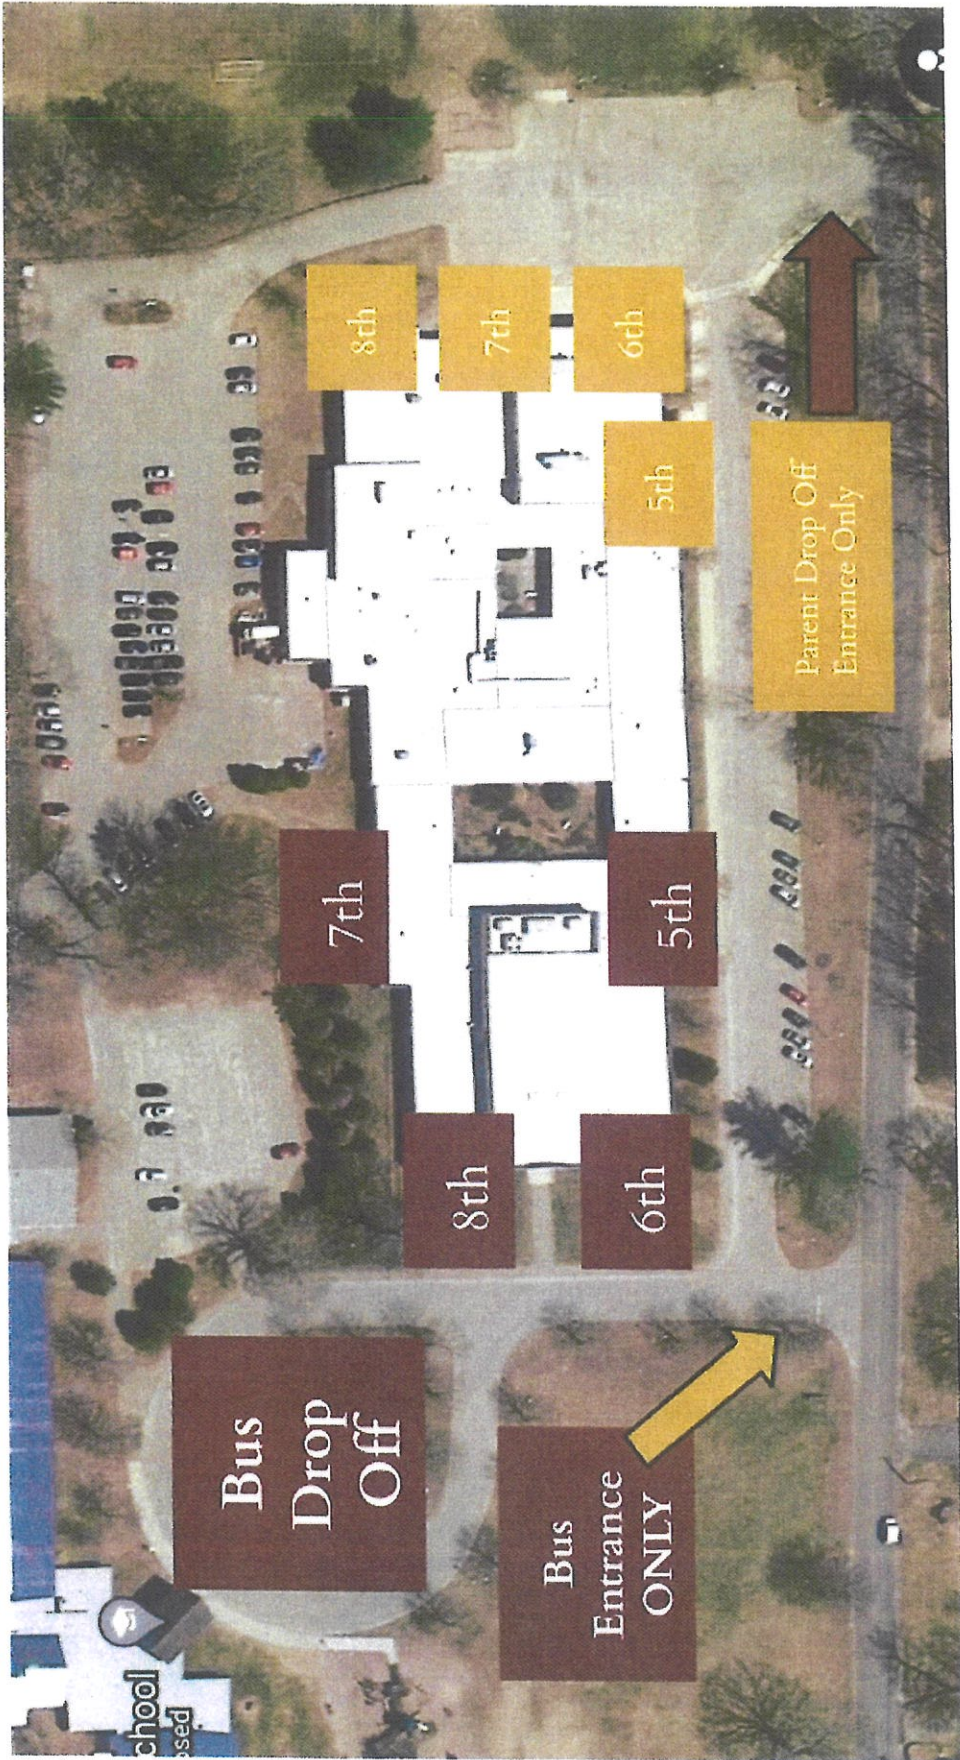

# Morning Drop Off Map


Parents will loop around and exit if they are dropping middle school students only off

If you need to drop off an elementary student as well, you will need to follow the loop and proceed to the elementary following the driveway behind

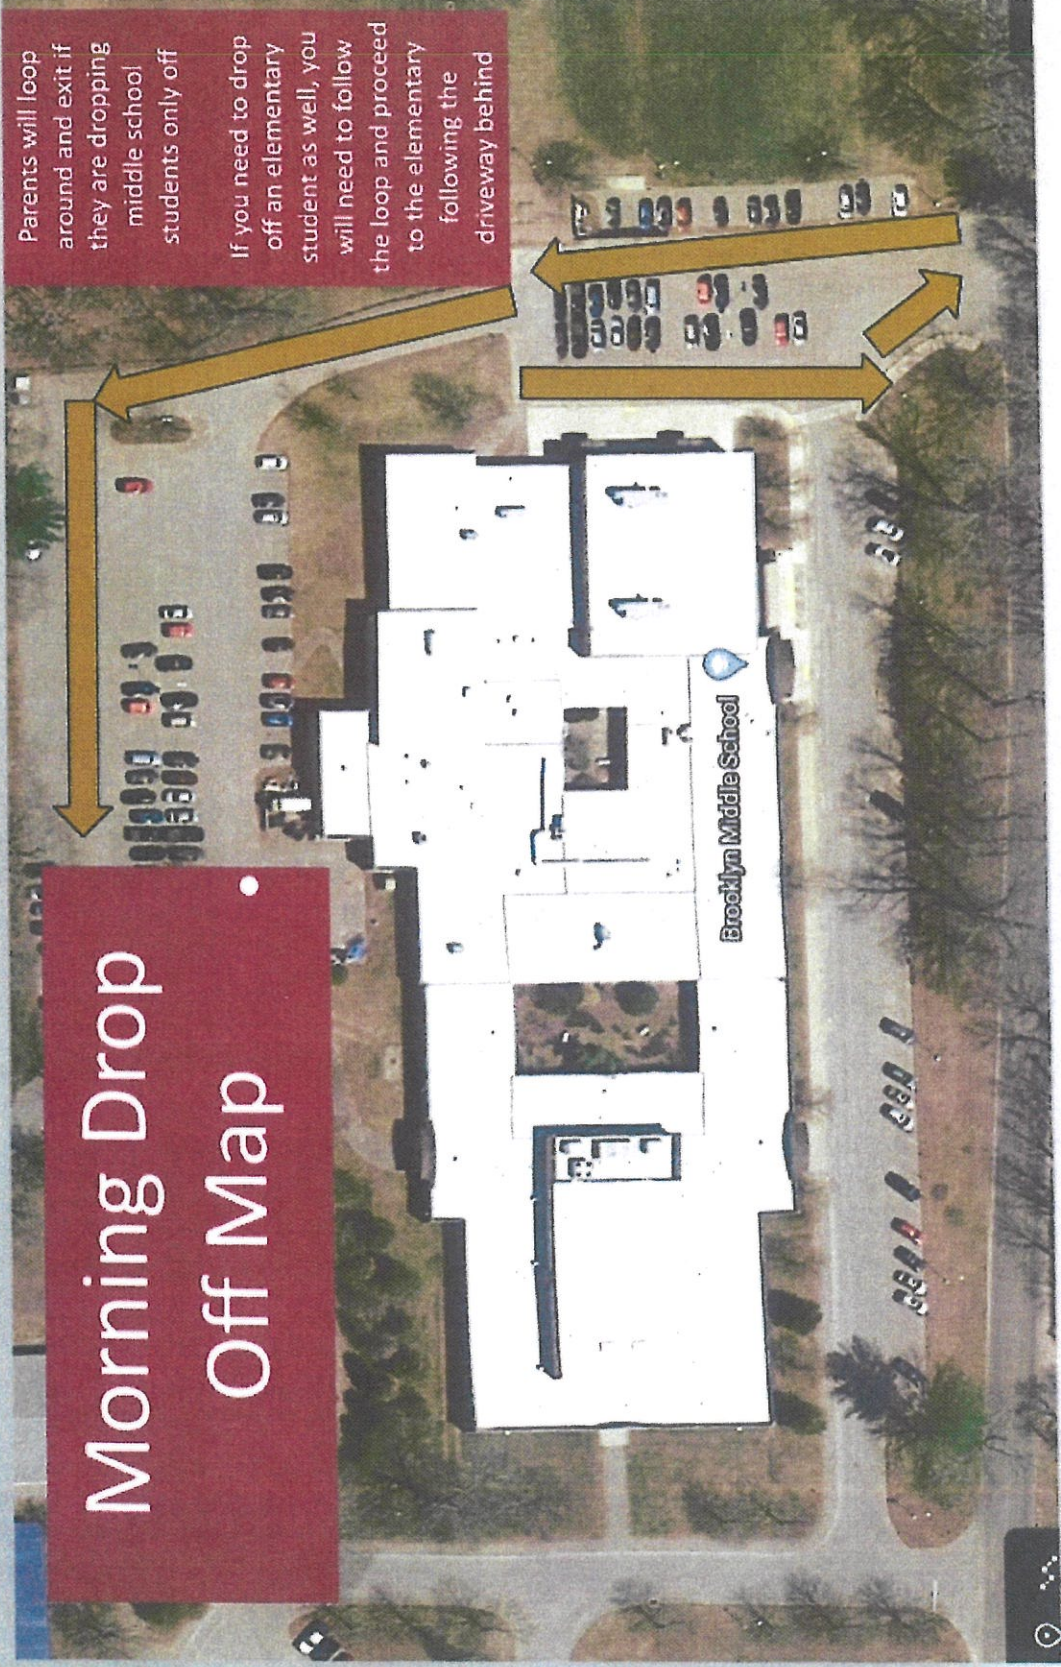




# Dismissal Map

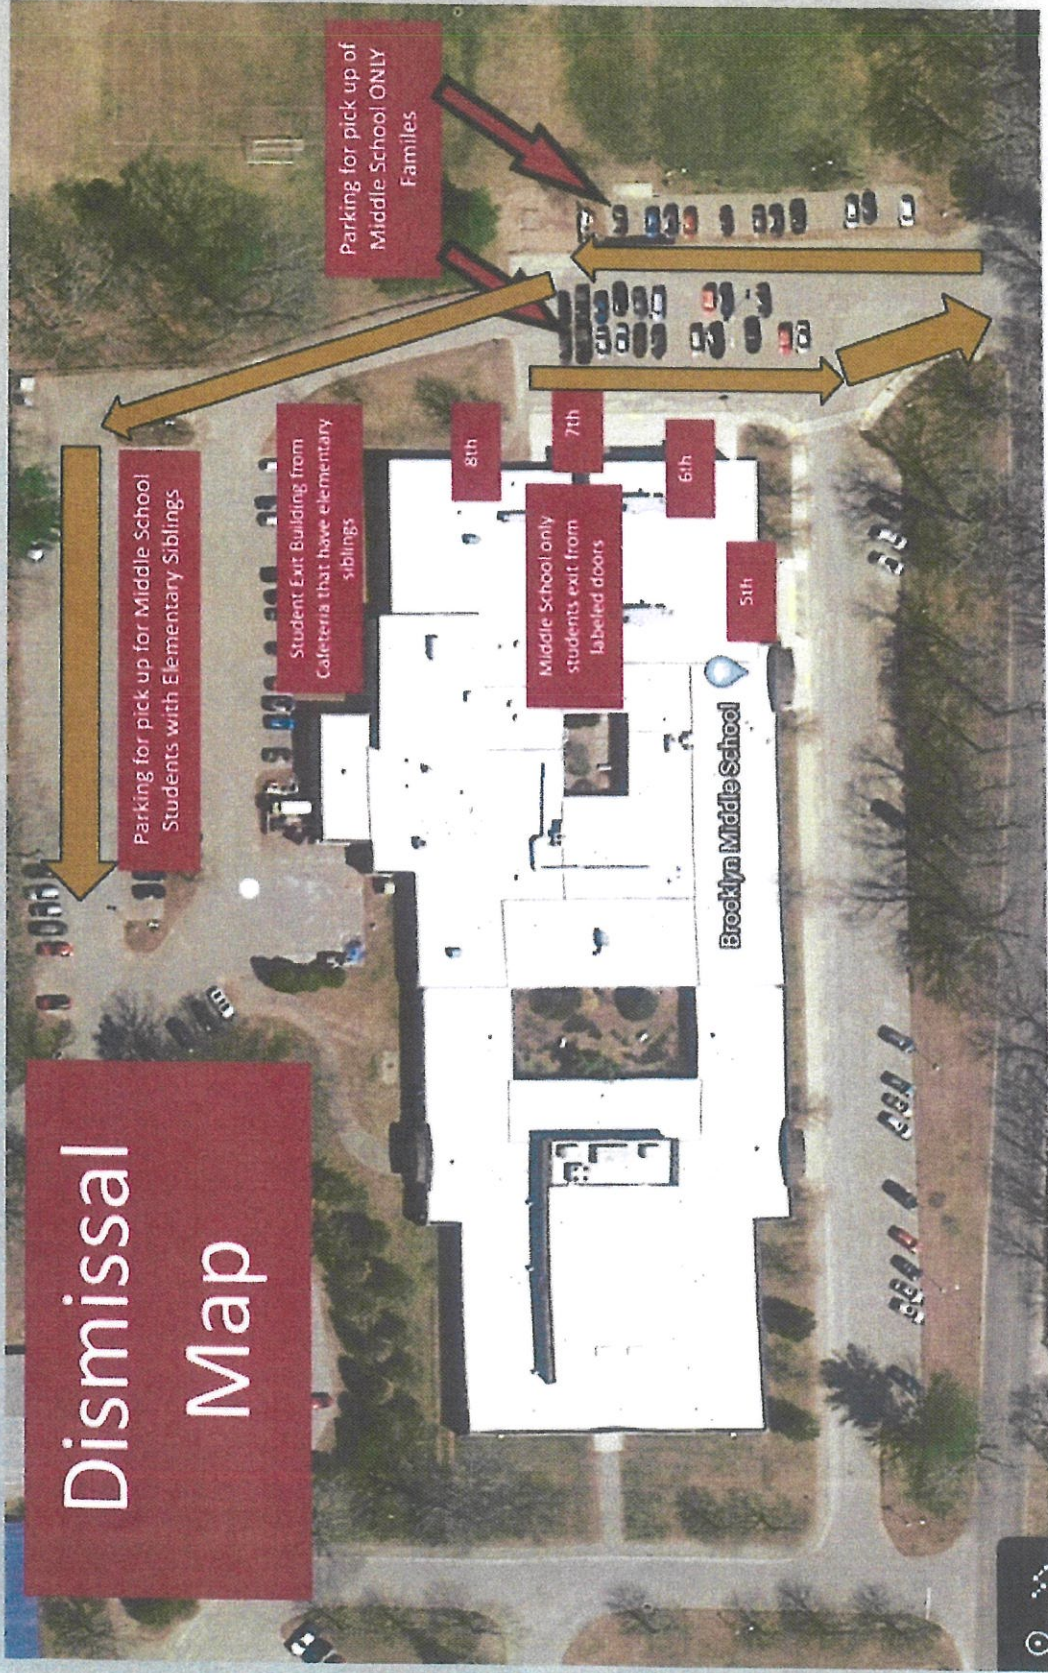

## Brooklyn Elementary School Drop Off and Pick Up Procedures

BES Drop Off/Pick Up Map Key	
	Morning Drop Off
	Afternoon Pick Up
	To maximize the efficiency of afternoon dismissal please make sure your child knows they will be picked up at the end of the school day OR if an unforeseen circumstance arises call the main office to notify the school no later than 3:00 pm. Any student who is unsure of the dismissal procedure will be put on the bus home.
Buses	Buses will drop off and pick up students at the elementary entrance loop. Students will be escorted into and out of the building when their busses arrive. Students will have assigned seating that will be determined by the bus run. Siblings will be placed in seats together.
Drop Off	Cars will enter on the right hand side of the middle school entrance and follow traffic pattern (see map) around to the back of the elementary school. Once around the back of the building, please stay to the left of the road.
Grade PreK, K, 1, 2 & 3	Similar to last year, continue to stay to the left of the road and follow the traffic pattern to the left of the back parking lot, alongside the building. Once you are directed, please have children exit the vehicle on the driver side of the vehicle. Remain in the line until the vehicle in front of you exits. <b>This area is a no passing zone.</b>
Grade 4 ONLY Drop off	Grade 4 students may be dropped off at the back of the elementary school where they will walk to the back entrance of the building. Please have children exit the vehicle on the driver side of the vehicle. Once a child has safely left the vehicle, grade 4 families may merge right and exit the parent drop off line.
Pick Up	Cars will enter on the right hand side of the middle school entrance and follow traffic pattern (see map) around to the back of the elementary school. Once around the back of the building, please stay to the left of the road.
Grade PreK, K, 1, 2, & 3	Similar to last year, continue to stay to the left of the road and follow the traffic pattern to the back parking lot, alongside the building. Children will enter the vehicle on the driver side of the vehicle. Remain in the line until the vehicle in front of you exits. <b>This area is a no passing zone.</b>
Grade 4 ONLY Drop off	Grade 4 students may be picked up at the back of the elementary school where they will walk to the vehicles. Once a child has safely entered the vehicle, grade 4 families may merge right and exit the parent drop off line.

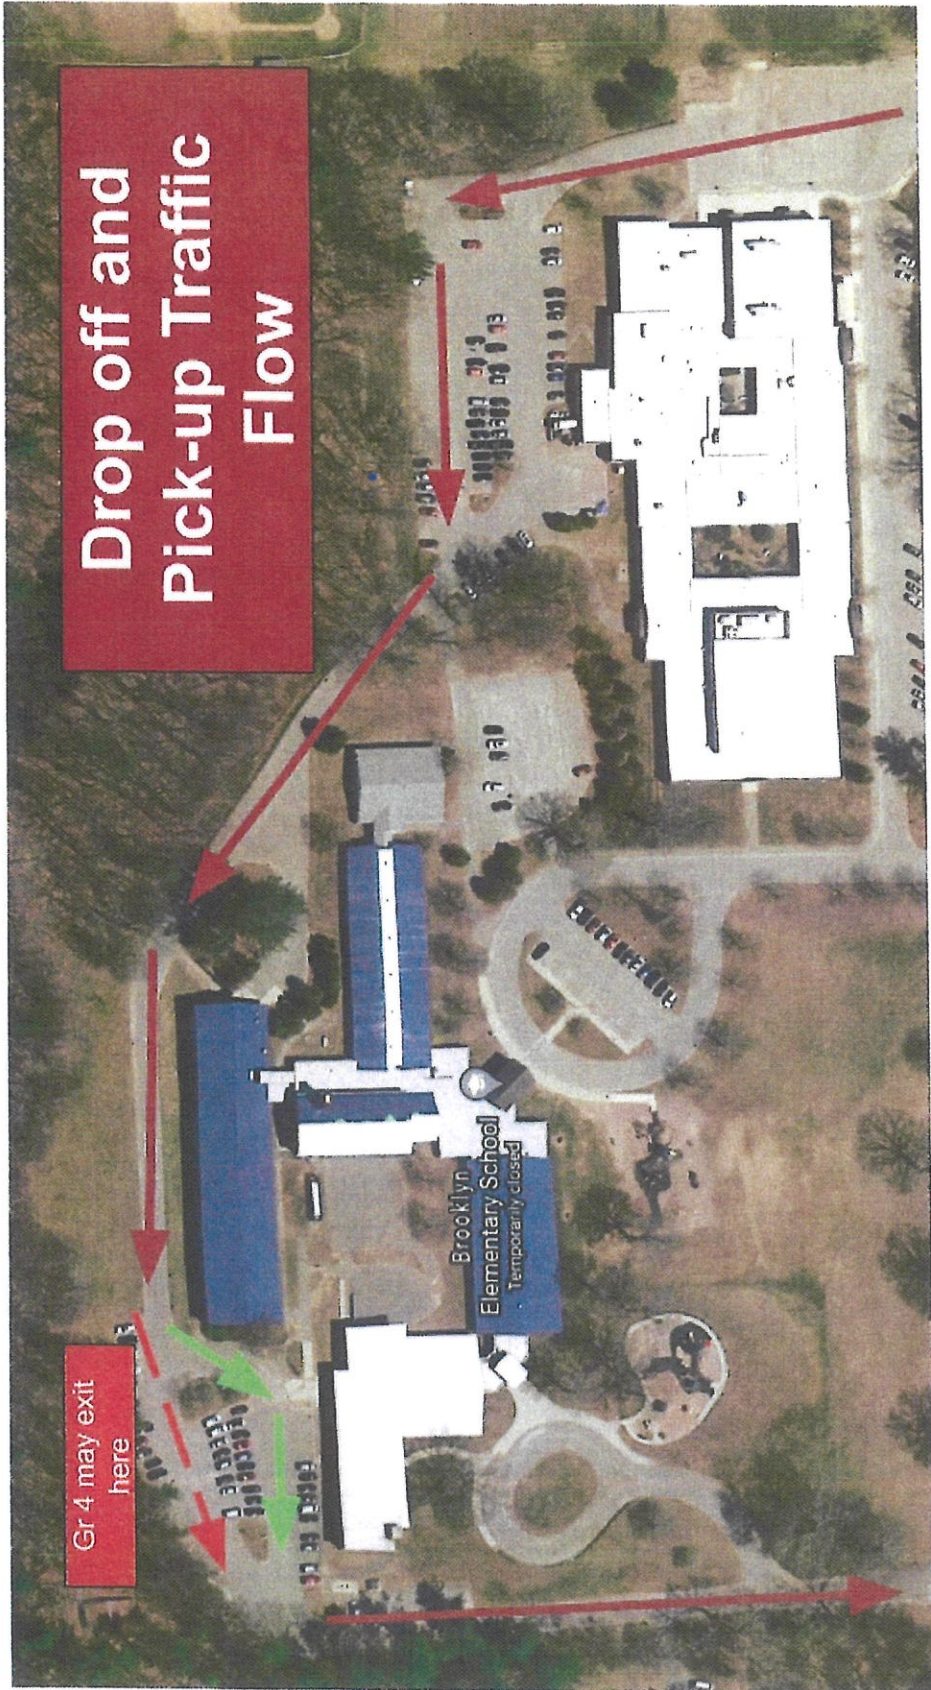


Drop off and  
Pick-up Traffic  
Flow

Gr 4 may exit  
here

Brooklyn  
Elementary School  
Temporarily closed

# Grade Level Entrance and Exit Map

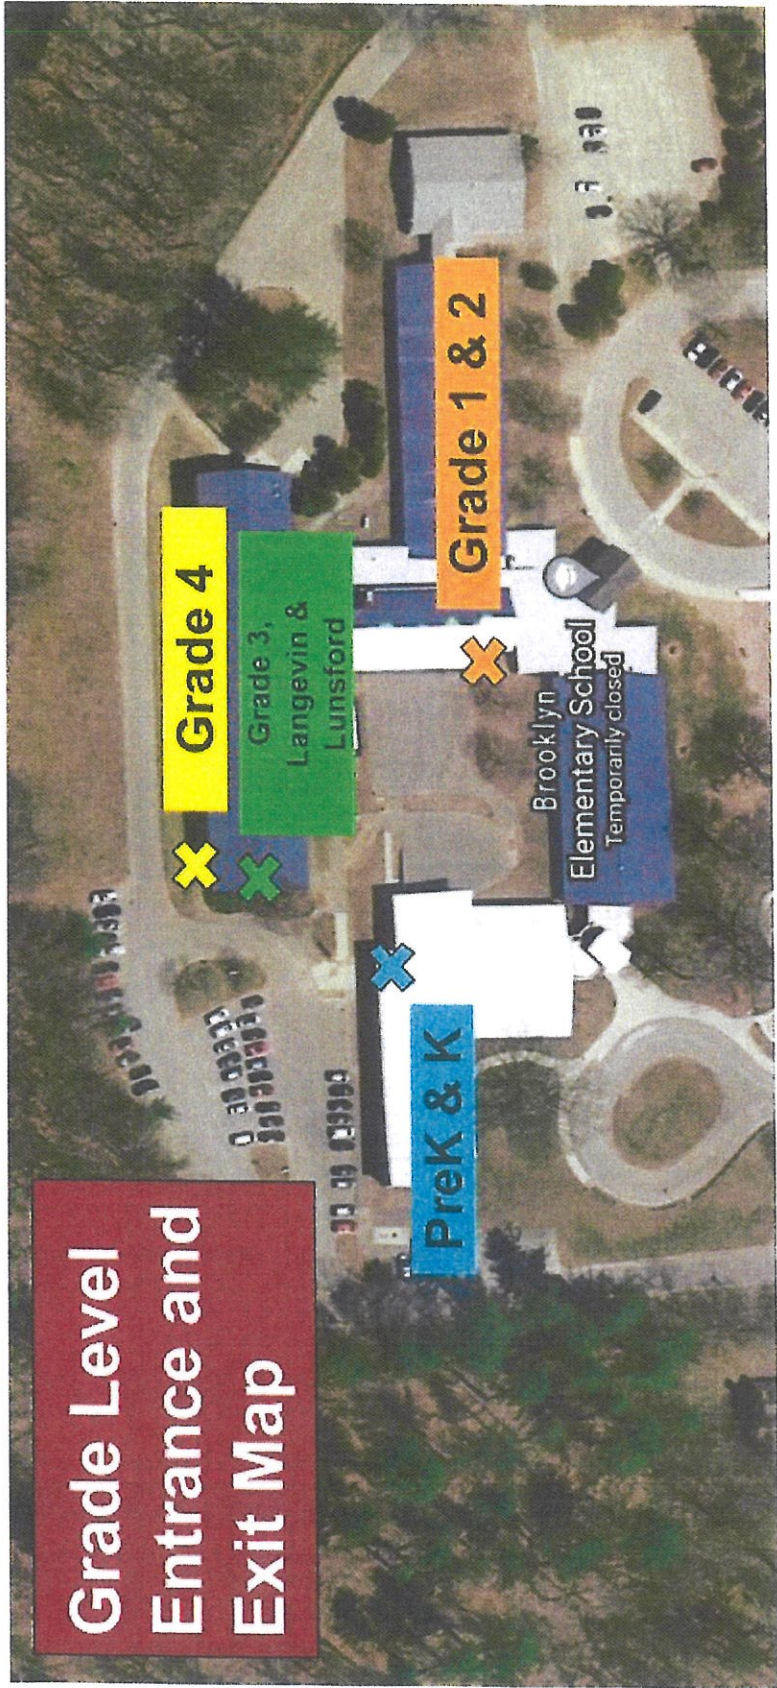

**ITE Trip Generation**  
**Residential Uses**



Data Plot and Equation

DATA STATISTICS

Land Use: Multifamily Housing (Low-Rise) - Not Close to Rail Transit (220) [Click for Description and Data Plots](#)

Independent Variable: Dwelling Units

Time Period: Weekday

Peak Hour of Adjacent Street Traffic: One Hour Between 4 and 6 p.m.

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 59

Avg. Num. of Dwelling Units: 241

Average Rate: 0.51

Range of Rates: 0.08 - 1.04

Standard Deviation: 0.15


Fitted Curve Equation:  $T = 0.43(X) + 20.55$

R<sup>2</sup>: 0.84

Directional Distribution: 63% entering, 37% exiting

Calculated Trip Ends: Average Rate: 26 (Total: 16 (Entry), 10 (Exit))

Fitted Curve: 42 (Total: 26 (Entry), 16 (Exit))

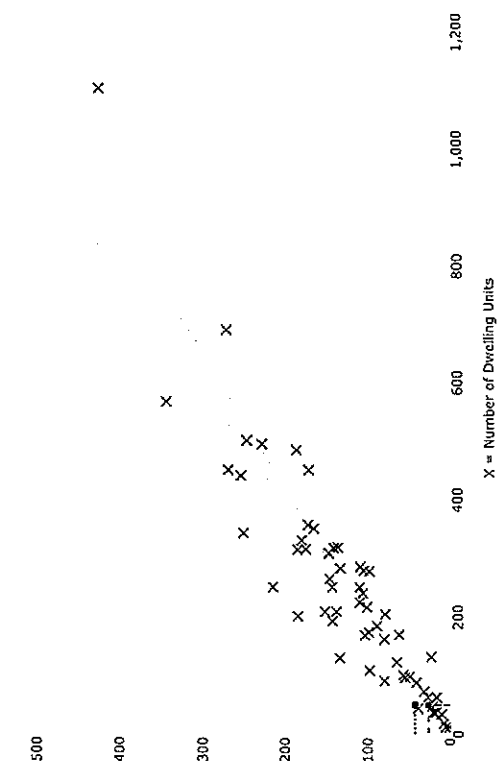

X = Number of Dwelling Units

Reset Zoom Restore

Average Rate

DATA SOURCE: Trip Generation Manual, 11th Ed

SEARCH BY LAND USE CODE: 220

LAND USE GROUP: (200-299) Residential

LAND USE: 220 - Multifamily Housing (Low-Rise)

LAND USE SUBCATEGORY: Not Close to Rail Transit

SETTING/LOCATION: General Urban/Suburban

INDEPENDENT VARIABLE (IV): Dwelling Units

TIME PERIOD: Weekday; Peak Hour of Adjacent Street Traffic

TRIP TYPE: Vehicle

ENTER IV VALUE TO CALCULATE TRIPS: 50 Calculate

Use the mouse wheel to Zoom Out or Zoom In.  
Hover the mouse pointer on data points to view X and T values.

Data Plot and Equation

DATA SOURCE: Trip Generation Manual, 11th Ed

SEARCH BY LAND USE CODE:

LAND USE GROUP: (200-299) Residential

LAND USE: 220 - Multifamily Housing (Low-Rise)

LAND USE SUBCATEGORY: Not Close to Rail Transit


SETTING/LOCATION: General Urban/Suburban

INDEPENDENT VARIABLE (IV): Dwelling Units

TIME PERIOD: Weekday, Peak Hour of Adjacent Street Traffic

TRIP TYPE: Vehicle

ENTER IV VALUE TO CALCULATE TRIPS.

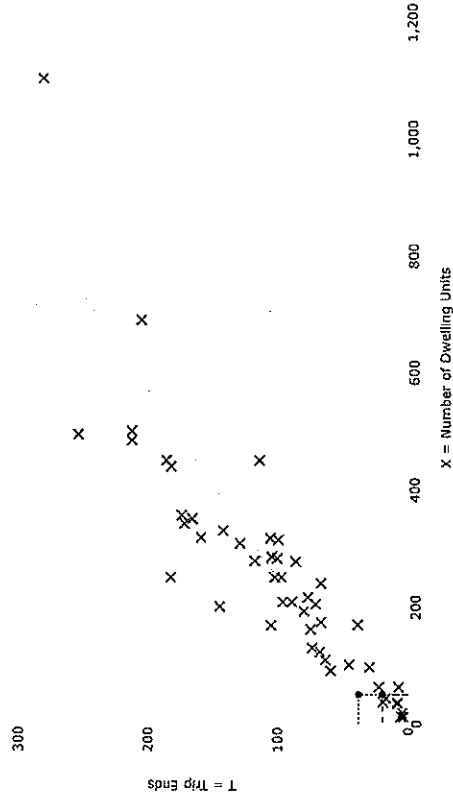

DATA STATISTICS

Land Use: Multifamily Housing (Low-Rise) - Not Close to Rail Transit (220) [Click for Description and Data Points](#)

Independent Variable: Dwelling Units

Time Period: Weekday  
Peak Hour of Adjacent Street Traffic  
One Hour Between 7 and 9 a.m.

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 49

Avg. Num. of Dwelling Units: 249

Average Rate: 0.40

Range of Rates: 0.13 - 0.73

Standard Deviation: 0.12

Fitted Curve Equation:  $T = 0.31(X) + 22.65$

$R^2$ : 0.79

Directional Distribution: 24% entering, 76% exiting

Calculated Trip Ends: Average Rate: 29 (Total: 5 (Entry), 15 (Exit))  
Fitted Curve: 38 (Total) 9 (Entry), 29 (Exit)

Use the mouse wheel to Zoom Out or Zoom In.  
Hover the mouse pointer on data points to view X and T values.



Data Plot and Equation

DATA STATISTICS

Land Use: Multifamily Housing (Low-Rise) - Not Close to Rail Transit (220) Click for Description and Data Plots

Independent Variable: Dwelling Units

Time Period: Weekday

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 22

Avg. Num. of Dwelling Units: 229

Average Rate: 6.74

Range of Rates: 2.45 - 12.50


Standard Deviation: 1.78

Fitted Curve Equation:  $T = 6.7(1^X) + 74.31$

R<sup>2</sup>: 0.86

Directional Distribution: 50% entering 50% exiting

Calculated Trip Ends: Average Rate: 337 (Total: 169 (Exit) 169 (Entry) 198 (Total) 198 (Entry) 198 (Exit))

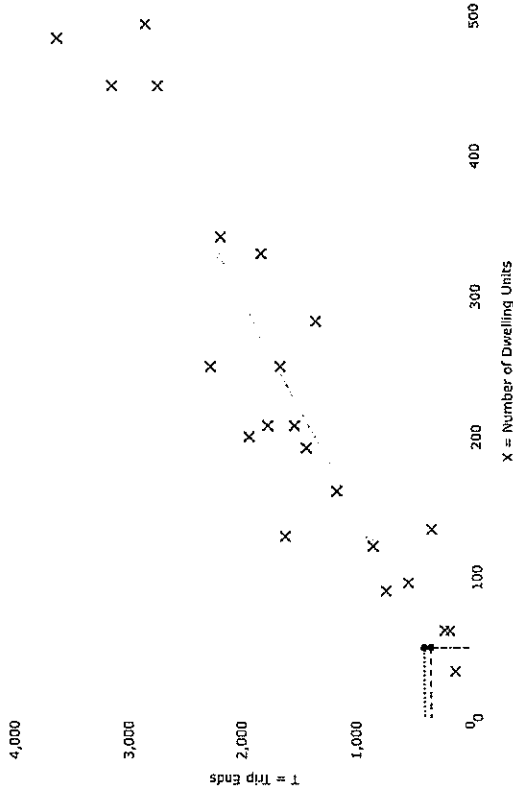

X = Number of Dwelling Units

Reset Zoom Restore

X Study Site

Average Rate

ENTER VALUE TO CALCULATE TRIPS:

Use the mouse wheel to Zoom Out or Zoom In.  
Hover the mouse pointer on data points to view X and T values.



# Graph Look Up



## Data Plot and Equation

DATA SOURCE: Trip Generation Manual, 11th Ed

SEARCH BY LAND USE CODE:

LAND USE GROUP: (200-299) Residential

LAND USE: 215 - Single-Family Attached Housing

LAND USE SUBCATEGORY: All Sites

SETTING/LOCATION: General Urban/Suburban

INDEPENDENT VARIABLE (IV): Dwelling Units

TIME PERIOD: Weekday

TRIP TYPE: Vehicle

ENTER IV VALUE TO CALCULATE TRIPS:

## DATA STATISTICS

Land Use: Single-Family Attached Housing (215) Click for Description and Data Plots

Independent Variable: Dwelling Units

Time Period: Weekday

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 22

Avg. Num. of Dwelling Units: 120

Average Rate: 7.20

Range of Rates: 4.70 - 10.97

Standard Deviation: 1.51


Fitted Curve Equation:  $T = 7.62(X) + 50.48$

$R^2$ : 0.94

Directional Distribution: 50% entering, 50% exiting

Calculated Trip Ends: Average Rate: 360 (Total), 180 (Entry), 180 (Exit)

Fitted Curve: 331 (Total), 165 (Entry), 166 (Exit)

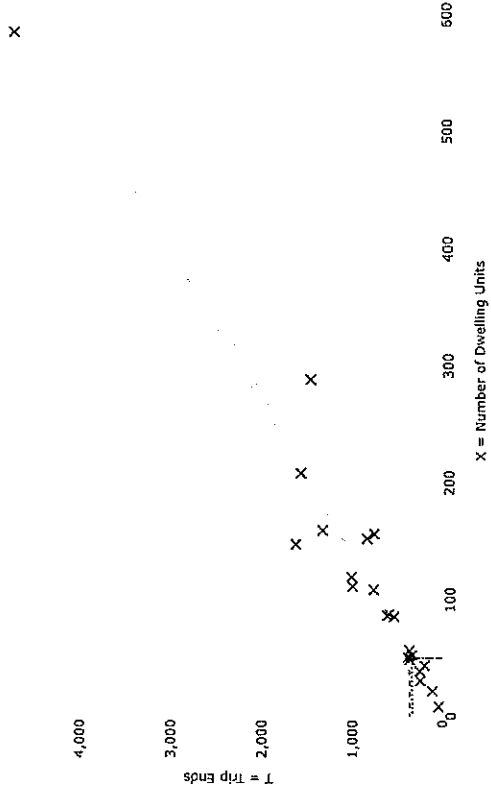

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and T values.

# Graph Look Up

## Data Plot and Equation

## DATA STATISTICS

Land Use:  
Single-Family Attached Housing (215) Click for Description and Data Plots

DATA SOURCE: Trip Generation Manual, 11th Ed

SEARCH BY LAND USE CODE:

LAND USE GROUP: (200-299) Residential

LAND USE: 215 - Single-Family Attached Housing

LAND USE SUBCATEGORY: All Sites

SETTING/LOCATION: General Urban/Suburban

INDEPENDENT VARIABLE (IV): Dwelling Units

TIME PERIOD: Weekday, Peak Hour of Adjacent Street Traffic

TRIP TYPE: Vehicle

ENTER IV VALUE TO CALCULATE TRIPS:  Calculate

500  
400  
300  
200  
100  
0

T = Trip Ends

X = Study Site

Reset Zoom Restore

X = Number of Dwelling Units

600

Average Rate

Directional Distribution:  
31% entering, 69% exiting

Calculated Trip Ends:  
Average Rate: 24 (Total: 7 (Entry), 17 (Exit))  
Fitted Curve: 20 (Total: 6 (Entry), 14 (Exit))

Independent Variable:  
Dwelling Units

Time Period:  
Weekday

Peak Hour of Adjacent Street Traffic  
One Hour Between 7 and 9 a.m.

Setting/Location:  
General Urban/Suburban

Trip Type:  
Vehicle

Number of Studies:  
45

Avg. Num. of Dwelling Units:  
135

Average Rate:  
0.48

Range of Rates:  
0.12 - 0.74

Standard Deviation:  
0.14

Fitted Curve Equation:  
 $T = 0.52(X) - 5.70$

$R^2$ :  
0.92

Directional Distribution:  
31% entering, 69% exiting

Calculated Trip Ends:  
Average Rate: 24 (Total: 7 (Entry), 17 (Exit))

Fitted Curve: 20 (Total: 6 (Entry), 14 (Exit))

Use the mouse wheel to Zoom Out or Zoom In.  
Hover the mouse pointer on data points to view X and T values.



# Graph Look Up

## Data Plot and Equation

DATA SOURCE: Trip Generation Manual, 11th Ed

SEARCH BY LAND USE CODE:

LAND USE GROUP: (200-299) Residential

LAND USE: 215 - Single-Family Attached Housing

LAND USE SUBCATEGORY: All Sites

SETTING/LOCATION: General Urban/Suburban

INDEPENDENT VARIABLE (IV): Dwelling Units

TIME PERIOD: Weekday, Peak Hour of Adjacent Street Traffic

TRIP TYPE: Vehicle

ENTER IV VALUE TO CALCULATE TRIPS:

## DATA STATISTICS

Land Use: Single-Family Attached Housing (215) Class for Description and Data Plots

Independent Variable: Dwelling Units

Time Period: Weekday

Peak Hour of Adjacent Street Traffic One Hour Between 4 and 5 p.m.

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 51

Avg. Num. of Dwelling Units: 136

Average Rate: 0.57

Range of Rates: 0.17 - 1.25

Standard Deviation: 0.18


Fitted Curve Equation:  $T = 0.60(X) - 3.93$

R<sup>2</sup>: 0.91

Directional Distribution: 57% entering, 43% exiting

Calculated Trip Ends: Average Rate: 29 (Total: 15 (Entry), 12 (Exit))

Fitted Curve: 26 (Total: 15 (Entry), 11 (Exit))

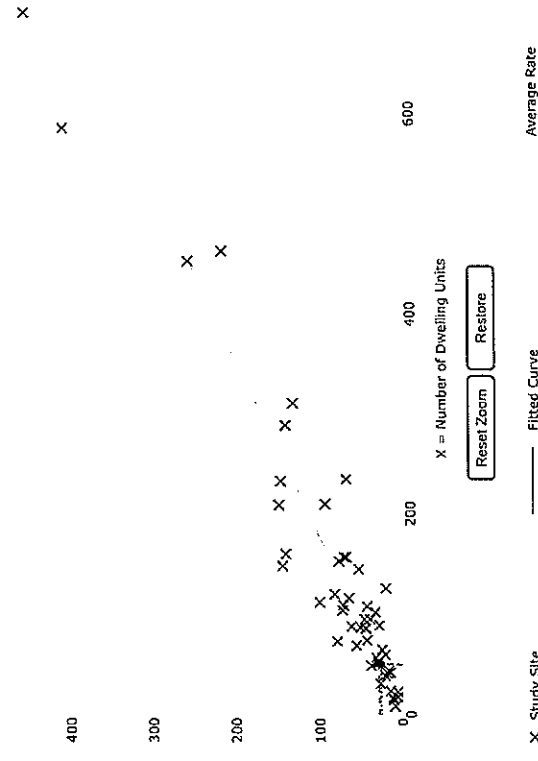

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.



Data Plot and Equation

DATA SOURCE: Trip Generation Manual, 11th Ed

SEARCH BY LAND USE CODE:

LAND USE GROUP: (200-299) Residential

LAND USE: 210 - Single-Family Detached Housing

LAND USE SUBCATEGORY: All Sites


SETTING/LOCATION: General Urban/Suburban

INDEPENDENT VARIABLE (IV): Dwelling Units

TIME PERIOD: Weekday

TRIP TYPE: Vehicle

ENTER IV VALUE TO CALCULATE TRIPS:

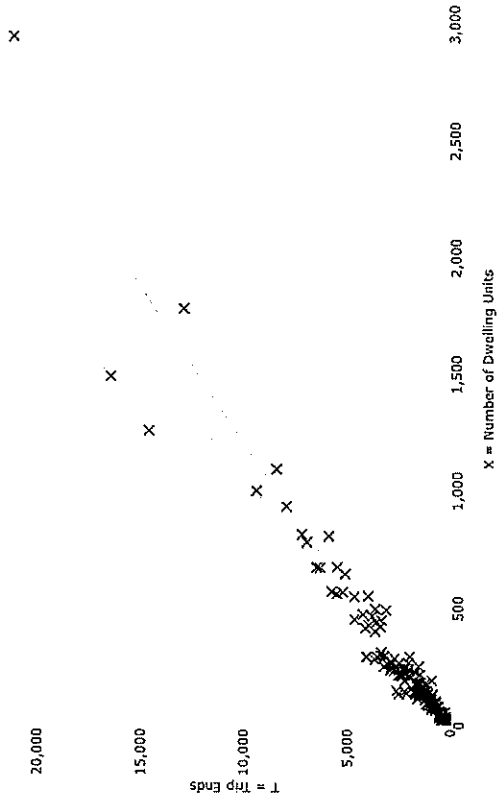

Average Rate

DATA STATISTICS

Land Use: Single-Family Detached Housing (210) Click for Description and Data Plots

Independent Variable: Dwelling Units

Time Period: Weekday

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 174

Avg. Num. of Dwelling Units: 245

Average Rate: 9.43

Range of Rates: 4.45 - 22.61

Standard Deviation: 2.13

Fitted Curve Equation:  $Lr(T) = 0.92 Ln(X) + 2.64$

R<sup>2</sup>: 0.95

Directional Distribution: 50% entering, 50% exiting

Calculated Trip Ends: Average Rate: 472 (Total), 236 (Entry), 236 (Exit) Fitted Curve: 532 (Total), 266 (Entry), 266 (Exit)

Use the mouse wheel to Zoom Out or Zoom In.  
Hover the mouse pointer on data points to view X and T values.

# Graph Look Up



## Data Plot and Equation

## DATA STATISTICS

Land Use: Single-Family Detached Housing (210) [Click for Description and Data Plots](#)

Independent Variable: Dwelling Units

Time Period: Weekday  
 Peak Hour of Adjacent Street Traffic  
 One Hour Between 7 and 9 a.m.

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 192

Avg. Num. of Dwelling Units: 226

Average Rate: 0.70

Range of Rates: 0.27 - 2.27

Standard Deviation: 0.24

Fitted Curve Equation:  $Ln(T) = 0.91 Ln(X) + 0.12$

$R^2$ : 0.90

Directional Distribution: 26% entering, 74% exiting

Calculated Trip Ends: Average Rate: 35 (Total) 9 (Entry) 26 (Exit)

Fitted Curve: 40 (Total), 10 (Entry), 30 (Exit)

DATA SOURCE: Trip Generation Manual, 11th Ed

SEARCH BY LAND USE CODE:

LAND USE GROUP: (200-299) Residential

LAND USE: 210 - Single-Family Detached Housing

LAND USE SUBCATEGORY: All Sites


SETTING/LOCATION: General Urban/Suburban

INDEPENDENT VARIABLE (IV): Dwelling Units

TIME PERIOD: Weekday, Peak Hour of Adjacent Street Traffic

TRIP TYPE: Vehicle

ENTER IV VALUE TO CALCULATE TRIPS:

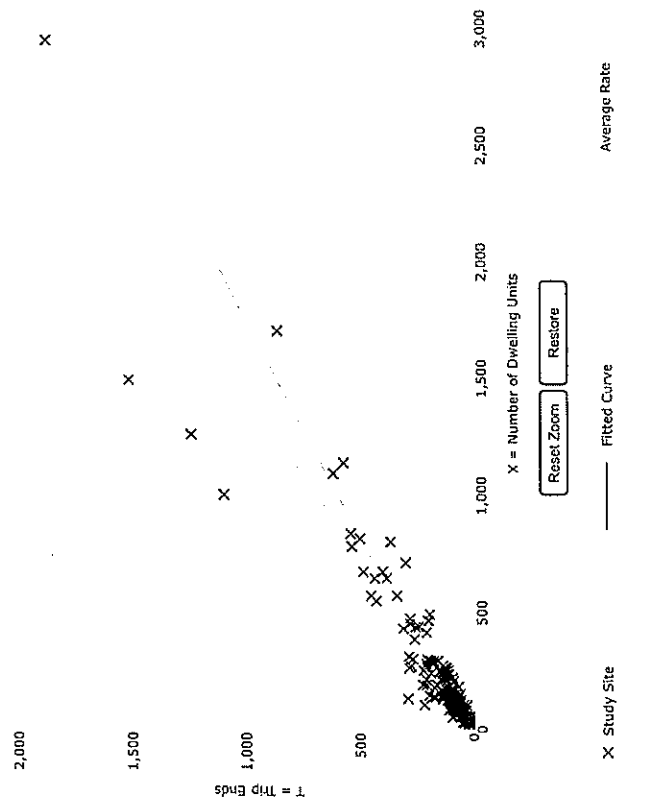

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.

# Graph Look Up



## Data Plot and Equation

DATA SOURCE: Trip Generation Manual, 11th Ed

SEARCH BY LAND USE CODE:

LAND USE GROUP: (200-299) Residential

LAND USE: 210 - Single-Family Detached Housing

LAND USE SUBCATEGORY: All Sites

SETTING/LOCATION: General Urban/Suburban

INDEPENDENT VARIABLE (IV): Dwelling Units

TIME PERIOD: Weekday, Peak Hour of Adjacent Street Traffic

TRIP TYPE: Vehicle

ENTER IV VALUE TO CALCULATE TRIPS:

## DATA STATISTICS

Land Use: Single-Family Detached Housing (210) [Click for Description and Data Plots](#)

Independent Variable: Dwelling Units

Time Period: Weekday  
Peak Hour of Adjacent Street Traffic  
One Hour Between 4 and 6 p.m.

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 206

Avg. Num. of Dwelling Units: 248

Average Rate: 0.94

Range of Rates: 0.35 - 2.99

Standard Deviation: 0.31

Fitted Curve Equation:  $Ln(T) = 0.94 Ln(X) + 0.27$

$R^2$ : 0.92

Directional Distribution: 63% entering, 37% exiting

Calculated Trip Ends: Average Rate, 47 (Total), 30 (Entry), 17 (Exit)

Fitted Curve: 52 (Total), 33 (Entry), 19 (Exit)



Use the mouse wheel to Zoom Out or Zoom In.  
Hover the mouse pointer on data points to view X and T values.

**ITE *Trip Generation* Worksheets**  
**Middle School / Elementary School**  
**Based on Square Footage**




# Graph Look Up

SEARCH FOR: 1000 SQ FT GFA

## DATA STATISTICS

Land Use: Elementary School (520) - Supplement  
 Independent Variable: 1000 SQ FT GFA  
 Time Period: Weekly  
 Setting/Location: General Urban/Suburban  
 Trip Type: Vehicle  
 Number of Studies: 16  
 Avg. 1000 Sq. Ft. GFA: 54  
 Average Rate: 19.55  
 Range of Rates: 17.49 - 25.97  
 Standard Deviation: 5.15  
 Fitted Curve Equation: Not Given  
 R<sup>2</sup>: \*\*\*\*  
 Directional Distribution: 50% entering, 50% exiting  
 Calculated Trip Ends: Average Rate: 19.55, Total: 850 Entry, 850 Exit

## Data Plot and Equation

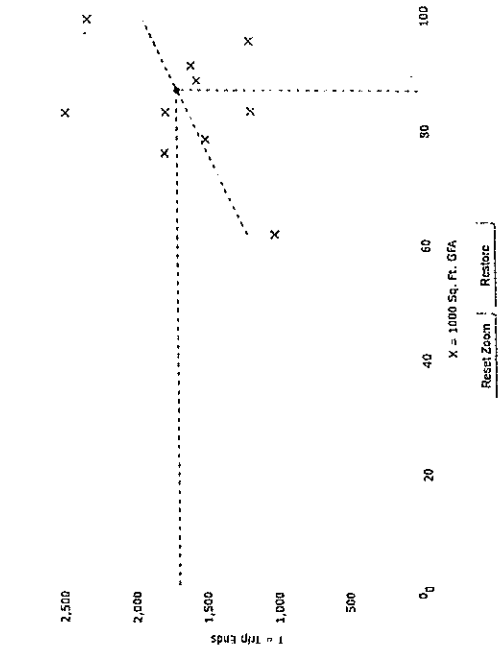

Query: Filter

DATA SOURCE: Trip Gen Manual, 1000 Sq - Supplement

SEARCH BY LAND USE CODE: 520

LAND USE GROUP: (600-589) Institutional

LAND USE: 520 - Elementary School

LAND USE SUBCATEGORY: All Sites

INDEPENDENT VARIABLE (X): 1000 SQ. FT. GFA

TIME PERIOD: Weekly

SETTING/LOCATION: General Urban/Suburban

TRIP TYPE: Vehicle

ENTER A VALUE TO CALCULATE TRIPS: 871



# Graph Look Up

**DATA SOURCE:**  
 The Gen Manual, 10th Ed - Supplement

**SEARCH BY LAND USE CODE:**

**LAND USE GROUP:**  
 (500-599) Institutional

**LAND USE:**  
 520 - Elementary School

**LAND USE SUBCATEGORY:**  
 All Sites

**INDEPENDENT VARIABLE (X):**  
 1000 Sq. Ft. GFA


**TRIP PERIOD:**  
 Weekday, Peak Hour of Adjacent Street Traffic

**SETTING/LOCATION:**  
 General Urban/Suburban

**TRIP TYPE:**  
 Vehicle

**ENTER IN VALUE TO CALCULATE TRIPS:**

Data Plot and Equation

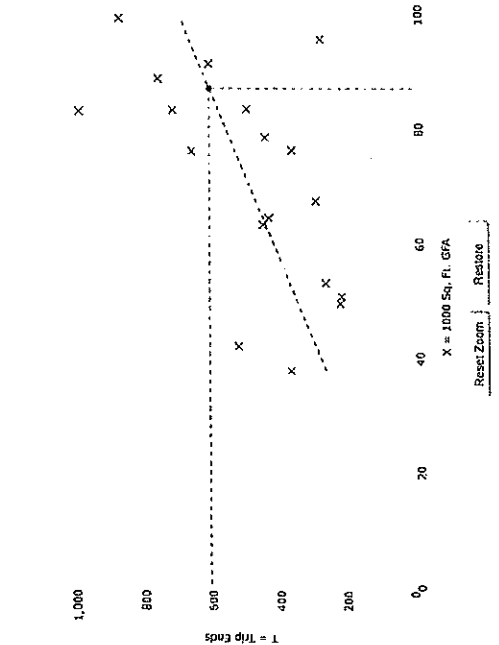

**DATA STATISTICS**  
 Land Use: Elementary School, 520, Gen Manual, 10th Ed - Supplement  
 Independent Variable: 1000 Sq. Ft. GFA  
 Time Period: Weekday, Peak Hour of Adjacent Street Traffic, One-Hour Interval, 7 AM to 9 AM  
 Setting/Location: General Urban/Suburban  
 Trip Type: Vehicle  
 Number of Studies: 9  
 Avg. 1000 Sq. Ft. GFA: 71  
 Average Rate: 6.97  
 Range of Rates: 2.88 - 13.45  
 Standard Deviation: 2.66  
 Fitted Curve Equation:  $Y = 10.00X - 0.0001X^2$   
 R Squared: .9999  
 Dimensional Distribution: 55% existing, 45% existing  
 Calculated Trip Ends: Average Rate: 6.97, Total: 354, Error: 27.3 (EM)

Use the mouse wheel to zoom out or zoom in.  
 Hover the mouse pointer on data points to view X and Y values.

ADDITIONAL INFORMATION

SEARCH BY LAND USE CODE



# Graph Look Up

Query:  File:

DATA SOURCE: Trip Gen Manual, 10th Ed - Supplement

SEARCH BY LAND USE CODE:

LAND USE GROUP: (500-599) Institutional

LAND USE: 520, Elementary School

LAND USE SUBCATEGORY: All Sites

INDEPENDENT VARIABLE BY: 1000 Sq. Ft. GFA

TIME PERIOD: Weekday, Peak Hour of Adjacent Street Traffic

SETTING/LOCATION: General Urban/Suburban

TRIP TYPE: Vehicle

ENTER VALUE TO CALCULATE TRIPS:

## Data Plot and Equation

Land Use: Elementary School (520): 1000 Sq. Ft. GFA

Independent Variable: 1000 Sq. Ft. GFA

Time Period: Weekday

Peak Hour of Adjacent Street Traffic: On-Trip, Between 4 and 6 a.m.

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 18

Avg. 3000 Sq. Ft. GFA: 71

Average Rate: 1.37

Range of Rates: 0.35 - 4.81


Standard Deviation: 0.97

Fitted Curve Equation:  $Y = 1.37X - 26.2$

R<sup>2</sup>: .88

Directional Distributions: 55% entering, 45% exiting

Calculated Trip Ends: Average Rate: 119.70(0), 93 Entry, 26 Exit

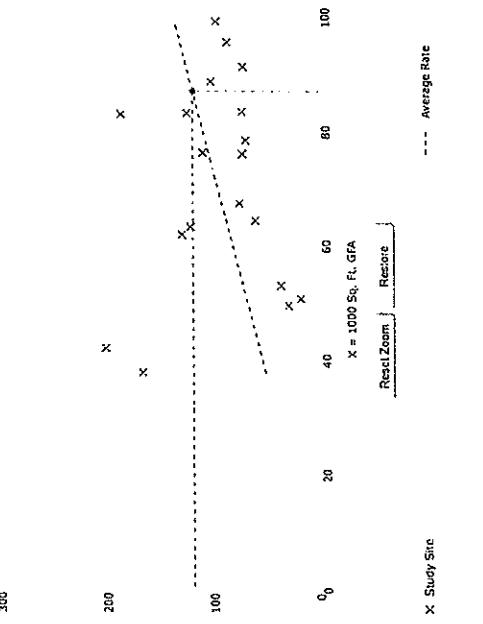

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.



# Graph Look Up

Query Filter

DATA SOURCE: Trip Gen Manual 10th Ed - Supplement

SEARCH BY LAND USE CODE: 520

LAND USE GROUP: (500-599) Institutional

LAND USE: 520 - Elementary School

LAND USE SUBCATEGORY: All Sites

INDEPENDENT VARIABLE (IV): 1000 Sq. Ft. GFA


TRIP PERIOD: Weekday, AM Peak Hour of Generator

SETTING/LOCATION: General Urban/Suburban

TRIP TYPE: Vehicle

ENTER IV VALUE TO CALCULATE TRIPS: 871 Calculate

## Data Plot and Equation

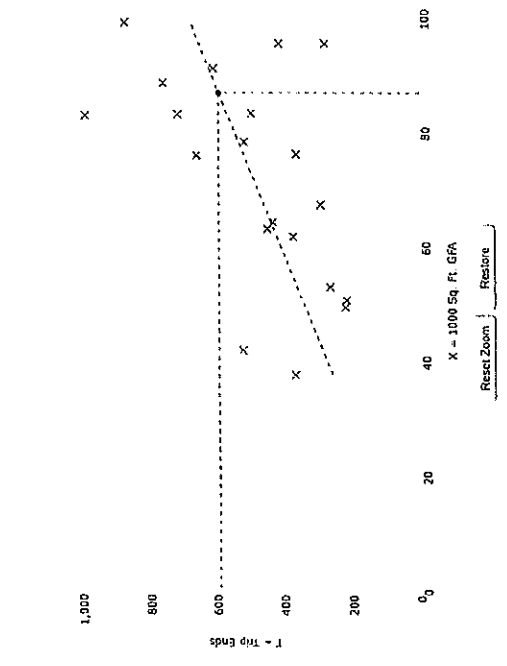

## DATA STATISTICS

Land Use: Elementary School (520) GFA, Institutional

Independent Variable: 1000 Sq. Ft. GFA

Time Period: Weekday, AM Peak Hour of Generator

Setting/Location: General Urban/Suburban

Trips Type: Vehicle

Number of Student: 22

Aug. 1000 Sq. Ft. GFA: 72

Average Rate: 0.60

Range of Rates: 2.88 - 12.45

Standard Deviation: 2.53

Fitted Curve Equation:  $Y = 10.00X + 100$

R<sup>2</sup>: .999

Directional Distribution: 45% during AM Peak

Calculated Trip Ends: Average Rate 552 Total 222, Entry, 307 (Exit)

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.



# Graph Look Up

Query Filter

DATA SOURCE: Trip Gen Manual, 10th Ed + Supplement

SEARCH BY LAND USE CODE: 520

LAND USE GROUP: (500-599) Institutional

LAND USE: 500 - Elementary School

LAND USE SUBCATEGORY: All Sites

INDEPENDENT VARIABLE (IV): 1000 Sq. Ft. GFA


TIME PERIOD: Weekday, PM Peak Hour of Generator

SETTING/LOCATION: General Urban/Suburban

TRIP TYPE: Vehicle

ENTER IV VALUE TO CALCULATE TRIPS: 1071 Calculate

## Data Plot and Equation

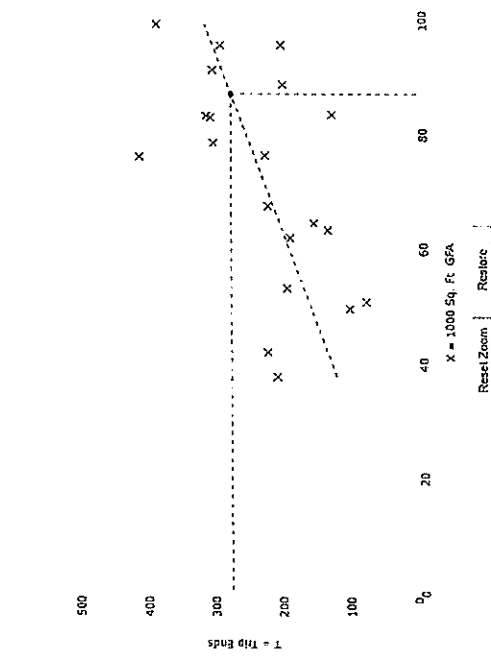

Land Use: Elementary School (500); CLASSIFICATION: 500.03

Independent Variables: 1000 Sq. Ft. GFA

Time Period: Weekday, PM Peak Hour of Generator

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 20

Avg. 1000 Sq. Ft. GFA: 72

Average Rate: 3.14

Range of Rates: 1.00 - 5.00

Standard Deviation: 1.11

Fitted Curve Equation: Not Given

R<sup>2</sup>: .99

Directional Distribution: 44% entering, 56% exiting

Calculated Trip Ends: Average Rate: 3.75 (Rate: 1271 Entry: 154 Entry)

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.



# Graph Look Up

Quality Filter

DATA SOURCE: Trip Gen Manual, 10th Ed - Supplement

SEARCH BY LAND USE CODE: 522

LAND USE GROUP: (500-599) Institutional

LAND USE: 522 - Middle School/Junior High School

LAND USE SUBCATEGORY: All Sites

INDEPENDENT VARIABLE (W): 1000 Sq. Ft. GFA

TIME PERIOD: Weekday

SETTING/LOCATION: General Urban/Suburban

TRIP TYPE: Vehicle

ENTER VALUE TO CALCULATE TRIPS: 880

Calculate

**Data Plot and Equation**

--- Average Rate

X Study Site

Reset Zoom Restore

X = 1000 Sq. Ft. GFA

**DATA STATISTICS**

Land Use: Middle School/Junior High School (522) 10/26/2017

Independent Variable: 1000 Sq. Ft. GFA

Time Period: (Weekday)

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 6

Avg: 1000 Sq. Ft. GFA  
1000

Average Rate: 20.11

Range of Rates: 12.51 - 48.31

Standard Deviation: 7.86

Fitted Curve Equation: Not Given

R<sup>2</sup>: .000

Directional Distribution: 50% entering, 50% exiting

Calculated Trip Ends: Average Rate: 1775 (Total: 8876 Entry, 896 Exit)

Use the mouse wheel to Zoom Out or Zoom In.  
Hover the mouse pointer on data points to view X and T values.


# Graph Look Up



Query: 5108

**DATA SOURCE:**  
 Trip Gen Manual, 10th Ed + Supplement  
**SEARCH BY LAND USE CODE:** 522  
**LAND USE GROUP:** (500-599) Institutional  
**LAND USE:** S22 - Middle School/Junior High School  
**LAND USE SUBCATEGORY:** All Sites  
**INDEPENDENT VARIABLE (X):** 1000 Sq. Ft. GFA  
**TIME PERIOD:** Weekday AM Peak Hour of Generator  
**SETTING/LOCATION:** General Urban/Suburban  
**TRIP TYPE:** Vehicle  
**INTERVAL VALUE TO CALCULATE TRIPS:** 88.0 Calculate

## Data Plot and Equation

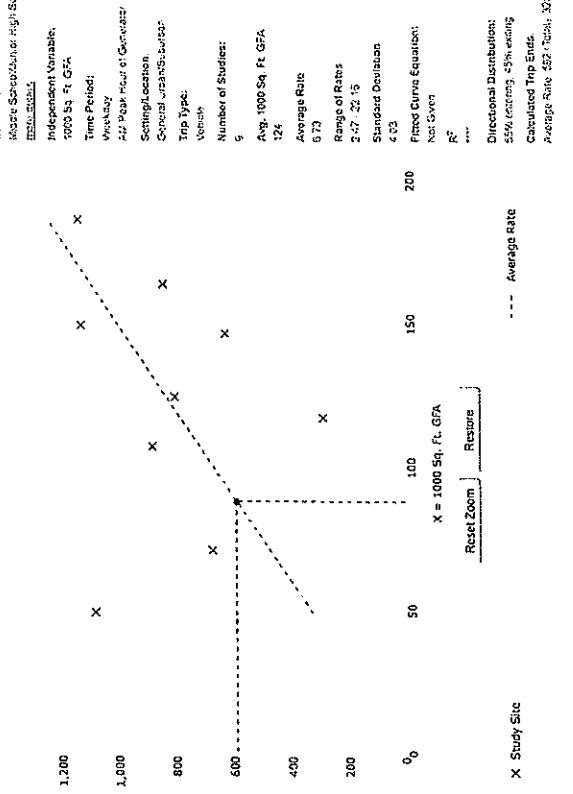

## DATA STATISTICS

**Land User:** Middle School/Junior High School (522) Query: 5108  
**INDEPENDENT VARIABLE:** 1000 Sq. Ft. GFA  
**Time Period:** All Peak Hour of Generator  
**Setting/Location:** General Urban/Suburban  
**Trip Type:** Vehicle  
**Number of Studies:** 6  
**Avrg. 1000-Sq. Ft. GFA:** 124  
**Average Rate:** 6.73  
**Range of Rates:** 2.47 - 22.15  
**Standard Deviation:** 4.32  
**Fitted Curve Equation:** Not Given  
**R<sup>2</sup>:** \*\*\*\*  
**Directional Distribution:** 55% entering, 45% exiting  
**Calculated Trip Ends:** Average Rate 452.7 Trips; 325 (Entry), 287 (Exit)

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.

ALL VALUES IN THIS REPORT ARE BASED ON THE DATA PROVIDED IN THE INPUT FILES.  
 THE USER IS RESPONSIBLE FOR THE ACCURACY OF THE DATA PROVIDED.



# Graph Look Up

SEARCH BY LAND USE CODE

Query Filter

DATA SOURCE:  
Trip Gen Manual, 10th Ed + Supplement

SEARCH BY LAND USE CODE

LAND USE GROUP:  
(500-599) Institutional

LAND USE:  
522 - Middle School/Junior High School

LAND USE SUBCATEGORY:  
All Sites

INDEPENDENT VARIABLE (IV):  
1000 SQ. FT. GFA

TIME PERIOD:  
Weekday, PM Peak Hour of Generator


SETTING/LOCATION:  
General Urban/Suburban

TRIP TYPE:  
Vehicle

ENTER IV VALUE TO CALCULATE TRIPS:  
60.0

Calculate

## Data Plot and Equation

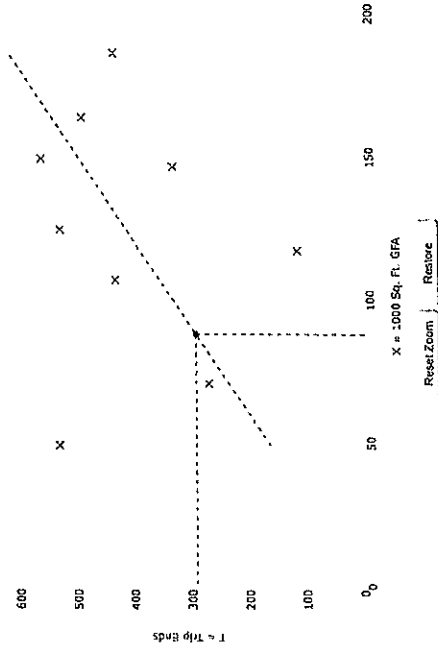

## DATA STATISTICS

Land Use: Middle School/Junior High School (522), Class Size: 200-250

Independent Variable: 1000 Sq. Ft. GFA

Time Period: Weekday, PM Peak Hour of Generator

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 5

Avg. 1000 Sq. Ft. GFA: 152

Average Rate: 8.33

Range of Rates: 5.99 - 10.65

Standard Deviation: 2.01

Fitted Curve Equation:  $T = 3.0X$

$R^2$ : .9999

Directional Distribution: 45% entering, 55% exiting

Calculated Trip Ends: Average Rate: 253, Total: 132, Entry: 161, Exit: 66

Use the mouse wheel to Zoom Out or Zoom In. Hover the mouse pointer on data points to view X and T values.

SEARCH BY LAND USE CODE

LAND USE CODE

SEARCH BY LAND USE CODE

SEARCH BY LAND USE CODE

SEARCH BY LAND USE CODE



# Graph Look Up

THE NUMBER OF TRIP ENDS

GRAPH OF TRIP ENDS

TRIP ENDS

TRIP ENDS

TRIP ENDS

## Data Plot and Equation

Query Filter

DATA SOURCE:  
 Trip Gen Manual, 10th Ed + Supplement

SEARCH BY LAND USE CODE:  
 522

LAND USE GROUP:  
 (600-599) Individual

LAND USE:  
 522 - Middle School/Junior High School

LAND USE SUBCATEGORY:  
 All Sites

INDEPENDENT VARIABLE (X):  
 1000 Sq. Ft. GFA

TIME PERIOD:  
 Weekday, Peak Hour of Adjacent Street Traffic

SETTING/LOCATION:  
 General Urban/Suburban

TRIP TYPE:  
 Vehicle

ENTER VALUE TO CALCULATE TRIPS:  
 850

## DATA STATISTICS

Land Use: Middle School/Junior High School (522) (600-599)

Independent Variable: 1000 Sq. Ft. GFA

Time Period: Weekday, Peak Hour of Adjacent Street Traffic

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 9

Avg. 1000 Sq. Ft. GFA: 116

Average Rate: 1.16

Range of Rates: 0.02 - 2.72


Standard Deviation: 0.51

Fitted Curve Equation: Not Given

R<sup>2</sup>: ---

Directional Distribution: 50% entering, 49% exiting

Calculated Trip Ends: Average Rate: 105 (Total: 94 Empty, 51 Exit)

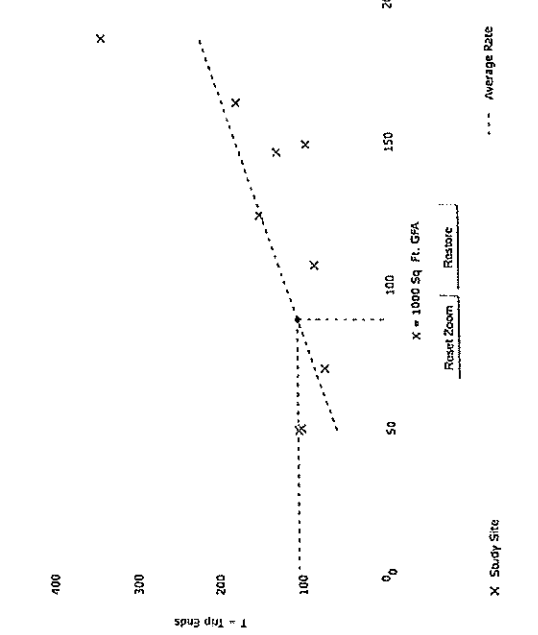

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.

TRIP ENDS

TRIP ENDS

TRIP ENDS

TRIP ENDS

TRIP ENDS



**ITE *Trip Generation* Worksheets**  
**Middle School / Elementary School**  
**Based on Students**

# Graph Look Up



City:

DATA SOURCE:  
  
 SEARCH BY LAND USE CODE:

LAND USE GROUP:  
  
 LAND USE:  
  
 LAND USE SUBCATEGORY:

INDEPENDENT VARIABLE (RV):  
  
 TIME PERIOD:

SETTING/LOCATION:  
  
 TRIP TYPE:

ENTER VALUE TO CALCULATE TRIPS:

**Data Plot and Equation**

Y-axis: Trip Ends (0 to 2,500)  
 X-axis: Study Site (0 to 1,000)

Legend:  
 X Study Site  
 --- Fitted Curve

Buttons:

**DATA STATISTICS**

Land Use: Elementary School (520 - Institutional)  
 Independent Variable: Students  
 Time Period: Weekday  
 Setting/Location: General Urban/Suburban  
 Trip Type: Vehicle  
 Number of Studies: 9  
 Avg. Num. of Students: 702  
 Average Rate: 1.09  
 Range of Rates: 1.91 - 2.45  
 Standard Deviation: 0.34  
 Fitted Curve Equation:  $Y = 4.33X^{1.1} - 156.03$   
 $R^2 = 0.72$   
 Directional Distributions:  
 Scale showing 50% empty  
 Calculated Trip Ends:  
 Average Rate: 945 (Tech: 472.60m, 473.16m)  
 Fitted Curve: 881 (Tech: 440 - Empty, 341.16m)

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.

# Graph Look Up

**Study Filter**

**DATA SOURCE:** Trip Gen Manual, 10th Ed + Supplement

**SEARCH BY LAND USE CODE:** 520

**LAND USE GROUP:** (500-599) Institutional

**LAND USE:** 520 - Elementary School

**LAND USE SUBCATEGORY:** All Sites

**INDEPENDENT VARIABLE (IV):** Students

**TIME PERIOD:** Weekday, Peak Hour of Adjacent Street Traffic

**SETTING/LOCATION:** General Urban/Suburban

**TRIP TYPE:** Vehicle

**ENTER IV VALUE TO CALCULATE TRIPS:** 500 Calculate

**Data Plot and Equation**

**DATA STATISTICS**

Land Use: Elementary School - 10th Ed + Supplement

Independent Variable: Students

Time Period: Weekday, Peak Hour of Adjacent Street Traffic

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 33

Avg. Num. of Students: 293

Average Rate: 0.67

Range of Rates: 0.24 - 1.47

Standard Deviation: 0.22

Fitted Curve Equation:  $T = 0.67X$

R<sup>2</sup>: 0.99

Directional Distribution: 5% entering, 95% exiting

Calculated Trip Ends: Average Rate: 0.67 (Total: 33, Entry: 154, Exit: 154)

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and T values.

# Graph Look Up

**DATA SOURCE:**  
 Trip Gen Manual, 10th Ed - Supplement  
 SEARCH BY LAND USE CODE:

**LAND USE GROUP:**  
 (600-699) Institutional  
 520 - Elementary School

**LAND USE SUBCATEGORY:**  
 All Sites

**INDEPENDENT VARIABLE (IV):**  
 Students

**TRIP PERIOD:**  
 Weekday, AM Peak Hour of Generator

**SETTING/LOCATION:**  
 General Urban/Suburban

**TRIP TYPE:**  
 Vehicle

**ENTER IN VALUE TO CALCULATE TRIPS:**

**Data Plot and Equation**

**DATA STATISTICS**

Land Use: Elementary School, 520 - Institutional, Supplement

Independent Variable: Students

Time Period: Weekday, AM Peak Hour of Generator

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 24

Avg. Num. of Students: 622

Average Rate: 0.824

Range of Rates: 0.74 - 0.91

Standard Deviation: 0.24

Fitted Curve Equation:  $Y = 0.824X - 158$

Not Given: R<sup>2</sup>, ...

Optional Distribution: 50% entering, 45% exiting

Calculated Trip Ends: Average Rate: 0.824 (Rough), 115 (Error), 150 (Avg.)

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.

ADD SITE VALUES TO THE  
 Y-AXIS

# Graph Look Up

DATA SOURCE: Trip Gen Manual, 10th Ed - Supplement

SEARCH BY LAND USE CODE: 520

LAND USE GROUP: (500-599) Institutional

LAND USE: 520 - Elementary School

LAND USE SUBCATEGORY: All Sites

INDEPENDENT VARIABLE (V): Students

TIME PERIOD: Weekday, PM Peak Hour of Generator

SETTING/LOCATION: General Urban/Suburban

TRIP TYPE: Vehicle

ENTER W VALUE TO CALCULATE TRIPS: 500 Calculate

**Data Plot and Equation**

Y-axis: Trip Ends (0 to 500)

X-axis: X = Number of Students (0 to 1,200)

Legend: X Study Site

--- Average Rate

Buttons: Reset Zoom, Restore

**DATA STATISTICS**

Land Use: Elementary Schools (500 - 599) Institutional

Independent Variable: Students

Time Period: Weekday

PM Peak Hour of Generator

Semi-Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 34

Avg. Num. of Students: 425

Average Rate: 0.24

Range of Rates: 0.17 - 0.32

Standard Deviation: 0.11

Fitted Curve Equation: Not Given

R<sup>2</sup>: ...

Directional Distribution: 45% during 45/45 mins

Calculated Trip Ends: ...

Average Rate: 170 (30% \* 70 Entry, 30-Entry)

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.

# Graph Look Up



Query Filter

DATA SOURCE: Trip Gen Manual, 10th Ed - Supplement

SEARCH BY LAND USE CODE: 522

LAND USE GROUP: (500-595) Institutional

LAND USE: 522 - Middle School/Junior High School

LAND USE SUBCATEGORY: All Sites

INDEPENDENT VARIABLE IVE: Students

TIME PERIOD: Weekday


SETTING/LOCATION: General Urban/Suburban

TRIP TYPE: Vehicle

ENTER VALUE TO CALCULATE TRIPS: 500

Calculate

## Data Plot and Equation

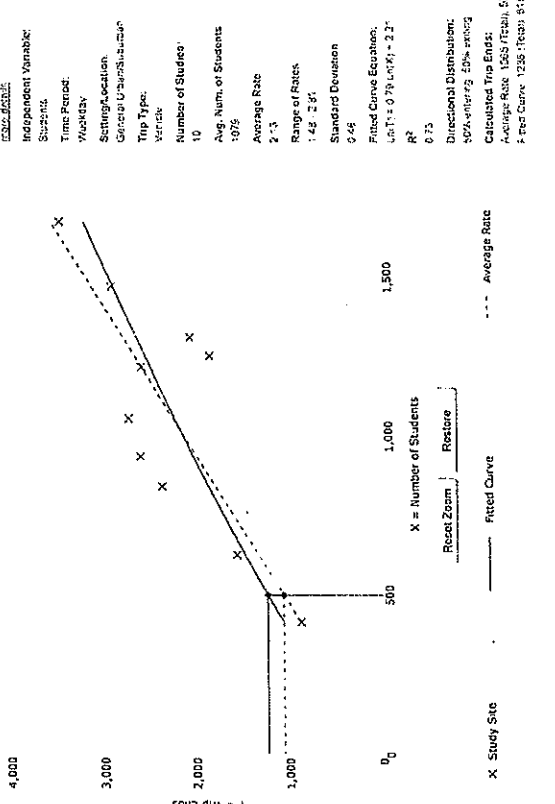

## DATA STATISTICS

Land Use: Middle School/Junior High School (522) General Urban/Suburban

Independent Variable: Students

Time Period: Weekday

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 10

Avg. Num. of Students: 1075

Average Rate: 2.3

Range of Rates: 1.48 - 2.81

Standard Deviation: 0.46

Fitted Curve Equation:  $Y = 2.3X - 0.0001X^2 - 2.2$

$R^2$ : 0.75

Directional Distribution: 50% entering, 50% exiting

Calculated Trip Ends: Average Rate 1565 (Total: 532 (Entry), 532 (Exit))

Fitted Curve: 1238 (Total: 518 (Entry), 518 (Exit))


Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.

# Graph Look Up

C:\67 5:48

**DATA SOURCE:** Trip Cost Manual, 10th Ed - Supplement  
**SEARCH BY LAND USE CODE:** 522  
**LAND USE GROUP:** (500-599) Institutional  
**LAND USE:** 522 - Middle School/Junior High School  
**LAND USE SUBCATEGORY:** All Sites  
**INDEPENDENT VARIABLE (X):** Students  
**TIME PERIOD:** Weekday, Peak Hour of Adjacent Street Traffic  
**SETTING/LOCATION:** General Urban/Suburban  
**TRIP TYPE:** Vehicle  
**ENTER VALUE TO CALCULATE TRIPS:** 500

## Data Plot and Equation

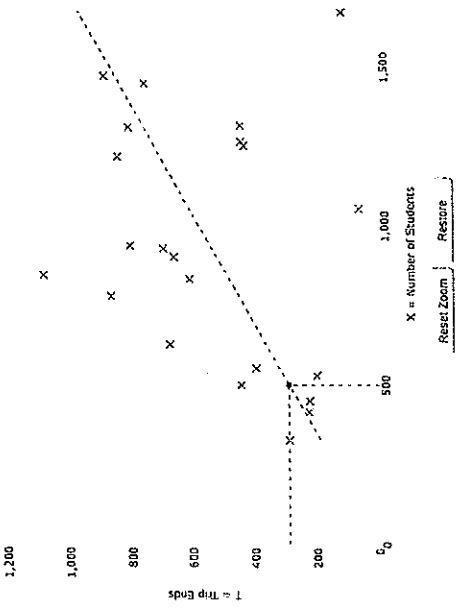

## DATA STATISTICS

**Land Use:** Middle School/Junior High School (522) - Single  
**INDEPENDENT VARIABLE:** Students  
**Time Period:** Weekday, Peak Hour of Adjacent Street Traffic  
**Setting/Location:** General Urban/Suburban  
**Trips:** 500  
**Number of Studies:** 22  
**Avg. Num. of Students:** 937  
**Average Rate:** 0.89  
**Range of Rates:** 0.05 - 1.26  
**Standard Deviation:** 0.132  
**Fitted Curve Equation:** Not Given  
**R<sup>2</sup>:** \*\*\*  
**Directional Distribution:** 54% entering, 45% exiting  
**Calculated Trip Ends:** 450  
**Average Rate (500 Total):** 107.14/day, 133.8/hour

Use the mouse wheel to Zoom Out or Zoom In. Hover the mouse pointer on data points to view X and Y values.

ADD VALUE TO MORE

IS 0.000000

SEARCH BY LAND USE CODE: 522 - Middle School/Junior High School

# Graph Look Up

Quality Flag

**DATA SOURCE:**  
 Trip Gen Manual, 10th Ed - Supplement

**SEARCH BY LAND USE CODE:**  
 522

**LAND USE GROUP:**  
 (500-599) Institutional

**LAND USE:**  
 522 - Middle School/Junior High School

**LAND USE SUBCATEGORY:**  
 All Sites

**INDEPENDENT VARIABLE (IV):**  
 Students


**TIME PERIOD:**  
 Weekday, Peak Hour of Adjacent Street Traffic

**SETTING/LOCATION:**  
 General Urban/Suburban

**TRIP TYPE:**  
 Vehicle

**ENTER IV VALUE TO CALCULATE TRIPS:**  
 500

## Data Plot and Equation

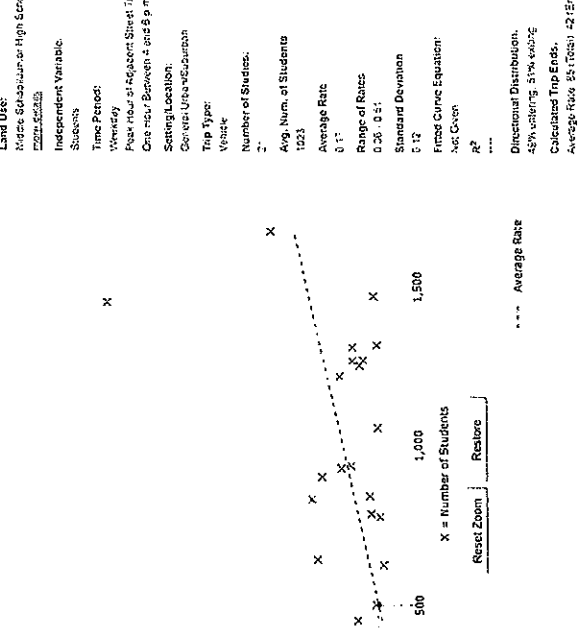

## DATA STATISTICS

**Land Use:**  
 Middle School/Junior High School (522) - Capacity

**INDEPENDENT VARIABLE:**  
 Students

**Time Period:**  
 Peak Hour of Adjacent Street Traffic  
 One Hour Between 4 and 9 p.m.

**Setting/Location:**  
 General Urban/Suburban

**Trip Type:**  
 Vehicle

**Number of Studies:**  
 1

**Avg. Num. of Students:**  
 1023

**Average Rate:**  
 0.57

**Range of Rates:**  
 0.36 - 0.81

**Standard Deviation:**  
 0.17

**Fitted Curve Equation:**  
 Not Given

**R<sup>2</sup>:**  
 1.00

**Directional Distribution:**  
 45% entering, 55% exiting

**Calculated Trip Ends:**  
 Average Rate 0.57 (Total 471 Trips) 43.1 Ends

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.




# Graph Look Up



## DATA STATISTICS

Land Use: Middle School/Junior High School - 552 - Class Br  
 Trip Gen Manual, 10th Ed - Supplement  
 Independent Variable: Students  
 Search by Land Use Code: 522  
 Land Use Group: (500-559) Institutional  
 Land Use: 522 - Middle School/Junior High School  
 Land Use Subcategory: All Sites  
 Independent Variable (IV): Students  
 Time Period: Weekday, AM Peak Hour of Generator  
 Settings/Location: General Urban/Suburban  
 Trip Type: Vehicle  
 Number of Studies: 15  
 Avg. Num. of Students: 947  
 Average Rate: 0.70  
 Range of Rates: 0.35 - 2.6  
 Standard Deviation: 0.22  
 Fitted Curve Equation:  $Ln(T) = 0.55 \cdot Ln(X) - 0.26$   
 $R^2 = 0.85$   
 Directional Distribution: 5% entering, 45% exiting  
 Calculated Trip Ends: Average Rate: 350 (Total: 192 (Entry), 155 (Exit))  
 Fitted Curve: 344 (Total: 189 (Entry), 155 (Exit))

## Data Plot and Equation

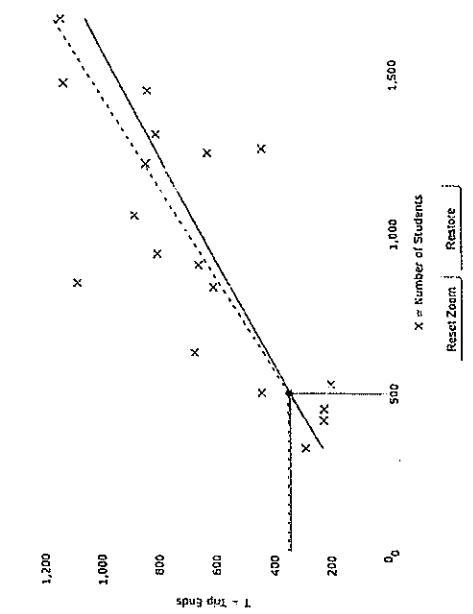

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.

## ENTER IN VALUE TO CALCULATE TRIPS:

500 Calculate



# Graph Look Up

July 2017

DATA SOURCE: Trip Gain Manual, 10th Ed + Supplement

SEARCH BY LAND USE CODE: 522

LAND USE GROUP: (300-599) Institutional

LAND USE: 522 - Middle School/Junior High School

LAND USE SUBCATEGORY: All Sites

INDEPENDENT VARIABLE (X): Students

TIME PERIOD: Weekday, PM Peak Hour of Generator

SETTING/LOCATION: General Urban/Suburban

TRIP TYPE: Vehicle

ENTER VALUE TO CALCULATE TRIPS: 500

Calculate

**Data Plot and Equation**

**DATA STATISTICS**

Land Use: Middle School/Junior High School (522) (1582) (2)

INDEPENDENT VARIABLE: Students

Time Period: PM Peak Hour of Generator

Setting/Location: General Urban/Suburban

Trip Type: Vehicle

Number of Studies: 2

Avg. Num. of Students: 544

Average Rate: 0.35

Range of Rates: 0.18 - 0.63

Standard Deviation: 0.13

Fitted Curve Equation:  $Y = 0.95 \cdot X^{0.66}$

R<sup>2</sup>: 0.98

Directional Distribution: 60% entering, 40% exiting

Calculated Trip Ends: Average Rate: 175 (1582) 80 (544) Fitted Curve: 152 (1582) 85 (544)

Use the mouse wheel to Zoom Out or Zoom In.  
 Hover the mouse pointer on data points to view X and Y values.

















Page 1 of 1

Page 1 of 1

**SYNCHRO Capacity Analysis Worksheets**

HCM Unsignalized Intersection Capacity Analysis  
 3: Gorman Rd & Louise Berry Dr/Private Drive

Combined Traffic  
 AM Peak Hour

												
Movement	EBL	EBT	EBR	WBL	WBT	WBR	NBL	NBT	NBR	SBL	SBT	SBR
Lane Configurations												
Traffic Volume (veh/h)	87	0	55	1	0	0	16	118	0	0	160	24
Future Volume (Veh/h)	87	0	55	1	0	0	16	118	0	0	160	24
Sign Control		Stop			Stop			Free			Free	
Grade		0%			0%			0%			0%	
Peak Hour Factor	0.40	0.40	0.40	0.25	0.25	0.25	0.70	0.70	0.70	0.70	0.70	0.70
Hourly flow rate (vph)	218	0	138	4	0	0	23	169	0	0	229	34
Pedestrians												
Lane Width (ft)												
Walking Speed (ft/s)												
Percent Blockage												
Right turn flare (veh)												
Median type								None			None	
Median storage (veh)												
Upstream signal (ft)												
pX, platoon unblocked												
vC, conflicting volume	461	461	246	599	478	169	263			169		
vC1, stage 1 conf vol												
vC2, stage 2 conf vol												
vCu, unblocked vol	461	461	246	599	478	169	263			169		
tC, single (s)	7.1	6.5	6.2	7.1	6.5	6.2	4.1			4.1		
tC, 2 stage (s)												
tF (s)	3.5	4.0	3.3	3.5	4.0	3.3	2.2			2.2		
p0 queue free %	57	100	83	99	100	100	98			100		
cM capacity (veh/h)	504	489	793	337	478	875	1301			1409		
Direction, Lane #	EB 1	WB 1	NB 1	SB 1								
Volume Total	356	4	192	263								
Volume Left	218	4	23	0								
Volume Right	138	0	0	34								
cSH	587	337	1301	1409								
Volume to Capacity	0.61	0.01	0.02	0.00								
Queue Length 95th (ft)	101	1	1	0								
Control Delay (s)	20.1	15.8	1.1	0.0								
Lane LOS	C	C	A									
Approach Delay (s)	20.1	15.8	1.1	0.0								
Approach LOS	C	C										
<b>Intersection Summary</b>												
Average Delay			9.1									
Intersection Capacity Utilization			33.7%		ICU Level of Service				A			
Analysis Period (min)			15									

















HCM Unsignalized Intersection Capacity Analysis  
6: Louise Berry Dr

Combined Traffic  
AM Peak Hour

	→	↘	↙	←	↖	↗
Movement	EBT	EBR	WBL	WBT	NBL	NBR
Lane Configurations	↗			↖	↗	
Traffic Volume (veh/h)	113	0	9	31	0	29
Future Volume (Veh/h)	113	0	9	31	0	29
Sign Control	Free			Free	Stop	
Grade	0%			0%	0%	
Peak Hour Factor	0.40	0.40	0.40	0.40	0.75	0.75
Hourly flow rate (vph)	282	0	22	78	0	39
<b>Pedestrians</b>						
Lane Width (ft)						
Walking Speed (ft/s)						
Percent Blockage						
Right turn flare (veh)						
Median type	None			None		
Median storage (veh)						
Upstream signal (ft)						
pX, platoon unblocked						
vC, conflicting volume			282		404	282
vC1, stage 1 conf vol						
vC2, stage 2 conf vol						
vCu, unblocked vol			282		404	282
tC, single (s)			4.1		6.4	6.2
tC, 2 stage (s)						
tF (s)			2.2		3.5	3.3
p0 queue free %			98		100	95
cM capacity (veh/h)			1280		592	757
<b>Direction, Lane #</b>	<b>EB 1</b>	<b>WB 1</b>	<b>NB 1</b>			
Volume Total	282	100	39			
Volume Left	0	22	0			
Volume Right	0	0	39			
cSH	1700	1280	757			
Volume to Capacity	0.17	0.02	0.05			
Queue Length 95th (ft)	0	1	4			
Control Delay (s)	0.0	1.8	10.0			
Lane LOS		A	B			
Approach Delay (s)	0.0	1.8	10.0			
Approach LOS			B			
<b>Intersection Summary</b>						
Average Delay			1.4			
Intersection Capacity Utilization			18.8%	ICU Level of Service		A
Analysis Period (min)			15			

HCM Unsignalized Intersection Capacity Analysis  
 3: Gorman Rd & Louise Berry Dr/Private Drive

Combined Traffic  
 School Peak Hour

													
Movement	EBL	EBT	EBR	WBL	WBT	WBR	NBL	NBT	NBR	SBL	SBT	SBR	
Lane Configurations													
Traffic Volume (veh/h)	100	0	44	0	0	0	5	81	0	0	134	9	
Future Volume (Veh/h)	100	0	44	0	0	0	5	81	0	0	134	9	
Sign Control		Stop			Stop			Free			Free		
Grade		0%			0%			0%			0%		
Peak Hour Factor	0.40	0.40	0.40	0.25	0.25	0.25	0.65	0.65	0.65	0.65	0.65	0.65	
Hourly flow rate (vph)	250	0	110	0	0	0	8	125	0	0	206	14	
Pedestrians													
Lane Width (ft)													
Walking Speed (ft/s)													
Percent Blockage													
Right turn flare (veh)													
Median type						None				None			
Median storage veh													
Upstream signal (ft)													
pX, platoon unblocked													
vC, conflicting volume	354	354	213	464	361	125	220			125			
vC1, stage 1 conf vol													
vC2, stage 2 conf vol													
vCu, unblocked vol	354	354	213	464	361	125	220			125			
tC, single (s)	7.1	6.5	6.2	7.1	6.5	6.2	4.1			4.1			
tC, 2 stage (s)													
tF (s)	3.5	4.0	3.3	3.5	4.0	3.3	2.2			2.2			
p0 queue free %	58	100	87	100	100	100	99			100			
cM capacity (veh/h)	598	568	827	439	563	926	1349			1462			
Direction, Lane #	EB 1	WB 1	NB 1	SB 1									
Volume Total	360	0	133	220									
Volume Left	250	0	8	0									
Volume Right	110	0	0	14									
cSH	654	1700	1349	1462									
Volume to Capacity	0.55	0.00	0.01	0.00									
Queue Length 95th (ft)	84	0	0	0									
Control Delay (s)	17.1	0.0	0.5	0.0									
Lane LOS	C	A	A										
Approach Delay (s)	17.1	0.0	0.5	0.0									
Approach LOS	C	A											
Intersection Summary													
Average Delay			8.7										
Intersection Capacity Utilization			23.3%	ICU Level of Service	A								
Analysis Period (min)			15										

















HCM Unsignalized Intersection Capacity Analysis  
6: Louise Berry Dr

Combined Traffic  
School Peak Hour

	→	↘	↙	←	↖	↗
Movement	EBT	EBR	WBL	WBT	NBL	NBR
Lane Configurations	↔			↔	↔	
Traffic Volume (veh/h)	133	0	10	4	0	11
Future Volume (Veh/h)	133	0	10	4	0	11
Sign Control	Free			Free	Stop	
Grade	0%			0%	0%	
Peak Hour Factor	0.92	0.92	0.92	0.92	0.92	0.92
Hourly flow rate (vph)	145	0	11	4	0	12
Pedestrians						
Lane Width (ft)						
Walking Speed (ft/s)						
Percent Blockage						
Right turn flare (veh)						
Median type	None		None			
Median storage veh						
Upstream signal (ft)						
pX, platoon unblocked						
vC, conflicting volume			145		171	145
vC1, stage 1 conf vol						
vC2, stage 2 conf vol						
vCu, unblocked vol			145		171	145
tC, single (s)			4.1		6.4	6.2
tC, 2 stage (s)						
tF (s)			2.2		3.5	3.3
p0 queue free %			99		100	99
cM capacity (veh/h)			1437		813	902
Direction, Lane #	EB 1	WB 1	NB 1			
Volume Total	145	15	12			
Volume Left	0	11	0			
Volume Right	0	0	12			
cSH	1700	1437	902			
Volume to Capacity	0.09	0.01	0.01			
Queue Length 95th (ft)	0	1	1			
Control Delay (s)	0.0	5.5	9.0			
Lane LOS		A	A			
Approach Delay (s)	0.0	5.5	9.0			
Approach LOS			A			
Intersection Summary						
Average Delay			1.1			
Intersection Capacity Utilization			19.0%	ICU Level of Service		A
Analysis Period (min)			15			

HCM Unsignalized Intersection Capacity Analysis  
 3: Gorman Rd & Louise Berry Dr/Private Drive

Combined Traffic  
 PM Peak Hour

												
Movement	EBL	EBT	EBR	WBL	WBT	WBR	NBL	NBT	NBR	SBL	SBT	SBR
Lane Configurations												
Traffic Volume (veh/h)	63	0	33	2	0	1	74	66	2	1	126	40
Future Volume (Veh/h)	63	0	33	2	0	1	74	66	2	1	126	40
Sign Control		Stop			Stop			Free			Free	
Grade		0%			0%			0%			0%	
Peak Hour Factor	0.25	0.25	0.25	0.92	0.92	0.92	0.75	0.75	0.75	0.75	0.75	0.75
Hourly flow rate (vph)	252	0	132	2	0	1	99	88	3	1	168	53
Pedestrians												
Lane Width (ft)												
Walking Speed (ft/s)												
Percent Blockage												
Right turn flare (veh)												
Median type												
Median storage veh												
Upstream signal (ft)												
pX, platoon unblocked												
vC, conflicting volume	485	486	194	616	510	90	221			91		
vC1, stage 1 conf vol												
vC2, stage 2 conf vol												
vCu, unblocked vol	485	486	194	616	510	90	221			91		
tC, single (s)	7.1	6.5	6.2	7.1	6.5	6.2	4.1			4.1		
tC, 2 stage (s)												
tF (s)	3.5	4.0	3.3	3.5	4.0	3.3	2.2			2.2		
p0 queue free %	46	100	84	99	100	100	93			100		
cM capacity (veh/h)	464	446	847	321	432	968	1348			1504		
Direction, Lane #												
	EB 1	WB 1	NB 1	SB 1								
Volume Total	384	3	190	222								
Volume Left	252	2	99	1								
Volume Right	132	1	3	53								
cSH	549	413	1348	1504								
Volume to Capacity	0.70	0.01	0.07	0.00								
Queue Length 95th (ft)	138	1	6	0								
Control Delay (s)	25.4	13.8	4.4	0.0								
Lane LOS	D	B	A	A								
Approach Delay (s)	25.4	13.8	4.4	0.0								
Approach LOS	D	B										
Intersection Summary												
Average Delay			13.3									
Intersection Capacity Utilization			33.2%	ICU Level of Service	A							
Analysis Period (min)			15									



HCM Unsignalized Intersection Capacity Analysis  
6: Louise Berry Dr

Combined Traffic  
PM Peak Hour

	→	↘	↙	←	↖	↗
Movement	EBT	EBR	WBL	WBT	NBL	NBR
Lane Configurations	↗			↖	↗	
Traffic Volume (veh/h)	80	0	26	88	0	16
Future Volume (Veh/h)	80	0	26	88	0	16
Sign Control	Free			Free	Stop	
Grade	0%			0%	0%	
Peak Hour Factor	0.92	0.92	0.92	0.92	0.92	0.92
Hourly flow rate (vph)	87	0	28	96	0	17
<b>Pedestrians</b>						
Lane Width (ft)						
Walking Speed (ft/s)						
Percent Blockage						
Right turn flare (veh)						
Median type	None			None		
Median storage (veh)						
Upstream signal (ft)						
pX, platoon unblocked						
vC, conflicting volume			87		239	87
vC1, stage 1 conf vol						
vC2, stage 2 conf vol						
vCu, unblocked vol			87		239	87
tC, single (s)			4.1		6.4	6.2
tC, 2 stage (s)						
tF (s)			2.2		3.5	3.3
p0 queue free %			98		100	98
cM capacity (veh/h)			1509		735	971
<b>Direction, Lane #</b>	<b>EB 1</b>	<b>WB 1</b>	<b>NB 1</b>			
Volume Total	87	124	17			
Volume Left	0	28	0			
Volume Right	0	0	17			
cSH	1700	1509	971			
Volume to Capacity	0.05	0.02	0.02			
Queue Length 95th (ft)	0	1	1			
Control Delay (s)	0.0	1.8	8.8			
Lane LOS		A	A			
Approach Delay (s)	0.0	1.8	8.8			
Approach LOS			A			
<b>Intersection Summary</b>						
Average Delay			1.6			
Intersection Capacity Utilization			22.7%	ICU Level of Service		A
Analysis Period (min)			15			

**UCONN Crash Data**

**Town of Brooklyn**

**Gorman Road Accident data**


**October 1, 2019 through October 1, 2022**

CrashId	Date	Day of Week	Time	Crash Severity	No of Veh	Milemarker	Landmark Description	Distance
633951	1/2/2020	Thursday	8:45 AM	Prop Damage Only	3	0.98	Brooklyn Elem School	50
752928	10/30/2020	Friday	5:00 PM	Prop Damage Only	1	1.48	Prince Hill Rd	115
854867	9/6/2021	Monday	3:53 PM	Prop Damage Only	2	0.73	SCHOOL ST	
941996	5/27/2022	Friday	6:27 PM	Prop Damage Only	2	0.95	School St	1

CrashId	Distance	Unit	Direction	First Harmful Event	Manner of Crash	Weather Cond	Light Condition	Road Surface
633951	50	Feet	N	Other Vehicle	Front to rear	Clear	Daylight	Dry
752928	115	Feet	S	Guardrail Face	Not Applicable	Snow	Daylight	Wet
854867				Other Vehicle	Front to rear	Clear	Daylight	Dry
941996	1	Tenths	N	Other Vehicle	Front to rear	Clear	Dusk	Dry

LINE	BEARING	DISTANCE
L1	N 113°49' E	8.88'
L2	N 09°28'18" E	25.48'
L3	S 89°46'21" E	25.92'
L4	N 00°34'43" W	23.50'
L5	N 08°18'28" E	23.74'

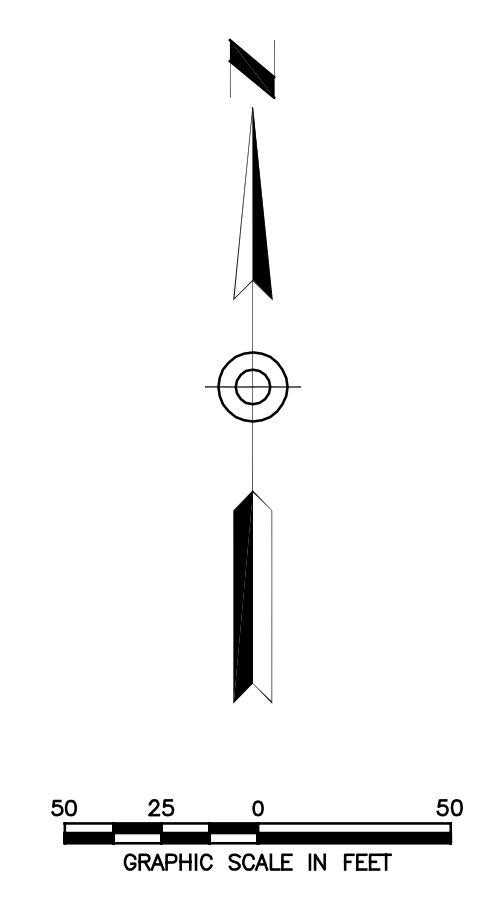

n/f  
Pierce Baptist Home, Inc.  
Map 19, Block 24, Lot 148

n/f  
Town of Brooklyn  
Map 19, Block 33, Lot 21

SEWER EASEMENT IN FAVOR OF THE TOWN OF BROOKLYN VOL. 617, PG. 278

ACCESS RIGHT OF WAY OVER LANEWAY IN FAVOR OF THE TOWN OF BROOKLYN VOL. 31, PG. 130

n/f  
Carl R. Baker & Darlene A. Baker  
Map 19, Block 24, Lot 158

n/f  
Curt R. Hostman  
Map 19, Block 33, Lot 20.1

n/f  
Curt R. Hostman  
Map 19, Block 33, Lot 20

n/f  
William J. Purcell, Jr.  
Map 19, Block 33, Lot 20.3

n/f  
Sally A. Wood  
Map 19, Block 33, Lot 104

n/f  
Sean P. Mahan  
Map 19, Block 33, Lot 13

n/f  
Mark S. Benard  
Map 19, Block 33, Lot 14


n/f  
Linda Atsales  
Map 19, Block 33, Lot 15

n/f  
Stephanie A. Hynes & Brennan D. Hynes  
Map 19, Block 33, Lot 16

n/f  
Richard E. Bein  
Map 19, Block 33, Lot 17

**LEGEND**

- IRON PIN TO BE SET
- IRON PIN FOUND
- DH DRILL HOLE FOUND
- UTILITY POLE
- CB CATCH BASIN
- SMH SANITARY MANHOLE
- EXISTING CONTOURS
- INLAND WETLANDS FLAG
- ○ ○ ○ ○ STONE WALL
- ○ ○ ○ ○ STONE WALL REMAINS

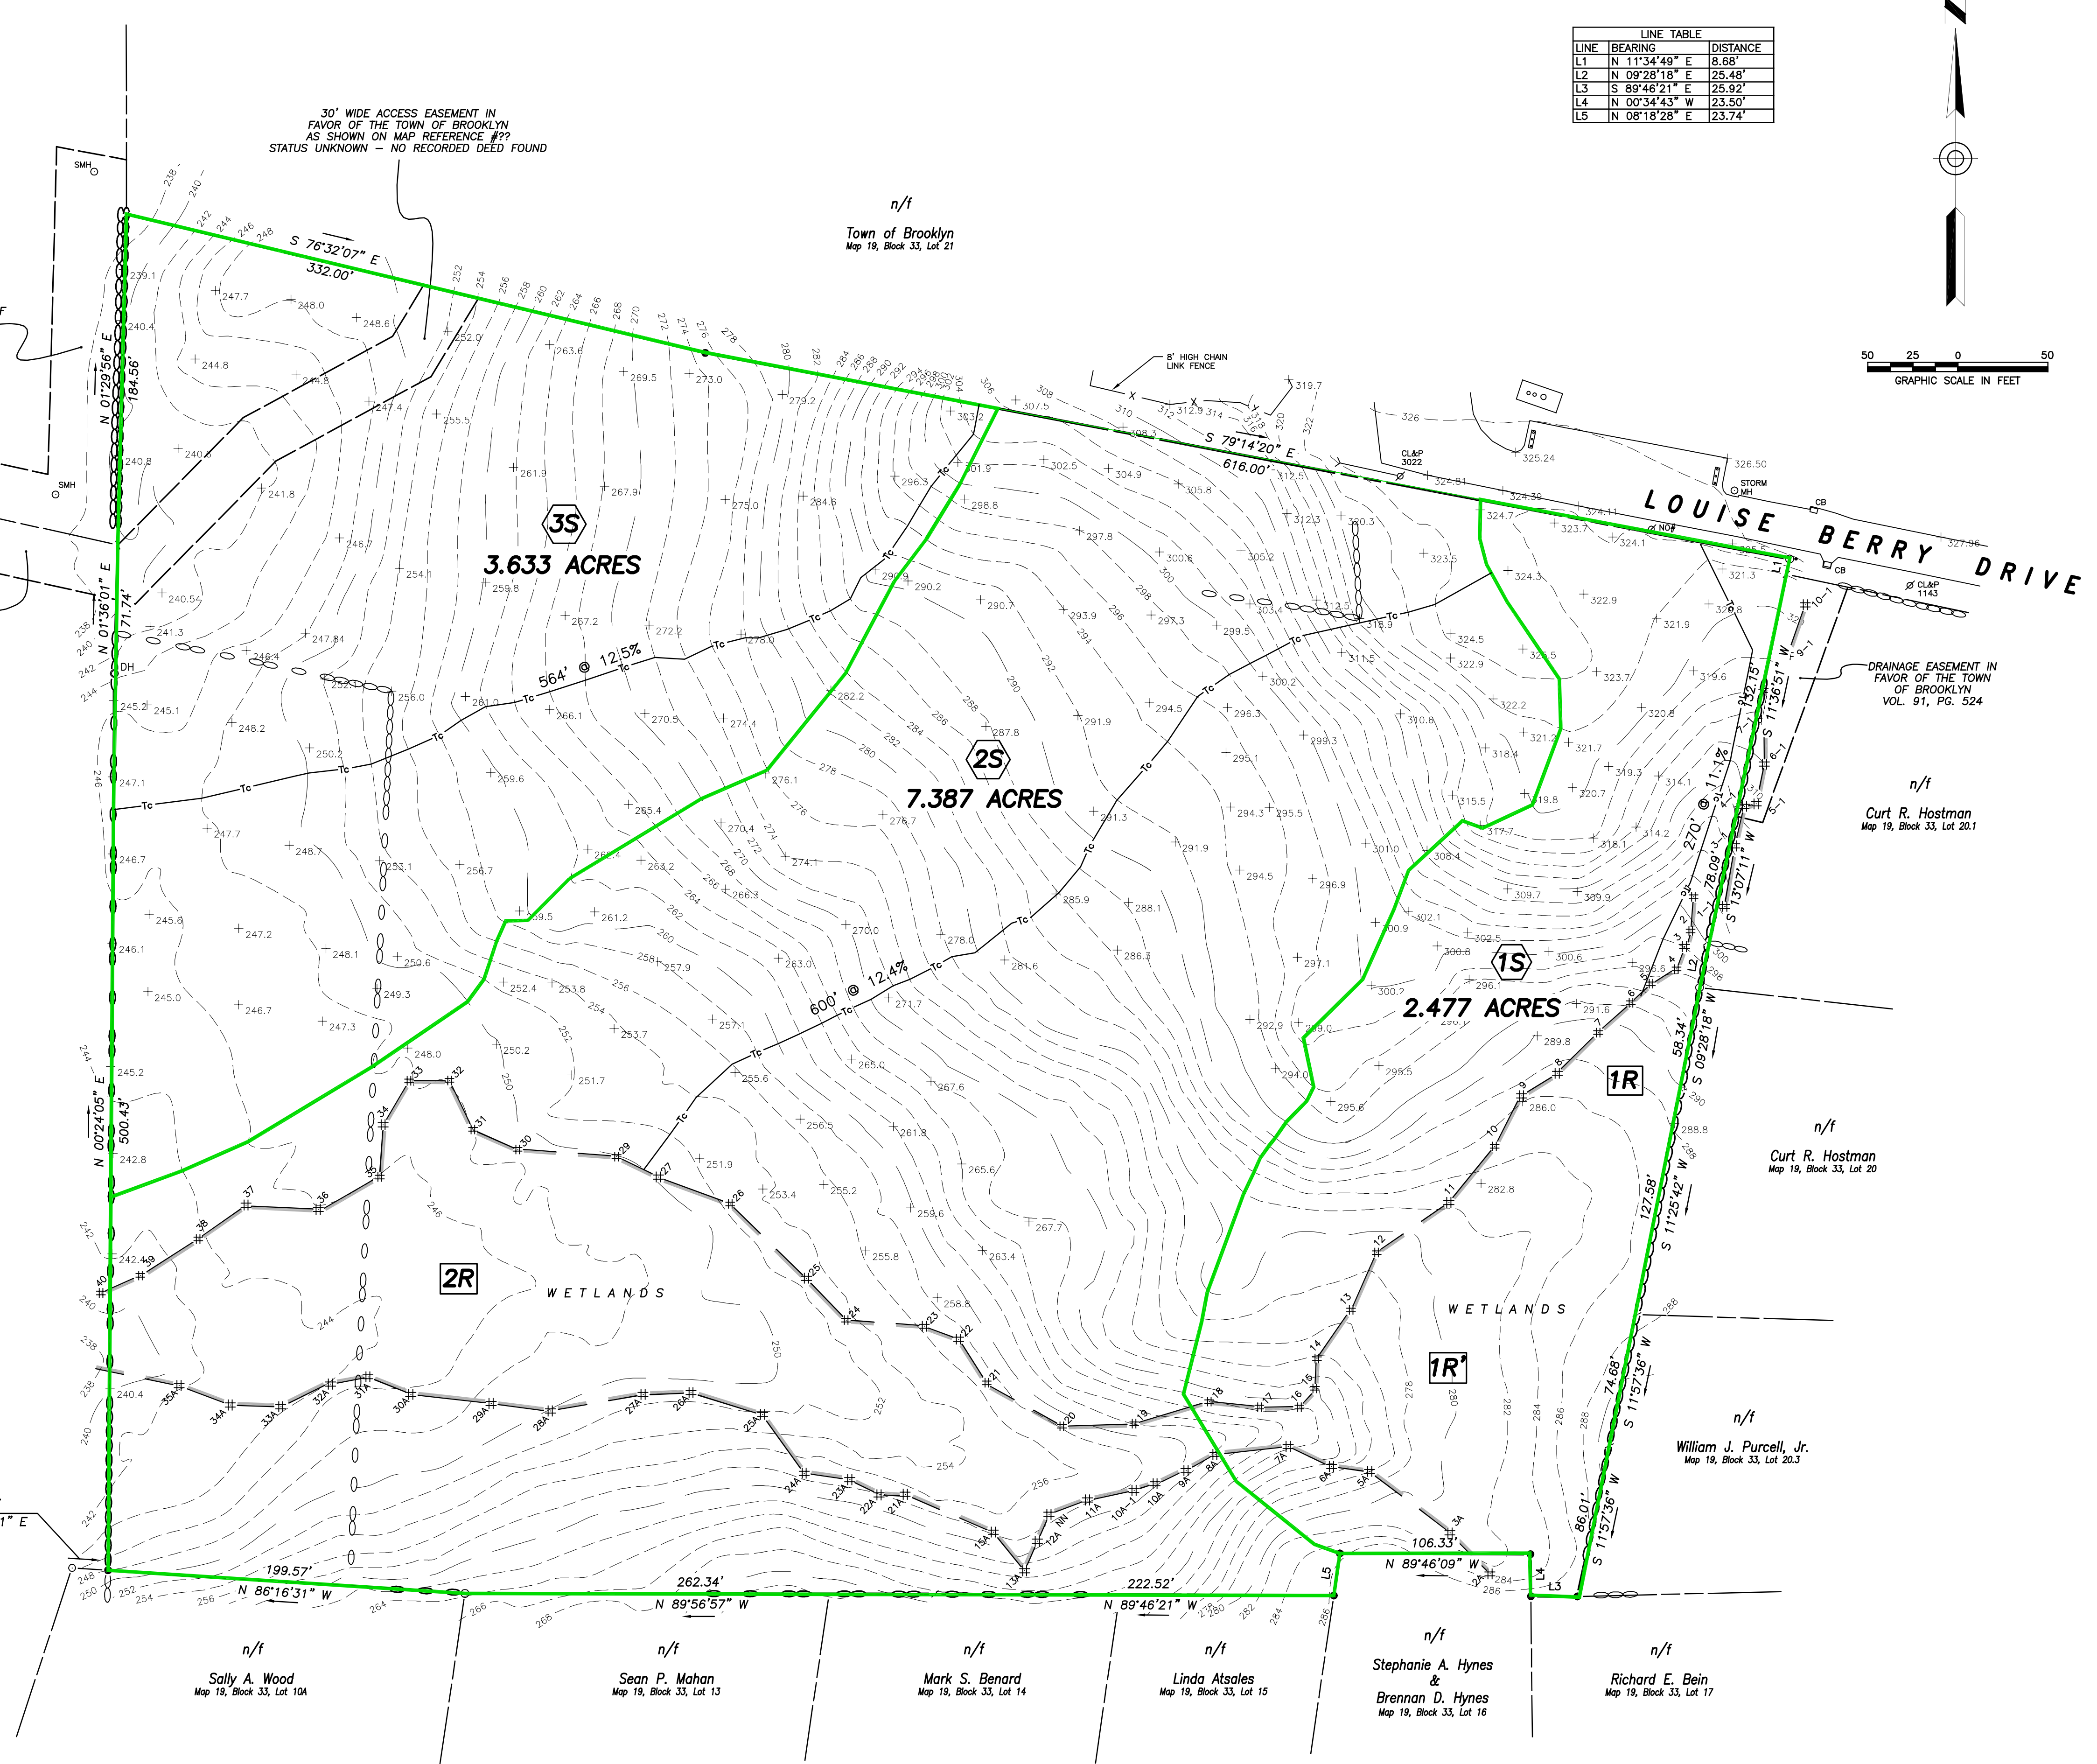


DATE	DESCRIPTION
08/24/2020	PER TOWN REVIEW
	REVISIONS

EXISTING DRAINAGE AREAS  
PREPARED FOR  
**SHANE POLLOCK**  
LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT

**Killingly Engineering Associates**  
Civil Engineering & Surveying  
114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 779-7299  
www.killinglyengineering.com

DATE: 4/23/2020	DRAWN: NET
SCALE: 1" = 50'	DESIGN: NET
SHEET: 1 OF 2	CHK BY: ---
DWG. No: CLIENT FILE	JOB No: 20014

Town of Brooklyn  
Map 33, Lot 21

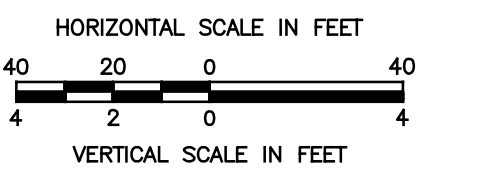

COORDINATE CONNECTION WITH THE BROOKLYN WATER POLLUTION CONTROL AUTHORITY INSPECTORS: CORE-IN-SEAL PENETRATION TO EXISTING MANHOLE. MAINTAIN SYSTEM FLOW AND FUNCTION DURING CONSTRUCTION.

EXISTING SMH  
T/F = 236.9  
F/L = 227.8

n/f  
Brooklyn Property Management, LLC  
Map 24, Lot 158

n/f  
Curt R. Hostman  
Map 33, Lot 20.1

n/f  
David R. Dumont  
Map 33, Lot 20

n/f  
William J. Purcell, Jr.  
Map 33, Lot 20.3

n/f  
Richard E. Bein  
Map 33, Lot 17

n/f  
Stephanie A. Hynes &  
Brennan D. Hynes  
Map 33, Lot 16

n/f  
Linda Atsales  
Map 33, Lot 15

n/f  
Mark S. Benard  
Map 33, Lot 14

n/f  
Cindy Scalzi &  
Greg Benoit  
Map 33, Lot 13

n/f  
Sally A. Wood  
Map 33, Lot 10A

DATE	DESCRIPTION
	REVISIONS

PROPOSED DRAINAGE AREAS  
PREPARED FOR  
**SHANE POLLOCK**  
LOUISE BERRY DRIVE  
BROOKLYN, CONNECTICUT

**Killingly Engineering Associates**  
Civil Engineering & Surveying  
114 Westcott Road  
P.O. Box 421  
Killingly, Connecticut 06241  
(860) 779-7299  
www.killinglyengineering.com

DATE: 4/23/2020	DRAWN: DNE
SCALE: 1" = 40'	DESIGN: NET
SHEET: 5 OF 9	CHK BY: ---
DWG. No: CLIENT FILE	JOB No: 20014

NORMAND E. THIBEAULT, JR., P.E.  
LIC #PEN 0022834

K:\2021\Drawings\2021\BROOKLYN.dwg Aug 01, 2022 - 11:48 AM

# **DRAINAGE REPORT**

*Prepared for*

## **PROPOSED MULTI-FAMILY DEVELOPMENT LOUISE BERRY DRIVE BROOKLYN, CT**

**July 2022**

*Prepared for*

Shane Pollock

*Prepared by*

**Killingly Engineering Associates**

*Civil Engineering & Surveying*



Normand Thibeault Jr., P.E.  
CT License #22834

## ***Introduction***

Shane Pollock & Erin F Mancuso have submitted a proposal to the Town of Brooklyn to construct a 50-unit condominium development with access from Louise Berry Drive in Brooklyn. The project will require construction of a 1000-foot-long paved private roadway with a cul-de-sac turnaround and public water and sanitary sewer. The original design for the property consisted of 100 units. The current design results in the creation of impervious surfaces consisting of pavement and roof but is a significant reduction then the original design. The current stormwater management design has been prepared in response to and in conjunction with Steven Trinkaus, P.E., a drainage consultant retained by the Town of Brooklyn to review the project.

## ***Summary***

According to the USDA-NRCS Soil Survey, the area of disturbance consists of Canton and Charlton fine sandy loams and the wetlands consist of Ridgebury, Leicester and Whitman soils. A walk of the property and wetlands delineation by Joseph Theroux verify that these descriptions are accurate. These soils are associated with hydrologic soil group B & D. The site sheet flows primarily to the south to a linear wetlands system before flowing to the west and ultimately off site. To the greatest degree possible, the existing drainage patterns will be preserved.

The bulk of the drainage from developed areas will be directed to two (2) separate stormwater basins with forebays. The first basin is centrally located on the site and will collect drainage from approximately 400' of the proposed roadway and three (3) of the building rooftops. This basin will discharge to a wet swale prior to flowing to the wetlands. The discharge from this basin ultimately flows to the on-site wetlands at approximately the midpoint of the wetlands system which addresses previous concerns of recharge to the wetlands. The second basin and forebay collects drainage from the remainder of the roadway and buildings and discharges at the terminus of the on-site wetlands.

The calculations utilized HydroCAD® Stormwater Modeling System, a computer model, to analyze pre-and post-development drainage conditions, and to aid in the design of the stormwater detention system. The model used the Soil Conservation Service TR-20 method with a Type III 24-hour rainfall to calculate the runoff. The 2 through 100-year frequency storms were analyzed to evaluate peak runoff for conditions with grassed and stone dust parking. Table 1 summarizes our findings; all peaks have been rounded to the nearest 0.1.

**Table 1. Grassed Parking vs. Stone Dust Parking Peak Runoff Rates**

Design Storm	Depth (in)	Existing Peak	Proposed Peak	Difference
2-Year	3.37	3.7 CFS	3.6 CFS	-0.1 CFS
5-Year	4.28	8.6 CFS	8.3 CFS	-0.3 CFS
10-Year	5.04	13.5 CFS	13.2 CFS	-0.3 CFS
25-Year	6.08	20.7 CFS	19.6 CFS	-1.1 CFS
50-Year	6.85	26.5 CFS	25.7 CFS	-0.8 CFS
100-Year	7.68	33.5 CFS	33.1 CFS	-0.4 CFS

As seen by the computations, there are slight decreases in runoff rates for all design storms. It is important to note that for post-construction conditions, we have conservatively modeled the post construction soils as hydrologic soil group D.

In addition to addressing pre- and post-construction peak runoff rates from the property to the wetlands and adjacent property, the design considers stormwater treatment and water quality for the project. Wherever possible, overland sheet flow is encouraged, catch basins will be constructed with sediment sumps, the final catch basin prior to discharge to the terminus stormwater basin will be fitted with a hooded outlet and the stormwater basins account for water quality volume (WQV).

## **Per Chapter 7 of the Connecticut DEEP Stormwater Quality Manual**

### **Section 7.4.1 Water Quality Volume**

#### **Basin 1 Water Quality Volume (WQV)**

$$WQV = (1.0)(R)(A)/12$$

$$R = 0.05 + 0.009(I) \quad I = \% \text{ Impervious} = 32.67\%$$

$$R = 0.05 + 0.009(32.67) = 0.344$$

$$A = 1.383 \text{ acres}$$

$$WQV = (1.0) (0.344) (1.383) / 12 = 0.04 \text{ ac-ft} = 1,728 \text{ c.f.}$$

3,023 c.f. provided to elevation 285.0

#### **Basin 2 Water Quality Volume**

$$WQV = (1.0)(R)(A)/12$$

$$R = 0.05 + 0.009(I) \quad I = \% \text{ Impervious} = 43.44\%$$

$$R = 0.05 + 0.009(43.44) = 0.391$$

$$A = 4.169 \text{ acres}$$

$$WQV = (1.0) (0.91) (4.169) / 12 = 0.317 \text{ ac-ft} = 13,771 \text{ c.f.}$$

9,375 c.f. provided in forebay & 5,230 to elevation 285.5 in main basin = 14,605 c.f.

### **Section 7.4.2 Water Quality Flow**

This section is utilized for treatment mechanisms such as grasses swales or proprietary treatment devices. Although the project calls for a wet swale from the first stormwater basin, the swale will not convey runoff directly from impervious surfaces.



### **Section 7.5.1 Groundwater Recharge Volume**

Per review of the project drainage by Mr. Trinkaus, it was determined that groundwater recharge volume was not an appropriate application for the site. The Water Quality Volume and Channel protection volume (first 1.5" of rain) have been accounted for based upon consultation with Mr. Trinkaus.

### **Section 7.5.2 Runoff Capture Volume (RCV)**


Not utilized for this application. This method is typically utilized to capture "clean" runoff from surfaces such as rooftops and infiltrate it into the soil.

### **Section 7.6 Peak Flow Control**

We have demonstrated that peak flows from the development will be slightly reduced for all design storms.

## **HYDROCAD CALCULATIONS**

## **EXISTING CONDITIONS**



Off Site West



Drainage Area 2




Drainage Area 1





Wetland Section 1



Peak off Site



Wetland Section 2



**Routing Diagram for Existing Conditions**  
Prepared by Killingly Engineering Associates, LLC, Printed 8/1/2022  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

## Existing Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 2-year Rainfall=3.37"  
Printed 8/1/2022  
Page 2

### Summary for Subcatchment 1S: Drainage Area 1

Runoff = 1.99 cfs @ 12.10 hrs, Volume= 0.157 af, Depth> 0.57"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

Area (ac)	CN	Description
0.930	73	Woods, Fair, HSG C
2.384	60	Woods, Fair, HSG B
3.314	64	Weighted Average
3.314		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.2	270	0.1110	0.86		Lag/CN Method, Tc 1

### Summary for Subcatchment 2S: Drainage Area 2

Runoff = 2.94 cfs @ 12.18 hrs, Volume= 0.301 af, Depth> 0.49"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

Area (ac)	CN	Description
1.418	73	Woods, Fair, HSG C
5.969	60	Woods, Fair, HSG B
7.387	62	Weighted Average
7.387		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.9	600	0.1240	1.01		Lag/CN Method, Tc-2

### Summary for Subcatchment 3S: Off Site West

Runoff = 3.36 cfs @ 12.12 hrs, Volume= 0.254 af, Depth> 0.84"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

Area (ac)	CN	Description
3.633	70	Woods, Good, HSG C
3.633		100.00% Pervious Area

## Existing Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 2-year Rainfall=3.37"  
Printed 8/1/2022  
Page 3

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.6	564	0.1250	1.24		Lag/CN Method, Tc-3

### Summary for Reach 1R: Wetland Section 1

Inflow Area = 3.314 ac, 0.00% Impervious, Inflow Depth > 0.57" for 2-year event  
Inflow = 1.99 cfs @ 12.10 hrs, Volume= 0.157 af  
Outflow = 1.75 cfs @ 12.21 hrs, Volume= 0.156 af, Atten= 12%, Lag= 6.5 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Max. Velocity= 1.15 fps, Min. Travel Time= 3.5 min  
Avg. Velocity = 0.58 fps, Avg. Travel Time= 6.9 min

Peak Storage= 371 cf @ 12.15 hrs  
Average Depth at Peak Storage= 0.09'  
Bank-Full Depth= 2.00' Flow Area= 173.3 sf, Capacity= 1,610.63 cfs

130.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
Length= 240.0' Slope= 0.0667 '/'  
Inlet Invert= 296.00', Outlet Invert= 280.00'



### Summary for Reach 1R': Wetland Section 2

Inflow Area = 3.314 ac, 0.00% Impervious, Inflow Depth > 0.57" for 2-year event  
Inflow = 1.75 cfs @ 12.21 hrs, Volume= 0.156 af  
Outflow = 1.72 cfs @ 12.22 hrs, Volume= 0.156 af, Atten= 2%, Lag= 0.7 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Max. Velocity= 5.19 fps, Min. Travel Time= 0.5 min  
Avg. Velocity = 2.70 fps, Avg. Travel Time= 0.9 min

Peak Storage= 49 cf @ 12.21 hrs  
Average Depth at Peak Storage= 0.07'  
Bank-Full Depth= 2.00' Flow Area= 53.3 sf, Capacity= 2,590.64 cfs

40.00' x 2.00' deep Parabolic Channel, n= 0.013 Asphalt, smooth  
Length= 145.0' Slope= 0.1241 '/'  
Inlet Invert= 280.00', Outlet Invert= 262.00'

## Existing Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 2-year Rainfall=3.37"  
Printed 8/1/2022  
Page 4

r

### Summary for Reach 2R: Peak off Site

Inflow Area = 10.701 ac, 0.00% Impervious, Inflow Depth > 0.51" for 2-year event  
Inflow = 4.60 cfs @ 12.21 hrs, Volume= 0.457 af  
Outflow = 3.74 cfs @ 12.47 hrs, Volume= 0.449 af, Atten= 19%, Lag= 15.8 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Max. Velocity= 1.35 fps, Min. Travel Time= 7.9 min  
Avg. Velocity = 0.74 fps, Avg. Travel Time= 14.5 min

Peak Storage= 1,783 cf @ 12.33 hrs  
Average Depth at Peak Storage= 0.17'  
Bank-Full Depth= 2.00' Flow Area= 113.3 sf, Capacity= 789.38 cfs

85.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
Length= 640.0' Slope= 0.0375 '/'  
Inlet Invert= 262.00', Outlet Invert= 238.00'

r

## Existing Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 5-year Rainfall=4.28"  
Printed 8/1/2022  
Page 5

### Summary for Subcatchment 1S: Drainage Area 1

Runoff = 4.00 cfs @ 12.09 hrs, Volume= 0.283 af, Depth> 1.03"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.28"

Area (ac)	CN	Description
0.930	73	Woods, Fair, HSG C
2.384	60	Woods, Fair, HSG B
3.314	64	Weighted Average
3.314		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.2	270	0.1110	0.86		Lag/CN Method, Tc 1

### Summary for Subcatchment 2S: Drainage Area 2

Runoff = 6.60 cfs @ 12.16 hrs, Volume= 0.561 af, Depth> 0.91"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.28"

Area (ac)	CN	Description
1.418	73	Woods, Fair, HSG C
5.969	60	Woods, Fair, HSG B
7.387	62	Weighted Average
7.387		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.9	600	0.1240	1.01		Lag/CN Method, Tc-2

### Summary for Subcatchment 3S: Off Site West

Runoff = 5.82 cfs @ 12.12 hrs, Volume= 0.421 af, Depth> 1.39"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.28"

Area (ac)	CN	Description
3.633	70	Woods, Good, HSG C
3.633		100.00% Pervious Area



**Existing Conditions**

Prepared by Killingly Engineering Associates, LLC  
 HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.6	564	0.1250	1.24		Lag/CN Method, Tc-3


**Summary for Reach 1R: Wetland Section 1**

Inflow Area = 3.314 ac, 0.00% Impervious, Inflow Depth > 1.03" for 5-year event  
 Inflow = 4.00 cfs @ 12.09 hrs, Volume= 0.283 af  
 Outflow = 3.64 cfs @ 12.18 hrs, Volume= 0.281 af, Atten= 9%, Lag= 4.9 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.42 fps, Min. Travel Time= 2.8 min  
 Avg. Velocity = 0.66 fps, Avg. Travel Time= 6.0 min

Peak Storage= 616 cf @ 12.13 hrs  
 Average Depth at Peak Storage= 0.12'  
 Bank-Full Depth= 2.00' Flow Area= 173.3 sf, Capacity= 1,610.63 cfs

130.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 240.0' Slope= 0.0667 '/'  
 Inlet Invert= 296.00', Outlet Invert= 280.00'

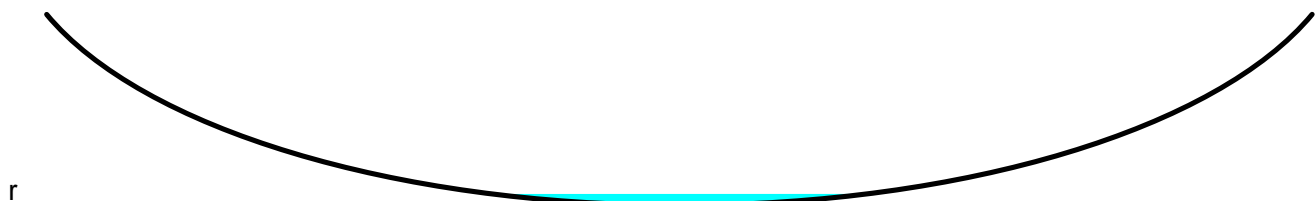

**Summary for Reach 1R': Wetland Section 2**

Inflow Area = 3.314 ac, 0.00% Impervious, Inflow Depth > 1.02" for 5-year event  
 Inflow = 3.64 cfs @ 12.18 hrs, Volume= 0.281 af  
 Outflow = 3.61 cfs @ 12.19 hrs, Volume= 0.281 af, Atten= 1%, Lag= 0.9 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 6.46 fps, Min. Travel Time= 0.4 min  
 Avg. Velocity = 3.03 fps, Avg. Travel Time= 0.8 min


Peak Storage= 82 cf @ 12.18 hrs  
 Average Depth at Peak Storage= 0.10'  
 Bank-Full Depth= 2.00' Flow Area= 53.3 sf, Capacity= 2,590.64 cfs

40.00' x 2.00' deep Parabolic Channel, n= 0.013 Asphalt, smooth  
 Length= 145.0' Slope= 0.1241 '/'  
 Inlet Invert= 280.00', Outlet Invert= 262.00'

**Existing Conditions**

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 5-year Rainfall=4.28"  
Printed 8/1/2022  
Page 7

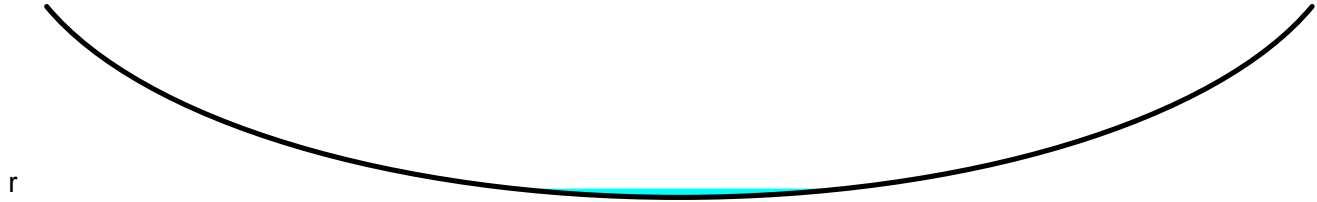

**Summary for Reach 2R: Peak off Site**

Inflow Area = 10.701 ac, 0.00% Impervious, Inflow Depth > 0.94" for 5-year event  
 Inflow = 10.14 cfs @ 12.17 hrs, Volume= 0.842 af  
 Outflow = 8.63 cfs @ 12.36 hrs, Volume= 0.832 af, Atten= 15%, Lag= 11.2 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.74 fps, Min. Travel Time= 6.1 min  
 Avg. Velocity = 0.84 fps, Avg. Travel Time= 12.6 min

Peak Storage= 3,183 cf @ 12.26 hrs  
 Average Depth at Peak Storage= 0.25'  
 Bank-Full Depth= 2.00' Flow Area= 113.3 sf, Capacity= 789.38 cfs

85.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 640.0' Slope= 0.0375 '/'  
 Inlet Invert= 262.00', Outlet Invert= 238.00'



## Existing Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 10-year Rainfall=5.04"  
Printed 8/1/2022  
Page 8

### Summary for Subcatchment 1S: Drainage Area 1

Runoff = 5.91 cfs @ 12.09 hrs, Volume= 0.404 af, Depth> 1.46"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.04"

Area (ac)	CN	Description
0.930	73	Woods, Fair, HSG C
2.384	60	Woods, Fair, HSG B
3.314	64	Weighted Average
3.314		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.2	270	0.1110	0.86		Lag/CN Method, Tc 1

### Summary for Subcatchment 2S: Drainage Area 2

Runoff = 10.12 cfs @ 12.16 hrs, Volume= 0.816 af, Depth> 1.33"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.04"

Area (ac)	CN	Description
1.418	73	Woods, Fair, HSG C
5.969	60	Woods, Fair, HSG B
7.387	62	Weighted Average
7.387		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.9	600	0.1240	1.01		Lag/CN Method, Tc-2

### Summary for Subcatchment 3S: Off Site West

Runoff = 8.07 cfs @ 12.12 hrs, Volume= 0.576 af, Depth> 1.90"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.04"

Area (ac)	CN	Description
3.633	70	Woods, Good, HSG C
3.633		100.00% Pervious Area

**Existing Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 9

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.6	564	0.1250	1.24		Lag/CN Method, Tc-3

**Summary for Reach 1R: Wetland Section 1**

Inflow Area = 3.314 ac, 0.00% Impervious, Inflow Depth > 1.46" for 10-year event  
 Inflow = 5.91 cfs @ 12.09 hrs, Volume= 0.404 af  
 Outflow = 5.50 cfs @ 12.16 hrs, Volume= 0.403 af, Atten= 7%, Lag= 4.4 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.62 fps, Min. Travel Time= 2.5 min  
 Avg. Velocity = 0.72 fps, Avg. Travel Time= 5.6 min

Peak Storage= 825 cf @ 12.12 hrs  
 Average Depth at Peak Storage= 0.15'  
 Bank-Full Depth= 2.00' Flow Area= 173.3 sf, Capacity= 1,610.63 cfs

130.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 240.0' Slope= 0.0667 '/'  
 Inlet Invert= 296.00', Outlet Invert= 280.00'



**Summary for Reach 1R': Wetland Section 2**

Inflow Area = 3.314 ac, 0.00% Impervious, Inflow Depth > 1.46" for 10-year event  
 Inflow = 5.50 cfs @ 12.16 hrs, Volume= 0.403 af  
 Outflow = 5.41 cfs @ 12.17 hrs, Volume= 0.402 af, Atten= 2%, Lag= 0.6 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 7.31 fps, Min. Travel Time= 0.3 min  
 Avg. Velocity = 3.28 fps, Avg. Travel Time= 0.7 min

Peak Storage= 108 cf @ 12.17 hrs  
 Average Depth at Peak Storage= 0.12'  
 Bank-Full Depth= 2.00' Flow Area= 53.3 sf, Capacity= 2,590.64 cfs

40.00' x 2.00' deep Parabolic Channel, n= 0.013 Asphalt, smooth  
 Length= 145.0' Slope= 0.1241 '/'  
 Inlet Invert= 280.00', Outlet Invert= 262.00'

## Existing Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 10-year Rainfall=5.04"  
Printed 8/1/2022  
Page 10



### Summary for Reach 2R: Peak off Site

Inflow Area = 10.701 ac, 0.00% Impervious, Inflow Depth > 1.37" for 10-year event  
Inflow = 15.48 cfs @ 12.16 hrs, Volume= 1.218 af  
Outflow = 13.48 cfs @ 12.32 hrs, Volume= 1.206 af, Atten= 13%, Lag= 9.5 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Max. Velocity= 1.99 fps, Min. Travel Time= 5.4 min  
Avg. Velocity = 0.91 fps, Avg. Travel Time= 11.7 min

Peak Storage= 4,333 cf @ 12.23 hrs  
Average Depth at Peak Storage= 0.31'  
Bank-Full Depth= 2.00' Flow Area= 113.3 sf, Capacity= 789.38 cfs

85.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
Length= 640.0' Slope= 0.0375 '/'  
Inlet Invert= 262.00', Outlet Invert= 238.00'



## Existing Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 25-year Rainfall=6.08"  
Printed 8/1/2022  
Page 11

### Summary for Subcatchment 1S: Drainage Area 1

Runoff = 8.79 cfs @ 12.09 hrs, Volume= 0.589 af, Depth> 2.13"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.08"

Area (ac)	CN	Description
0.930	73	Woods, Fair, HSG C
2.384	60	Woods, Fair, HSG B
3.314	64	Weighted Average
3.314		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.2	270	0.1110	0.86		Lag/CN Method, Tc 1

### Summary for Subcatchment 2S: Drainage Area 2

Runoff = 15.46 cfs @ 12.15 hrs, Volume= 1.207 af, Depth> 1.96"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.08"

Area (ac)	CN	Description
1.418	73	Woods, Fair, HSG C
5.969	60	Woods, Fair, HSG B
7.387	62	Weighted Average
7.387		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.9	600	0.1240	1.01		Lag/CN Method, Tc-2

### Summary for Subcatchment 3S: Off Site West

Runoff = 11.36 cfs @ 12.11 hrs, Volume= 0.804 af, Depth> 2.66"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.08"

Area (ac)	CN	Description
3.633	70	Woods, Good, HSG C
3.633		100.00% Pervious Area

**Existing Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 12

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.6	564	0.1250	1.24		Lag/CN Method, Tc-3


**Summary for Reach 1R: Wetland Section 1**

Inflow Area = 3.314 ac, 0.00% Impervious, Inflow Depth > 2.13" for 25-year event  
 Inflow = 8.79 cfs @ 12.09 hrs, Volume= 0.589 af  
 Outflow = 8.21 cfs @ 12.15 hrs, Volume= 0.586 af, Atten= 7%, Lag= 4.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.84 fps, Min. Travel Time= 2.2 min  
 Avg. Velocity = 0.77 fps, Avg. Travel Time= 5.2 min

Peak Storage= 1,097 cf @ 12.11 hrs  
 Average Depth at Peak Storage= 0.18'  
 Bank-Full Depth= 2.00' Flow Area= 173.3 sf, Capacity= 1,610.63 cfs

130.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 240.0' Slope= 0.0667 '/'  
 Inlet Invert= 296.00', Outlet Invert= 280.00'

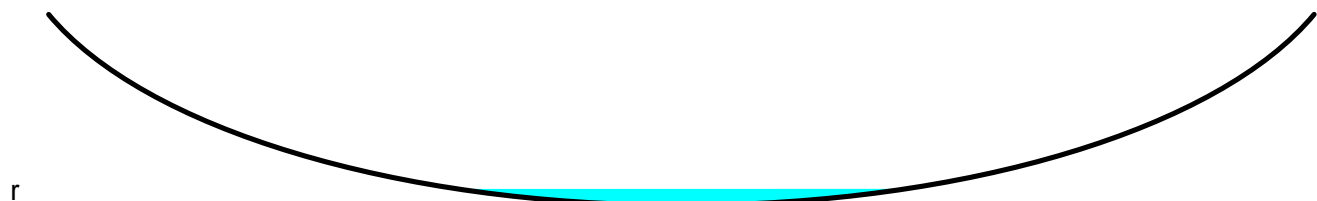

**Summary for Reach 1R': Wetland Section 2**

Inflow Area = 3.314 ac, 0.00% Impervious, Inflow Depth > 2.12" for 25-year event  
 Inflow = 8.21 cfs @ 12.15 hrs, Volume= 0.586 af  
 Outflow = 8.10 cfs @ 12.16 hrs, Volume= 0.586 af, Atten= 1%, Lag= 0.5 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 8.28 fps, Min. Travel Time= 0.3 min  
 Avg. Velocity = 3.54 fps, Avg. Travel Time= 0.7 min


Peak Storage= 143 cf @ 12.16 hrs  
 Average Depth at Peak Storage= 0.14'  
 Bank-Full Depth= 2.00' Flow Area= 53.3 sf, Capacity= 2,590.64 cfs

40.00' x 2.00' deep Parabolic Channel, n= 0.013 Asphalt, smooth  
 Length= 145.0' Slope= 0.1241 '/'  
 Inlet Invert= 280.00', Outlet Invert= 262.00'

**Existing Conditions**

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 25-year Rainfall=6.08"  
Printed 8/1/2022  
Page 13

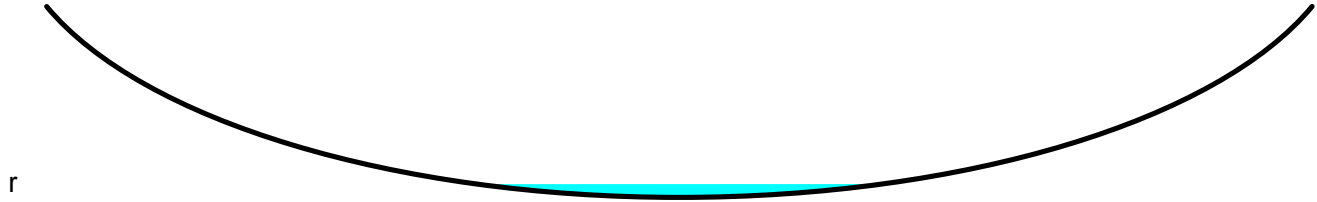

**Summary for Reach 2R: Peak off Site**

Inflow Area = 10.701 ac, 0.00% Impervious, Inflow Depth > 2.01" for 25-year event  
 Inflow = 23.54 cfs @ 12.16 hrs, Volume= 1.793 af  
 Outflow = 20.73 cfs @ 12.29 hrs, Volume= 1.778 af, Atten= 12%, Lag= 8.4 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.29 fps, Min. Travel Time= 4.7 min  
 Avg. Velocity = 0.98 fps, Avg. Travel Time= 10.9 min

Peak Storage= 5,921 cf @ 12.21 hrs  
 Average Depth at Peak Storage= 0.38'  
 Bank-Full Depth= 2.00' Flow Area= 113.3 sf, Capacity= 789.38 cfs

85.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 640.0' Slope= 0.0375 '/'  
 Inlet Invert= 262.00', Outlet Invert= 238.00'





## Existing Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 50-year Rainfall=6.85"  
Printed 8/1/2022  
Page 14

### Summary for Subcatchment 1S: Drainage Area 1

Runoff = 11.06 cfs @ 12.09 hrs, Volume= 0.736 af, Depth> 2.66"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

Area (ac)	CN	Description
0.930	73	Woods, Fair, HSG C
2.384	60	Woods, Fair, HSG B
3.314	64	Weighted Average
3.314		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.2	270	0.1110	0.86		Lag/CN Method, Tc 1

### Summary for Subcatchment 2S: Drainage Area 2

Runoff = 19.71 cfs @ 12.15 hrs, Volume= 1.521 af, Depth> 2.47"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

Area (ac)	CN	Description
1.418	73	Woods, Fair, HSG C
5.969	60	Woods, Fair, HSG B
7.387	62	Weighted Average
7.387		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.9	600	0.1240	1.01		Lag/CN Method, Tc-2

### Summary for Subcatchment 3S: Off Site West

Runoff = 13.89 cfs @ 12.11 hrs, Volume= 0.983 af, Depth> 3.25"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

Area (ac)	CN	Description
3.633	70	Woods, Good, HSG C
3.633		100.00% Pervious Area

**Existing Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 15

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.6	564	0.1250	1.24		Lag/CN Method, Tc-3

**Summary for Reach 1R: Wetland Section 1**

Inflow Area = 3.314 ac, 0.00% Impervious, Inflow Depth > 2.66" for 50-year event  
 Inflow = 11.06 cfs @ 12.09 hrs, Volume= 0.736 af  
 Outflow = 10.33 cfs @ 12.15 hrs, Volume= 0.733 af, Atten= 7%, Lag= 3.8 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.98 fps, Min. Travel Time= 2.0 min  
 Avg. Velocity = 0.80 fps, Avg. Travel Time= 5.0 min

Peak Storage= 1,293 cf @ 12.11 hrs  
 Average Depth at Peak Storage= 0.20'  
 Bank-Full Depth= 2.00' Flow Area= 173.3 sf, Capacity= 1,610.63 cfs

130.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 240.0' Slope= 0.0667 '/'  
 Inlet Invert= 296.00', Outlet Invert= 280.00'



**Summary for Reach 1R': Wetland Section 2**

Inflow Area = 3.314 ac, 0.00% Impervious, Inflow Depth > 2.65" for 50-year event  
 Inflow = 10.33 cfs @ 12.15 hrs, Volume= 0.733 af  
 Outflow = 10.23 cfs @ 12.16 hrs, Volume= 0.733 af, Atten= 1%, Lag= 0.4 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 8.91 fps, Min. Travel Time= 0.3 min  
 Avg. Velocity = 3.70 fps, Avg. Travel Time= 0.7 min

Peak Storage= 168 cf @ 12.15 hrs  
 Average Depth at Peak Storage= 0.16'  
 Bank-Full Depth= 2.00' Flow Area= 53.3 sf, Capacity= 2,590.64 cfs

40.00' x 2.00' deep Parabolic Channel, n= 0.013 Asphalt, smooth  
 Length= 145.0' Slope= 0.1241 '/'  
 Inlet Invert= 280.00', Outlet Invert= 262.00'

**Existing Conditions**

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 50-year Rainfall=6.85"  
Printed 8/1/2022  
Page 16



**Summary for Reach 2R: Peak off Site**

Inflow Area = 10.701 ac, 0.00% Impervious, Inflow Depth > 2.53" for 50-year event  
 Inflow = 29.92 cfs @ 12.15 hrs, Volume= 2.254 af  
 Outflow = 26.53 cfs @ 12.28 hrs, Volume= 2.236 af, Atten= 11%, Lag= 7.5 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.47 fps, Min. Travel Time= 4.3 min  
 Avg. Velocity = 1.03 fps, Avg. Travel Time= 10.4 min

Peak Storage= 7,045 cf @ 12.20 hrs  
 Average Depth at Peak Storage= 0.42'  
 Bank-Full Depth= 2.00' Flow Area= 113.3 sf, Capacity= 789.38 cfs

85.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 640.0' Slope= 0.0375 '/'  
 Inlet Invert= 262.00', Outlet Invert= 238.00'



## Existing Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 100-year Rainfall=7.68"  
Printed 8/1/2022  
Page 17

### Summary for Subcatchment 1S: Drainage Area 1

Runoff = 13.60 cfs @ 12.08 hrs, Volume= 0.902 af, Depth> 3.27"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.68"

Area (ac)	CN	Description
0.930	73	Woods, Fair, HSG C
2.384	60	Woods, Fair, HSG B
3.314	64	Weighted Average
3.314		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.2	270	0.1110	0.86		Lag/CN Method, Tc 1

### Summary for Subcatchment 2S: Drainage Area 2

Runoff = 24.50 cfs @ 12.15 hrs, Volume= 1.878 af, Depth> 3.05"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.68"

Area (ac)	CN	Description
1.418	73	Woods, Fair, HSG C
5.969	60	Woods, Fair, HSG B
7.387	62	Weighted Average
7.387		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.9	600	0.1240	1.01		Lag/CN Method, Tc-2

### Summary for Subcatchment 3S: Off Site West

Runoff = 16.68 cfs @ 12.11 hrs, Volume= 1.182 af, Depth> 3.90"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.68"

Area (ac)	CN	Description
3.633	70	Woods, Good, HSG C
3.633		100.00% Pervious Area

**Existing Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 18

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.6	564	0.1250	1.24		Lag/CN Method, Tc-3

**Summary for Reach 1R: Wetland Section 1**

Inflow Area = 3.314 ac, 0.00% Impervious, Inflow Depth > 3.27" for 100-year event  
 Inflow = 13.60 cfs @ 12.08 hrs, Volume= 0.902 af  
 Outflow = 12.70 cfs @ 12.14 hrs, Volume= 0.899 af, Atten= 7%, Lag= 3.6 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.12 fps, Min. Travel Time= 1.9 min  
 Avg. Velocity = 0.84 fps, Avg. Travel Time= 4.8 min

Peak Storage= 1,497 cf @ 12.11 hrs  
 Average Depth at Peak Storage= 0.22'  
 Bank-Full Depth= 2.00' Flow Area= 173.3 sf, Capacity= 1,610.63 cfs

130.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 240.0' Slope= 0.0667 '/'  
 Inlet Invert= 296.00', Outlet Invert= 280.00'



**Summary for Reach 1R': Wetland Section 2**

Inflow Area = 3.314 ac, 0.00% Impervious, Inflow Depth > 3.26" for 100-year event  
 Inflow = 12.70 cfs @ 12.14 hrs, Volume= 0.899 af  
 Outflow = 12.60 cfs @ 12.15 hrs, Volume= 0.899 af, Atten= 1%, Lag= 0.4 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 9.50 fps, Min. Travel Time= 0.3 min  
 Avg. Velocity = 3.85 fps, Avg. Travel Time= 0.6 min


Peak Storage= 194 cf @ 12.15 hrs  
 Average Depth at Peak Storage= 0.17'  
 Bank-Full Depth= 2.00' Flow Area= 53.3 sf, Capacity= 2,590.64 cfs

40.00' x 2.00' deep Parabolic Channel, n= 0.013 Asphalt, smooth  
 Length= 145.0' Slope= 0.1241 '/'  
 Inlet Invert= 280.00', Outlet Invert= 262.00'

**Existing Conditions**

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 100-year Rainfall=7.68"  
Printed 8/1/2022  
Page 19

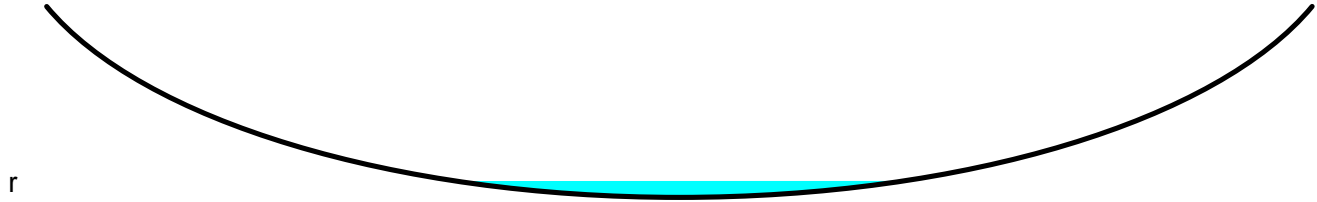

**Summary for Reach 2R: Peak off Site**

Inflow Area = 10.701 ac, 0.00% Impervious, Inflow Depth > 3.11" for 100-year event  
 Inflow = 37.10 cfs @ 12.15 hrs, Volume= 2.777 af  
 Outflow = 33.47 cfs @ 12.27 hrs, Volume= 2.758 af, Atten= 10%, Lag= 7.0 min




Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.65 fps, Min. Travel Time= 4.0 min  
 Avg. Velocity = 1.08 fps, Avg. Travel Time= 9.9 min

Peak Storage= 8,223 cf @ 12.20 hrs  
 Average Depth at Peak Storage= 0.47'  
 Bank-Full Depth= 2.00' Flow Area= 113.3 sf, Capacity= 789.38 cfs

85.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 640.0' Slope= 0.0375 '/'  
 Inlet Invert= 262.00', Outlet Invert= 238.00'



## **PROPOSED CONDITIONS**

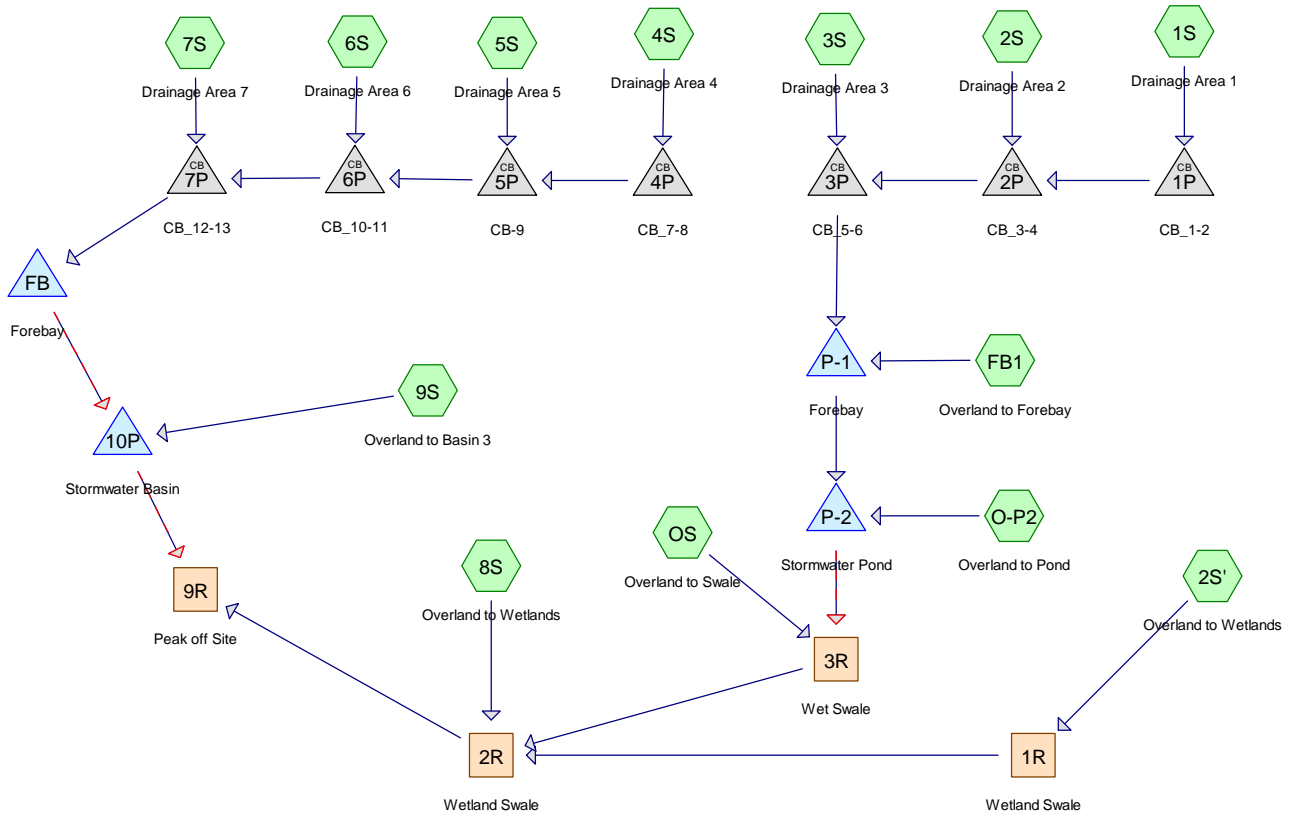

**Routing Diagram for Proposed Conditions**  
 Prepared by Killingly Engineering Associates, LLC, Printed 8/1/2022  
 HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC



## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 2-year Rainfall=3.37"  
Printed 8/1/2022  
Page 2

### Summary for Subcatchment 1S: Drainage Area 1

Runoff = 0.40 cfs @ 12.13 hrs, Volume= 0.030 af, Depth> 1.85"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

Area (sf)	CN	Description
4,120	98	Paved parking, HSG B
4,450	74	>75% Grass cover, Good, HSG C
8,570	86	Weighted Average
4,450		51.93% Pervious Area
4,120		48.07% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.1	111	0.0710	0.20		<b>Sheet Flow, Tc-1</b> Grass: Dense n= 0.240 P2= 3.37"

### Summary for Subcatchment 2S: Drainage Area 2

Runoff = 0.82 cfs @ 12.02 hrs, Volume= 0.049 af, Depth> 1.94"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

Area (sf)	CN	Description
6,287	74	>75% Grass cover, Good, HSG C
* 7,033	98	Roof/pavement
13,320	87	Weighted Average
6,287		47.20% Pervious Area
7,033		52.80% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.0	125	0.0100	2.03		<b>Shallow Concentrated Flow, Tc-2</b> Paved Kv= 20.3 fps

### Summary for Subcatchment 2S': Overland to Wetlands

Runoff = 1.31 cfs @ 12.19 hrs, Volume= 0.117 af, Depth> 0.79"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 3

Area (sf)	CN	Description
38,320	73	Woods, Fair, HSG C
21,500	55	Woods, Good, HSG B
2,724	98	Roofs, HSG B
15,044	74	>75% Grass cover, Good, HSG C
77,588	69	Weighted Average
74,864		96.49% Pervious Area
2,724		3.51% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.2	200	0.1100	0.27		<b>Sheet Flow, Tc-2s</b> Grass: Dense n= 0.240 P2= 3.37"

**Summary for Subcatchment 3S: Drainage Area 3**

Runoff = 1.10 cfs @ 12.09 hrs, Volume= 0.074 af, Depth> 1.56"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

Area (sf)	CN	Description
* 8,529	98	Paved parking/roof
16,209	74	>75% Grass cover, Good, HSG C
24,738	82	Weighted Average
16,209		65.52% Pervious Area
8,529		34.48% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0	105	0.1100	0.35		<b>Sheet Flow, Tc-4a</b> Grass: Short n= 0.150 P2= 3.37"
0.7	160	0.0310	3.57		<b>Shallow Concentrated Flow, Tc-4b</b> Paved Kv= 20.3 fps

5.7 265 Total

**Summary for Subcatchment 4S: Drainage Area 4**

Runoff = 3.76 cfs @ 12.04 hrs, Volume= 0.227 af, Depth> 1.70"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 4

Area (sf)	CN	Description
* 30,200	98	Paved parking & roof HSG A
20,000	74	>75% Grass cover, Good, HSG C
19,500	73	Woods, Fair, HSG C
69,700	84	Weighted Average
39,500		56.67% Pervious Area
30,200		43.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.9	130	0.0100	1.13		<b>Sheet Flow, Tc-3</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 5S: Drainage Area 5**

Runoff = 1.62 cfs @ 12.02 hrs, Volume= 0.098 af, Depth&gt; 1.86"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

Area (sf)	CN	Description
* 13,450	98	Paved surfaces & roof
14,147	74	>75% Grass cover, Good, HSG C
27,597	86	Weighted Average
14,147		51.26% Pervious Area
13,450		48.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	180	0.0500	2.29		<b>Sheet Flow, Tc-5</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 6S: Drainage Area 6**

Runoff = 2.52 cfs @ 12.05 hrs, Volume= 0.154 af, Depth&gt; 1.70"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

Area (sf)	CN	Description
* 21,025	98	Pavement/Roofs, HSG B
22,990	74	>75% Grass cover, Good, HSG C
3,300	60	Woods, Fair, HSG B
47,315	84	Weighted Average
26,290		55.56% Pervious Area
21,025		44.44% Impervious Area

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 5

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.2	180	0.0500	0.95		<b>Lag/CN Method, Tc-6</b>

**Summary for Subcatchment 7S: Drainage Area 7**

Runoff = 1.07 cfs @ 12.02 hrs, Volume= 0.071 af, Depth> 2.84"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

Area (sf)	CN	Description
* 12,295	98	Roof & Pavement
* 716	74	>75% Grass cover, Good, HSG B/D
13,011	97	Weighted Average
716		5.50% Pervious Area
12,295		94.50% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	175	0.0580	2.42		<b>Sheet Flow, Tc-7</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 8S: Overland to Wetlands**

Runoff = 2.69 cfs @ 12.22 hrs, Volume= 0.255 af, Depth> 0.74"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

Area (sf)	CN	Description
24,323	74	>75% Grass cover, Good, HSG C
61,975	77	Woods, Good, HSG D
93,653	60	Woods, Fair, HSG B
179,951	68	Weighted Average
179,951		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
14.1	152	0.1240	0.18		<b>Sheet Flow, Tc-8</b> Woods: Light underbrush n= 0.400 P2= 3.37"

**Summary for Subcatchment 9S: Overland to Basin 3**

Runoff = 0.88 cfs @ 12.05 hrs, Volume= 0.054 af, Depth> 1.17"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 2-year Rainfall=3.37"  
Printed 8/1/2022  
Page 6

Area (sf)	CN	Description
22,063	74	>75% Grass cover, Good, HSG C
1,920	98	Roofs, HSG C
23,983	76	Weighted Average
22,063		91.99% Pervious Area
1,920		8.01% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.3	145	0.1100	1.05		Lag/CN Method, Tc-9

### Summary for Subcatchment FB1: Overland to Forebay

Runoff = 0.19 cfs @ 12.05 hrs, Volume= 0.012 af, Depth> 1.05"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

Area (sf)	CN	Description
5,861	74	>75% Grass cover, Good, HSG C
5,861		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.1	98	0.0800	0.78		Lag/CN Method, Tc-FB-1

### Summary for Subcatchment O-P2: Overland to Pond

Runoff = 0.25 cfs @ 12.03 hrs, Volume= 0.016 af, Depth> 1.05"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

Area (sf)	CN	Description
7,761	74	>75% Grass cover, Good, HSG C
7,761		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	30	0.0330	0.40		Lag/CN Method, Tc-P2

### Summary for Subcatchment OS: Overland to Swale

Runoff = 0.44 cfs @ 12.05 hrs, Volume= 0.028 af, Depth> 0.95"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.37"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC  
 HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
 Type III 24-hr 2-year Rainfall=3.37"  
 Printed 8/1/2022  
 Page 7

Area (sf)	CN	Description
1,650	60	Woods, Fair, HSG B
13,622	74	>75% Grass cover, Good, HSG C
15,272	72	Weighted Average
15,272		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.0					Direct Entry, Tc-OS

**Summary for Reach 1R: Wetland Swale**

Inflow Area = 1.781 ac, 3.51% Impervious, Inflow Depth > 0.79" for 2-year event  
 Inflow = 1.31 cfs @ 12.19 hrs, Volume= 0.117 af  
 Outflow = 1.23 cfs @ 12.31 hrs, Volume= 0.116 af, Atten= 6%, Lag= 7.2 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.25 fps, Min. Travel Time= 3.9 min  
 Avg. Velocity = 0.62 fps, Avg. Travel Time= 7.8 min

Peak Storage= 288 cf @ 12.25 hrs  
 Average Depth at Peak Storage= 0.09'  
 Bank-Full Depth= 2.00' Flow Area= 106.7 sf, Capacity= 1,056.58 cfs

80.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 290.0' Slope= 0.0759 '/'  
 Inlet Invert= 294.00', Outlet Invert= 272.00'



**Summary for Reach 2R: Wetland Swale**

Inflow Area = 7.646 ac, 6.73% Impervious, Inflow Depth > 0.74" for 2-year event  
 Inflow = 3.97 cfs @ 12.26 hrs, Volume= 0.471 af  
 Outflow = 3.48 cfs @ 12.51 hrs, Volume= 0.463 af, Atten= 12%, Lag= 15.3 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.43 fps, Min. Travel Time= 8.3 min  
 Avg. Velocity = 0.77 fps, Avg. Travel Time= 15.4 min


Peak Storage= 1,738 cf @ 12.37 hrs  
 Average Depth at Peak Storage= 0.15'  
 Bank-Full Depth= 2.00' Flow Area= 113.3 sf, Capacity= 890.78 cfs

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 2-year Rainfall=3.37"  
Printed 8/1/2022  
Page 8

85.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
Length= 712.0' Slope= 0.0478 '/'  
Inlet Invert= 272.00', Outlet Invert= 238.00'

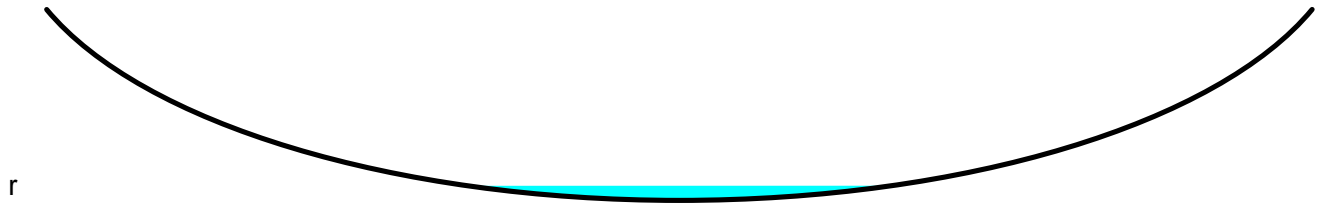

**Summary for Reach 3R: Wet Swale**

Inflow Area = 1.734 ac, 26.06% Impervious, Inflow Depth > 0.69" for 2-year event  
Inflow = 0.44 cfs @ 12.05 hrs, Volume= 0.100 af  
Outflow = 0.40 cfs @ 12.11 hrs, Volume= 0.100 af, Atten= 9%, Lag= 3.7 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Max. Velocity= 1.32 fps, Min. Travel Time= 2.1 min  
Avg. Velocity = 0.83 fps, Avg. Travel Time= 3.3 min

Peak Storage= 52 cf @ 12.07 hrs  
Average Depth at Peak Storage= 0.04'  
Bank-Full Depth= 1.00' Flow Area= 10.0 sf, Capacity= 99.84 cfs

8.00' x 1.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides  
Side Slope Z-value= 2.0 '/' Top Width= 12.00'  
Length= 165.0' Slope= 0.0970 '/'  
Inlet Invert= 270.00', Outlet Invert= 254.00'



**Summary for Reach 9R: Peak off Site**

Inflow Area = 11.815 ac, 19.68% Impervious, Inflow Depth > 0.81" for 2-year event  
Inflow = 3.62 cfs @ 12.53 hrs, Volume= 0.800 af  
Outflow = 3.62 cfs @ 12.53 hrs, Volume= 0.800 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 2-year Rainfall=3.37"  
Printed 8/1/2022  
Page 9

### Summary for Pond 1P: CB\_1-2

Inflow Area = 0.197 ac, 48.07% Impervious, Inflow Depth > 1.85" for 2-year event  
Inflow = 0.40 cfs @ 12.13 hrs, Volume= 0.030 af  
Outflow = 0.40 cfs @ 12.13 hrs, Volume= 0.030 af, Atten= 0%, Lag= 0.0 min  
Primary = 0.40 cfs @ 12.13 hrs, Volume= 0.030 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 311.79' @ 12.13 hrs  
Flood Elev= 316.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	311.50'	<b>15.0" Round Culvert</b> L= 128.7' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 311.50' / 298.95' S= 0.0975 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=0.39 cfs @ 12.13 hrs HW=311.79' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 0.39 cfs @ 1.83 fps)

### Summary for Pond 2P: CB\_3-4

Inflow Area = 0.503 ac, 50.95% Impervious, Inflow Depth > 1.90" for 2-year event  
Inflow = 1.05 cfs @ 12.03 hrs, Volume= 0.080 af  
Outflow = 1.05 cfs @ 12.03 hrs, Volume= 0.080 af, Atten= 0%, Lag= 0.0 min  
Primary = 1.05 cfs @ 12.03 hrs, Volume= 0.080 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 299.34' @ 12.03 hrs  
Flood Elev= 303.30'

Device	Routing	Invert	Outlet Devices
#1	Primary	298.85'	<b>15.0" Round Culvert</b> L= 131.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 298.85' / 286.60' S= 0.0934 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=1.03 cfs @ 12.03 hrs HW=299.33' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 1.03 cfs @ 2.36 fps)

### Summary for Pond 3P: CB\_5-6

Inflow Area = 1.070 ac, 42.21% Impervious, Inflow Depth > 1.72" for 2-year event  
Inflow = 2.06 cfs @ 12.07 hrs, Volume= 0.153 af  
Outflow = 2.06 cfs @ 12.07 hrs, Volume= 0.153 af, Atten= 0%, Lag= 0.0 min  
Primary = 2.06 cfs @ 12.07 hrs, Volume= 0.153 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs



**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 10

Peak Elev= 287.21' @ 12.07 hrs

Flood Elev= 291.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	286.50'	<b>15.0" Round Culvert</b> L= 81.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 286.50' / 285.70' S= 0.0099 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=2.01 cfs @ 12.07 hrs HW=287.20' (Free Discharge)↑**1=Culvert** (Inlet Controls 2.01 cfs @ 2.85 fps)**Summary for Pond 4P: CB\_7-8**

Inflow Area = 1.600 ac, 43.33% Impervious, Inflow Depth > 1.70" for 2-year event  
 Inflow = 3.76 cfs @ 12.04 hrs, Volume= 0.227 af  
 Outflow = 3.76 cfs @ 12.04 hrs, Volume= 0.227 af, Atten= 0%, Lag= 0.0 min  
 Primary = 3.76 cfs @ 12.04 hrs, Volume= 0.227 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 273.53' @ 12.04 hrs

Flood Elev= 277.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	272.50'	<b>15.0" Round Culvert</b> L= 128.2' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 272.50' / 263.70' S= 0.0686 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=3.62 cfs @ 12.04 hrs HW=273.51' (Free Discharge)↑**1=Culvert** (Inlet Controls 3.62 cfs @ 3.42 fps)**Summary for Pond 5P: CB-9**

Inflow Area = 2.234 ac, 44.86% Impervious, Inflow Depth > 1.75" for 2-year event  
 Inflow = 5.34 cfs @ 12.03 hrs, Volume= 0.325 af  
 Outflow = 5.34 cfs @ 12.03 hrs, Volume= 0.325 af, Atten= 0%, Lag= 0.0 min  
 Primary = 5.34 cfs @ 12.03 hrs, Volume= 0.325 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 265.03' @ 12.03 hrs

Flood Elev= 267.30'

Device	Routing	Invert	Outlet Devices
#1	Primary	263.60'	<b>15.0" Round Culvert</b> L= 100.6' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 263.60' / 253.10' S= 0.1044 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=5.13 cfs @ 12.03 hrs HW=264.98' (Free Discharge)↑**1=Culvert** (Inlet Controls 5.13 cfs @ 4.18 fps)

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 2-year Rainfall=3.37"  
Printed 8/1/2022  
Page 11

### Summary for Pond 6P: CB\_10-11

Inflow Area = 3.320 ac, 44.72% Impervious, Inflow Depth > 1.73" for 2-year event  
Inflow = 7.80 cfs @ 12.04 hrs, Volume= 0.479 af  
Outflow = 7.80 cfs @ 12.04 hrs, Volume= 0.479 af, Atten= 0%, Lag= 0.0 min  
Primary = 7.80 cfs @ 12.04 hrs, Volume= 0.479 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 254.59' @ 12.04 hrs  
Flood Elev= 259.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	253.00'	<b>18.0" Round Culvert</b> L= 172.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 253.00' / 245.10' S= 0.0459 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf

**Primary OutFlow** Max=7.57 cfs @ 12.04 hrs HW=254.54' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 7.57 cfs @ 4.28 fps)

### Summary for Pond 7P: CB\_12-13

Inflow Area = 3.619 ac, 48.83% Impervious, Inflow Depth > 1.82" for 2-year event  
Inflow = 8.81 cfs @ 12.04 hrs, Volume= 0.550 af  
Outflow = 8.81 cfs @ 12.04 hrs, Volume= 0.550 af, Atten= 0%, Lag= 0.0 min  
Primary = 8.81 cfs @ 12.04 hrs, Volume= 0.550 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 246.82' @ 12.04 hrs  
Flood Elev= 249.60'

Device	Routing	Invert	Outlet Devices
#1	Primary	245.00'	<b>18.0" Round Culvert</b> L= 36.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 245.00' / 244.00' S= 0.0278 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf

**Primary OutFlow** Max=8.51 cfs @ 12.04 hrs HW=246.75' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 8.51 cfs @ 4.82 fps)

### Summary for Pond 10P: Stormwater Basin

Inflow Area = 4.169 ac, 43.44% Impervious, Inflow Depth > 1.63" for 2-year event  
Inflow = 6.84 cfs @ 12.12 hrs, Volume= 0.567 af  
Outflow = 0.87 cfs @ 14.66 hrs, Volume= 0.338 af, Atten= 87%, Lag= 152.4 min  
Primary = 0.87 cfs @ 14.66 hrs, Volume= 0.338 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 246.58' @ 14.66 hrs Surf.Area= 7,085 sf Storage= 13,937 cf

Plug-Flow detention time= 211.6 min calculated for 0.336 af (59% of inflow)

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 2-year Rainfall=3.37"  
Printed 8/1/2022  
Page 12

Center-of-Mass det. time= 134.2 min ( 960.7 - 826.5 )

Volume	Invert	Avail.Storage	Storage Description
#1	240.00'	26,654 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
240.00	508	0	0
242.00	892	1,400	1,400
244.00	1,386	2,278	3,678
245.00	2,520	1,953	5,631
245.50	5,230	1,938	7,569
246.00	5,523	2,688	10,257
248.00	10,874	16,397	26,654

Device	Routing	Invert	Outlet Devices
#1	Primary	242.50'	<b>18.0" Round Culvert</b> L= 32.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 242.50' / 242.00' S= 0.0156 '/ Cc= 0.900 n= 0.012, Flow Area= 1.77 sf
#2	Device 1	245.50'	<b>5.0" Vert. Orifice/Grate</b> C= 0.600
#3	Device 1	246.50'	<b>6.0" x 12.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	247.00'	<b>6.0" x 12.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=0.85 cfs @ 14.66 hrs HW=246.58' (Free Discharge)

- ↑ 1=Culvert (Passes 0.85 cfs of 15.54 cfs potential flow)
- ↑ 2=Orifice/Grate (Orifice Controls 0.61 cfs @ 4.51 fps)
- ↑ 3=Orifice/Grate (Weir Controls 0.24 cfs @ 0.95 fps)
- ↑ 4=Orifice/Grate ( Controls 0.00 cfs)

### Summary for Pond FB: Forebay

Inflow Area = 3.619 ac, 48.83% Impervious, Inflow Depth > 1.82" for 2-year event  
 Inflow = 8.81 cfs @ 12.04 hrs, Volume= 0.550 af  
 Outflow = 6.25 cfs @ 12.12 hrs, Volume= 0.514 af, Atten= 29%, Lag= 4.8 min  
 Primary = 1.38 cfs @ 12.12 hrs, Volume= 0.437 af  
 Secondary = 4.87 cfs @ 12.12 hrs, Volume= 0.076 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 246.17' @ 12.12 hrs Surf.Area= 2,432 sf Storage= 7,234 cf

Plug-Flow detention time= 71.0 min calculated for 0.514 af (93% of inflow)  
 Center-of-Mass det. time= 47.3 min ( 828.3 - 781.1 )

Volume	Invert	Avail.Storage	Storage Description
#1	242.00'	9,375 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 13

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
242.00	1,096	0	0
244.00	1,678	2,774	2,774
246.00	2,365	4,043	6,817
247.00	2,750	2,558	9,375

Device	Routing	Invert	Outlet Devices
#1	Primary	243.00'	<b>6.0" Round Culvert</b> L= 36.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 243.00' / 242.50' S= 0.0139 ' / Cc= 0.900 n= 0.012, Flow Area= 0.20 sf
#2	Secondary	246.00'	<b>35.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

**Primary OutFlow** Max=1.37 cfs @ 12.12 hrs HW=246.14' (Free Discharge)

↑**1=Culvert** (Barrel Controls 1.37 cfs @ 7.00 fps)

**Secondary OutFlow** Max=4.22 cfs @ 12.12 hrs HW=246.14' (Free Discharge)

↑**2=Broad-Crested Rectangular Weir** (Weir Controls 4.22 cfs @ 0.88 fps)

**Summary for Pond P-1: Forebay**

Inflow Area = 1.205 ac, 37.50% Impervious, Inflow Depth > 1.65" for 2-year event  
 Inflow = 2.25 cfs @ 12.06 hrs, Volume= 0.165 af  
 Outflow = 1.09 cfs @ 12.31 hrs, Volume= 0.095 af, Atten= 52%, Lag= 14.9 min  
 Primary = 1.09 cfs @ 12.31 hrs, Volume= 0.095 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 285.15' @ 12.31 hrs Surf.Area= 1,601 sf Storage= 3,253 cf

Plug-Flow detention time= 147.0 min calculated for 0.095 af (58% of inflow)  
 Center-of-Mass det. time= 68.7 min ( 859.5 - 790.8 )

Volume	Invert	Avail.Storage	Storage Description
#1	282.00'	4,711 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
282.00	545	0	0
284.00	1,130	1,675	1,675
285.00	1,565	1,348	3,023
286.00	1,812	1,689	4,711

Device	Routing	Invert	Outlet Devices
#1	Primary	285.00'	<b>8.0' long x 8.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC  
 HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
 Type III 24-hr 2-year Rainfall=3.37"  
 Printed 8/1/2022  
 Page 14

2.50	3.00	3.50	4.00	4.50	5.00	5.50
Coef. (English)	2.43	2.54	2.70	2.69	2.68	2.68
	2.65	2.65	2.66	2.66	2.68	2.70

**Primary OutFlow** Max=1.06 cfs @ 12.31 hrs HW=285.14' (Free Discharge)  
 1=Broad-Crested Rectangular Weir (Weir Controls 1.06 cfs @ 0.92 fps)

**Summary for Pond P-2: Stormwater Pond**

Inflow Area = 1.383 ac, 32.67% Impervious, Inflow Depth > 0.96" for 2-year event  
 Inflow = 1.18 cfs @ 12.31 hrs, Volume= 0.111 af  
 Outflow = 0.17 cfs @ 14.14 hrs, Volume= 0.073 af, Atten= 85%, Lag= 110.1 min  
 Primary = 0.17 cfs @ 14.14 hrs, Volume= 0.073 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 272.84' @ 14.14 hrs Surf.Area= 2,761 sf Storage= 2,156 cf

Plug-Flow detention time= 172.5 min calculated for 0.073 af (65% of inflow)  
 Center-of-Mass det. time= 93.2 min ( 946.0 - 852.9 )

Volume	Invert	Avail.Storage	Storage Description
#1	272.00'	22,675 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
272.00	2,375	0	0
274.00	3,295	5,670	5,670
276.00	4,225	7,520	13,190
278.00	5,260	9,485	22,675

Device	Routing	Invert	Outlet Devices
#1	Primary	272.00'	<b>18.0" Round Culvert</b> L= 30.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 272.00' / 270.00' S= 0.0667 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf
#2	Device 1	272.50'	<b>4.0" Vert. Orifice/Grate</b> C= 0.600
#3	Device 1	275.00'	<b>6.0" Vert. Orifice/Grate</b> C= 0.600
#4	Primary	276.00'	<b>12.0" W x 6.0" H Vert. Orifice/Grate</b> C= 0.600
#5	Primary	277.00'	<b>18.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=0.17 cfs @ 14.14 hrs HW=272.84' (Free Discharge)

- 1=Culvert (Passes 0.17 cfs of 2.80 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.17 cfs @ 2.00 fps)
- 3=Orifice/Grate ( Controls 0.00 cfs)
- 4=Orifice/Grate ( Controls 0.00 cfs)
- 5=Orifice/Grate ( Controls 0.00 cfs)

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 5-year Rainfall=4.27"  
Printed 8/1/2022  
Page 15

### Summary for Subcatchment 1S: Drainage Area 1

Runoff = 0.56 cfs @ 12.13 hrs, Volume= 0.043 af, Depth> 2.62"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.27"

Area (sf)	CN	Description
4,120	98	Paved parking, HSG B
4,450	74	>75% Grass cover, Good, HSG C
8,570	86	Weighted Average
4,450		51.93% Pervious Area
4,120		48.07% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.1	111	0.0710	0.20		<b>Sheet Flow, Tc-1</b> Grass: Dense n= 0.240 P2= 3.37"

### Summary for Subcatchment 2S: Drainage Area 2

Runoff = 1.14 cfs @ 12.02 hrs, Volume= 0.069 af, Depth> 2.72"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.27"

Area (sf)	CN	Description
6,287	74	>75% Grass cover, Good, HSG C
* 7,033	98	Roof/pavement
13,320	87	Weighted Average
6,287		47.20% Pervious Area
7,033		52.80% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.0	125	0.0100	2.03		<b>Shallow Concentrated Flow, Tc-2</b> Paved Kv= 20.3 fps

### Summary for Subcatchment 2S': Overland to Wetlands

Runoff = 2.31 cfs @ 12.18 hrs, Volume= 0.195 af, Depth> 1.32"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.27"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 16

Area (sf)	CN	Description
38,320	73	Woods, Fair, HSG C
21,500	55	Woods, Good, HSG B
2,724	98	Roofs, HSG B
15,044	74	>75% Grass cover, Good, HSG C
77,588	69	Weighted Average
74,864		96.49% Pervious Area
2,724		3.51% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.2	200	0.1100	0.27		<b>Sheet Flow, Tc-2s</b> Grass: Dense n= 0.240 P2= 3.37"

**Summary for Subcatchment 3S: Drainage Area 3**

Runoff = 1.60 cfs @ 12.09 hrs, Volume= 0.108 af, Depth> 2.27"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.27"

Area (sf)	CN	Description
* 8,529	98	Paved parking/roof
16,209	74	>75% Grass cover, Good, HSG C
24,738	82	Weighted Average
16,209		65.52% Pervious Area
8,529		34.48% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0	105	0.1100	0.35		<b>Sheet Flow, Tc-4a</b> Grass: Short n= 0.150 P2= 3.37"
0.7	160	0.0310	3.57		<b>Shallow Concentrated Flow, Tc-4b</b> Paved Kv= 20.3 fps

5.7 265 Total

**Summary for Subcatchment 4S: Drainage Area 4**

Runoff = 5.34 cfs @ 12.04 hrs, Volume= 0.326 af, Depth> 2.45"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.27"

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 5-year Rainfall=4.27"  
Printed 8/1/2022  
Page 17

	Area (sf)	CN	Description
*	30,200	98	Paved parking & roof HSG A
	20,000	74	>75% Grass cover, Good, HSG C
	19,500	73	Woods, Fair, HSG C
	69,700	84	Weighted Average
	39,500		56.67% Pervious Area
	30,200		43.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.9	130	0.0100	1.13		<b>Sheet Flow, Tc-3</b> Smooth surfaces n= 0.011 P2= 3.37"

### Summary for Subcatchment 5S: Drainage Area 5

Runoff = 2.26 cfs @ 12.02 hrs, Volume= 0.139 af, Depth> 2.62"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.27"

	Area (sf)	CN	Description
*	13,450	98	Paved surfaces & roof
	14,147	74	>75% Grass cover, Good, HSG C
	27,597	86	Weighted Average
	14,147		51.26% Pervious Area
	13,450		48.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	180	0.0500	2.29		<b>Sheet Flow, Tc-5</b> Smooth surfaces n= 0.011 P2= 3.37"

### Summary for Subcatchment 6S: Drainage Area 6

Runoff = 3.58 cfs @ 12.05 hrs, Volume= 0.221 af, Depth> 2.45"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.27"

	Area (sf)	CN	Description
*	21,025	98	Pavement/Roofs, HSG B
	22,990	74	>75% Grass cover, Good, HSG C
	3,300	60	Woods, Fair, HSG B
	47,315	84	Weighted Average
	26,290		55.56% Pervious Area
	21,025		44.44% Impervious Area



**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 18

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.2	180	0.0500	0.95		<b>Lag/CN Method, Tc-6</b>

**Summary for Subcatchment 7S: Drainage Area 7**

Runoff = 1.36 cfs @ 12.02 hrs, Volume= 0.091 af, Depth&gt; 3.67"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.27"

Area (sf)	CN	Description
* 12,295	98	Roof & Pavement
* 716	74	>75% Grass cover, Good, HSG B/D
13,011	97	Weighted Average
716		5.50% Pervious Area
12,295		94.50% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	175	0.0580	2.42		<b>Sheet Flow, Tc-7</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 8S: Overland to Wetlands**

Runoff = 4.84 cfs @ 12.21 hrs, Volume= 0.431 af, Depth&gt; 1.25"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.27"

Area (sf)	CN	Description
24,323	74	>75% Grass cover, Good, HSG C
61,975	77	Woods, Good, HSG D
93,653	60	Woods, Fair, HSG B
179,951	68	Weighted Average
179,951		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
14.1	152	0.1240	0.18		<b>Sheet Flow, Tc-8</b> Woods: Light underbrush n= 0.400 P2= 3.37"

**Summary for Subcatchment 9S: Overland to Basin 3**

Runoff = 1.37 cfs @ 12.04 hrs, Volume= 0.083 af, Depth&gt; 1.80"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.27"

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 5-year Rainfall=4.27"  
Printed 8/1/2022  
Page 19

Area (sf)	CN	Description
22,063	74	>75% Grass cover, Good, HSG C
1,920	98	Roofs, HSG C
23,983	76	Weighted Average
22,063		91.99% Pervious Area
1,920		8.01% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.3	145	0.1100	1.05		Lag/CN Method, Tc-9

### Summary for Subcatchment FB1: Overland to Forebay

Runoff = 0.31 cfs @ 12.04 hrs, Volume= 0.019 af, Depth> 1.66"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.27"

Area (sf)	CN	Description
5,861	74	>75% Grass cover, Good, HSG C
5,861		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.1	98	0.0800	0.78		Lag/CN Method, Tc-FB-1

### Summary for Subcatchment O-P2: Overland to Pond

Runoff = 0.41 cfs @ 12.03 hrs, Volume= 0.025 af, Depth> 1.66"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.27"

Area (sf)	CN	Description
7,761	74	>75% Grass cover, Good, HSG C
7,761		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	30	0.0330	0.40		Lag/CN Method, Tc-P2

### Summary for Subcatchment OS: Overland to Swale

Runoff = 0.73 cfs @ 12.04 hrs, Volume= 0.044 af, Depth> 1.52"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 5-year Rainfall=4.27"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC  
 HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
 Type III 24-hr 5-year Rainfall=4.27"  
 Printed 8/1/2022  
 Page 20

Area (sf)	CN	Description
1,650	60	Woods, Fair, HSG B
13,622	74	>75% Grass cover, Good, HSG C
15,272	72	Weighted Average
15,272		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.0					Direct Entry, Tc-OS

**Summary for Reach 1R: Wetland Swale**

Inflow Area = 1.781 ac, 3.51% Impervious, Inflow Depth > 1.32" for 5-year event  
 Inflow = 2.31 cfs @ 12.18 hrs, Volume= 0.195 af  
 Outflow = 2.20 cfs @ 12.28 hrs, Volume= 0.194 af, Atten= 5%, Lag= 5.9 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.48 fps, Min. Travel Time= 3.3 min  
 Avg. Velocity = 0.70 fps, Avg. Travel Time= 6.9 min

Peak Storage= 430 cf @ 12.23 hrs  
 Average Depth at Peak Storage= 0.12'  
 Bank-Full Depth= 2.00' Flow Area= 106.7 sf, Capacity= 1,056.58 cfs

80.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 290.0' Slope= 0.0759 '/'  
 Inlet Invert= 294.00', Outlet Invert= 272.00'



**Summary for Reach 2R: Wetland Swale**

Inflow Area = 7.646 ac, 6.73% Impervious, Inflow Depth > 1.29" for 5-year event  
 Inflow = 7.26 cfs @ 12.24 hrs, Volume= 0.822 af  
 Outflow = 6.57 cfs @ 12.45 hrs, Volume= 0.811 af, Atten= 10%, Lag= 12.3 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.74 fps, Min. Travel Time= 6.8 min  
 Avg. Velocity = 0.86 fps, Avg. Travel Time= 13.8 min


Peak Storage= 2,700 cf @ 12.33 hrs  
 Average Depth at Peak Storage= 0.21'  
 Bank-Full Depth= 2.00' Flow Area= 113.3 sf, Capacity= 890.78 cfs

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 5-year Rainfall=4.27"  
Printed 8/1/2022  
Page 21

85.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
Length= 712.0' Slope= 0.0478 '/'  
Inlet Invert= 272.00', Outlet Invert= 238.00'

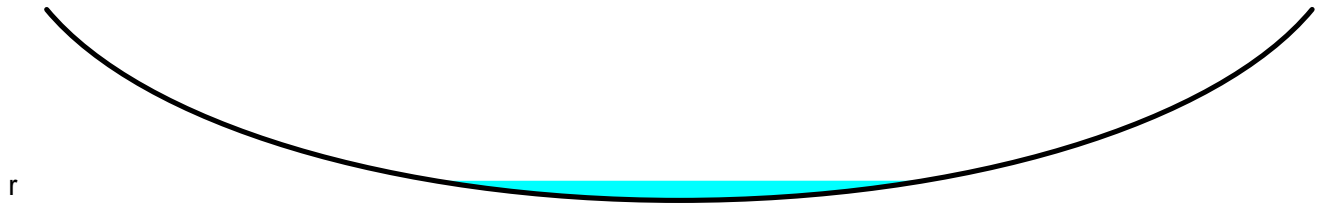

**Summary for Reach 3R: Wet Swale**

Inflow Area =	1.734 ac, 26.06% Impervious, Inflow Depth > 1.36" for 5-year event
Inflow =	0.73 cfs @ 12.04 hrs, Volume= 0.197 af
Outflow =	0.67 cfs @ 12.09 hrs, Volume= 0.196 af, Atten= 9%, Lag= 3.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Max. Velocity= 1.63 fps, Min. Travel Time= 1.7 min  
Avg. Velocity = 1.01 fps, Avg. Travel Time= 2.7 min

Peak Storage= 72 cf @ 12.06 hrs  
Average Depth at Peak Storage= 0.05'  
Bank-Full Depth= 1.00' Flow Area= 10.0 sf, Capacity= 99.84 cfs

8.00' x 1.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides  
Side Slope Z-value= 2.0 '/' Top Width= 12.00'  
Length= 165.0' Slope= 0.0970 '/'  
Inlet Invert= 270.00', Outlet Invert= 254.00'



**Summary for Reach 9R: Peak off Site**

Inflow Area =	11.815 ac, 19.68% Impervious, Inflow Depth > 1.41" for 5-year event
Inflow =	8.20 cfs @ 12.47 hrs, Volume= 1.386 af
Outflow =	8.20 cfs @ 12.47 hrs, Volume= 1.386 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 5-year Rainfall=4.27"  
Printed 8/1/2022  
Page 22

### Summary for Pond 1P: CB\_1-2

Inflow Area = 0.197 ac, 48.07% Impervious, Inflow Depth > 2.62" for 5-year event  
Inflow = 0.56 cfs @ 12.13 hrs, Volume= 0.043 af  
Outflow = 0.56 cfs @ 12.13 hrs, Volume= 0.043 af, Atten= 0%, Lag= 0.0 min  
Primary = 0.56 cfs @ 12.13 hrs, Volume= 0.043 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 311.85' @ 12.13 hrs  
Flood Elev= 316.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	311.50'	<b>15.0" Round Culvert</b> L= 128.7' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 311.50' / 298.95' S= 0.0975 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=0.55 cfs @ 12.13 hrs HW=311.84' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 0.55 cfs @ 2.00 fps)

### Summary for Pond 2P: CB\_3-4

Inflow Area = 0.503 ac, 50.95% Impervious, Inflow Depth > 2.68" for 5-year event  
Inflow = 1.47 cfs @ 12.03 hrs, Volume= 0.112 af  
Outflow = 1.47 cfs @ 12.03 hrs, Volume= 0.112 af, Atten= 0%, Lag= 0.0 min  
Primary = 1.47 cfs @ 12.03 hrs, Volume= 0.112 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 299.43' @ 12.03 hrs  
Flood Elev= 303.30'

Device	Routing	Invert	Outlet Devices
#1	Primary	298.85'	<b>15.0" Round Culvert</b> L= 131.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 298.85' / 286.60' S= 0.0934 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=1.43 cfs @ 12.03 hrs HW=299.43' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 1.43 cfs @ 2.59 fps)

### Summary for Pond 3P: CB\_5-6

Inflow Area = 1.070 ac, 42.21% Impervious, Inflow Depth > 2.46" for 5-year event  
Inflow = 2.94 cfs @ 12.07 hrs, Volume= 0.220 af  
Outflow = 2.94 cfs @ 12.07 hrs, Volume= 0.220 af, Atten= 0%, Lag= 0.0 min  
Primary = 2.94 cfs @ 12.07 hrs, Volume= 0.220 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 5-year Rainfall=4.27"  
Printed 8/1/2022  
Page 23

Peak Elev= 287.38' @ 12.07 hrs  
Flood Elev= 291.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	286.50'	<b>15.0" Round Culvert</b> L= 81.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 286.50' / 285.70' S= 0.0099 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=2.87 cfs @ 12.07 hrs HW=287.37' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 2.87 cfs @ 3.17 fps)

### Summary for Pond 4P: CB\_7-8

Inflow Area = 1.600 ac, 43.33% Impervious, Inflow Depth > 2.45" for 5-year event  
Inflow = 5.34 cfs @ 12.04 hrs, Volume= 0.326 af  
Outflow = 5.34 cfs @ 12.04 hrs, Volume= 0.326 af, Atten= 0%, Lag= 0.0 min  
Primary = 5.34 cfs @ 12.04 hrs, Volume= 0.326 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 273.94' @ 12.04 hrs  
Flood Elev= 277.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	272.50'	<b>15.0" Round Culvert</b> L= 128.2' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 272.50' / 263.70' S= 0.0686 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=5.14 cfs @ 12.04 hrs HW=273.88' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 5.14 cfs @ 4.19 fps)

### Summary for Pond 5P: CB-9

Inflow Area = 2.234 ac, 44.86% Impervious, Inflow Depth > 2.50" for 5-year event  
Inflow = 7.56 cfs @ 12.03 hrs, Volume= 0.465 af  
Outflow = 7.56 cfs @ 12.03 hrs, Volume= 0.465 af, Atten= 0%, Lag= 0.0 min  
Primary = 7.56 cfs @ 12.03 hrs, Volume= 0.465 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 265.84' @ 12.03 hrs  
Flood Elev= 267.30'

Device	Routing	Invert	Outlet Devices
#1	Primary	263.60'	<b>15.0" Round Culvert</b> L= 100.6' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 263.60' / 253.10' S= 0.1044 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=7.25 cfs @ 12.03 hrs HW=265.73' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 7.25 cfs @ 5.91 fps)

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 5-year Rainfall=4.27"  
Printed 8/1/2022  
Page 24

### Summary for Pond 6P: CB\_10-11

Inflow Area = 3.320 ac, 44.72% Impervious, Inflow Depth > 2.48" for 5-year event  
Inflow = 11.07 cfs @ 12.04 hrs, Volume= 0.686 af  
Outflow = 11.07 cfs @ 12.04 hrs, Volume= 0.686 af, Atten= 0%, Lag= 0.0 min  
Primary = 11.07 cfs @ 12.04 hrs, Volume= 0.686 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 255.43' @ 12.04 hrs  
Flood Elev= 259.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	253.00'	<b>18.0" Round Culvert</b> L= 172.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 253.00' / 245.10' S= 0.0459 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf

**Primary OutFlow** Max=10.71 cfs @ 12.04 hrs HW=255.33' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 10.71 cfs @ 6.06 fps)

### Summary for Pond 7P: CB\_12-13

Inflow Area = 3.619 ac, 48.83% Impervious, Inflow Depth > 2.58" for 5-year event  
Inflow = 12.36 cfs @ 12.04 hrs, Volume= 0.778 af  
Outflow = 12.36 cfs @ 12.04 hrs, Volume= 0.778 af, Atten= 0%, Lag= 0.0 min  
Primary = 12.36 cfs @ 12.04 hrs, Volume= 0.778 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 247.85' @ 12.04 hrs  
Flood Elev= 249.60'

Device	Routing	Invert	Outlet Devices
#1	Primary	245.00'	<b>18.0" Round Culvert</b> L= 36.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 245.00' / 244.00' S= 0.0278 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf

**Primary OutFlow** Max=11.92 cfs @ 12.04 hrs HW=247.71' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 11.92 cfs @ 6.75 fps)

### Summary for Pond 10P: Stormwater Basin

Inflow Area = 4.169 ac, 43.44% Impervious, Inflow Depth > 2.37" for 5-year event  
Inflow = 15.79 cfs @ 12.06 hrs, Volume= 0.823 af  
Outflow = 1.79 cfs @ 12.61 hrs, Volume= 0.575 af, Atten= 89%, Lag= 32.9 min  
Primary = 1.79 cfs @ 12.61 hrs, Volume= 0.575 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 246.75' @ 12.61 hrs Surf.Area= 7,523 sf Storage= 15,132 cf

Plug-Flow detention time= 161.9 min calculated for 0.575 af (70% of inflow)

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 5-year Rainfall=4.27"  
Printed 8/1/2022  
Page 25

Center-of-Mass det. time= 94.4 min ( 908.0 - 813.6 )

Volume	Invert	Avail.Storage	Storage Description
#1	240.00'	26,654 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
240.00	508	0	0
242.00	892	1,400	1,400
244.00	1,386	2,278	3,678
245.00	2,520	1,953	5,631
245.50	5,230	1,938	7,569
246.00	5,523	2,688	10,257
248.00	10,874	16,397	26,654

Device	Routing	Invert	Outlet Devices
#1	Primary	242.50'	<b>18.0" Round Culvert</b> L= 32.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 242.50' / 242.00' S= 0.0156 '/ Cc= 0.900 n= 0.012, Flow Area= 1.77 sf
#2	Device 1	245.50'	<b>5.0" Vert. Orifice/Grate</b> C= 0.600
#3	Device 1	246.50'	<b>6.0" x 12.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	247.00'	<b>6.0" x 12.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=1.87 cfs @ 12.61 hrs HW=246.75' (Free Discharge)

- ↑ 1=Culvert (Passes 1.87 cfs of 15.91 cfs potential flow)
- ↑ 2=Orifice/Grate (Orifice Controls 0.67 cfs @ 4.91 fps)
- ↑ 3=Orifice/Grate (Orifice Controls 1.20 cfs @ 2.39 fps)
- ↑ 4=Orifice/Grate ( Controls 0.00 cfs)

### Summary for Pond FB: Forebay

Inflow Area = 3.619 ac, 48.83% Impervious, Inflow Depth > 2.58" for 5-year event  
 Inflow = 12.36 cfs @ 12.04 hrs, Volume= 0.778 af  
 Outflow = 14.44 cfs @ 12.06 hrs, Volume= 0.740 af, Atten= 0%, Lag= 1.2 min  
 Primary = 1.41 cfs @ 12.06 hrs, Volume= 0.547 af  
 Secondary = 13.03 cfs @ 12.06 hrs, Volume= 0.193 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 246.29' @ 12.06 hrs Surf.Area= 2,475 sf Storage= 7,510 cf

Plug-Flow detention time= 59.6 min calculated for 0.737 af (95% of inflow)  
 Center-of-Mass det. time= 41.4 min ( 815.3 - 773.9 )

Volume	Invert	Avail.Storage	Storage Description
#1	242.00'	9,375 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)



**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 26

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
242.00	1,096	0	0
244.00	1,678	2,774	2,774
246.00	2,365	4,043	6,817
247.00	2,750	2,558	9,375

Device	Routing	Invert	Outlet Devices
#1	Primary	243.00'	<b>6.0" Round Culvert</b> L= 36.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 243.00' / 242.50' S= 0.0139 ' / Cc= 0.900 n= 0.012, Flow Area= 0.20 sf
#2	Secondary	246.00'	<b>35.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

**Primary OutFlow** Max=1.40 cfs @ 12.06 hrs HW=246.27' (Free Discharge)

↑**1=Culvert** (Barrel Controls 1.40 cfs @ 7.14 fps)

**Secondary OutFlow** Max=11.95 cfs @ 12.06 hrs HW=246.27' (Free Discharge)

↑**2=Broad-Crested Rectangular Weir** (Weir Controls 11.95 cfs @ 1.27 fps)

**Summary for Pond P-1: Forebay**

Inflow Area = 1.205 ac, 37.50% Impervious, Inflow Depth > 2.37" for 5-year event  
 Inflow = 3.24 cfs @ 12.06 hrs, Volume= 0.238 af  
 Outflow = 3.01 cfs @ 12.12 hrs, Volume= 0.168 af, Atten= 7%, Lag= 3.7 min  
 Primary = 3.01 cfs @ 12.12 hrs, Volume= 0.168 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 285.29' @ 12.12 hrs Surf.Area= 1,636 sf Storage= 3,483 cf

Plug-Flow detention time= 112.0 min calculated for 0.168 af (71% of inflow)  
 Center-of-Mass det. time= 46.0 min ( 828.6 - 782.6 )

Volume	Invert	Avail.Storage	Storage Description
#1	282.00'	4,711 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
282.00	545	0	0
284.00	1,130	1,675	1,675
285.00	1,565	1,348	3,023
286.00	1,812	1,689	4,711

Device	Routing	Invert	Outlet Devices
#1	Primary	285.00'	<b>8.0' long x 8.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC  
 HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
 Type III 24-hr 5-year Rainfall=4.27"  
 Printed 8/1/2022  
 Page 27

2.50	3.00	3.50	4.00	4.50	5.00	5.50
Coef. (English)	2.43	2.54	2.70	2.69	2.68	2.68
	2.65	2.65	2.66	2.66	2.68	2.70
	2.64	2.64	2.64	2.64	2.64	2.64

**Primary OutFlow** Max=2.78 cfs @ 12.12 hrs HW=285.27' (Free Discharge)  
 1=Broad-Crested Rectangular Weir (Weir Controls 2.78 cfs @ 1.28 fps)

**Summary for Pond P-2: Stormwater Pond**

Inflow Area = 1.383 ac, 32.67% Impervious, Inflow Depth > 1.68" for 5-year event  
 Inflow = 3.24 cfs @ 12.12 hrs, Volume= 0.193 af  
 Outflow = 0.35 cfs @ 13.15 hrs, Volume= 0.152 af, Atten= 89%, Lag= 61.6 min  
 Primary = 0.35 cfs @ 13.15 hrs, Volume= 0.152 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 273.37' @ 13.15 hrs Surf.Area= 3,007 sf Storage= 3,696 cf

Plug-Flow detention time= 147.4 min calculated for 0.152 af (79% of inflow)  
 Center-of-Mass det. time= 92.3 min ( 917.5 - 825.2 )

Volume	Invert	Avail.Storage	Storage Description
#1	272.00'	22,675 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
272.00	2,375	0	0
274.00	3,295	5,670	5,670
276.00	4,225	7,520	13,190
278.00	5,260	9,485	22,675

Device	Routing	Invert	Outlet Devices
#1	Primary	272.00'	<b>18.0" Round Culvert</b> L= 30.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 272.00' / 270.00' S= 0.0667 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf
#2	Device 1	272.50'	<b>4.0" Vert. Orifice/Grate</b> C= 0.600
#3	Device 1	275.00'	<b>6.0" Vert. Orifice/Grate</b> C= 0.600
#4	Primary	276.00'	<b>12.0" W x 6.0" H Vert. Orifice/Grate</b> C= 0.600
#5	Primary	277.00'	<b>18.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=0.35 cfs @ 13.15 hrs HW=273.37' (Free Discharge)

- 1=Culvert (Passes 0.35 cfs of 5.97 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.35 cfs @ 4.05 fps)
- 3=Orifice/Grate ( Controls 0.00 cfs)
- 4=Orifice/Grate ( Controls 0.00 cfs)
- 5=Orifice/Grate ( Controls 0.00 cfs)

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 10-year Rainfall=5.02"  
Printed 8/1/2022  
Page 28

### Summary for Subcatchment 1S: Drainage Area 1

Runoff = 0.70 cfs @ 12.13 hrs, Volume= 0.054 af, Depth> 3.28"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.02"

Area (sf)	CN	Description
4,120	98	Paved parking, HSG B
4,450	74	>75% Grass cover, Good, HSG C
8,570	86	Weighted Average
4,450		51.93% Pervious Area
4,120		48.07% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.1	111	0.0710	0.20		<b>Sheet Flow, Tc-1</b> Grass: Dense n= 0.240 P2= 3.37"

### Summary for Subcatchment 2S: Drainage Area 2

Runoff = 1.41 cfs @ 12.01 hrs, Volume= 0.086 af, Depth> 3.38"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.02"

Area (sf)	CN	Description
6,287	74	>75% Grass cover, Good, HSG C
* 7,033	98	Roof/pavement
13,320	87	Weighted Average
6,287		47.20% Pervious Area
7,033		52.80% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.0	125	0.0100	2.03		<b>Shallow Concentrated Flow, Tc-2</b> Paved Kv= 20.3 fps

### Summary for Subcatchment 2S': Overland to Wetlands

Runoff = 3.23 cfs @ 12.18 hrs, Volume= 0.268 af, Depth> 1.81"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.02"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 29

Area (sf)	CN	Description
38,320	73	Woods, Fair, HSG C
21,500	55	Woods, Good, HSG B
2,724	98	Roofs, HSG B
15,044	74	>75% Grass cover, Good, HSG C
77,588	69	Weighted Average
74,864		96.49% Pervious Area
2,724		3.51% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.2	200	0.1100	0.27		<b>Sheet Flow, Tc-2s</b> Grass: Dense n= 0.240 P2= 3.37"

**Summary for Subcatchment 3S: Drainage Area 3**

Runoff = 2.03 cfs @ 12.09 hrs, Volume= 0.137 af, Depth> 2.90"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.02"

Area (sf)	CN	Description
* 8,529	98	Paved parking/roof
16,209	74	>75% Grass cover, Good, HSG C
24,738	82	Weighted Average
16,209		65.52% Pervious Area
8,529		34.48% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0	105	0.1100	0.35		<b>Sheet Flow, Tc-4a</b> Grass: Short n= 0.150 P2= 3.37"
0.7	160	0.0310	3.57		<b>Shallow Concentrated Flow, Tc-4b</b> Paved Kv= 20.3 fps

5.7 265 Total

**Summary for Subcatchment 4S: Drainage Area 4**

Runoff = 6.69 cfs @ 12.03 hrs, Volume= 0.412 af, Depth> 3.09"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.02"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 30

Area (sf)	CN	Description
* 30,200	98	Paved parking & roof HSG A
20,000	74	>75% Grass cover, Good, HSG C
19,500	73	Woods, Fair, HSG C
69,700	84	Weighted Average
39,500		56.67% Pervious Area
30,200		43.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.9	130	0.0100	1.13		<b>Sheet Flow, Tc-3</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 5S: Drainage Area 5**

Runoff = 2.80 cfs @ 12.02 hrs, Volume= 0.173 af, Depth> 3.28"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.02"

Area (sf)	CN	Description
* 13,450	98	Paved surfaces & roof
14,147	74	>75% Grass cover, Good, HSG C
27,597	86	Weighted Average
14,147		51.26% Pervious Area
13,450		48.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	180	0.0500	2.29		<b>Sheet Flow, Tc-5</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 6S: Drainage Area 6**

Runoff = 4.49 cfs @ 12.05 hrs, Volume= 0.280 af, Depth> 3.09"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.02"

Area (sf)	CN	Description
* 21,025	98	Pavement/Roofs, HSG B
22,990	74	>75% Grass cover, Good, HSG C
3,300	60	Woods, Fair, HSG B
47,315	84	Weighted Average
26,290		55.56% Pervious Area
21,025		44.44% Impervious Area

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 31

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.2	180	0.0500	0.95		<b>Lag/CN Method, Tc-6</b>

**Summary for Subcatchment 7S: Drainage Area 7**

Runoff = 1.61 cfs @ 12.02 hrs, Volume= 0.109 af, Depth&gt; 4.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.02"

Area (sf)	CN	Description
* 12,295	98	Roof & Pavement
* 716	74	>75% Grass cover, Good, HSG B/D
13,011	97	Weighted Average
716		5.50% Pervious Area
12,295		94.50% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	175	0.0580	2.42		<b>Sheet Flow, Tc-7</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 8S: Overland to Wetlands**

Runoff = 6.84 cfs @ 12.21 hrs, Volume= 0.596 af, Depth&gt; 1.73"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.02"

Area (sf)	CN	Description
24,323	74	>75% Grass cover, Good, HSG C
61,975	77	Woods, Good, HSG D
93,653	60	Woods, Fair, HSG B
179,951	68	Weighted Average
179,951		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
14.1	152	0.1240	0.18		<b>Sheet Flow, Tc-8</b> Woods: Light underbrush n= 0.400 P2= 3.37"

**Summary for Subcatchment 9S: Overland to Basin 3**

Runoff = 1.81 cfs @ 12.04 hrs, Volume= 0.109 af, Depth&gt; 2.37"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.02"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 32

Area (sf)	CN	Description
22,063	74	>75% Grass cover, Good, HSG C
1,920	98	Roofs, HSG C
23,983	76	Weighted Average
22,063		91.99% Pervious Area
1,920		8.01% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.3	145	0.1100	1.05		<b>Lag/CN Method, Tc-9</b>

**Summary for Subcatchment FB1: Overland to Forebay**

Runoff = 0.41 cfs @ 12.04 hrs, Volume= 0.025 af, Depth&gt; 2.21"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.02"

Area (sf)	CN	Description
5,861	74	>75% Grass cover, Good, HSG C
5,861		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.1	98	0.0800	0.78		<b>Lag/CN Method, Tc-FB-1</b>

**Summary for Subcatchment O-P2: Overland to Pond**

Runoff = 0.54 cfs @ 12.03 hrs, Volume= 0.033 af, Depth&gt; 2.21"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.02"

Area (sf)	CN	Description
7,761	74	>75% Grass cover, Good, HSG C
7,761		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	30	0.0330	0.40		<b>Lag/CN Method, Tc-P2</b>

**Summary for Subcatchment OS: Overland to Swale**

Runoff = 0.99 cfs @ 12.04 hrs, Volume= 0.060 af, Depth&gt; 2.05"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 10-year Rainfall=5.02"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 10-year Rainfall=5.02"  
Printed 8/1/2022  
Page 33

Area (sf)	CN	Description
1,650	60	Woods, Fair, HSG B
13,622	74	>75% Grass cover, Good, HSG C
15,272	72	Weighted Average
15,272		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.0					Direct Entry, Tc-OS


**Summary for Reach 1R: Wetland Swale**

Inflow Area = 1.781 ac, 3.51% Impervious, Inflow Depth > 1.81" for 10-year event  
Inflow = 3.23 cfs @ 12.18 hrs, Volume= 0.268 af  
Outflow = 3.13 cfs @ 12.27 hrs, Volume= 0.267 af, Atten= 3%, Lag= 5.3 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Max. Velocity= 1.65 fps, Min. Travel Time= 2.9 min  
Avg. Velocity = 0.74 fps, Avg. Travel Time= 6.5 min

Peak Storage= 549 cf @ 12.22 hrs  
Average Depth at Peak Storage= 0.14'  
Bank-Full Depth= 2.00' Flow Area= 106.7 sf, Capacity= 1,056.58 cfs

80.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
Length= 290.0' Slope= 0.0759 '/'  
Inlet Invert= 294.00', Outlet Invert= 272.00'

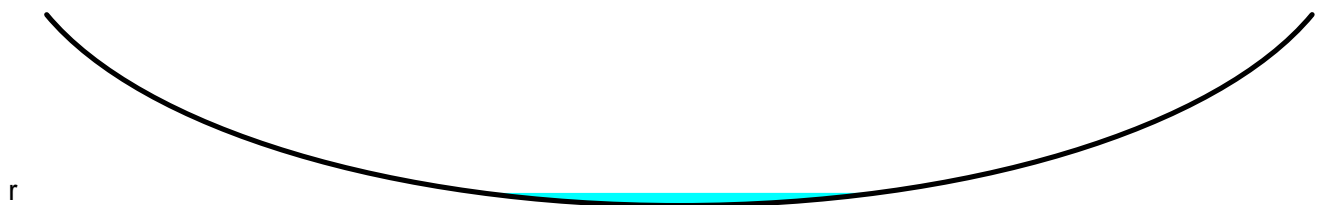

**Summary for Reach 2R: Wetland Swale**

Inflow Area = 7.646 ac, 6.73% Impervious, Inflow Depth > 1.79" for 10-year event  
Inflow = 10.48 cfs @ 12.23 hrs, Volume= 1.143 af  
Outflow = 9.64 cfs @ 12.41 hrs, Volume= 1.129 af, Atten= 8%, Lag= 10.7 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Max. Velocity= 1.96 fps, Min. Travel Time= 6.1 min  
Avg. Velocity = 0.93 fps, Avg. Travel Time= 12.8 min

Peak Storage= 3,512 cf @ 12.31 hrs  
Average Depth at Peak Storage= 0.25'  
Bank-Full Depth= 2.00' Flow Area= 113.3 sf, Capacity= 890.78 cfs



**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 34

85.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 712.0' Slope= 0.0478 '/'  
 Inlet Invert= 272.00', Outlet Invert= 238.00'




**Summary for Reach 3R: Wet Swale**

Inflow Area = 1.734 ac, 26.06% Impervious, Inflow Depth > 1.94" for 10-year event  
 Inflow = 1.00 cfs @ 12.05 hrs, Volume= 0.280 af  
 Outflow = 0.95 cfs @ 12.10 hrs, Volume= 0.279 af, Atten= 5%, Lag= 3.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.85 fps, Min. Travel Time= 1.5 min  
 Avg. Velocity = 1.11 fps, Avg. Travel Time= 2.5 min

Peak Storage= 88 cf @ 12.07 hrs  
 Average Depth at Peak Storage= 0.07'  
 Bank-Full Depth= 1.00' Flow Area= 10.0 sf, Capacity= 99.84 cfs

8.00' x 1.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides  
 Side Slope Z-value= 2.0 '/' Top Width= 12.00'  
 Length= 165.0' Slope= 0.0970 '/'  
 Inlet Invert= 270.00', Outlet Invert= 254.00'

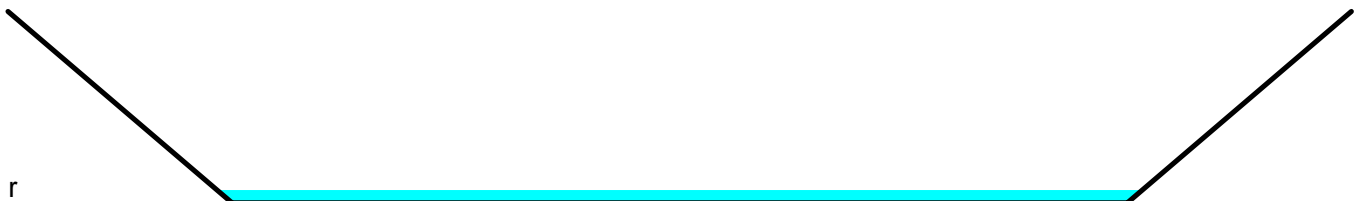

**Summary for Reach 9R: Peak off Site**

Inflow Area = 11.815 ac, 19.68% Impervious, Inflow Depth > 1.94" for 10-year event  
 Inflow = 13.19 cfs @ 12.42 hrs, Volume= 1.911 af  
 Outflow = 13.19 cfs @ 12.42 hrs, Volume= 1.911 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 35

**Summary for Pond 1P: CB\_1-2**

Inflow Area = 0.197 ac, 48.07% Impervious, Inflow Depth > 3.28" for 10-year event  
 Inflow = 0.70 cfs @ 12.13 hrs, Volume= 0.054 af  
 Outflow = 0.70 cfs @ 12.13 hrs, Volume= 0.054 af, Atten= 0%, Lag= 0.0 min  
 Primary = 0.70 cfs @ 12.13 hrs, Volume= 0.054 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 311.89' @ 12.13 hrs

Flood Elev= 316.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	311.50'	<b>15.0" Round Culvert</b> L= 128.7' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 311.50' / 298.95' S= 0.0975 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=0.68 cfs @ 12.13 hrs HW=311.89' (Free Discharge)↑**1=Culvert** (Inlet Controls 0.68 cfs @ 2.12 fps)**Summary for Pond 2P: CB\_3-4**

Inflow Area = 0.503 ac, 50.95% Impervious, Inflow Depth > 3.34" for 10-year event  
 Inflow = 1.81 cfs @ 12.03 hrs, Volume= 0.140 af  
 Outflow = 1.81 cfs @ 12.03 hrs, Volume= 0.140 af, Atten= 0%, Lag= 0.0 min  
 Primary = 1.81 cfs @ 12.03 hrs, Volume= 0.140 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 299.51' @ 12.03 hrs

Flood Elev= 303.30'

Device	Routing	Invert	Outlet Devices
#1	Primary	298.85'	<b>15.0" Round Culvert</b> L= 131.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 298.85' / 286.60' S= 0.0934 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=1.77 cfs @ 12.03 hrs HW=299.50' (Free Discharge)↑**1=Culvert** (Inlet Controls 1.77 cfs @ 2.75 fps)**Summary for Pond 3P: CB\_5-6**

Inflow Area = 1.070 ac, 42.21% Impervious, Inflow Depth > 3.11" for 10-year event  
 Inflow = 3.69 cfs @ 12.06 hrs, Volume= 0.277 af  
 Outflow = 3.69 cfs @ 12.06 hrs, Volume= 0.277 af, Atten= 0%, Lag= 0.0 min  
 Primary = 3.69 cfs @ 12.06 hrs, Volume= 0.277 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 36

Peak Elev= 287.52' @ 12.06 hrs

Flood Elev= 291.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	286.50'	<b>15.0" Round Culvert</b> L= 81.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 286.50' / 285.70' S= 0.0099 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=3.60 cfs @ 12.06 hrs HW=287.50' (Free Discharge)↑**1=Culvert** (Inlet Controls 3.60 cfs @ 3.41 fps)**Summary for Pond 4P: CB\_7-8**

Inflow Area = 1.600 ac, 43.33% Impervious, Inflow Depth > 3.09" for 10-year event  
 Inflow = 6.69 cfs @ 12.03 hrs, Volume= 0.412 af  
 Outflow = 6.69 cfs @ 12.03 hrs, Volume= 0.412 af, Atten= 0%, Lag= 0.0 min  
 Primary = 6.69 cfs @ 12.03 hrs, Volume= 0.412 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 274.40' @ 12.04 hrs

Flood Elev= 277.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	272.50'	<b>15.0" Round Culvert</b> L= 128.2' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 272.50' / 263.70' S= 0.0686 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=6.42 cfs @ 12.03 hrs HW=274.31' (Free Discharge)↑**1=Culvert** (Inlet Controls 6.42 cfs @ 5.23 fps)**Summary for Pond 5P: CB-9**

Inflow Area = 2.234 ac, 44.86% Impervious, Inflow Depth > 3.15" for 10-year event  
 Inflow = 9.44 cfs @ 12.03 hrs, Volume= 0.586 af  
 Outflow = 9.44 cfs @ 12.03 hrs, Volume= 0.586 af, Atten= 0%, Lag= 0.0 min  
 Primary = 9.44 cfs @ 12.03 hrs, Volume= 0.586 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 266.74' @ 12.03 hrs

Flood Elev= 267.30'

Device	Routing	Invert	Outlet Devices
#1	Primary	263.60'	<b>15.0" Round Culvert</b> L= 100.6' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 263.60' / 253.10' S= 0.1044 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=9.04 cfs @ 12.03 hrs HW=266.57' (Free Discharge)↑**1=Culvert** (Inlet Controls 9.04 cfs @ 7.37 fps)

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 10-year Rainfall=5.02"  
Printed 8/1/2022  
Page 37

### Summary for Pond 6P: CB\_10-11

Inflow Area = 3.320 ac, 44.72% Impervious, Inflow Depth > 3.13" for 10-year event  
Inflow = 13.82 cfs @ 12.04 hrs, Volume= 0.865 af  
Outflow = 13.82 cfs @ 12.04 hrs, Volume= 0.865 af, Atten= 0%, Lag= 0.0 min  
Primary = 13.82 cfs @ 12.04 hrs, Volume= 0.865 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 256.37' @ 12.04 hrs  
Flood Elev= 259.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	253.00'	<b>18.0" Round Culvert</b> L= 172.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 253.00' / 245.10' S= 0.0459 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf

**Primary OutFlow** Max=13.36 cfs @ 12.04 hrs HW=256.22' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 13.36 cfs @ 7.56 fps)

### Summary for Pond 7P: CB\_12-13

Inflow Area = 3.619 ac, 48.83% Impervious, Inflow Depth > 3.23" for 10-year event  
Inflow = 15.35 cfs @ 12.04 hrs, Volume= 0.974 af  
Outflow = 15.35 cfs @ 12.04 hrs, Volume= 0.974 af, Atten= 0%, Lag= 0.0 min  
Primary = 15.35 cfs @ 12.04 hrs, Volume= 0.974 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 248.98' @ 12.04 hrs  
Flood Elev= 249.60'

Device	Routing	Invert	Outlet Devices
#1	Primary	245.00'	<b>18.0" Round Culvert</b> L= 36.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 245.00' / 244.00' S= 0.0278 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf

**Primary OutFlow** Max=14.79 cfs @ 12.04 hrs HW=248.77' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 14.79 cfs @ 8.37 fps)

### Summary for Pond 10P: Stormwater Basin

Inflow Area = 4.169 ac, 43.44% Impervious, Inflow Depth > 3.00" for 10-year event  
Inflow = 16.88 cfs @ 12.04 hrs, Volume= 1.044 af  
Outflow = 3.60 cfs @ 12.46 hrs, Volume= 0.782 af, Atten= 79%, Lag= 24.9 min  
Primary = 3.60 cfs @ 12.46 hrs, Volume= 0.782 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 247.19' @ 12.46 hrs Surf.Area= 8,701 sf Storage= 18,704 cf

Plug-Flow detention time= 137.7 min calculated for 0.782 af (75% of inflow)

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 38

Center-of-Mass det. time= 76.3 min ( 882.1 - 805.8 )

Volume	Invert	Avail.Storage	Storage Description
#1	240.00'	26,654 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
240.00	508	0	0
242.00	892	1,400	1,400
244.00	1,386	2,278	3,678
245.00	2,520	1,953	5,631
245.50	5,230	1,938	7,569
246.00	5,523	2,688	10,257
248.00	10,874	16,397	26,654

Device	Routing	Invert	Outlet Devices
#1	Primary	242.50'	<b>18.0" Round Culvert</b> L= 32.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 242.50' / 242.00' S= 0.0156 '/ Cc= 0.900 n= 0.012, Flow Area= 1.77 sf
#2	Device 1	245.50'	<b>5.0" Vert. Orifice/Grate</b> C= 0.600
#3	Device 1	246.50'	<b>6.0" x 12.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	247.00'	<b>6.0" x 12.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=3.58 cfs @ 12.46 hrs HW=247.19' (Free Discharge)

- 1=Culvert (Passes 3.58 cfs of 16.88 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.80 cfs @ 5.85 fps)
- 3=Orifice/Grate (Orifice Controls 1.99 cfs @ 3.99 fps)
- 4=Orifice/Grate (Weir Controls 0.79 cfs @ 1.41 fps)

**Summary for Pond FB: Forebay**

Inflow Area = 3.619 ac, 48.83% Impervious, Inflow Depth > 3.23" for 10-year event  
 Inflow = 15.35 cfs @ 12.04 hrs, Volume= 0.974 af  
 Outflow = 15.07 cfs @ 12.04 hrs, Volume= 0.935 af, Atten= 2%, Lag= 0.4 min  
 Primary = 1.41 cfs @ 12.04 hrs, Volume= 0.634 af  
 Secondary = 13.66 cfs @ 12.04 hrs, Volume= 0.301 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 246.29' @ 12.04 hrs Surf.Area= 2,478 sf Storage= 7,527 cf

Plug-Flow detention time= 53.9 min calculated for 0.935 af (96% of inflow)  
 Center-of-Mass det. time= 38.3 min ( 807.4 - 769.1 )

Volume	Invert	Avail.Storage	Storage Description
#1	242.00'	9,375 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 39

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
242.00	1,096	0	0
244.00	1,678	2,774	2,774
246.00	2,365	4,043	6,817
247.00	2,750	2,558	9,375

Device	Routing	Invert	Outlet Devices
#1	Primary	243.00'	<b>6.0" Round Culvert</b> L= 36.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 243.00' / 242.50' S= 0.0139 ' / Cc= 0.900 n= 0.012, Flow Area= 0.20 sf
#2	Secondary	246.00'	<b>35.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

**Primary OutFlow** Max=1.41 cfs @ 12.04 hrs HW=246.29' (Free Discharge)

↑**1=Culvert** (Barrel Controls 1.41 cfs @ 7.16 fps)

**Secondary OutFlow** Max=13.34 cfs @ 12.04 hrs HW=246.29' (Free Discharge)

↑**2=Broad-Crested Rectangular Weir** (Weir Controls 13.34 cfs @ 1.32 fps)

**Summary for Pond P-1: Forebay**

Inflow Area = 1.205 ac, 37.50% Impervious, Inflow Depth > 3.01" for 10-year event  
 Inflow = 4.08 cfs @ 12.06 hrs, Volume= 0.302 af  
 Outflow = 3.93 cfs @ 12.09 hrs, Volume= 0.232 af, Atten= 4%, Lag= 1.9 min  
 Primary = 3.93 cfs @ 12.09 hrs, Volume= 0.232 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 285.34' @ 12.09 hrs Surf.Area= 1,648 sf Storage= 3,564 cf

Plug-Flow detention time= 96.6 min calculated for 0.232 af (77% of inflow)  
 Center-of-Mass det. time= 38.8 min ( 816.0 - 777.2 )

Volume	Invert	Avail.Storage	Storage Description
#1	282.00'	4,711 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
282.00	545	0	0
284.00	1,130	1,675	1,675
285.00	1,565	1,348	3,023
286.00	1,812	1,689	4,711

Device	Routing	Invert	Outlet Devices
#1	Primary	285.00'	<b>8.0' long x 8.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 40

2.50	3.00	3.50	4.00	4.50	5.00	5.50
Coef. (English)	2.43	2.54	2.70	2.69	2.68	2.68
	2.66	2.64	2.64	2.64	2.64	2.64
	2.65	2.65	2.66	2.66	2.68	2.70
				2.70	2.74	

**Primary OutFlow** Max=3.88 cfs @ 12.09 hrs HW=285.33' (Free Discharge)

1=Broad-Crested Rectangular Weir (Weir Controls 3.88 cfs @ 1.45 fps)

**Summary for Pond P-2: Stormwater Pond**

Inflow Area = 1.383 ac, 32.67% Impervious, Inflow Depth > 2.30" for 10-year event  
 Inflow = 4.31 cfs @ 12.08 hrs, Volume= 0.265 af  
 Outflow = 0.47 cfs @ 13.03 hrs, Volume= 0.220 af, Atten= 89%, Lag= 56.9 min  
 Primary = 0.47 cfs @ 13.03 hrs, Volume= 0.220 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 273.94' @ 13.03 hrs Surf.Area= 3,266 sf Storage= 5,462 cf

Plug-Flow detention time= 154.8 min calculated for 0.219 af (83% of inflow)  
 Center-of-Mass det. time= 108.2 min ( 921.7 - 813.5 )

Volume	Invert	Avail.Storage	Storage Description
#1	272.00'	22,675 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
272.00	2,375	0	0
274.00	3,295	5,670	5,670
276.00	4,225	7,520	13,190
278.00	5,260	9,485	22,675

Device	Routing	Invert	Outlet Devices
#1	Primary	272.00'	<b>18.0" Round Culvert</b> L= 30.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 272.00' / 270.00' S= 0.0667 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf
#2	Device 1	272.50'	<b>4.0" Vert. Orifice/Grate</b> C= 0.600
#3	Device 1	275.00'	<b>6.0" Vert. Orifice/Grate</b> C= 0.600
#4	Primary	276.00'	<b>12.0" W x 6.0" H Vert. Orifice/Grate</b> C= 0.600
#5	Primary	277.00'	<b>18.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=0.47 cfs @ 13.03 hrs HW=273.94' (Free Discharge)

- 1=Culvert (Passes 0.47 cfs of 8.18 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.47 cfs @ 5.43 fps)
- 3=Orifice/Grate ( Controls 0.00 cfs)
- 4=Orifice/Grate ( Controls 0.00 cfs)
- 5=Orifice/Grate ( Controls 0.00 cfs)

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 25-year Rainfall=6.05"  
Printed 8/1/2022  
Page 41

### Summary for Subcatchment 1S: Drainage Area 1

Runoff = 0.89 cfs @ 12.13 hrs, Volume= 0.069 af, Depth> 4.20"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.05"

Area (sf)	CN	Description
4,120	98	Paved parking, HSG B
4,450	74	>75% Grass cover, Good, HSG C
8,570	86	Weighted Average
4,450		51.93% Pervious Area
4,120		48.07% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.1	111	0.0710	0.20		<b>Sheet Flow, Tc-1</b> Grass: Dense n= 0.240 P2= 3.37"

### Summary for Subcatchment 2S: Drainage Area 2

Runoff = 1.77 cfs @ 12.01 hrs, Volume= 0.110 af, Depth> 4.32"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.05"

Area (sf)	CN	Description
6,287	74	>75% Grass cover, Good, HSG C
* 7,033	98	Roof/pavement
13,320	87	Weighted Average
6,287		47.20% Pervious Area
7,033		52.80% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.0	125	0.0100	2.03		<b>Shallow Concentrated Flow, Tc-2</b> Paved Kv= 20.3 fps

### Summary for Subcatchment 2S': Overland to Wetlands

Runoff = 4.62 cfs @ 12.17 hrs, Volume= 0.377 af, Depth> 2.54"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.05"



**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 42

Area (sf)	CN	Description
38,320	73	Woods, Fair, HSG C
21,500	55	Woods, Good, HSG B
2,724	98	Roofs, HSG B
15,044	74	>75% Grass cover, Good, HSG C
77,588	69	Weighted Average
74,864		96.49% Pervious Area
2,724		3.51% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.2	200	0.1100	0.27		<b>Sheet Flow, Tc-2s</b> Grass: Dense n= 0.240 P2= 3.37"

**Summary for Subcatchment 3S: Drainage Area 3**

Runoff = 2.62 cfs @ 12.09 hrs, Volume= 0.179 af, Depth> 3.79"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.05"

Area (sf)	CN	Description
* 8,529	98	Paved parking/roof
16,209	74	>75% Grass cover, Good, HSG C
24,738	82	Weighted Average
16,209		65.52% Pervious Area
8,529		34.48% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0	105	0.1100	0.35		<b>Sheet Flow, Tc-4a</b> Grass: Short n= 0.150 P2= 3.37"
0.7	160	0.0310	3.57		<b>Shallow Concentrated Flow, Tc-4b</b> Paved Kv= 20.3 fps

5.7 265 Total

**Summary for Subcatchment 4S: Drainage Area 4**

Runoff = 8.55 cfs @ 12.03 hrs, Volume= 0.533 af, Depth> 4.00"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.05"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 43

Area (sf)	CN	Description
* 30,200	98	Paved parking & roof HSG A
20,000	74	>75% Grass cover, Good, HSG C
19,500	73	Woods, Fair, HSG C
69,700	84	Weighted Average
39,500		56.67% Pervious Area
30,200		43.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.9	130	0.0100	1.13		<b>Sheet Flow, Tc-3</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 5S: Drainage Area 5**

Runoff = 3.55 cfs @ 12.02 hrs, Volume= 0.222 af, Depth> 4.21"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.05"

Area (sf)	CN	Description
* 13,450	98	Paved surfaces & roof
14,147	74	>75% Grass cover, Good, HSG C
27,597	86	Weighted Average
14,147		51.26% Pervious Area
13,450		48.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	180	0.0500	2.29		<b>Sheet Flow, Tc-5</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 6S: Drainage Area 6**

Runoff = 5.74 cfs @ 12.05 hrs, Volume= 0.362 af, Depth> 4.00"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.05"

Area (sf)	CN	Description
* 21,025	98	Pavement/Roofs, HSG B
22,990	74	>75% Grass cover, Good, HSG C
3,300	60	Woods, Fair, HSG B
47,315	84	Weighted Average
26,290		55.56% Pervious Area
21,025		44.44% Impervious Area

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 44

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.2	180	0.0500	0.95		<b>Lag/CN Method, Tc-6</b>

**Summary for Subcatchment 7S: Drainage Area 7**

Runoff = 1.95 cfs @ 12.02 hrs, Volume= 0.132 af, Depth&gt; 5.30"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.05"

Area (sf)	CN	Description
* 12,295	98	Roof & Pavement
* 716	74	>75% Grass cover, Good, HSG B/D
13,011	97	Weighted Average
716		5.50% Pervious Area
12,295		94.50% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	175	0.0580	2.42		<b>Sheet Flow, Tc-7</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 8S: Overland to Wetlands**

Runoff = 9.79 cfs @ 12.20 hrs, Volume= 0.843 af, Depth&gt; 2.45"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.05"

Area (sf)	CN	Description
24,323	74	>75% Grass cover, Good, HSG C
61,975	77	Woods, Good, HSG D
93,653	60	Woods, Fair, HSG B
179,951	68	Weighted Average
179,951		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
14.1	152	0.1240	0.18		<b>Sheet Flow, Tc-8</b> Woods: Light underbrush n= 0.400 P2= 3.37"

**Summary for Subcatchment 9S: Overland to Basin 3**

Runoff = 2.42 cfs @ 12.04 hrs, Volume= 0.147 af, Depth&gt; 3.20"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.05"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 45

Area (sf)	CN	Description
22,063	74	>75% Grass cover, Good, HSG C
1,920	98	Roofs, HSG C
23,983	76	Weighted Average
22,063		91.99% Pervious Area
1,920		8.01% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.3	145	0.1100	1.05		<b>Lag/CN Method, Tc-9</b>

**Summary for Subcatchment FB1: Overland to Forebay**

Runoff = 0.56 cfs @ 12.04 hrs, Volume= 0.034 af, Depth&gt; 3.01"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.05"

Area (sf)	CN	Description
5,861	74	>75% Grass cover, Good, HSG C
5,861		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.1	98	0.0800	0.78		<b>Lag/CN Method, Tc-FB-1</b>

**Summary for Subcatchment O-P2: Overland to Pond**

Runoff = 0.74 cfs @ 12.02 hrs, Volume= 0.045 af, Depth&gt; 3.01"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.05"

Area (sf)	CN	Description
7,761	74	>75% Grass cover, Good, HSG C
7,761		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	30	0.0330	0.40		<b>Lag/CN Method, Tc-P2</b>

**Summary for Subcatchment OS: Overland to Swale**

Runoff = 1.37 cfs @ 12.04 hrs, Volume= 0.082 af, Depth&gt; 2.82"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 25-year Rainfall=6.05"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 46

Area (sf)	CN	Description
1,650	60	Woods, Fair, HSG B
13,622	74	>75% Grass cover, Good, HSG C
15,272	72	Weighted Average
15,272		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.0					Direct Entry, Tc-OS

**Summary for Reach 1R: Wetland Swale**

Inflow Area = 1.781 ac, 3.51% Impervious, Inflow Depth > 2.54" for 25-year event  
 Inflow = 4.62 cfs @ 12.17 hrs, Volume= 0.377 af  
 Outflow = 4.45 cfs @ 12.26 hrs, Volume= 0.375 af, Atten= 4%, Lag= 4.9 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.84 fps, Min. Travel Time= 2.6 min  
 Avg. Velocity = 0.79 fps, Avg. Travel Time= 6.1 min

Peak Storage= 704 cf @ 12.21 hrs  
 Average Depth at Peak Storage= 0.16'  
 Bank-Full Depth= 2.00' Flow Area= 106.7 sf, Capacity= 1,056.58 cfs

80.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 290.0' Slope= 0.0759 '/'  
 Inlet Invert= 294.00', Outlet Invert= 272.00'



**Summary for Reach 2R: Wetland Swale**

Inflow Area = 7.646 ac, 6.73% Impervious, Inflow Depth > 2.52" for 25-year event  
 Inflow = 15.08 cfs @ 12.22 hrs, Volume= 1.607 af  
 Outflow = 13.91 cfs @ 12.38 hrs, Volume= 1.590 af, Atten= 8%, Lag= 9.5 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.19 fps, Min. Travel Time= 5.4 min  
 Avg. Velocity = 0.99 fps, Avg. Travel Time= 11.9 min

Peak Storage= 4,546 cf @ 12.29 hrs  
 Average Depth at Peak Storage= 0.29'  
 Bank-Full Depth= 2.00' Flow Area= 113.3 sf, Capacity= 890.78 cfs

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 25-year Rainfall=6.05"  
Printed 8/1/2022  
Page 47

85.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
Length= 712.0' Slope= 0.0478 '/'  
Inlet Invert= 272.00', Outlet Invert= 238.00'



**Summary for Reach 3R: Wet Swale**

Inflow Area =	1.734 ac, 26.06% Impervious, Inflow Depth > 2.70"	for 25-year event
Inflow =	1.66 cfs @ 12.05 hrs, Volume=	0.390 af
Outflow =	1.54 cfs @ 12.09 hrs, Volume=	0.389 af, Atten= 7%, Lag= 2.3 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Max. Velocity= 2.26 fps, Min. Travel Time= 1.2 min  
Avg. Velocity = 1.22 fps, Avg. Travel Time= 2.3 min

Peak Storage= 120 cf @ 12.06 hrs  
Average Depth at Peak Storage= 0.09'  
Bank-Full Depth= 1.00' Flow Area= 10.0 sf, Capacity= 99.84 cfs

8.00' x 1.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides  
Side Slope Z-value= 2.0 '/' Top Width= 12.00'  
Length= 165.0' Slope= 0.0970 '/'  
Inlet Invert= 270.00', Outlet Invert= 254.00'



**Summary for Reach 9R: Peak off Site**

Inflow Area =	11.815 ac, 19.68% Impervious, Inflow Depth > 2.71"	for 25-year event
Inflow =	19.55 cfs @ 12.38 hrs, Volume=	2.667 af
Outflow =	19.55 cfs @ 12.38 hrs, Volume=	2.667 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 48

**Summary for Pond 1P: CB\_1-2**

Inflow Area = 0.197 ac, 48.07% Impervious, Inflow Depth > 4.20" for 25-year event  
 Inflow = 0.89 cfs @ 12.13 hrs, Volume= 0.069 af  
 Outflow = 0.89 cfs @ 12.13 hrs, Volume= 0.069 af, Atten= 0%, Lag= 0.0 min  
 Primary = 0.89 cfs @ 12.13 hrs, Volume= 0.069 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 311.94' @ 12.13 hrs

Flood Elev= 316.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	311.50'	<b>15.0" Round Culvert</b> L= 128.7' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 311.50' / 298.95' S= 0.0975 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=0.87 cfs @ 12.13 hrs HW=311.94' (Free Discharge)↑**1=Culvert** (Inlet Controls 0.87 cfs @ 2.26 fps)**Summary for Pond 2P: CB\_3-4**

Inflow Area = 0.503 ac, 50.95% Impervious, Inflow Depth > 4.27" for 25-year event  
 Inflow = 2.29 cfs @ 12.03 hrs, Volume= 0.179 af  
 Outflow = 2.29 cfs @ 12.03 hrs, Volume= 0.179 af, Atten= 0%, Lag= 0.0 min  
 Primary = 2.29 cfs @ 12.03 hrs, Volume= 0.179 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 299.60' @ 12.03 hrs

Flood Elev= 303.30'

Device	Routing	Invert	Outlet Devices
#1	Primary	298.85'	<b>15.0" Round Culvert</b> L= 131.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 298.85' / 286.60' S= 0.0934 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=2.24 cfs @ 12.03 hrs HW=299.59' (Free Discharge)↑**1=Culvert** (Inlet Controls 2.24 cfs @ 2.94 fps)**Summary for Pond 3P: CB\_5-6**

Inflow Area = 1.070 ac, 42.21% Impervious, Inflow Depth > 4.02" for 25-year event  
 Inflow = 4.72 cfs @ 12.06 hrs, Volume= 0.358 af  
 Outflow = 4.72 cfs @ 12.06 hrs, Volume= 0.358 af, Atten= 0%, Lag= 0.0 min  
 Primary = 4.72 cfs @ 12.06 hrs, Volume= 0.358 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 49

Peak Elev= 287.76' @ 12.06 hrs

Flood Elev= 291.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	286.50'	<b>15.0" Round Culvert</b> L= 81.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 286.50' / 285.70' S= 0.0099 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=4.62 cfs @ 12.06 hrs HW=287.73' (Free Discharge)↑**1=Culvert** (Inlet Controls 4.62 cfs @ 3.78 fps)**Summary for Pond 4P: CB\_7-8**

Inflow Area = 1.600 ac, 43.33% Impervious, Inflow Depth > 4.00" for 25-year event  
 Inflow = 8.55 cfs @ 12.03 hrs, Volume= 0.533 af  
 Outflow = 8.55 cfs @ 12.03 hrs, Volume= 0.533 af, Atten= 0%, Lag= 0.0 min  
 Primary = 8.55 cfs @ 12.03 hrs, Volume= 0.533 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 275.20' @ 12.03 hrs

Flood Elev= 277.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	272.50'	<b>15.0" Round Culvert</b> L= 128.2' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 272.50' / 263.70' S= 0.0686 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=8.20 cfs @ 12.03 hrs HW=275.05' (Free Discharge)↑**1=Culvert** (Inlet Controls 8.20 cfs @ 6.68 fps)**Summary for Pond 5P: CB-9**

Inflow Area = 2.234 ac, 44.86% Impervious, Inflow Depth > 4.06" for 25-year event  
 Inflow = 12.02 cfs @ 12.03 hrs, Volume= 0.756 af  
 Outflow = 12.02 cfs @ 12.03 hrs, Volume= 0.756 af, Atten= 0%, Lag= 0.0 min  
 Primary = 12.02 cfs @ 12.03 hrs, Volume= 0.756 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 268.31' @ 12.03 hrs

Flood Elev= 267.30'

Device	Routing	Invert	Outlet Devices
#1	Primary	263.60'	<b>15.0" Round Culvert</b> L= 100.6' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 263.60' / 253.10' S= 0.1044 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=11.51 cfs @ 12.03 hrs HW=268.02' (Free Discharge)↑**1=Culvert** (Inlet Controls 11.51 cfs @ 9.38 fps)



**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 50

**Summary for Pond 6P: CB\_10-11**

Inflow Area = 3.320 ac, 44.72% Impervious, Inflow Depth > 4.04" for 25-year event  
 Inflow = 17.63 cfs @ 12.04 hrs, Volume= 1.118 af  
 Outflow = 17.63 cfs @ 12.04 hrs, Volume= 1.118 af, Atten= 0%, Lag= 0.0 min  
 Primary = 17.63 cfs @ 12.04 hrs, Volume= 1.118 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 258.02' @ 12.04 hrs

Flood Elev= 259.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	253.00'	<b>18.0" Round Culvert</b> L= 172.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 253.00' / 245.10' S= 0.0459 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf

**Primary OutFlow** Max=17.02 cfs @ 12.04 hrs HW=257.75' (Free Discharge)↑**1=Culvert** (Inlet Controls 17.02 cfs @ 9.63 fps)**Summary for Pond 7P: CB\_12-13**

Inflow Area = 3.619 ac, 48.83% Impervious, Inflow Depth > 4.14" for 25-year event  
 Inflow = 19.48 cfs @ 12.04 hrs, Volume= 1.250 af  
 Outflow = 19.48 cfs @ 12.04 hrs, Volume= 1.250 af, Atten= 0%, Lag= 0.0 min  
 Primary = 19.48 cfs @ 12.04 hrs, Volume= 1.250 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 250.95' @ 12.04 hrs

Flood Elev= 249.60'

Device	Routing	Invert	Outlet Devices
#1	Primary	245.00'	<b>18.0" Round Culvert</b> L= 36.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 245.00' / 244.00' S= 0.0278 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf

**Primary OutFlow** Max=18.76 cfs @ 12.04 hrs HW=250.61' (Free Discharge)↑**1=Culvert** (Inlet Controls 18.76 cfs @ 10.62 fps)**Summary for Pond 10P: Stormwater Basin**

Inflow Area = 4.169 ac, 43.44% Impervious, Inflow Depth > 3.90" for 25-year event  
 Inflow = 21.90 cfs @ 12.04 hrs, Volume= 1.356 af  
 Outflow = 5.64 cfs @ 12.40 hrs, Volume= 1.077 af, Atten= 74%, Lag= 21.1 min  
 Primary = 5.64 cfs @ 12.40 hrs, Volume= 1.077 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 247.72' @ 12.40 hrs Surf.Area= 10,130 sf Storage= 23,735 cf

Plug-Flow detention time= 117.6 min calculated for 1.073 af (79% of inflow)

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 51

Center-of-Mass det. time= 63.1 min ( 860.8 - 797.7 )

Volume	Invert	Avail.Storage	Storage Description
#1	240.00'	26,654 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
240.00	508	0	0
242.00	892	1,400	1,400
244.00	1,386	2,278	3,678
245.00	2,520	1,953	5,631
245.50	5,230	1,938	7,569
246.00	5,523	2,688	10,257
248.00	10,874	16,397	26,654

Device	Routing	Invert	Outlet Devices
#1	Primary	242.50'	<b>18.0" Round Culvert</b> L= 32.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 242.50' / 242.00' S= 0.0156 '/ Cc= 0.900 n= 0.012, Flow Area= 1.77 sf
#2	Device 1	245.50'	<b>5.0" Vert. Orifice/Grate</b> C= 0.600
#3	Device 1	246.50'	<b>6.0" x 12.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	247.00'	<b>6.0" x 12.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=5.64 cfs @ 12.40 hrs HW=247.72' (Free Discharge)

- ↑ **1=Culvert** (Passes 5.64 cfs of 17.99 cfs potential flow)
- ↑ **2=Orifice/Grate** (Orifice Controls 0.93 cfs @ 6.83 fps)
- ↑ **3=Orifice/Grate** (Orifice Controls 2.66 cfs @ 5.32 fps)
- ↑ **4=Orifice/Grate** (Orifice Controls 2.04 cfs @ 4.09 fps)

**Summary for Pond FB: Forebay**

Inflow Area = 3.619 ac, 48.83% Impervious, Inflow Depth > 4.14" for 25-year event  
 Inflow = 19.48 cfs @ 12.04 hrs, Volume= 1.250 af  
 Outflow = 19.48 cfs @ 12.05 hrs, Volume= 1.209 af, Atten= 0%, Lag= 0.6 min  
 Primary = 1.42 cfs @ 12.05 hrs, Volume= 0.747 af  
 Secondary = 18.06 cfs @ 12.05 hrs, Volume= 0.462 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 246.35' @ 12.05 hrs Surf.Area= 2,499 sf Storage= 7,667 cf

Plug-Flow detention time= 48.3 min calculated for 1.205 af (96% of inflow)  
 Center-of-Mass det. time= 35.4 min ( 799.2 - 763.7 )

Volume	Invert	Avail.Storage	Storage Description
#1	242.00'	9,375 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 52

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
242.00	1,096	0	0
244.00	1,678	2,774	2,774
246.00	2,365	4,043	6,817
247.00	2,750	2,558	9,375

Device	Routing	Invert	Outlet Devices
#1	Primary	243.00'	<b>6.0" Round Culvert</b> L= 36.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 243.00' / 242.50' S= 0.0139 ' / Cc= 0.900 n= 0.012, Flow Area= 0.20 sf
#2	Secondary	246.00'	<b>35.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

**Primary OutFlow** Max=1.42 cfs @ 12.05 hrs HW=246.35' (Free Discharge)

↑**1=Culvert** (Barrel Controls 1.42 cfs @ 7.23 fps)

**Secondary OutFlow** Max=17.72 cfs @ 12.05 hrs HW=246.35' (Free Discharge)

↑**2=Broad-Crested Rectangular Weir** (Weir Controls 17.72 cfs @ 1.47 fps)

**Summary for Pond P-1: Forebay**

Inflow Area = 1.205 ac, 37.50% Impervious, Inflow Depth > 3.90" for 25-year event  
 Inflow = 5.26 cfs @ 12.06 hrs, Volume= 0.392 af  
 Outflow = 5.08 cfs @ 12.09 hrs, Volume= 0.322 af, Atten= 3%, Lag= 1.7 min  
 Primary = 5.08 cfs @ 12.09 hrs, Volume= 0.322 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 285.40' @ 12.09 hrs Surf.Area= 1,663 sf Storage= 3,663 cf

Plug-Flow detention time= 83.1 min calculated for 0.321 af (82% of inflow)  
 Center-of-Mass det. time= 34.0 min ( 805.3 - 771.3 )

Volume	Invert	Avail.Storage	Storage Description
#1	282.00'	4,711 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
282.00	545	0	0
284.00	1,130	1,675	1,675
285.00	1,565	1,348	3,023
286.00	1,812	1,689	4,711

Device	Routing	Invert	Outlet Devices
#1	Primary	285.00'	<b>8.0' long x 8.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 53

2.50	3.00	3.50	4.00	4.50	5.00	5.50
Coef. (English)	2.43	2.54	2.70	2.69	2.68	2.68
	2.65	2.65	2.66	2.66	2.68	2.70

**Primary OutFlow** Max=4.99 cfs @ 12.09 hrs HW=285.39' (Free Discharge)

1=Broad-Crested Rectangular Weir (Weir Controls 4.99 cfs @ 1.59 fps)

**Summary for Pond P-2: Stormwater Pond**

Inflow Area = 1.383 ac, 32.67% Impervious, Inflow Depth > 3.18" for 25-year event  
 Inflow = 5.67 cfs @ 12.07 hrs, Volume= 0.366 af  
 Outflow = 0.60 cfs @ 13.01 hrs, Volume= 0.308 af, Atten= 89%, Lag= 56.3 min  
 Primary = 0.60 cfs @ 13.01 hrs, Volume= 0.308 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 274.72' @ 13.01 hrs Surf.Area= 3,630 sf Storage= 8,164 cf

Plug-Flow detention time= 171.8 min calculated for 0.308 af (84% of inflow)  
 Center-of-Mass det. time= 127.0 min ( 930.3 - 803.3 )

Volume	Invert	Avail.Storage	Storage Description
#1	272.00'	22,675 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
272.00	2,375	0	0
274.00	3,295	5,670	5,670
276.00	4,225	7,520	13,190
278.00	5,260	9,485	22,675

Device	Routing	Invert	Outlet Devices
#1	Primary	272.00'	<b>18.0" Round Culvert</b> L= 30.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 272.00' / 270.00' S= 0.0667 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf
#2	Device 1	272.50'	<b>4.0" Vert. Orifice/Grate</b> C= 0.600
#3	Device 1	275.00'	<b>6.0" Vert. Orifice/Grate</b> C= 0.600
#4	Primary	276.00'	<b>12.0" W x 6.0" H Vert. Orifice/Grate</b> C= 0.600
#5	Primary	277.00'	<b>18.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=0.60 cfs @ 13.01 hrs HW=274.72' (Free Discharge)

- 1=Culvert (Passes 0.60 cfs of 10.54 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.60 cfs @ 6.90 fps)
- 3=Orifice/Grate ( Controls 0.00 cfs)
- 4=Orifice/Grate ( Controls 0.00 cfs)
- 5=Orifice/Grate ( Controls 0.00 cfs)

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 50-year Rainfall=6.85"  
Printed 8/1/2022  
Page 54

### Summary for Subcatchment 1S: Drainage Area 1

Runoff = 1.03 cfs @ 12.13 hrs, Volume= 0.081 af, Depth> 4.93"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

Area (sf)	CN	Description
4,120	98	Paved parking, HSG B
4,450	74	>75% Grass cover, Good, HSG C
8,570	86	Weighted Average
4,450		51.93% Pervious Area
4,120		48.07% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.1	111	0.0710	0.20		<b>Sheet Flow, Tc-1</b> Grass: Dense n= 0.240 P2= 3.37"

### Summary for Subcatchment 2S: Drainage Area 2

Runoff = 2.05 cfs @ 12.01 hrs, Volume= 0.129 af, Depth> 5.05"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

Area (sf)	CN	Description
6,287	74	>75% Grass cover, Good, HSG C
* 7,033	98	Roof/pavement
13,320	87	Weighted Average
6,287		47.20% Pervious Area
7,033		52.80% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.0	125	0.0100	2.03		<b>Shallow Concentrated Flow, Tc-2</b> Paved Kv= 20.3 fps

### Summary for Subcatchment 2S': Overland to Wetlands

Runoff = 5.73 cfs @ 12.17 hrs, Volume= 0.466 af, Depth> 3.14"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 55

Area (sf)	CN	Description
38,320	73	Woods, Fair, HSG C
21,500	55	Woods, Good, HSG B
2,724	98	Roofs, HSG B
15,044	74	>75% Grass cover, Good, HSG C
77,588	69	Weighted Average
74,864		96.49% Pervious Area
2,724		3.51% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.2	200	0.1100	0.27		<b>Sheet Flow, Tc-2s</b> Grass: Dense n= 0.240 P2= 3.37"

**Summary for Subcatchment 3S: Drainage Area 3**

Runoff = 3.08 cfs @ 12.09 hrs, Volume= 0.213 af, Depth> 4.50"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

Area (sf)	CN	Description
* 8,529	98	Paved parking/roof
16,209	74	>75% Grass cover, Good, HSG C
24,738	82	Weighted Average
16,209		65.52% Pervious Area
8,529		34.48% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0	105	0.1100	0.35		<b>Sheet Flow, Tc-4a</b> Grass: Short n= 0.150 P2= 3.37"
0.7	160	0.0310	3.57		<b>Shallow Concentrated Flow, Tc-4b</b> Paved Kv= 20.3 fps

5.7 265 Total

**Summary for Subcatchment 4S: Drainage Area 4**

Runoff = 9.99 cfs @ 12.03 hrs, Volume= 0.629 af, Depth> 4.72"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 56

Area (sf)	CN	Description
* 30,200	98	Paved parking & roof HSG A
20,000	74	>75% Grass cover, Good, HSG C
19,500	73	Woods, Fair, HSG C
69,700	84	Weighted Average
39,500		56.67% Pervious Area
30,200		43.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.9	130	0.0100	1.13		<b>Sheet Flow, Tc-3</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 5S: Drainage Area 5**

Runoff = 4.13 cfs @ 12.02 hrs, Volume= 0.261 af, Depth> 4.94"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

Area (sf)	CN	Description
* 13,450	98	Paved surfaces & roof
14,147	74	>75% Grass cover, Good, HSG C
27,597	86	Weighted Average
14,147		51.26% Pervious Area
13,450		48.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	180	0.0500	2.29		<b>Sheet Flow, Tc-5</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 6S: Drainage Area 6**

Runoff = 6.71 cfs @ 12.05 hrs, Volume= 0.427 af, Depth> 4.72"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

Area (sf)	CN	Description
* 21,025	98	Pavement/Roofs, HSG B
22,990	74	>75% Grass cover, Good, HSG C
3,300	60	Woods, Fair, HSG B
47,315	84	Weighted Average
26,290		55.56% Pervious Area
21,025		44.44% Impervious Area

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 57

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.2	180	0.0500	0.95		<b>Lag/CN Method, Tc-6</b>

**Summary for Subcatchment 7S: Drainage Area 7**

Runoff = 2.21 cfs @ 12.02 hrs, Volume= 0.150 af, Depth&gt; 6.03"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

Area (sf)	CN	Description
* 12,295	98	Roof & Pavement
* 716	74	>75% Grass cover, Good, HSG B/D
13,011	97	Weighted Average
716		5.50% Pervious Area
12,295		94.50% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	175	0.0580	2.42		<b>Sheet Flow, Tc-7</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 8S: Overland to Wetlands**

Runoff = 12.20 cfs @ 12.20 hrs, Volume= 1.047 af, Depth&gt; 3.04"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

Area (sf)	CN	Description
24,323	74	>75% Grass cover, Good, HSG C
61,975	77	Woods, Good, HSG D
93,653	60	Woods, Fair, HSG B
179,951	68	Weighted Average
179,951		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
14.1	152	0.1240	0.18		<b>Sheet Flow, Tc-8</b> Woods: Light underbrush n= 0.400 P2= 3.37"

**Summary for Subcatchment 9S: Overland to Basin 3**

Runoff = 2.91 cfs @ 12.04 hrs, Volume= 0.177 af, Depth&gt; 3.86"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"



**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 58

Area (sf)	CN	Description
22,063	74	>75% Grass cover, Good, HSG C
1,920	98	Roofs, HSG C
23,983	76	Weighted Average
22,063		91.99% Pervious Area
1,920		8.01% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.3	145	0.1100	1.05		<b>Lag/CN Method, Tc-9</b>

**Summary for Subcatchment FB1: Overland to Forebay**

Runoff = 0.68 cfs @ 12.04 hrs, Volume= 0.041 af, Depth&gt; 3.66"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

Area (sf)	CN	Description
5,861	74	>75% Grass cover, Good, HSG C
5,861		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.1	98	0.0800	0.78		<b>Lag/CN Method, Tc-FB-1</b>

**Summary for Subcatchment O-P2: Overland to Pond**

Runoff = 0.90 cfs @ 12.02 hrs, Volume= 0.054 af, Depth&gt; 3.66"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

Area (sf)	CN	Description
7,761	74	>75% Grass cover, Good, HSG C
7,761		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	30	0.0330	0.40		<b>Lag/CN Method, Tc-P2</b>

**Summary for Subcatchment OS: Overland to Swale**

Runoff = 1.67 cfs @ 12.04 hrs, Volume= 0.101 af, Depth&gt; 3.45"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 50-year Rainfall=6.85"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 59

Area (sf)	CN	Description
1,650	60	Woods, Fair, HSG B
13,622	74	>75% Grass cover, Good, HSG C
15,272	72	Weighted Average
15,272		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.0					Direct Entry, Tc-OS

**Summary for Reach 1R: Wetland Swale**

Inflow Area = 1.781 ac, 3.51% Impervious, Inflow Depth > 3.14" for 50-year event  
 Inflow = 5.73 cfs @ 12.17 hrs, Volume= 0.466 af  
 Outflow = 5.51 cfs @ 12.25 hrs, Volume= 0.464 af, Atten= 4%, Lag= 4.7 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 1.97 fps, Min. Travel Time= 2.4 min  
 Avg. Velocity = 0.82 fps, Avg. Travel Time= 5.9 min

Peak Storage= 818 cf @ 12.21 hrs  
 Average Depth at Peak Storage= 0.18'  
 Bank-Full Depth= 2.00' Flow Area= 106.7 sf, Capacity= 1,056.58 cfs

80.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 290.0' Slope= 0.0759 '/'  
 Inlet Invert= 294.00', Outlet Invert= 272.00'



**Summary for Reach 2R: Wetland Swale**

Inflow Area = 7.646 ac, 6.73% Impervious, Inflow Depth > 3.11" for 50-year event  
 Inflow = 18.76 cfs @ 12.22 hrs, Volume= 1.983 af  
 Outflow = 17.45 cfs @ 12.36 hrs, Volume= 1.963 af, Atten= 7%, Lag= 8.9 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.34 fps, Min. Travel Time= 5.1 min  
 Avg. Velocity = 1.04 fps, Avg. Travel Time= 11.4 min

Peak Storage= 5,315 cf @ 12.28 hrs  
 Average Depth at Peak Storage= 0.33'  
 Bank-Full Depth= 2.00' Flow Area= 113.3 sf, Capacity= 890.78 cfs

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 60

85.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 712.0' Slope= 0.0478 '/'  
 Inlet Invert= 272.00', Outlet Invert= 238.00'



**Summary for Reach 3R: Wet Swale**

Inflow Area = 1.734 ac, 26.06% Impervious, Inflow Depth > 3.28" for 50-year event  
 Inflow = 2.07 cfs @ 12.04 hrs, Volume= 0.473 af  
 Outflow = 1.95 cfs @ 12.07 hrs, Volume= 0.472 af, Atten= 6%, Lag= 1.8 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.47 fps, Min. Travel Time= 1.1 min  
 Avg. Velocity = 1.27 fps, Avg. Travel Time= 2.2 min

Peak Storage= 137 cf @ 12.06 hrs  
 Average Depth at Peak Storage= 0.10'  
 Bank-Full Depth= 1.00' Flow Area= 10.0 sf, Capacity= 99.84 cfs

8.00' x 1.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides  
 Side Slope Z-value= 2.0 '/' Top Width= 12.00'  
 Length= 165.0' Slope= 0.0970 '/'  
 Inlet Invert= 270.00', Outlet Invert= 254.00'



**Summary for Reach 9R: Peak off Site**

Inflow Area = 11.815 ac, 19.68% Impervious, Inflow Depth > 3.33" for 50-year event  
 Inflow = 25.74 cfs @ 12.35 hrs, Volume= 3.275 af  
 Outflow = 25.74 cfs @ 12.35 hrs, Volume= 3.275 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 61

**Summary for Pond 1P: CB\_1-2**

Inflow Area = 0.197 ac, 48.07% Impervious, Inflow Depth > 4.93" for 50-year event  
 Inflow = 1.03 cfs @ 12.13 hrs, Volume= 0.081 af  
 Outflow = 1.03 cfs @ 12.13 hrs, Volume= 0.081 af, Atten= 0%, Lag= 0.0 min  
 Primary = 1.03 cfs @ 12.13 hrs, Volume= 0.081 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 311.98' @ 12.13 hrs

Flood Elev= 316.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	311.50'	<b>15.0" Round Culvert</b> L= 128.7' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 311.50' / 298.95' S= 0.0975 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=1.01 cfs @ 12.13 hrs HW=311.98' (Free Discharge)↑**1=Culvert** (Inlet Controls 1.01 cfs @ 2.35 fps)**Summary for Pond 2P: CB\_3-4**

Inflow Area = 0.503 ac, 50.95% Impervious, Inflow Depth > 5.00" for 50-year event  
 Inflow = 2.66 cfs @ 12.03 hrs, Volume= 0.209 af  
 Outflow = 2.66 cfs @ 12.03 hrs, Volume= 0.209 af, Atten= 0%, Lag= 0.0 min  
 Primary = 2.66 cfs @ 12.03 hrs, Volume= 0.209 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 299.67' @ 12.03 hrs

Flood Elev= 303.30'

Device	Routing	Invert	Outlet Devices
#1	Primary	298.85'	<b>15.0" Round Culvert</b> L= 131.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 298.85' / 286.60' S= 0.0934 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=2.60 cfs @ 12.03 hrs HW=299.66' (Free Discharge)↑**1=Culvert** (Inlet Controls 2.60 cfs @ 3.07 fps)**Summary for Pond 3P: CB\_5-6**

Inflow Area = 1.070 ac, 42.21% Impervious, Inflow Depth > 4.73" for 50-year event  
 Inflow = 5.52 cfs @ 12.06 hrs, Volume= 0.422 af  
 Outflow = 5.52 cfs @ 12.06 hrs, Volume= 0.422 af, Atten= 0%, Lag= 0.0 min  
 Primary = 5.52 cfs @ 12.06 hrs, Volume= 0.422 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 62

Peak Elev= 288.00' @ 12.06 hrs

Flood Elev= 291.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	286.50'	<b>15.0" Round Culvert</b> L= 81.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 286.50' / 285.70' S= 0.0099 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=5.40 cfs @ 12.06 hrs HW=287.96' (Free Discharge)↑**1=Culvert** (Inlet Controls 5.40 cfs @ 4.40 fps)**Summary for Pond 4P: CB\_7-8**

Inflow Area = 1.600 ac, 43.33% Impervious, Inflow Depth > 4.72" for 50-year event  
 Inflow = 9.99 cfs @ 12.03 hrs, Volume= 0.629 af  
 Outflow = 9.99 cfs @ 12.03 hrs, Volume= 0.629 af, Atten= 0%, Lag= 0.0 min  
 Primary = 9.99 cfs @ 12.03 hrs, Volume= 0.629 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 275.95' @ 12.03 hrs

Flood Elev= 277.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	272.50'	<b>15.0" Round Culvert</b> L= 128.2' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 272.50' / 263.70' S= 0.0686 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=9.58 cfs @ 12.03 hrs HW=275.75' (Free Discharge)↑**1=Culvert** (Inlet Controls 9.58 cfs @ 7.81 fps)**Summary for Pond 5P: CB-9**

Inflow Area = 2.234 ac, 44.86% Impervious, Inflow Depth > 4.78" for 50-year event  
 Inflow = 14.03 cfs @ 12.03 hrs, Volume= 0.890 af  
 Outflow = 14.03 cfs @ 12.03 hrs, Volume= 0.890 af, Atten= 0%, Lag= 0.0 min  
 Primary = 14.03 cfs @ 12.03 hrs, Volume= 0.890 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 269.79' @ 12.03 hrs

Flood Elev= 267.30'

Device	Routing	Invert	Outlet Devices
#1	Primary	263.60'	<b>15.0" Round Culvert</b> L= 100.6' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 263.60' / 253.10' S= 0.1044 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=13.43 cfs @ 12.03 hrs HW=269.39' (Free Discharge)↑**1=Culvert** (Inlet Controls 13.43 cfs @ 10.95 fps)

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 50-year Rainfall=6.85"  
Printed 8/1/2022  
Page 63

### Summary for Pond 6P: CB\_10-11

Inflow Area = 3.320 ac, 44.72% Impervious, Inflow Depth > 4.76" for 50-year event  
Inflow = 20.59 cfs @ 12.04 hrs, Volume= 1.317 af  
Outflow = 20.59 cfs @ 12.04 hrs, Volume= 1.317 af, Atten= 0%, Lag= 0.0 min  
Primary = 20.59 cfs @ 12.04 hrs, Volume= 1.317 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 259.57' @ 12.04 hrs  
Flood Elev= 259.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	253.00'	<b>18.0" Round Culvert</b> L= 172.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 253.00' / 245.10' S= 0.0459 '/ Cc= 0.900 n= 0.012, Flow Area= 1.77 sf

**Primary OutFlow** Max=19.86 cfs @ 12.04 hrs HW=259.20' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 19.86 cfs @ 11.24 fps)

### Summary for Pond 7P: CB\_12-13

Inflow Area = 3.619 ac, 48.83% Impervious, Inflow Depth > 4.86" for 50-year event  
Inflow = 22.69 cfs @ 12.04 hrs, Volume= 1.467 af  
Outflow = 22.69 cfs @ 12.04 hrs, Volume= 1.467 af, Atten= 0%, Lag= 0.0 min  
Primary = 22.69 cfs @ 12.04 hrs, Volume= 1.467 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 252.80' @ 12.04 hrs  
Flood Elev= 249.60'

Device	Routing	Invert	Outlet Devices
#1	Primary	245.00'	<b>18.0" Round Culvert</b> L= 36.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 245.00' / 244.00' S= 0.0278 '/ Cc= 0.900 n= 0.012, Flow Area= 1.77 sf

**Primary OutFlow** Max=21.84 cfs @ 12.04 hrs HW=252.34' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 21.84 cfs @ 12.36 fps)

### Summary for Pond 10P: Stormwater Basin

Inflow Area = 4.169 ac, 43.44% Impervious, Inflow Depth > 4.61" for 50-year event  
Inflow = 25.65 cfs @ 12.04 hrs, Volume= 1.602 af  
Outflow = 10.69 cfs @ 12.23 hrs, Volume= 1.313 af, Atten= 58%, Lag= 11.4 min  
Primary = 10.69 cfs @ 12.23 hrs, Volume= 1.313 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 250.43' @ 12.24 hrs Surf.Area= 10,874 sf Storage= 26,654 cf

Plug-Flow detention time= 108.1 min calculated for 1.308 af (82% of inflow)

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 64

Center-of-Mass det. time= 57.4 min ( 849.8 - 792.5 )

Volume	Invert	Avail.Storage	Storage Description
#1	240.00'	26,654 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
240.00	508	0	0
242.00	892	1,400	1,400
244.00	1,386	2,278	3,678
245.00	2,520	1,953	5,631
245.50	5,230	1,938	7,569
246.00	5,523	2,688	10,257
248.00	10,874	16,397	26,654

Device	Routing	Invert	Outlet Devices
#1	Primary	242.50'	<b>18.0" Round Culvert</b> L= 32.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 242.50' / 242.00' S= 0.0156 '/ Cc= 0.900 n= 0.012, Flow Area= 1.77 sf
#2	Device 1	245.50'	<b>5.0" Vert. Orifice/Grate</b> C= 0.600
#3	Device 1	246.50'	<b>6.0" x 12.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	247.00'	<b>6.0" x 12.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=10.33 cfs @ 12.23 hrs HW=250.20' (Free Discharge)

- 1=Culvert (Passes 10.33 cfs of 22.43 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 1.39 cfs @ 10.21 fps)
- 3=Orifice/Grate (Orifice Controls 4.63 cfs @ 9.26 fps)
- 4=Orifice/Grate (Orifice Controls 4.31 cfs @ 8.62 fps)

**Summary for Pond FB: Forebay**

Inflow Area =	3.619 ac, 48.83% Impervious, Inflow Depth > 4.86" for 50-year event
Inflow =	22.69 cfs @ 12.04 hrs, Volume= 1.467 af
Outflow =	22.74 cfs @ 12.04 hrs, Volume= 1.425 af, Atten= 0%, Lag= 0.6 min
Primary =	1.43 cfs @ 12.04 hrs, Volume= 0.826 af
Secondary =	21.31 cfs @ 12.04 hrs, Volume= 0.599 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 246.39' @ 12.04 hrs Surf.Area= 2,514 sf Storage= 7,760 cf

Plug-Flow detention time= 45.3 min calculated for 1.425 af (97% of inflow)  
Center-of-Mass det. time= 33.6 min ( 793.8 - 760.2 )

Volume	Invert	Avail.Storage	Storage Description
#1	242.00'	9,375 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 65

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
242.00	1,096	0	0
244.00	1,678	2,774	2,774
246.00	2,365	4,043	6,817
247.00	2,750	2,558	9,375

Device	Routing	Invert	Outlet Devices
#1	Primary	243.00'	<b>6.0" Round Culvert</b> L= 36.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 243.00' / 242.50' S= 0.0139 ' / Cc= 0.900 n= 0.012, Flow Area= 0.20 sf
#2	Secondary	246.00'	<b>35.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

**Primary OutFlow** Max=1.43 cfs @ 12.04 hrs HW=246.38' (Free Discharge)

↑**1=Culvert** (Barrel Controls 1.43 cfs @ 7.26 fps)

**Secondary OutFlow** Max=20.83 cfs @ 12.04 hrs HW=246.38' (Free Discharge)

↑**2=Broad-Crested Rectangular Weir** (Weir Controls 20.83 cfs @ 1.56 fps)

**Summary for Pond P-1: Forebay**

Inflow Area = 1.205 ac, 37.50% Impervious, Inflow Depth > 4.61" for 50-year event  
 Inflow = 6.17 cfs @ 12.06 hrs, Volume= 0.463 af  
 Outflow = 5.98 cfs @ 12.09 hrs, Volume= 0.393 af, Atten= 3%, Lag= 1.6 min  
 Primary = 5.98 cfs @ 12.09 hrs, Volume= 0.393 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 285.44' @ 12.09 hrs Surf.Area= 1,673 sf Storage= 3,733 cf

Plug-Flow detention time= 76.0 min calculated for 0.392 af (85% of inflow)  
 Center-of-Mass det. time= 32.0 min ( 799.4 - 767.5 )

Volume	Invert	Avail.Storage	Storage Description
#1	282.00'	4,711 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
282.00	545	0	0
284.00	1,130	1,675	1,675
285.00	1,565	1,348	3,023
286.00	1,812	1,689	4,711

Device	Routing	Invert	Outlet Devices
#1	Primary	285.00'	<b>8.0' long x 8.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00



**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 66

2.50	3.00	3.50	4.00	4.50	5.00	5.50
Coef. (English)	2.43	2.54	2.70	2.69	2.68	2.68
	2.66	2.64	2.64	2.64	2.64	2.64
	2.65	2.65	2.66	2.66	2.68	2.70
				2.70	2.74	

**Primary OutFlow** Max=5.86 cfs @ 12.09 hrs HW=285.43' (Free Discharge)

↑ **1=Broad-Crested Rectangular Weir** (Weir Controls 5.86 cfs @ 1.69 fps)

**Summary for Pond P-2: Stormwater Pond**

Inflow Area = 1.383 ac, 32.67% Impervious, Inflow Depth > 3.88" for 50-year event  
 Inflow = 6.71 cfs @ 12.07 hrs, Volume= 0.447 af  
 Outflow = 0.84 cfs @ 12.83 hrs, Volume= 0.372 af, Atten= 87%, Lag= 45.5 min  
 Primary = 0.84 cfs @ 12.83 hrs, Volume= 0.372 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 275.25' @ 12.83 hrs Surf.Area= 3,875 sf Storage= 10,142 cf

Plug-Flow detention time= 176.6 min calculated for 0.372 af (83% of inflow)  
 Center-of-Mass det. time= 130.8 min ( 928.3 - 797.6 )

Volume	Invert	Avail.Storage	Storage Description
#1	272.00'	22,675 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
272.00	2,375	0	0
274.00	3,295	5,670	5,670
276.00	4,225	7,520	13,190
278.00	5,260	9,485	22,675

Device	Routing	Invert	Outlet Devices
#1	Primary	272.00'	<b>18.0" Round Culvert</b> L= 30.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 272.00' / 270.00' S= 0.0667 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf
#2	Device 1	272.50'	<b>4.0" Vert. Orifice/Grate</b> C= 0.600
#3	Device 1	275.00'	<b>6.0" Vert. Orifice/Grate</b> C= 0.600
#4	Primary	276.00'	<b>12.0" W x 6.0" H Vert. Orifice/Grate</b> C= 0.600
#5	Primary	277.00'	<b>18.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=0.84 cfs @ 12.83 hrs HW=275.25' (Free Discharge)

- ↑ **1=Culvert** (Passes 0.84 cfs of 11.86 cfs potential flow)
- ↑ **2=Orifice/Grate** (Orifice Controls 0.67 cfs @ 7.73 fps)
- ↑ **3=Orifice/Grate** (Orifice Controls 0.16 cfs @ 1.69 fps)
- ↑ **4=Orifice/Grate** ( Controls 0.00 cfs)
- ↑ **5=Orifice/Grate** ( Controls 0.00 cfs)

## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 100-year Rainfall=7.64"  
Printed 8/1/2022  
Page 67

### Summary for Subcatchment 1S: Drainage Area 1

Runoff = 1.17 cfs @ 12.13 hrs, Volume= 0.093 af, Depth> 5.65"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.64"

Area (sf)	CN	Description
4,120	98	Paved parking, HSG B
4,450	74	>75% Grass cover, Good, HSG C
8,570	86	Weighted Average
4,450		51.93% Pervious Area
4,120		48.07% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.1	111	0.0710	0.20		<b>Sheet Flow, Tc-1</b> Grass: Dense n= 0.240 P2= 3.37"

### Summary for Subcatchment 2S: Drainage Area 2

Runoff = 2.33 cfs @ 12.01 hrs, Volume= 0.147 af, Depth> 5.77"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.64"

Area (sf)	CN	Description
6,287	74	>75% Grass cover, Good, HSG C
* 7,033	98	Roof/pavement
13,320	87	Weighted Average
6,287		47.20% Pervious Area
7,033		52.80% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.0	125	0.0100	2.03		<b>Shallow Concentrated Flow, Tc-2</b> Paved Kv= 20.3 fps

### Summary for Subcatchment 2S': Overland to Wetlands

Runoff = 6.85 cfs @ 12.17 hrs, Volume= 0.558 af, Depth> 3.76"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.64"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 68

Area (sf)	CN	Description
38,320	73	Woods, Fair, HSG C
21,500	55	Woods, Good, HSG B
2,724	98	Roofs, HSG B
15,044	74	>75% Grass cover, Good, HSG C
77,588	69	Weighted Average
74,864		96.49% Pervious Area
2,724		3.51% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.2	200	0.1100	0.27		<b>Sheet Flow, Tc-2s</b> Grass: Dense n= 0.240 P2= 3.37"

**Summary for Subcatchment 3S: Drainage Area 3**

Runoff = 3.54 cfs @ 12.09 hrs, Volume= 0.246 af, Depth> 5.20"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.64"

Area (sf)	CN	Description
* 8,529	98	Paved parking/roof
16,209	74	>75% Grass cover, Good, HSG C
24,738	82	Weighted Average
16,209		65.52% Pervious Area
8,529		34.48% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0	105	0.1100	0.35		<b>Sheet Flow, Tc-4a</b> Grass: Short n= 0.150 P2= 3.37"
0.7	160	0.0310	3.57		<b>Shallow Concentrated Flow, Tc-4b</b> Paved Kv= 20.3 fps

5.7 265 Total

**Summary for Subcatchment 4S: Drainage Area 4**

Runoff = 11.41 cfs @ 12.03 hrs, Volume= 0.725 af, Depth> 5.43"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.64"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 69

Area (sf)	CN	Description
* 30,200	98	Paved parking & roof HSG A
20,000	74	>75% Grass cover, Good, HSG C
19,500	73	Woods, Fair, HSG C
69,700	84	Weighted Average
39,500		56.67% Pervious Area
30,200		43.33% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.9	130	0.0100	1.13		<b>Sheet Flow, Tc-3</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 5S: Drainage Area 5**

Runoff = 4.70 cfs @ 12.02 hrs, Volume= 0.299 af, Depth> 5.66"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.64"

Area (sf)	CN	Description
* 13,450	98	Paved surfaces & roof
14,147	74	>75% Grass cover, Good, HSG C
27,597	86	Weighted Average
14,147		51.26% Pervious Area
13,450		48.74% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	180	0.0500	2.29		<b>Sheet Flow, Tc-5</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 6S: Drainage Area 6**

Runoff = 7.67 cfs @ 12.05 hrs, Volume= 0.492 af, Depth> 5.43"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.64"

Area (sf)	CN	Description
* 21,025	98	Pavement/Roofs, HSG B
22,990	74	>75% Grass cover, Good, HSG C
3,300	60	Woods, Fair, HSG B
47,315	84	Weighted Average
26,290		55.56% Pervious Area
21,025		44.44% Impervious Area

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 70

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
3.2	180	0.0500	0.95		<b>Lag/CN Method, Tc-6</b>

**Summary for Subcatchment 7S: Drainage Area 7**

Runoff = 2.47 cfs @ 12.02 hrs, Volume= 0.168 af, Depth&gt; 6.75"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.64"

Area (sf)	CN	Description
* 12,295	98	Roof & Pavement
* 716	74	>75% Grass cover, Good, HSG B/D
13,011	97	Weighted Average
716		5.50% Pervious Area
12,295		94.50% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	175	0.0580	2.42		<b>Sheet Flow, Tc-7</b> Smooth surfaces n= 0.011 P2= 3.37"

**Summary for Subcatchment 8S: Overland to Wetlands**

Runoff = 14.65 cfs @ 12.20 hrs, Volume= 1.256 af, Depth&gt; 3.65"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.64"

Area (sf)	CN	Description
24,323	74	>75% Grass cover, Good, HSG C
61,975	77	Woods, Good, HSG D
93,653	60	Woods, Fair, HSG B
179,951	68	Weighted Average
179,951		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
14.1	152	0.1240	0.18		<b>Sheet Flow, Tc-8</b> Woods: Light underbrush n= 0.400 P2= 3.37"

**Summary for Subcatchment 9S: Overland to Basin 3**

Runoff = 3.40 cfs @ 12.04 hrs, Volume= 0.208 af, Depth&gt; 4.53"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.64"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 71

Area (sf)	CN	Description
22,063	74	>75% Grass cover, Good, HSG C
1,920	98	Roofs, HSG C
23,983	76	Weighted Average
22,063		91.99% Pervious Area
1,920		8.01% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.3	145	0.1100	1.05		<b>Lag/CN Method, Tc-9</b>

**Summary for Subcatchment FB1: Overland to Forebay**

Runoff = 0.79 cfs @ 12.04 hrs, Volume= 0.048 af, Depth&gt; 4.31"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.64"

Area (sf)	CN	Description
5,861	74	>75% Grass cover, Good, HSG C
5,861		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.1	98	0.0800	0.78		<b>Lag/CN Method, Tc-FB-1</b>

**Summary for Subcatchment O-P2: Overland to Pond**

Runoff = 1.05 cfs @ 12.02 hrs, Volume= 0.064 af, Depth&gt; 4.32"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.64"

Area (sf)	CN	Description
7,761	74	>75% Grass cover, Good, HSG C
7,761		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.3	30	0.0330	0.40		<b>Lag/CN Method, Tc-P2</b>

**Summary for Subcatchment OS: Overland to Swale**

Runoff = 1.97 cfs @ 12.04 hrs, Volume= 0.120 af, Depth&gt; 4.10"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=7.64"

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 72

Area (sf)	CN	Description
1,650	60	Woods, Fair, HSG B
13,622	74	>75% Grass cover, Good, HSG C
15,272	72	Weighted Average
15,272		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
2.0					Direct Entry, Tc-OS

**Summary for Reach 1R: Wetland Swale**

Inflow Area = 1.781 ac, 3.51% Impervious, Inflow Depth > 3.76" for 100-year event  
 Inflow = 6.85 cfs @ 12.17 hrs, Volume= 0.558 af  
 Outflow = 6.60 cfs @ 12.25 hrs, Volume= 0.556 af, Atten= 4%, Lag= 4.4 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.09 fps, Min. Travel Time= 2.3 min  
 Avg. Velocity = 0.85 fps, Avg. Travel Time= 5.7 min

Peak Storage= 928 cf @ 12.20 hrs  
 Average Depth at Peak Storage= 0.19'  
 Bank-Full Depth= 2.00' Flow Area= 106.7 sf, Capacity= 1,056.58 cfs

80.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 290.0' Slope= 0.0759 '/'  
 Inlet Invert= 294.00', Outlet Invert= 272.00'



**Summary for Reach 2R: Wetland Swale**

Inflow Area = 7.646 ac, 6.73% Impervious, Inflow Depth > 3.72" for 100-year event  
 Inflow = 22.50 cfs @ 12.21 hrs, Volume= 2.373 af  
 Outflow = 21.02 cfs @ 12.35 hrs, Volume= 2.351 af, Atten= 7%, Lag= 8.5 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.49 fps, Min. Travel Time= 4.8 min  
 Avg. Velocity = 1.07 fps, Avg. Travel Time= 11.1 min

Peak Storage= 6,069 cf @ 12.27 hrs  
 Average Depth at Peak Storage= 0.36'  
 Bank-Full Depth= 2.00' Flow Area= 113.3 sf, Capacity= 890.78 cfs

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 73

85.00' x 2.00' deep Parabolic Channel, n= 0.050 Scattered brush, heavy weeds  
 Length= 712.0' Slope= 0.0478 '/'  
 Inlet Invert= 272.00', Outlet Invert= 238.00'



**Summary for Reach 3R: Wet Swale**

Inflow Area = 1.734 ac, 26.06% Impervious, Inflow Depth > 3.90" for 100-year event  
 Inflow = 2.45 cfs @ 12.04 hrs, Volume= 0.563 af  
 Outflow = 2.32 cfs @ 12.07 hrs, Volume= 0.561 af, Atten= 5%, Lag= 1.6 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 2.64 fps, Min. Travel Time= 1.0 min  
 Avg. Velocity = 1.31 fps, Avg. Travel Time= 2.1 min

Peak Storage= 153 cf @ 12.05 hrs  
 Average Depth at Peak Storage= 0.11'  
 Bank-Full Depth= 1.00' Flow Area= 10.0 sf, Capacity= 99.84 cfs

8.00' x 1.00' deep channel, n= 0.040 Earth, cobble bottom, clean sides  
 Side Slope Z-value= 2.0 '/' Top Width= 12.00'  
 Length= 165.0' Slope= 0.0970 '/'  
 Inlet Invert= 270.00', Outlet Invert= 254.00'



**Summary for Reach 9R: Peak off Site**

Inflow Area = 11.815 ac, 19.68% Impervious, Inflow Depth > 3.96" for 100-year event  
 Inflow = 33.08 cfs @ 12.11 hrs, Volume= 3.901 af  
 Outflow = 33.08 cfs @ 12.11 hrs, Volume= 3.901 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs



## Proposed Conditions

Prepared by Killingly Engineering Associates, LLC  
HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Pollock - Louise Berry  
Type III 24-hr 100-year Rainfall=7.64"  
Printed 8/1/2022  
Page 74

### Summary for Pond 1P: CB\_1-2

Inflow Area = 0.197 ac, 48.07% Impervious, Inflow Depth > 5.65" for 100-year event  
Inflow = 1.17 cfs @ 12.13 hrs, Volume= 0.093 af  
Outflow = 1.17 cfs @ 12.13 hrs, Volume= 0.093 af, Atten= 0%, Lag= 0.0 min  
Primary = 1.17 cfs @ 12.13 hrs, Volume= 0.093 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 312.02' @ 12.13 hrs  
Flood Elev= 316.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	311.50'	<b>15.0" Round Culvert</b> L= 128.7' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 311.50' / 298.95' S= 0.0975 '/ Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=1.15 cfs @ 12.13 hrs HW=312.01' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 1.15 cfs @ 2.43 fps)

### Summary for Pond 2P: CB\_3-4

Inflow Area = 0.503 ac, 50.95% Impervious, Inflow Depth > 5.72" for 100-year event  
Inflow = 3.02 cfs @ 12.03 hrs, Volume= 0.240 af  
Outflow = 3.02 cfs @ 12.03 hrs, Volume= 0.240 af, Atten= 0%, Lag= 0.0 min  
Primary = 3.02 cfs @ 12.03 hrs, Volume= 0.240 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 299.74' @ 12.03 hrs  
Flood Elev= 303.30'

Device	Routing	Invert	Outlet Devices
#1	Primary	298.85'	<b>15.0" Round Culvert</b> L= 131.1' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 298.85' / 286.60' S= 0.0934 '/ Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=2.95 cfs @ 12.03 hrs HW=299.73' (Free Discharge)  
↑**1=Culvert** (Inlet Controls 2.95 cfs @ 3.19 fps)

### Summary for Pond 3P: CB\_5-6

Inflow Area = 1.070 ac, 42.21% Impervious, Inflow Depth > 5.45" for 100-year event  
Inflow = 6.32 cfs @ 12.06 hrs, Volume= 0.486 af  
Outflow = 6.32 cfs @ 12.06 hrs, Volume= 0.486 af, Atten= 0%, Lag= 0.0 min  
Primary = 6.32 cfs @ 12.06 hrs, Volume= 0.486 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 75

Peak Elev= 288.26' @ 12.06 hrs

Flood Elev= 291.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	286.50'	<b>15.0" Round Culvert</b> L= 81.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 286.50' / 285.70' S= 0.0099 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=6.18 cfs @ 12.06 hrs HW=288.22' (Free Discharge)↑**1=Culvert** (Inlet Controls 6.18 cfs @ 5.04 fps)**Summary for Pond 4P: CB\_7-8**

Inflow Area = 1.600 ac, 43.33% Impervious, Inflow Depth > 5.43" for 100-year event  
 Inflow = 11.41 cfs @ 12.03 hrs, Volume= 0.725 af  
 Outflow = 11.41 cfs @ 12.03 hrs, Volume= 0.725 af, Atten= 0%, Lag= 0.0 min  
 Primary = 11.41 cfs @ 12.03 hrs, Volume= 0.725 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 276.82' @ 12.03 hrs

Flood Elev= 277.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	272.50'	<b>15.0" Round Culvert</b> L= 128.2' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 272.50' / 263.70' S= 0.0686 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=10.94 cfs @ 12.03 hrs HW=276.55' (Free Discharge)↑**1=Culvert** (Inlet Controls 10.94 cfs @ 8.91 fps)**Summary for Pond 5P: CB-9**

Inflow Area = 2.234 ac, 44.86% Impervious, Inflow Depth > 5.50" for 100-year event  
 Inflow = 16.01 cfs @ 12.03 hrs, Volume= 1.024 af  
 Outflow = 16.01 cfs @ 12.03 hrs, Volume= 1.024 af, Atten= 0%, Lag= 0.0 min  
 Primary = 16.01 cfs @ 12.03 hrs, Volume= 1.024 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 271.47' @ 12.03 hrs

Flood Elev= 267.30'

Device	Routing	Invert	Outlet Devices
#1	Primary	263.60'	<b>15.0" Round Culvert</b> L= 100.6' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 263.60' / 253.10' S= 0.1044 '/' Cc= 0.900 n= 0.012, Flow Area= 1.23 sf

**Primary OutFlow** Max=15.33 cfs @ 12.03 hrs HW=270.95' (Free Discharge)↑**1=Culvert** (Inlet Controls 15.33 cfs @ 12.49 fps)

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 76

**Summary for Pond 6P: CB\_10-11**

Inflow Area = 3.320 ac, 44.72% Impervious, Inflow Depth > 5.48" for 100-year event  
 Inflow = 23.50 cfs @ 12.04 hrs, Volume= 1.515 af  
 Outflow = 23.50 cfs @ 12.04 hrs, Volume= 1.515 af, Atten= 0%, Lag= 0.0 min  
 Primary = 23.50 cfs @ 12.04 hrs, Volume= 1.515 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 261.33' @ 12.04 hrs

Flood Elev= 259.50'

Device	Routing	Invert	Outlet Devices
#1	Primary	253.00'	<b>18.0" Round Culvert</b> L= 172.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 253.00' / 245.10' S= 0.0459 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf

**Primary OutFlow** Max=22.67 cfs @ 12.04 hrs HW=260.85' (Free Discharge)↑**1=Culvert** (Inlet Controls 22.67 cfs @ 12.83 fps)**Summary for Pond 7P: CB\_12-13**

Inflow Area = 3.619 ac, 48.83% Impervious, Inflow Depth > 5.58" for 100-year event  
 Inflow = 25.85 cfs @ 12.03 hrs, Volume= 1.683 af  
 Outflow = 25.85 cfs @ 12.03 hrs, Volume= 1.683 af, Atten= 0%, Lag= 0.0 min  
 Primary = 25.85 cfs @ 12.03 hrs, Volume= 1.683 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 254.90' @ 12.04 hrs

Flood Elev= 249.60'

Device	Routing	Invert	Outlet Devices
#1	Primary	245.00'	<b>18.0" Round Culvert</b> L= 36.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 245.00' / 244.00' S= 0.0278 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf

**Primary OutFlow** Max=24.87 cfs @ 12.03 hrs HW=254.30' (Free Discharge)↑**1=Culvert** (Inlet Controls 24.87 cfs @ 14.08 fps)**Summary for Pond 10P: Stormwater Basin**

Inflow Area = 4.169 ac, 43.44% Impervious, Inflow Depth > 5.32" for 100-year event  
 Inflow = 29.32 cfs @ 12.04 hrs, Volume= 1.848 af  
 Outflow = 24.44 cfs @ 12.11 hrs, Volume= 1.549 af, Atten= 17%, Lag= 3.7 min  
 Primary = 24.44 cfs @ 12.11 hrs, Volume= 1.549 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Peak Elev= 266.37' @ 12.10 hrs Surf.Area= 10,874 sf Storage= 26,654 cf

Plug-Flow detention time= 99.2 min calculated for 1.549 af (84% of inflow)

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 77

Center-of-Mass det. time= 51.1 min ( 839.1 - 788.0 )

Volume	Invert	Avail.Storage	Storage Description
#1	240.00'	26,654 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
240.00	508	0	0
242.00	892	1,400	1,400
244.00	1,386	2,278	3,678
245.00	2,520	1,953	5,631
245.50	5,230	1,938	7,569
246.00	5,523	2,688	10,257
248.00	10,874	16,397	26,654

Device	Routing	Invert	Outlet Devices
#1	Primary	242.50'	<b>18.0" Round Culvert</b> L= 32.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 242.50' / 242.00' S= 0.0156 '/ Cc= 0.900 n= 0.012, Flow Area= 1.77 sf
#2	Device 1	245.50'	<b>5.0" Vert. Orifice/Grate</b> C= 0.600
#3	Device 1	246.50'	<b>6.0" x 12.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	247.00'	<b>6.0" x 12.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=23.31 cfs @ 12.11 hrs HW=264.78' (Free Discharge)

- 1=Culvert (Passes 23.31 cfs of 39.48 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 2.87 cfs @ 21.03 fps)
- 3=Orifice/Grate (Orifice Controls 10.29 cfs @ 20.59 fps)
- 4=Orifice/Grate (Orifice Controls 10.15 cfs @ 20.30 fps)

**Summary for Pond FB: Forebay**

Inflow Area =	3.619 ac, 48.83% Impervious, Inflow Depth > 5.58" for 100-year event
Inflow =	25.85 cfs @ 12.03 hrs, Volume= 1.683 af
Outflow =	25.92 cfs @ 12.04 hrs, Volume= 1.640 af, Atten= 0%, Lag= 0.5 min
Primary =	1.43 cfs @ 12.04 hrs, Volume= 0.898 af
Secondary =	24.49 cfs @ 12.04 hrs, Volume= 0.741 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
Peak Elev= 246.42' @ 12.04 hrs Surf.Area= 2,527 sf Storage= 7,847 cf

Plug-Flow detention time= 42.6 min calculated for 1.634 af (97% of inflow)  
Center-of-Mass det. time= 32.0 min ( 789.3 - 757.3 )

Volume	Invert	Avail.Storage	Storage Description
#1	242.00'	9,375 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 78

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
242.00	1,096	0	0
244.00	1,678	2,774	2,774
246.00	2,365	4,043	6,817
247.00	2,750	2,558	9,375

Device	Routing	Invert	Outlet Devices
#1	Primary	243.00'	<b>6.0" Round Culvert</b> L= 36.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 243.00' / 242.50' S= 0.0139 ' / Cc= 0.900 n= 0.012, Flow Area= 0.20 sf
#2	Secondary	246.00'	<b>35.0' long x 4.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.38 2.54 2.69 2.68 2.67 2.67 2.65 2.66 2.66 2.68 2.72 2.73 2.76 2.79 2.88 3.07 3.32

**Primary OutFlow** Max=1.43 cfs @ 12.04 hrs HW=246.41' (Free Discharge)

↑**1=Culvert** (Barrel Controls 1.43 cfs @ 7.30 fps)

**Secondary OutFlow** Max=23.88 cfs @ 12.04 hrs HW=246.42' (Free Discharge)

↑**2=Broad-Crested Rectangular Weir** (Weir Controls 23.88 cfs @ 1.64 fps)

**Summary for Pond P-1: Forebay**

Inflow Area = 1.205 ac, 37.50% Impervious, Inflow Depth > 5.32" for 100-year event  
 Inflow = 7.08 cfs @ 12.06 hrs, Volume= 0.534 af  
 Outflow = 6.87 cfs @ 12.08 hrs, Volume= 0.464 af, Atten= 3%, Lag= 1.4 min  
 Primary = 6.87 cfs @ 12.08 hrs, Volume= 0.464 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 285.48' @ 12.08 hrs Surf.Area= 1,683 sf Storage= 3,798 cf

Plug-Flow detention time= 71.1 min calculated for 0.464 af (87% of inflow)  
 Center-of-Mass det. time= 30.3 min ( 794.6 - 764.3 )

Volume	Invert	Avail.Storage	Storage Description
#1	282.00'	4,711 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
282.00	545	0	0
284.00	1,130	1,675	1,675
285.00	1,565	1,348	3,023
286.00	1,812	1,689	4,711

Device	Routing	Invert	Outlet Devices
#1	Primary	285.00'	<b>8.0' long x 8.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00

**Proposed Conditions**

Prepared by Killingly Engineering Associates, LLC

Printed 8/1/2022

HydroCAD® 10.00-26 s/n 07240 © 2020 HydroCAD Software Solutions LLC

Page 79

2.50	3.00	3.50	4.00	4.50	5.00	5.50
Coef. (English)	2.43	2.54	2.70	2.69	2.68	2.68
	2.66	2.64	2.64	2.64	2.64	2.64
	2.65	2.65	2.66	2.66	2.68	2.70
				2.70	2.74	

**Primary OutFlow** Max=6.73 cfs @ 12.08 hrs HW=285.47' (Free Discharge)

1=Broad-Crested Rectangular Weir (Weir Controls 6.73 cfs @ 1.78 fps)

**Summary for Pond P-2: Stormwater Pond**

Inflow Area = 1.383 ac, 32.67% Impervious, Inflow Depth > 4.58" for 100-year event  
 Inflow = 7.75 cfs @ 12.07 hrs, Volume= 0.528 af  
 Outflow = 1.31 cfs @ 12.62 hrs, Volume= 0.443 af, Atten= 83%, Lag= 32.8 min  
 Primary = 1.31 cfs @ 12.62 hrs, Volume= 0.443 af

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 275.63' @ 12.62 hrs Surf.Area= 4,054 sf Storage= 11,672 cf

Plug-Flow detention time= 163.8 min calculated for 0.443 af (84% of inflow)  
 Center-of-Mass det. time= 119.5 min ( 912.4 - 792.9 )

Volume	Invert	Avail.Storage	Storage Description
#1	272.00'	22,675 cf	<b>Custom Stage Data (Prismatic)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
272.00	2,375	0	0
274.00	3,295	5,670	5,670
276.00	4,225	7,520	13,190
278.00	5,260	9,485	22,675

Device	Routing	Invert	Outlet Devices
#1	Primary	272.00'	<b>18.0" Round Culvert</b> L= 30.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 272.00' / 270.00' S= 0.0667 '/' Cc= 0.900 n= 0.012, Flow Area= 1.77 sf
#2	Device 1	272.50'	<b>4.0" Vert. Orifice/Grate</b> C= 0.600
#3	Device 1	275.00'	<b>6.0" Vert. Orifice/Grate</b> C= 0.600
#4	Primary	276.00'	<b>12.0" W x 6.0" H Vert. Orifice/Grate</b> C= 0.600
#5	Primary	277.00'	<b>18.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=1.31 cfs @ 12.62 hrs HW=275.63' (Free Discharge)

- 1=Culvert (Passes 1.31 cfs of 12.75 cfs potential flow)
- 2=Orifice/Grate (Orifice Controls 0.72 cfs @ 8.29 fps)
- 3=Orifice/Grate (Orifice Controls 0.58 cfs @ 2.98 fps)
- 4=Orifice/Grate ( Controls 0.00 cfs)
- 5=Orifice/Grate ( Controls 0.00 cfs)

**SUPPORTING DOCUMENTATION**

**NOAA Point Precipitation Estimates  
Web Soil Survey**



**NOAA Atlas 14, Volume 10, Version 3**  
**Location name: Brooklyn, Connecticut, USA\***  
**Latitude: 41.7827°, Longitude: -71.9363°**  
**Elevation: 329.49 ft\*\***

\* source: ESRI Maps

\*\* source: USGS



**POINT PRECIPITATION FREQUENCY ESTIMATES**

Sanja Perica, Sandra Pavlovic, Michael St. Laurent, Carl Trypaluk, Dale Unruh, Orlan Wilhite

NOAA, National Weather Service, Silver Spring, Maryland

PF\_tabular | PF\_graphical | Maps\_&amp;\_aerials

**PF tabular**

<b>PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches)<sup>1</sup></b>										
<b>Duration</b>	<b>Average recurrence interval (years)</b>									
	<b>1</b>	<b>2</b>	<b>5</b>	<b>10</b>	<b>25</b>	<b>50</b>	<b>100</b>	<b>200</b>	<b>500</b>	<b>1000</b>
<b>5-min</b>	<b>0.337</b> (0.256-0.442)	<b>0.400</b> (0.304-0.525)	<b>0.503</b> (0.381-0.662)	<b>0.587</b> (0.443-0.777)	<b>0.704</b> (0.515-0.965)	<b>0.793</b> (0.569-1.11)	<b>0.884</b> (0.618-1.27)	<b>0.982</b> (0.658-1.45)	<b>1.12</b> (0.723-1.70)	<b>1.23</b> (0.775-1.89)
<b>10-min</b>	<b>0.477</b> (0.363-0.626)	<b>0.566</b> (0.430-0.743)	<b>0.711</b> (0.539-0.937)	<b>0.831</b> (0.627-1.10)	<b>0.997</b> (0.730-1.37)	<b>1.12</b> (0.807-1.57)	<b>1.25</b> (0.876-1.80)	<b>1.39</b> (0.932-2.05)	<b>1.58</b> (1.02-2.40)	<b>1.74</b> (1.10-2.68)
<b>15-min</b>	<b>0.562</b> (0.427-0.737)	<b>0.666</b> (0.506-0.875)	<b>0.836</b> (0.634-1.10)	<b>0.978</b> (0.738-1.30)	<b>1.17</b> (0.859-1.61)	<b>1.32</b> (0.949-1.84)	<b>1.47</b> (1.03-2.12)	<b>1.64</b> (1.10-2.41)	<b>1.86</b> (1.21-2.83)	<b>2.04</b> (1.29-3.15)
<b>30-min</b>	<b>0.775</b> (0.590-1.02)	<b>0.919</b> (0.699-1.21)	<b>1.16</b> (0.875-1.52)	<b>1.35</b> (1.02-1.79)	<b>1.62</b> (1.19-2.22)	<b>1.82</b> (1.31-2.54)	<b>2.03</b> (1.42-2.92)	<b>2.26</b> (1.51-3.33)	<b>2.57</b> (1.66-3.90)	<b>2.82</b> (1.78-4.35)
<b>60-min</b>	<b>0.988</b> (0.752-1.30)	<b>1.17</b> (0.891-1.54)	<b>1.47</b> (1.12-1.94)	<b>1.72</b> (1.30-2.28)	<b>2.07</b> (1.51-2.83)	<b>2.33</b> (1.67-3.25)	<b>2.59</b> (1.81-3.73)	<b>2.88</b> (1.93-4.24)	<b>3.28</b> (2.12-4.97)	<b>3.59</b> (2.28-5.55)
<b>2-hr</b>	<b>1.26</b> (0.966-1.65)	<b>1.50</b> (1.15-1.96)	<b>1.89</b> (1.44-2.47)	<b>2.21</b> (1.67-2.91)	<b>2.65</b> (1.95-3.62)	<b>2.98</b> (2.15-4.15)	<b>3.32</b> (2.35-4.78)	<b>3.72</b> (2.49-5.44)	<b>4.28</b> (2.78-6.45)	<b>4.74</b> (3.01-7.28)
<b>3-hr</b>	<b>1.46</b> (1.12-1.90)	<b>1.73</b> (1.33-2.26)	<b>2.18</b> (1.66-2.85)	<b>2.55</b> (1.93-3.35)	<b>3.06</b> (2.26-4.17)	<b>3.44</b> (2.50-4.78)	<b>3.84</b> (2.72-5.52)	<b>4.31</b> (2.90-6.28)	<b>4.99</b> (3.24-7.49)	<b>5.55</b> (3.53-8.49)
<b>6-hr</b>	<b>1.87</b> (1.44-2.42)	<b>2.22</b> (1.70-2.88)	<b>2.79</b> (2.13-3.63)	<b>3.26</b> (2.49-4.26)	<b>3.91</b> (2.90-5.32)	<b>4.40</b> (3.21-6.10)	<b>4.92</b> (3.51-7.05)	<b>5.53</b> (3.73-8.02)	<b>6.43</b> (4.19-9.60)	<b>7.19</b> (4.58-10.9)
<b>12-hr</b>	<b>2.36</b> (1.82-3.05)	<b>2.81</b> (2.17-3.63)	<b>3.53</b> (2.72-4.58)	<b>4.14</b> (3.17-5.39)	<b>4.97</b> (3.70-6.72)	<b>5.59</b> (4.09-7.71)	<b>6.25</b> (4.47-8.91)	<b>7.03</b> (4.76-10.1)	<b>8.17</b> (5.34-12.1)	<b>9.14</b> (5.85-13.8)
<b>24-hr</b>	<b>2.82</b> (2.19-3.62)	<b>3.37</b> (2.61-4.34)	<b>4.28</b> (3.30-5.52)	<b>5.03</b> (3.87-6.52)	<b>6.06</b> (4.54-8.16)	<b>6.84</b> (5.03-9.38)	<b>7.66</b> (5.50-10.9)	<b>8.62</b> (5.86-12.4)	<b>10.1</b> (6.59-14.8)	<b>11.3</b> (7.22-16.9)
<b>2-day</b>	<b>3.17</b> (2.47-4.06)	<b>3.84</b> (2.99-4.92)	<b>4.92</b> (3.82-6.33)	<b>5.83</b> (4.50-7.52)	<b>7.07</b> (5.31-9.48)	<b>7.99</b> (5.90-10.9)	<b>8.98</b> (6.48-12.7)	<b>10.2</b> (6.92-14.5)	<b>11.9</b> (7.83-17.4)	<b>13.4</b> (8.62-19.9)
<b>3-day</b>	<b>3.44</b> (2.68-4.39)	<b>4.16</b> (3.25-5.32)	<b>5.35</b> (4.16-6.85)	<b>6.33</b> (4.90-8.14)	<b>7.68</b> (5.79-10.3)	<b>8.69</b> (6.44-11.8)	<b>9.77</b> (7.08-13.8)	<b>11.1</b> (7.55-15.7)	<b>13.0</b> (8.58-19.0)	<b>14.7</b> (9.48-21.8)
<b>4-day</b>	<b>3.67</b> (2.88-4.68)	<b>4.45</b> (3.47-5.67)	<b>5.71</b> (4.45-7.30)	<b>6.75</b> (5.23-8.67)	<b>8.19</b> (6.18-10.9)	<b>9.25</b> (6.87-12.6)	<b>10.4</b> (7.56-14.7)	<b>11.8</b> (8.06-16.7)	<b>13.9</b> (9.17-20.2)	<b>15.7</b> (10.1-23.2)
<b>7-day</b>	<b>4.34</b>	<b>5.21</b>	<b>6.63</b>	<b>7.81</b>	<b>9.43</b>	<b>10.6</b>	<b>11.9</b>	<b>13.5</b>	<b>15.9</b>	<b>18.0</b>




	(3.41-5.52)	(4.09-6.62)	(5.19-8.45)	(6.08-9.99)	(7.15-12.5)	(7.92-14.4)	(8.70-16.7)	(9.26-19.0)	(10.5-23.0)	(11.6-26.4)
<b>10-day</b>	<b>5.02</b> (3.95-6.36)	<b>5.95</b> (4.68-7.54)	<b>7.46</b> (5.84-9.48)	<b>8.71</b> (6.79-11.1)	<b>10.4</b> (7.92-13.8)	<b>11.7</b> (8.74-15.8)	<b>13.1</b> (9.54-18.3)	<b>14.7</b> (10.1-20.7)	<b>17.2</b> (11.4-24.8)	<b>19.3</b> (12.5-28.3)
<b>20-day</b>	<b>7.17</b> (5.67-9.05)	<b>8.16</b> (6.45-10.3)	<b>9.78</b> (7.70-12.4)	<b>11.1</b> (8.71-14.1)	<b>13.0</b> (9.85-17.0)	<b>14.4</b> (10.7-19.1)	<b>15.8</b> (11.4-21.6)	<b>17.4</b> (12.0-24.2)	<b>19.6</b> (13.0-28.0)	<b>21.3</b> (13.9-31.0)
<b>30-day</b>	<b>8.99</b> (7.12-11.3)	<b>10.0</b> (7.92-12.6)	<b>11.7</b> (9.20-14.7)	<b>13.0</b> (10.2-16.5)	<b>14.9</b> (11.3-19.4)	<b>16.4</b> (12.2-21.6)	<b>17.8</b> (12.8-24.1)	<b>19.3</b> (13.4-26.8)	<b>21.2</b> (14.2-30.2)	<b>22.6</b> (14.7-32.8)
<b>45-day</b>	<b>11.2</b> (8.93-14.1)	<b>12.3</b> (9.74-15.4)	<b>14.0</b> (11.1-17.6)	<b>15.4</b> (12.1-19.5)	<b>17.3</b> (13.2-22.4)	<b>18.9</b> (14.0-24.7)	<b>20.3</b> (14.6-27.1)	<b>21.7</b> (15.1-29.9)	<b>23.3</b> (15.6-33.0)	<b>24.3</b> (15.9-35.1)
<b>60-day</b>	<b>13.1</b> (10.4-16.4)	<b>14.2</b> (11.3-17.8)	<b>15.9</b> (12.6-20.0)	<b>17.4</b> (13.7-21.9)	<b>19.4</b> (14.7-24.9)	<b>21.0</b> (15.6-27.3)	<b>22.4</b> (16.1-29.8)	<b>23.7</b> (16.5-32.6)	<b>25.1</b> (16.9-35.5)	<b>26.0</b> (17.0-37.4)


<sup>1</sup> Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS). Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values. Please refer to NOAA Atlas 14 document for more information.

[Back to Top](#)

### PF graphical

PDS-based depth-duration-frequency (DDF) curves  
Latitude: 41.7827°, Longitude: -71.9363°

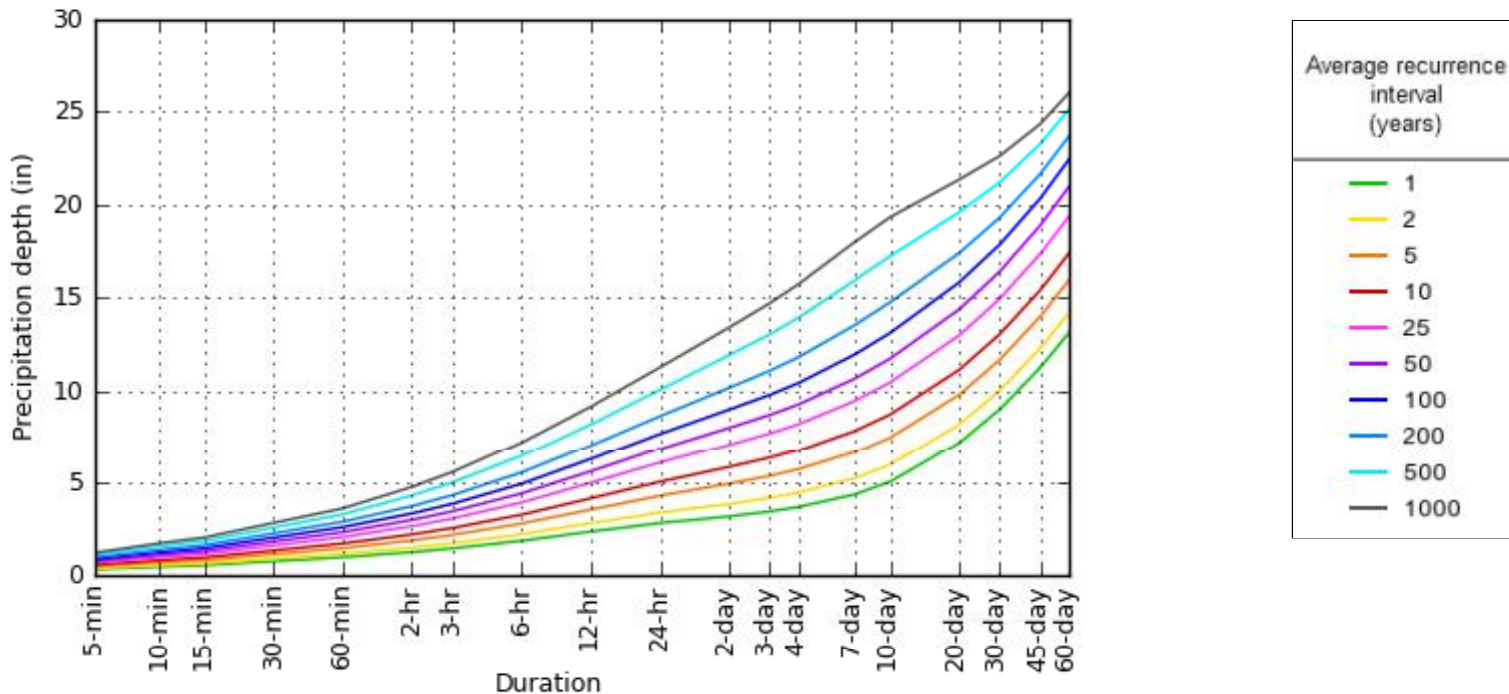

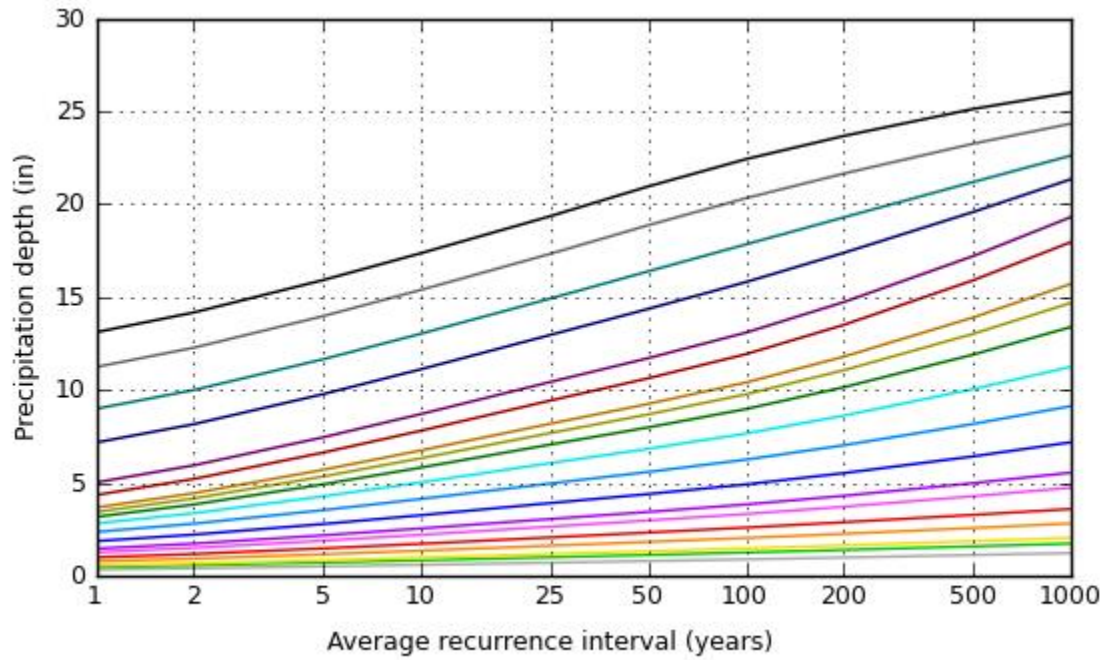

Duration	
5-min	2-day
10-min	3-day
15-min	4-day
30-min	7-day
60-min	10-day
2-hr	20-day
3-hr	30-day
6-hr	45-day
12-hr	60-day
24-hr	

NOAA Atlas 14, Volume 10, Version 3

Created (GMT): Tue Dec 8 14:02:09 2020


[Back to Top](#)

## Maps & aerials


**Small scale terrain**




Large scale terrain

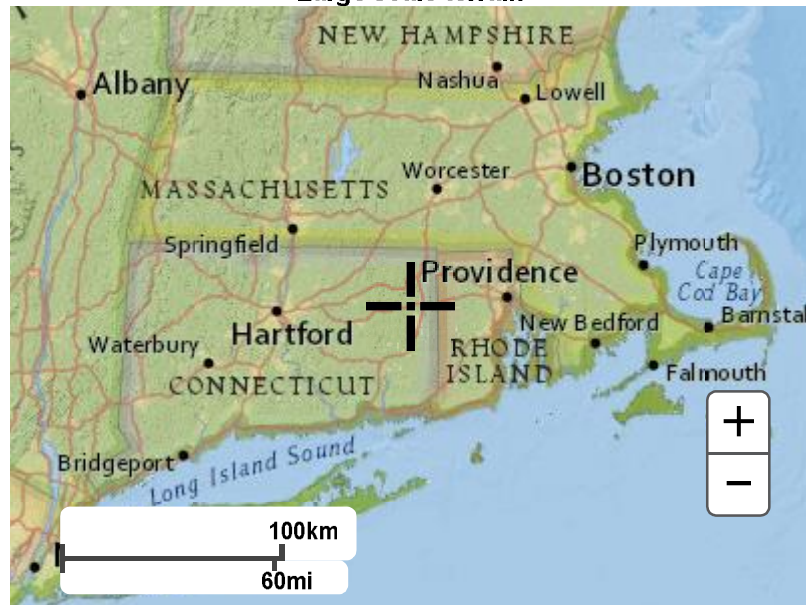

Large scale map

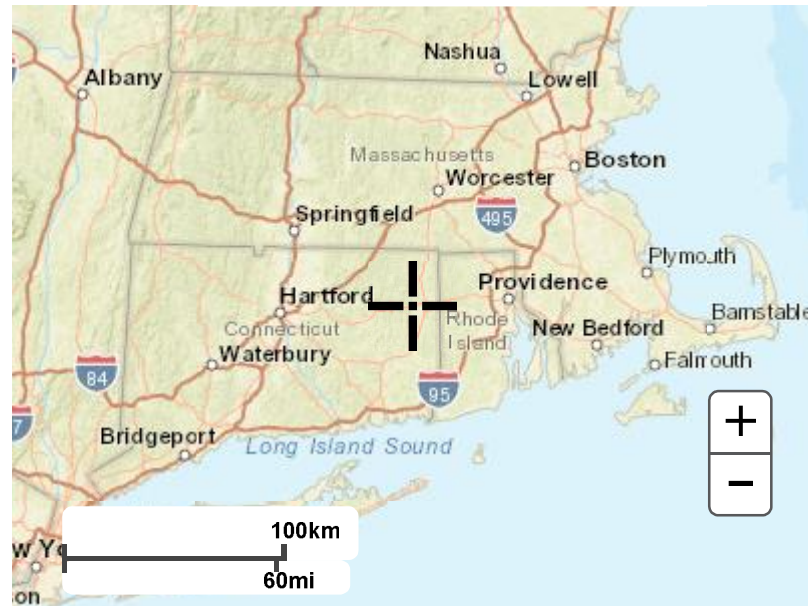

Large scale aerial

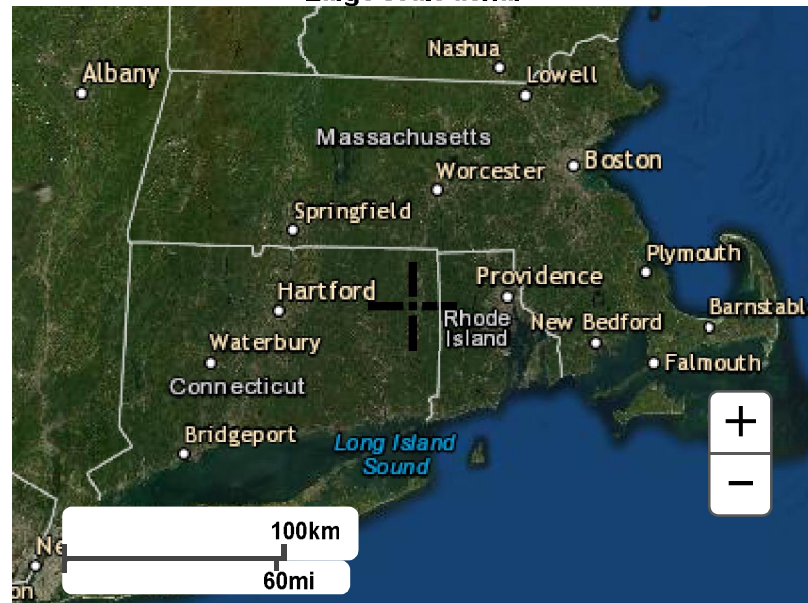

[Back to Top](#)

US Department of Commerce  
National Oceanic and Atmospheric Administration  
[National Weather Service](#)  
[National Water Center](#)  
1325 East West Highway  
Silver Spring, MD 20910  
Questions?: [HDSC.Questions@noaa.gov](mailto:HDSC.Questions@noaa.gov)


[Disclaimer](#)

Hydrologic Soil Group—State of Connecticut  
(Louise Berry Drive)



Soil Map may not be valid at this scale.


Map Scale: 1:1,850 if printed on A landscape (11" x 8.5") sheet.



Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 19N WGS84




## MAP LEGEND

### Area of Interest (AOI)









 Area of Interest (AOI)

### Soils

#### Soil Rating Polygons





 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Lines


 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Points






 A  
 A/D  
 B  
 B/D

 C  
 C/D  
 D  
 Not rated or not available

### Water Features

 Streams and Canals

### Transportation

 Rails  
 Interstate Highways  
 US Routes  
 Major Roads  
 Local Roads

### Background

 Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:12,000.

**Warning:** Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: State of Connecticut  
 Survey Area Data: Version 20, Jun 9, 2020

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Apr 14, 2011—Aug 27, 2016

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
3	Ridgebury, Leicester, and Whitman soils, 0 to 8 percent slopes, extremely stony	D	3.1	27.8%
34B	Merrimac fine sandy loam, 3 to 8 percent slopes	A	0.0	0.4%
60B	Canton and Charlton fine sandy loams, 3 to 8 percent slopes	B	4.7	42.9%
61C	Canton and Charlton fine sandy loams, 8 to 15 percent slopes, very stony	B	2.9	26.0%
62D	Canton and Charlton fine sandy loams, 15 to 35 percent slopes, extremely stony	B	0.1	0.7%
701B	Ninigret fine sandy loam, 3 to 8 percent slopes	C	0.2	2.2%
<b>Totals for Area of Interest</b>			<b>11.0</b>	<b>100.0%</b>



## Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

## Rating Options

*Aggregation Method:* Dominant Condition

*Component Percent Cutoff:* None Specified

*Tie-break Rule:* Higher

## **DRAINAGE AREA PLANS**